


ALL REINSTATEMENT WORKS ARE TO BE IN ACCORDANCE WITH LANDOWNER REQUIREMENTS

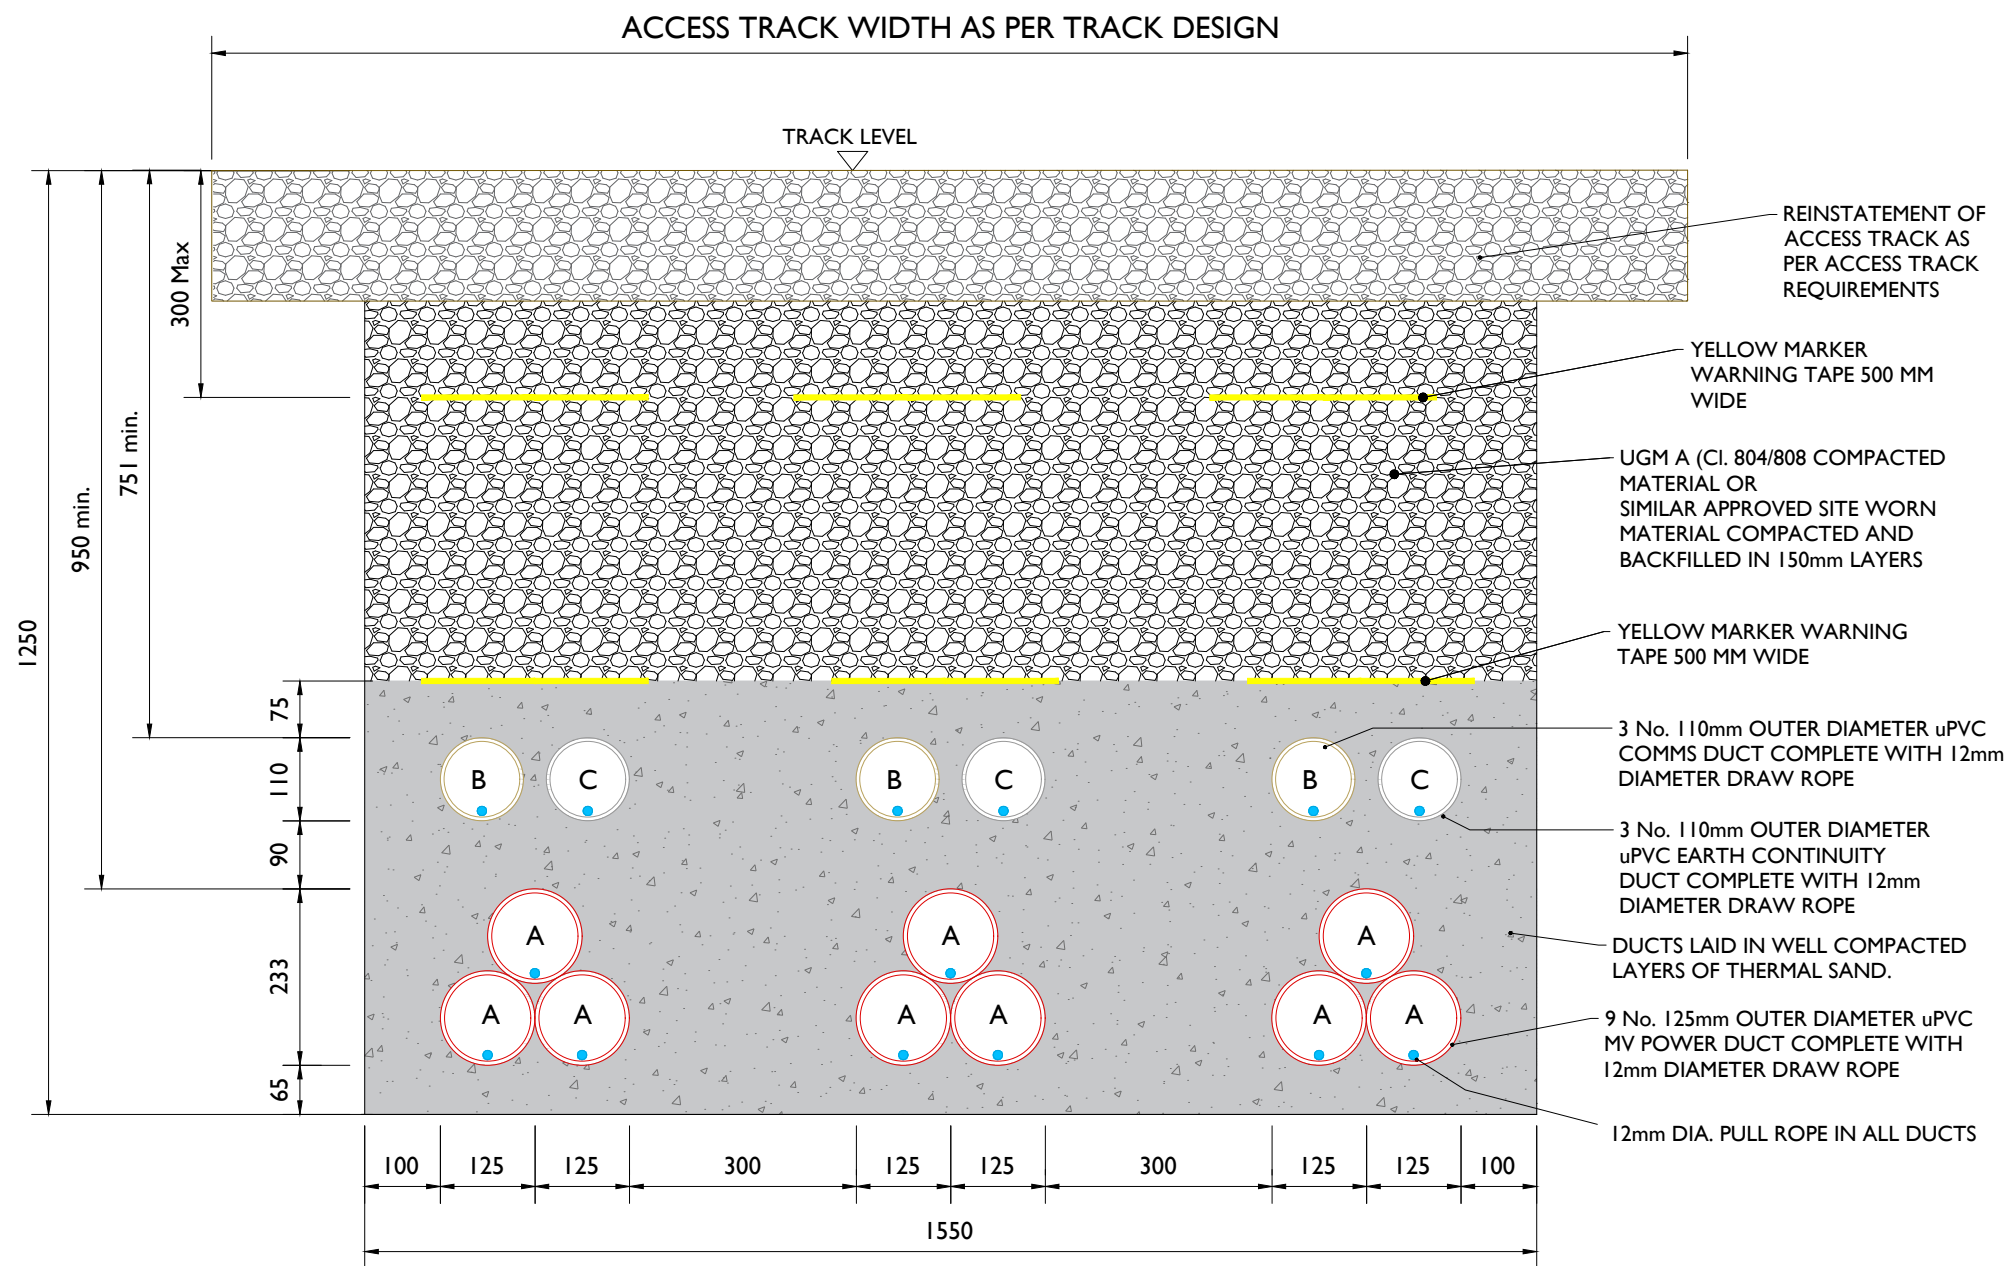

Note:

- This drawing is to be read in conjunction with relevant drawings, specifications and reports
- Dimensions are in millimeters, unless noted otherwise
- Drawings are not to be scaled use figured dimensions only

A = 125mm: OUTER DIAMETER POWER DUCT,
 B = 110mm: OUTER DIAMETER COMMS DUCT,
 C = 110mm: OUTER DIAMETER ECC DUCT

Typical Section Through Off Road / Access Track

SCALE 1:10



Head Office
 Beenreigh,
 Abbeydorney,
 Tralee, Co. Kerry
 Ireland
 Tel: 00353 66 7135710

CLIENT

PROJECT

Coom Green Energy Park
 33kV Interconnection

PROJECT NUMBER
 300-100920

SHEET NUMBER
 300100920-DR-117

SHEET TITLE

Typical Triple Circuit Section
 Through Access Track

DRAWING STATUS
 For Planning

ISSUE/REVISION

I/R	DATE	DESCRIPTION
P1	06.02.26	Issued for Planning
N1	25.07.25	Issued for Client Review