


**ALL REINSTATEMENT WORKS ARE TO BE IN ACCORDANCE WITH LANDOWNER REQUIREMENTS**



A = 125mm: OUTER DIAMETER POWER DUCT,  
 B = 110mm: OUTER DIAMETER COMMS DUCT,  
 C = 110mm: OUTER DIAMETER ECC DUCT

**Typical Section Through Off Road / Grassland**  
 SCALE 1:10

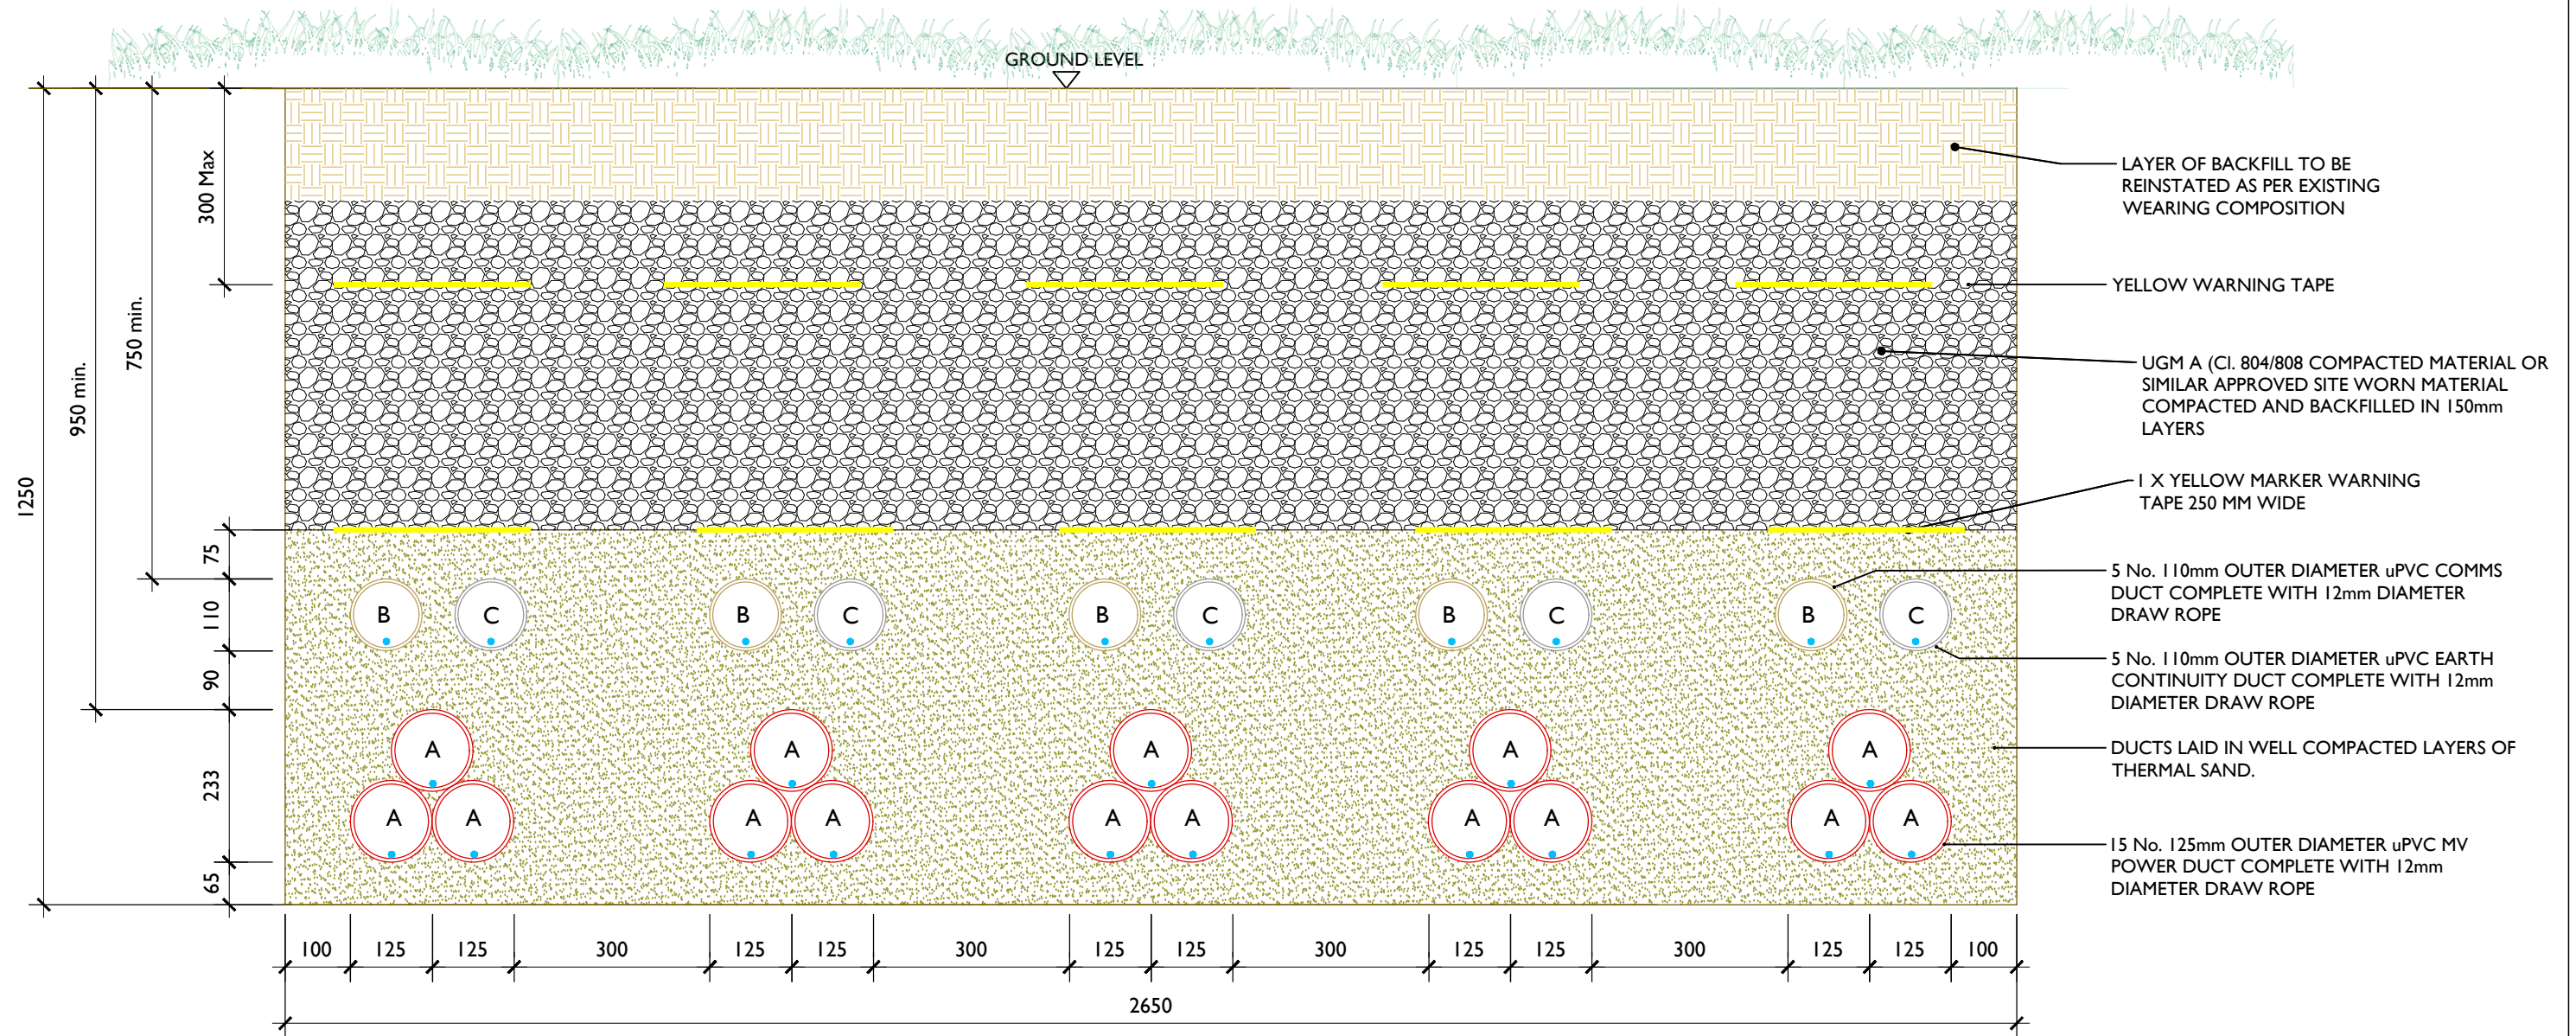

Head Office  
 Beenreigh,  
 Abbeydorney,  
 Tralee, Co. Kerry  
 Ireland  
 Tel: 00353 66 7135710

CLIENT

PROJECT  
**Coom Green Energy Park  
 33kV Interconnection**

PROJECT NUMBER  
**300-100920**

SHEET NUMBER  
**300100920-DR-123**

SHEET TITLE  
**Quin Cable Ducts in Grassland**

DRAWING STATUS  
**For Planning**

ISSUE/REVISION

I/R	DATE	DESCRIPTION
P1	06.02.26	Issued for Planning
N1	25.07.25	Issued for Client Review