
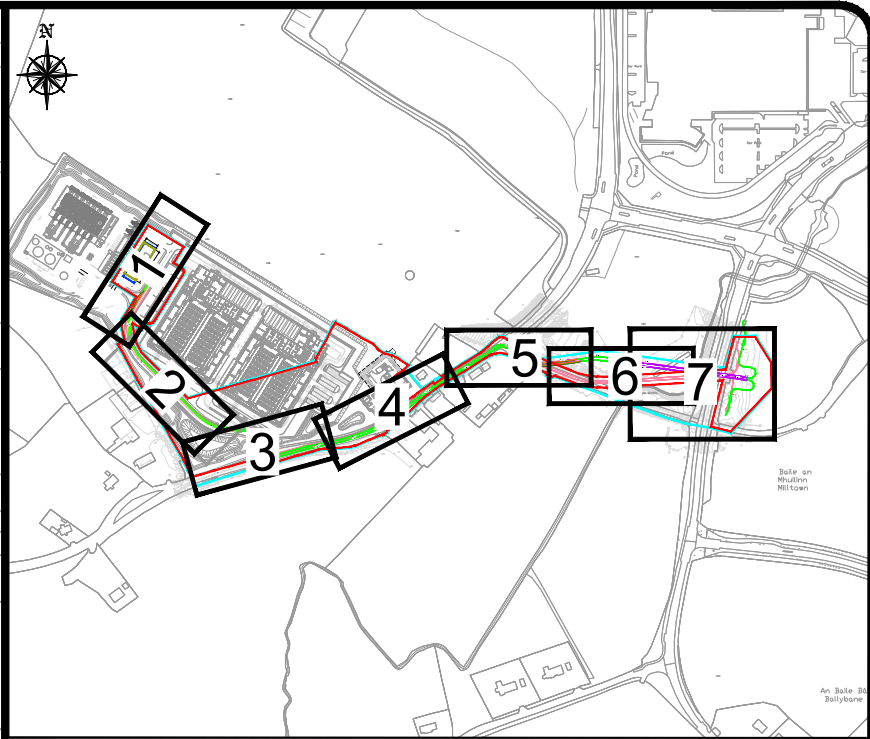


DRAWING IS PRODUCED USING THE IRISH TRANSVERSE MERCATOR (ITM) GEOGRAPHIC COORDINATE SYSTEM

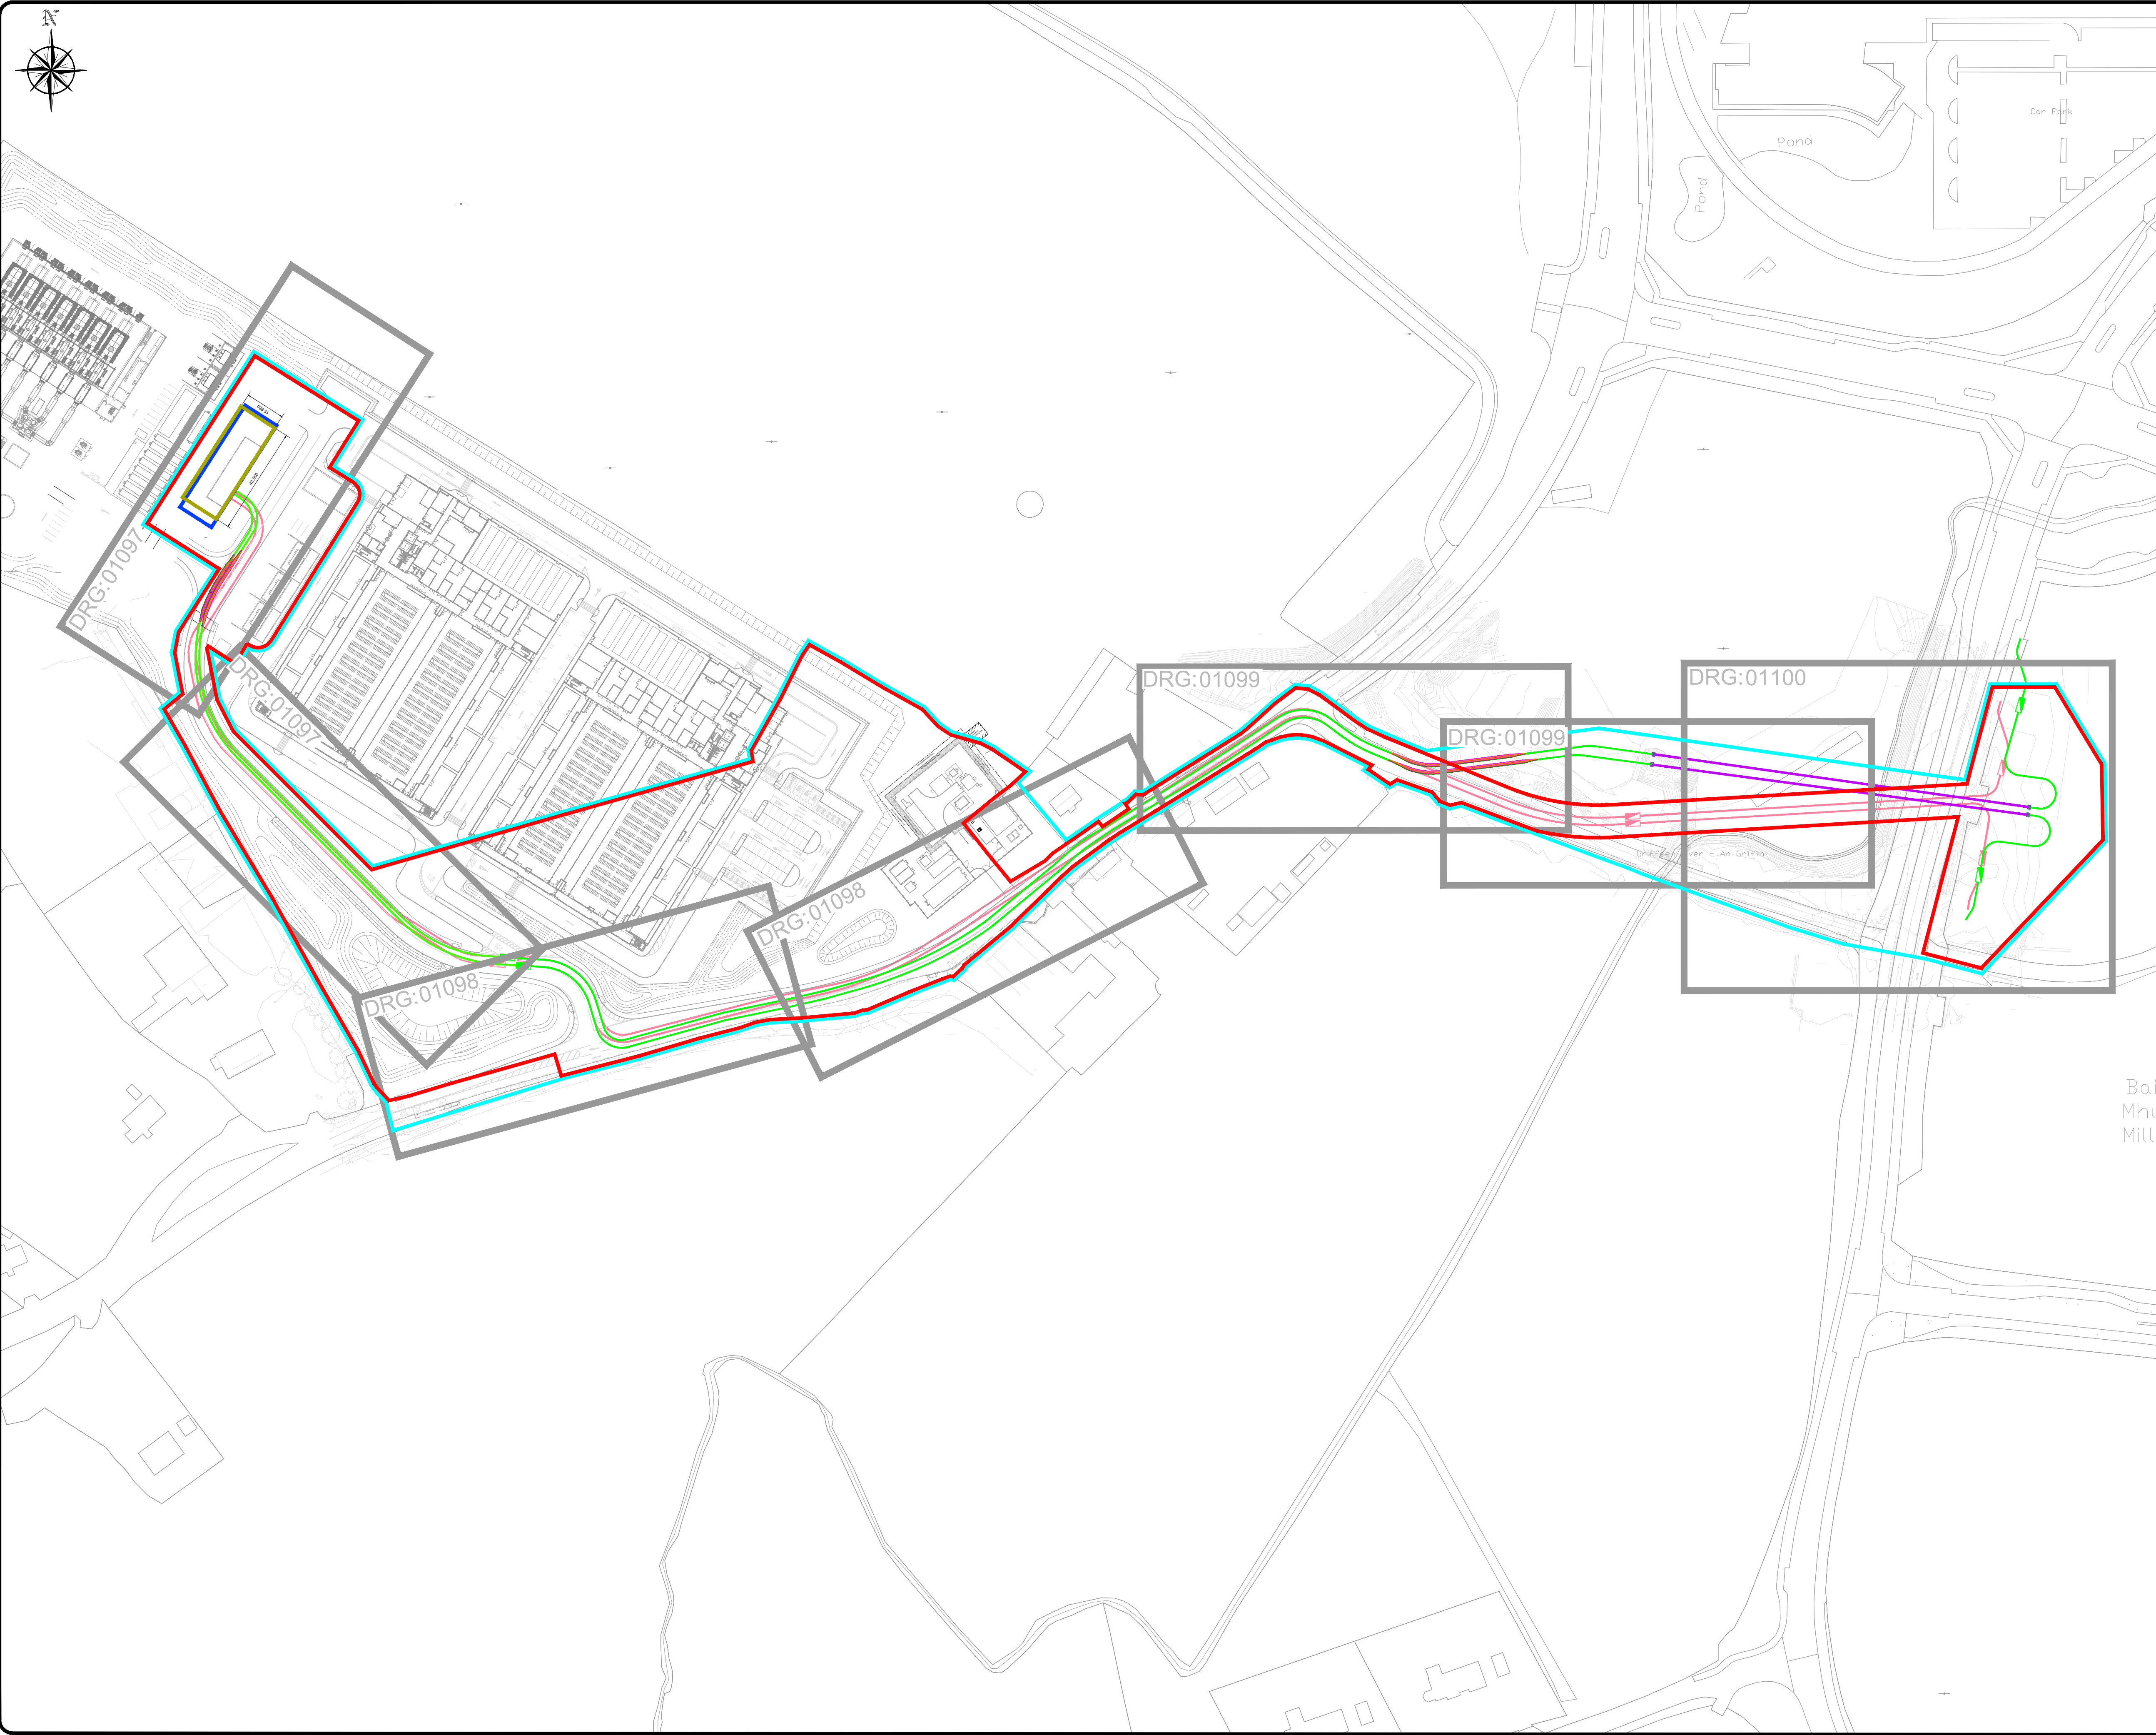

- KEYPLAN**
N.T.S.
- LEGEND:**
- SITE BOUNDARY - APPROVED
 - SITE BOUNDARY - PROPOSED
 - GIS SITE BOUNDARY - APPROVED
 - GIS SITE BOUNDARY - PROPOSED
 - 110KV GRID CONNECTION TWIN CIRCUITS - PROPOSED
 - 110KV GRID CONNECTION TWIN CIRCUITS - PLANNING APPROVED
 - HDD 750mmØ BORE (HORIZONTAL DIRECTIONAL DRILL) PROPOSED
 - SINGLE 110KV 200mmØ SDR 21 HDPE DUCT - PROPOSED
 - SINGLE COMMS 125mmØ SDR 17.6 HDPE DUCT - PROPOSED
 - JOINT BAY / PULL PIT - PROPOSED
 - JOINT BAY / PULL PIT - PLANNING APPROVED

SOUTH DUBLIN COUNTY COUNCIL
COMHAIRLE CONTAE ATHA CLIATH THEAS

OSI MAP Sheet No: 3325-B

This map is certified to be computer generated
from Ordnance Survey Digital Map Base

Rev	Date	Details	By	App
P01	14.04.26	FOR INFORMATION	DW	ALS

Project Phase - Project Stage:
PLANNING ALTERATIONS

CLIENT:
ECHELON DATA CENTRES

Civil & Structural

Clifton Scannell Emerson Associates

Clifton Scannell Emerson Associates Limited
Consulting Engineers,
3rd Floor The Highline,
Bakers Point, Pottery Road,
Dun Laoghaire, Co. Dublin,
Ireland, A96 KW29

T. +353 1 288 5006
F. +353 1 283 3486
E. info@csea.ie
W. www.csea.ie

Design Management + M&E + LEED

ETIOS
Engineering View

Client: **ECHELON DATA CENTRES**
Project: **R120 EXTERNAL WORKS**

Drawing Title:
**110KV ALIGNMENT ALTERATIONS
OVERALL LAYOUT PLAN**

Originator:	Role:	Drawn By:	Designed By:	Checked By:
CSE	C	DW	HB	LP
Scale:	Date:	Project No.	Revision:	Status:
@ A1	1:1250	MAR 2026	20_147A	
Drawing No.	DUB40-R120-SE-XX-CSE-DR-C-01096			P01
				S2