
CLASSIFICATION - Atkins Base Line (Low Risk)

© Copyright AtkinsRéalis. No dimensions to be scaled from this drawing. Dimensions to be checked on site and any discrepancies to be notified to the Architect/Engineer

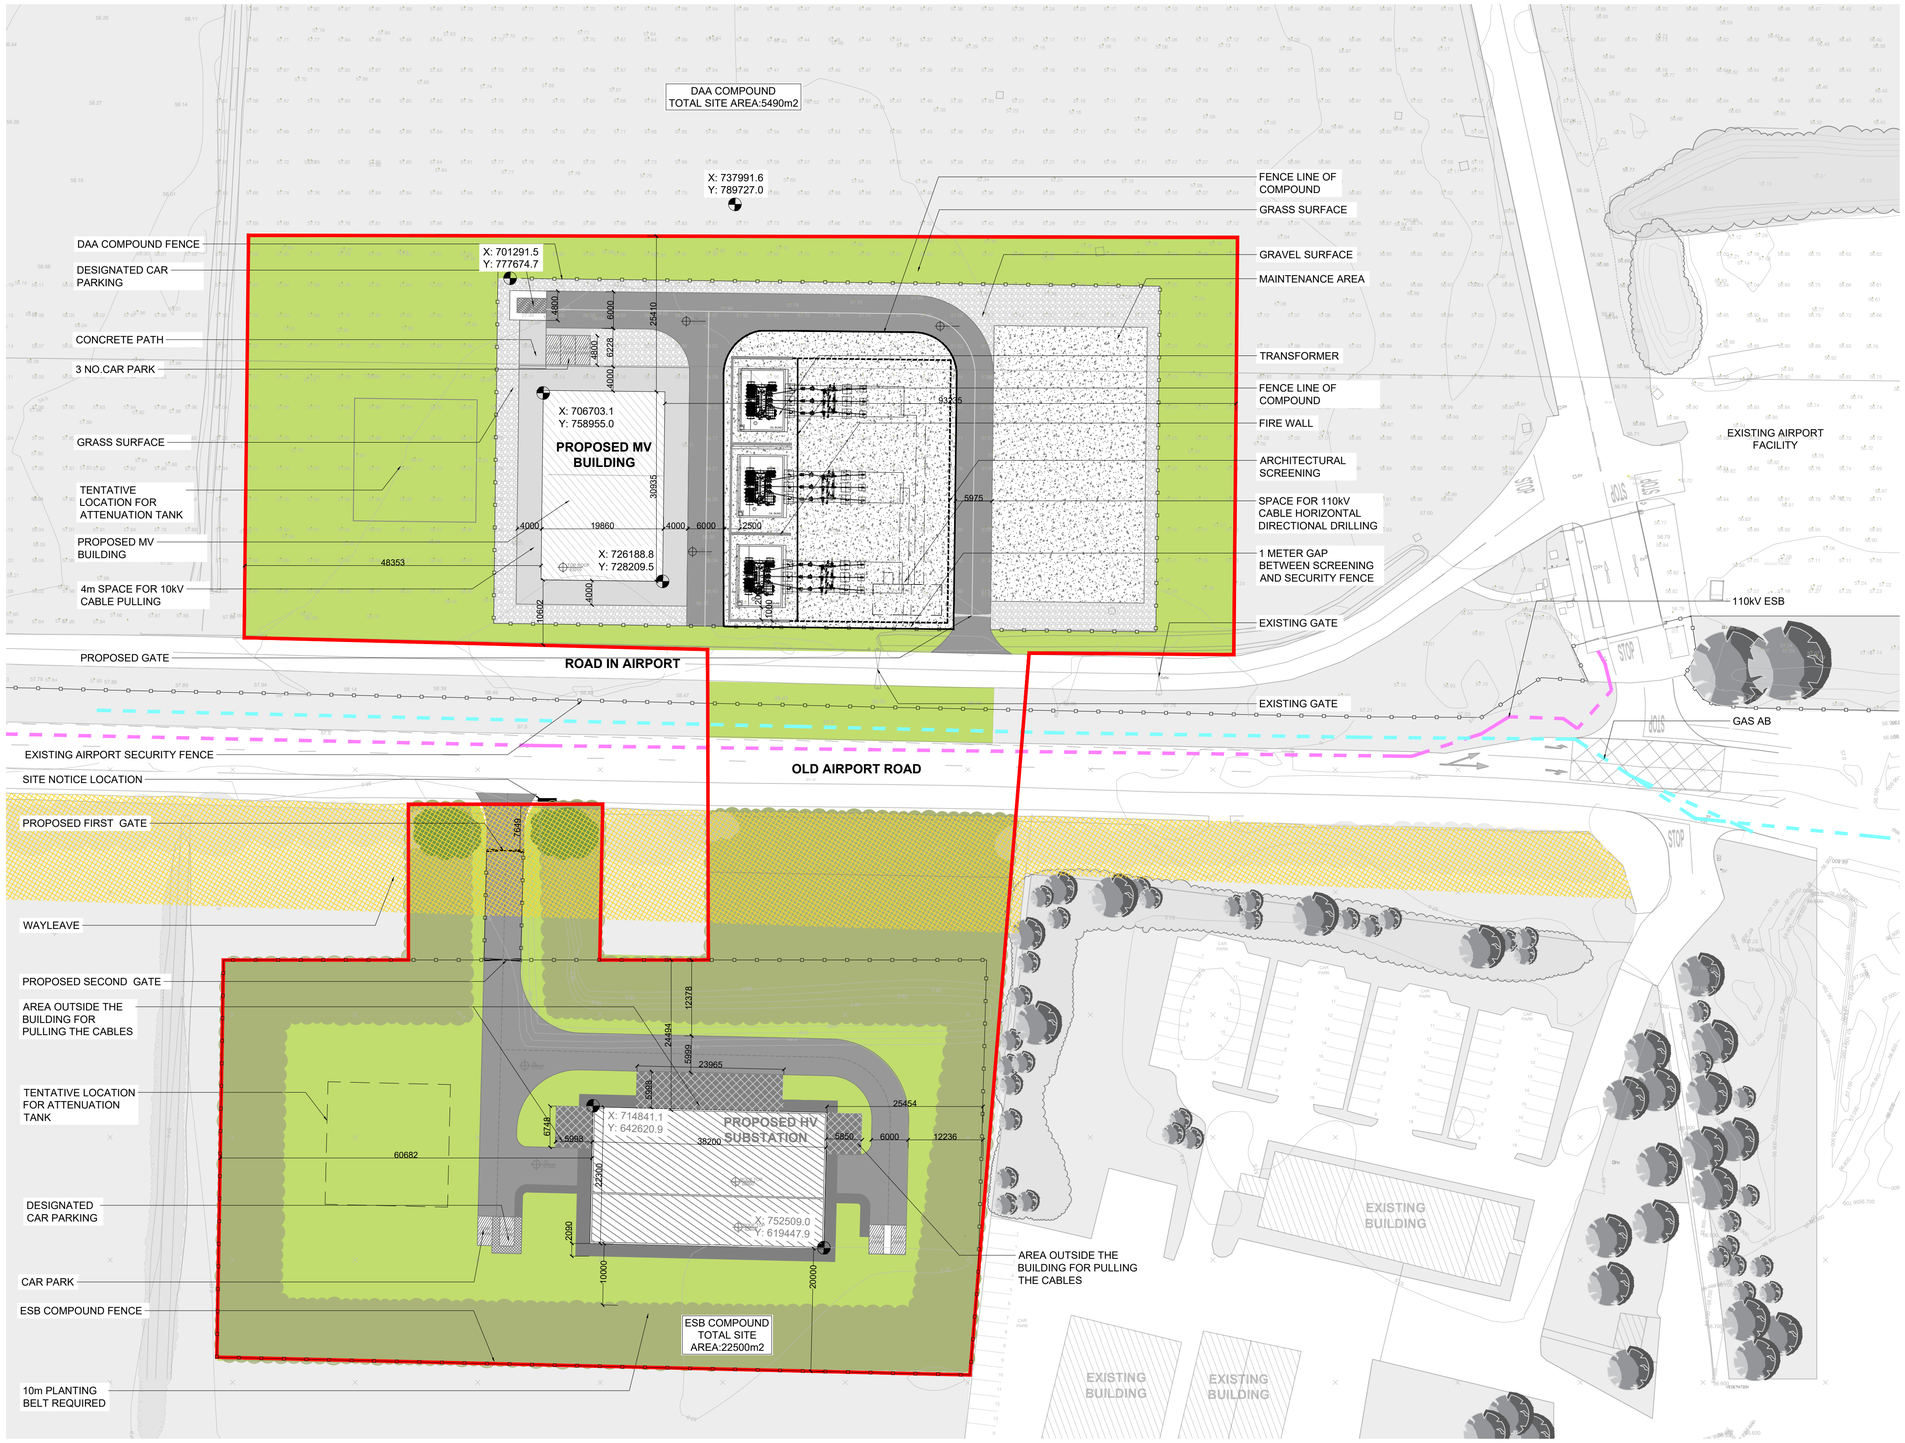

1
300-1101

SITE LAYOUT PLAN
1:500

RED LINE
WAYLEAVE
GREEN FEILD
SHRUB AREA
CONCRETE PATH
GRAVEL BASE
BUILDING
AREA FOR PULLING THE CABLES
110kV ESB
GAS

SAFETY, HEALTH AND ENVIRONMENTAL INFORMATION

In addition to the hazards/risks normally associated with the types of work detailed on this drawing, note the following:

CONSTRUCTION

The contractor is to confirm that the location of existing utilities and services information indicated in the drawings is accurate.

MAINTENANCE/CLEANING

The contractor is to confirm that the location of existing utilities and services information indicated in the drawings is accurate.

DECOMMISSIONING/DEMOLITION

It is assumed that all works will be carried out by a competent contractor working, where appropriate, to an approved method statement

REVISION SCHEDULE

NO.	DATE	REVISED BY	DESCRIPTION
F00	02/JUN/2026	XL	Draft RIAI Stage 2
F01	27/JUL/2026	XL	RIAI Stage 2

CLIENT:

daa

FRAMEWORK CONSULTANT :

AtkinsRéalis

ATKINS HOUSE,150 AIRSIDE BUSINESS PARK,
SWORDS, DUBLIN,K67 K5W4
Tel : +353 1 810 8000 Email : info.ie@atkinsrealis.com

PROJECT:
LOT 2 WO 37
2nd HV MV Primary Connection Substation

TITLE:
Proposed Substation
Site Layout Plan

ORIGINATOR:	CHECKER:	REVIEWER:	APPROVER:
XL	AH	AH	AJB

STATUS:	SCALE:	SHEET:	DATE:
FEASIBILITY	1:500	A1	2026-6-02

DRAWING NUMBER: D25200-ATK-S99-XX-XXX-DR-A-300-1101 REV: F01

CLASSIFICATION - AtkinsRéalis Base Line (Low Risk)

28/7/26 15:15:10