



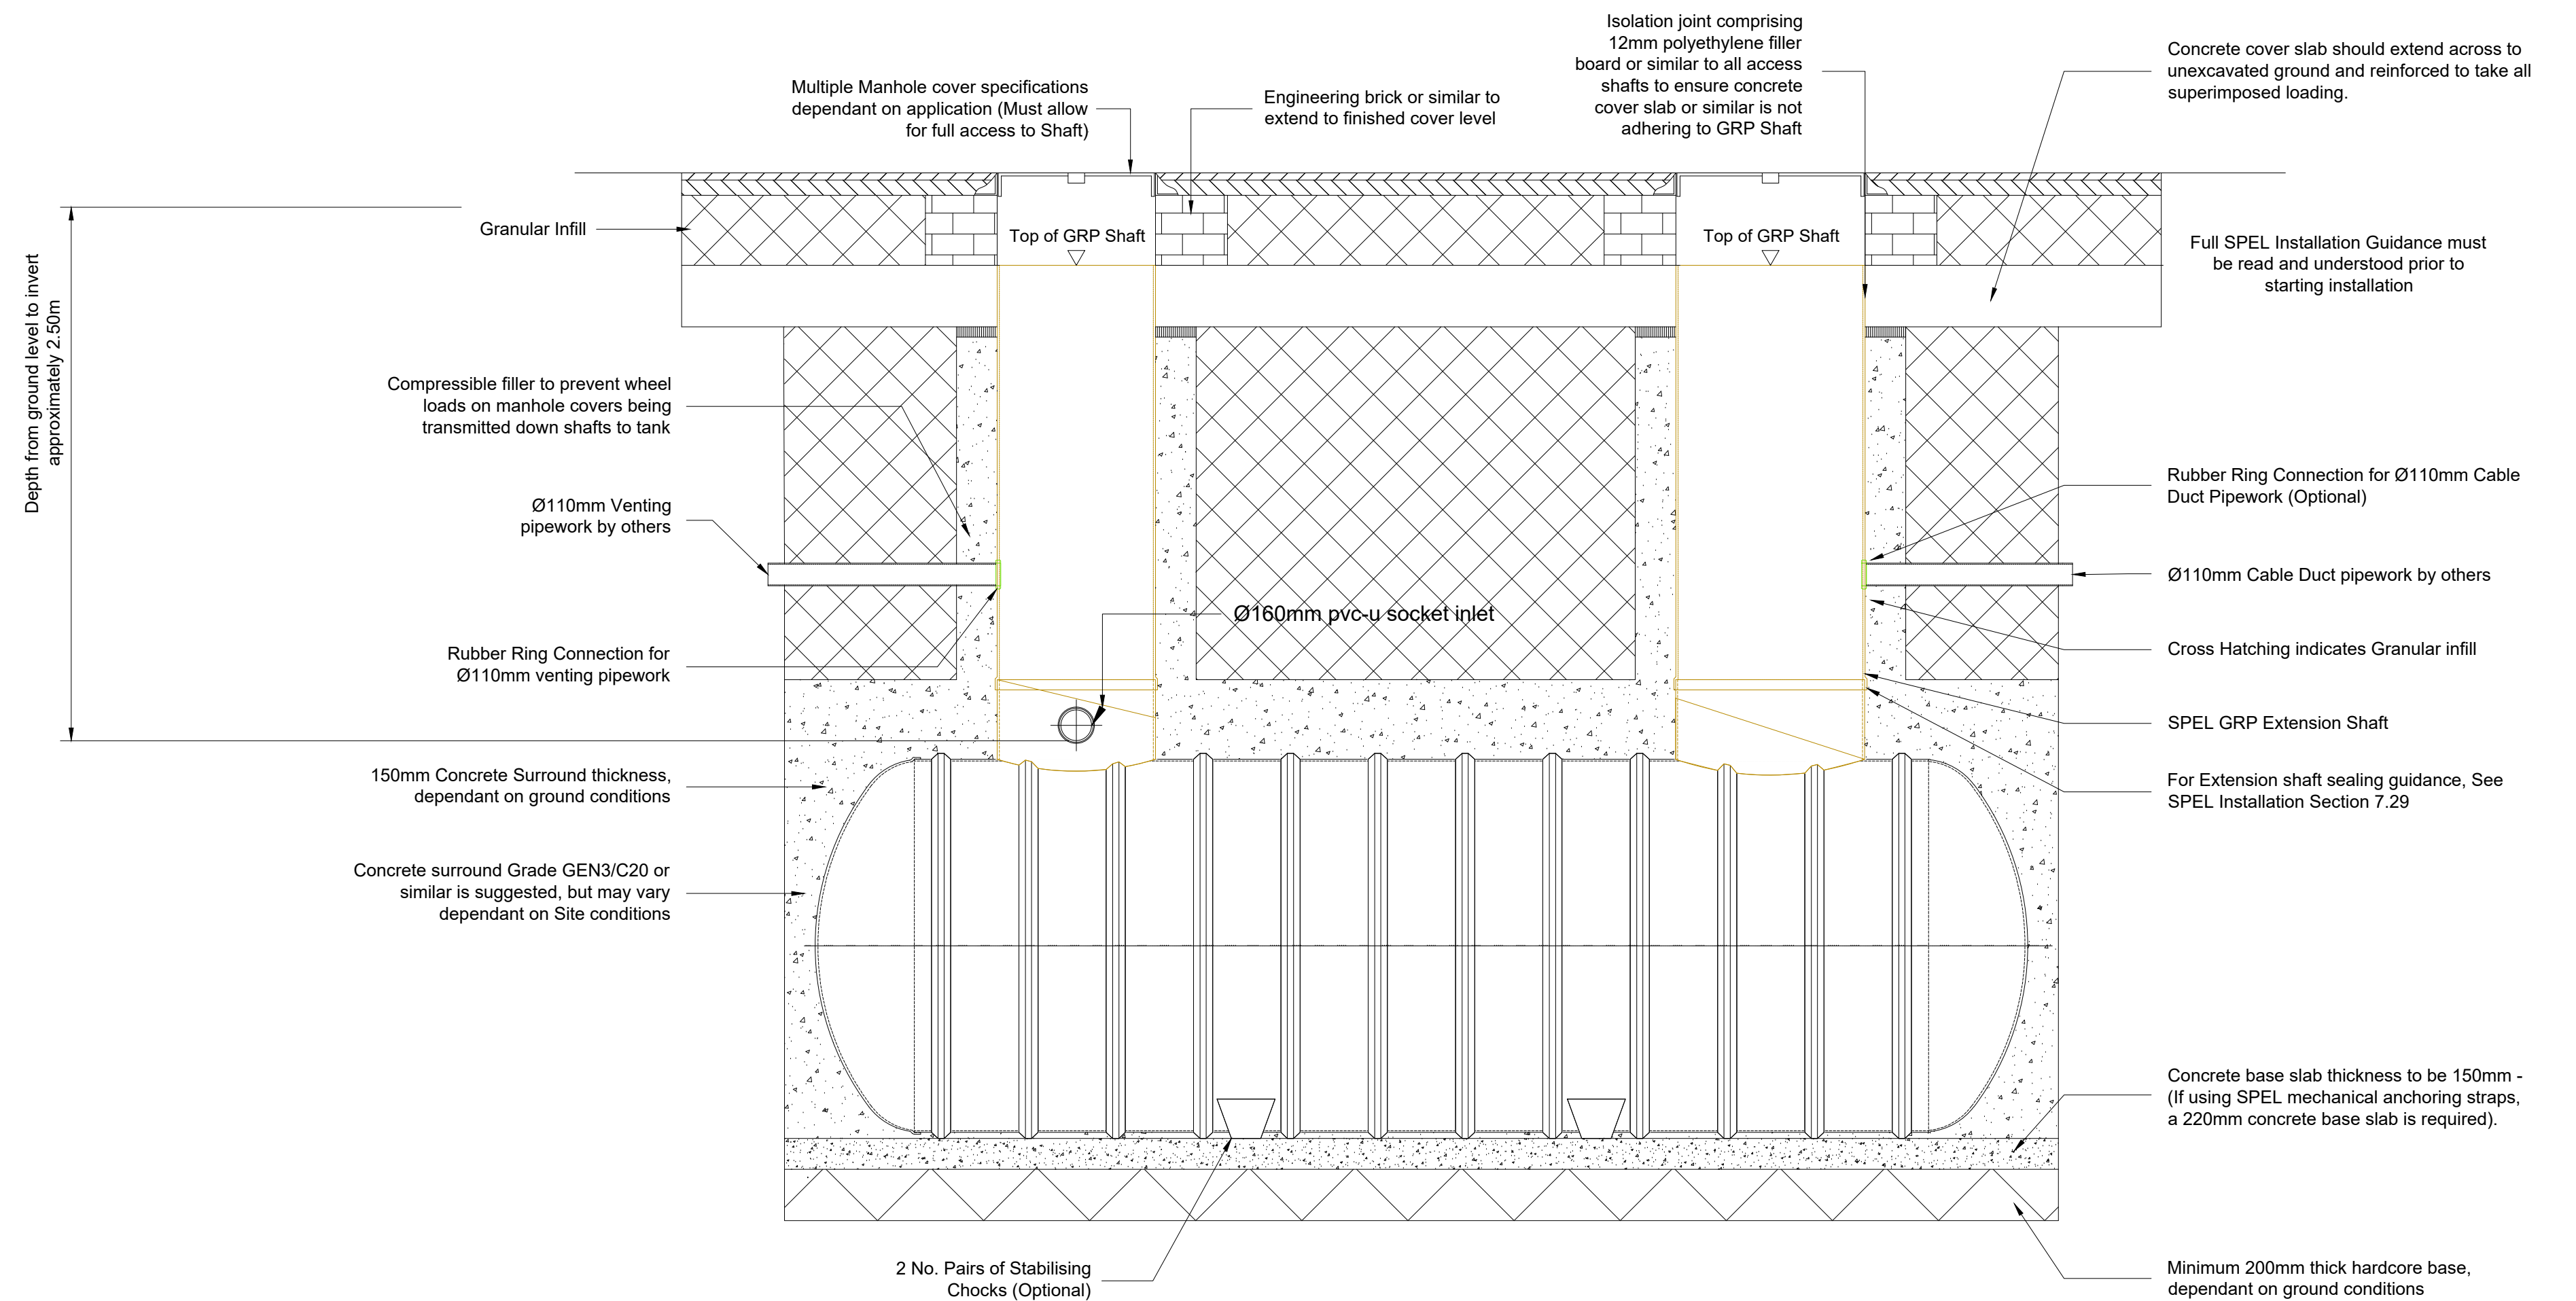

TYPICAL WASTEWATER STORAGE TANK
CROSS-SECTION
Scale 1:25

- Notes
1. For planning purposes only. Not for construction.
 2. All dimensions are in metres unless otherwise noted.
 3. Levels provided on this drawing are shown relative to finished stone level. For site specific levels, refer to site elevations.

Key to symbols



Reference drawings

PL1	28/01/2026	SHY	Planning Issue	GR	NR
Rev	Date	Drawn	Description	Ch'k'd	App'd

M
MOTT
MACDONALD

South Block
Rockfield
Dundrum
Dublin 16
Ireland
T +353 (0)1 291 6700
F
W www.mottmac.com

Client



Title
Donore 110 kV Substation

Typical Drainage Details
Sheet 2

Designed	C. Godor	Eng check	G. Reid	
Drawn	S. Healy	Coordination	A. Sethi	
Dwg check	R. McGowan	Approved	N. Roche	
Scale at A1 1:25	Status APR	Rev PL1	Security STD	
Drawing Number 229101684-MMD-01-XX-DR-D-0201				