

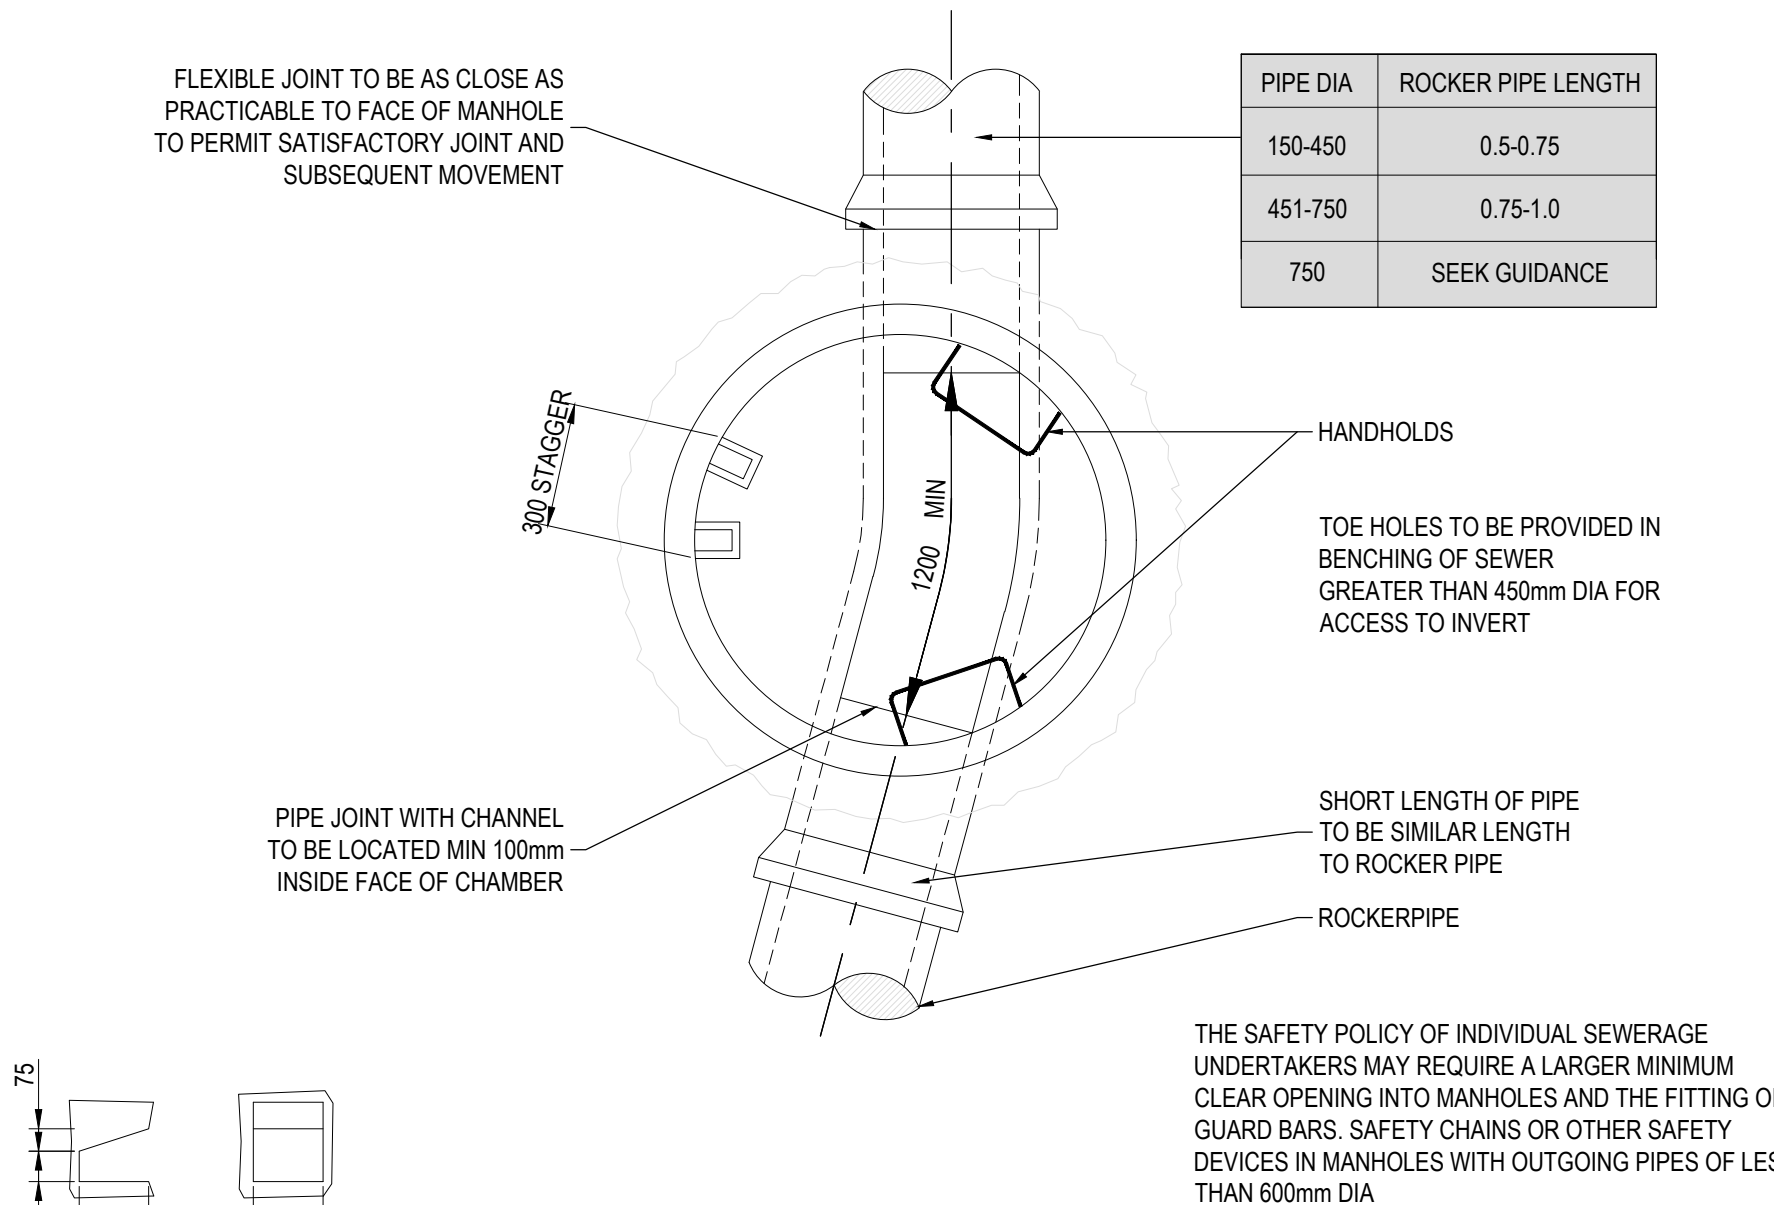
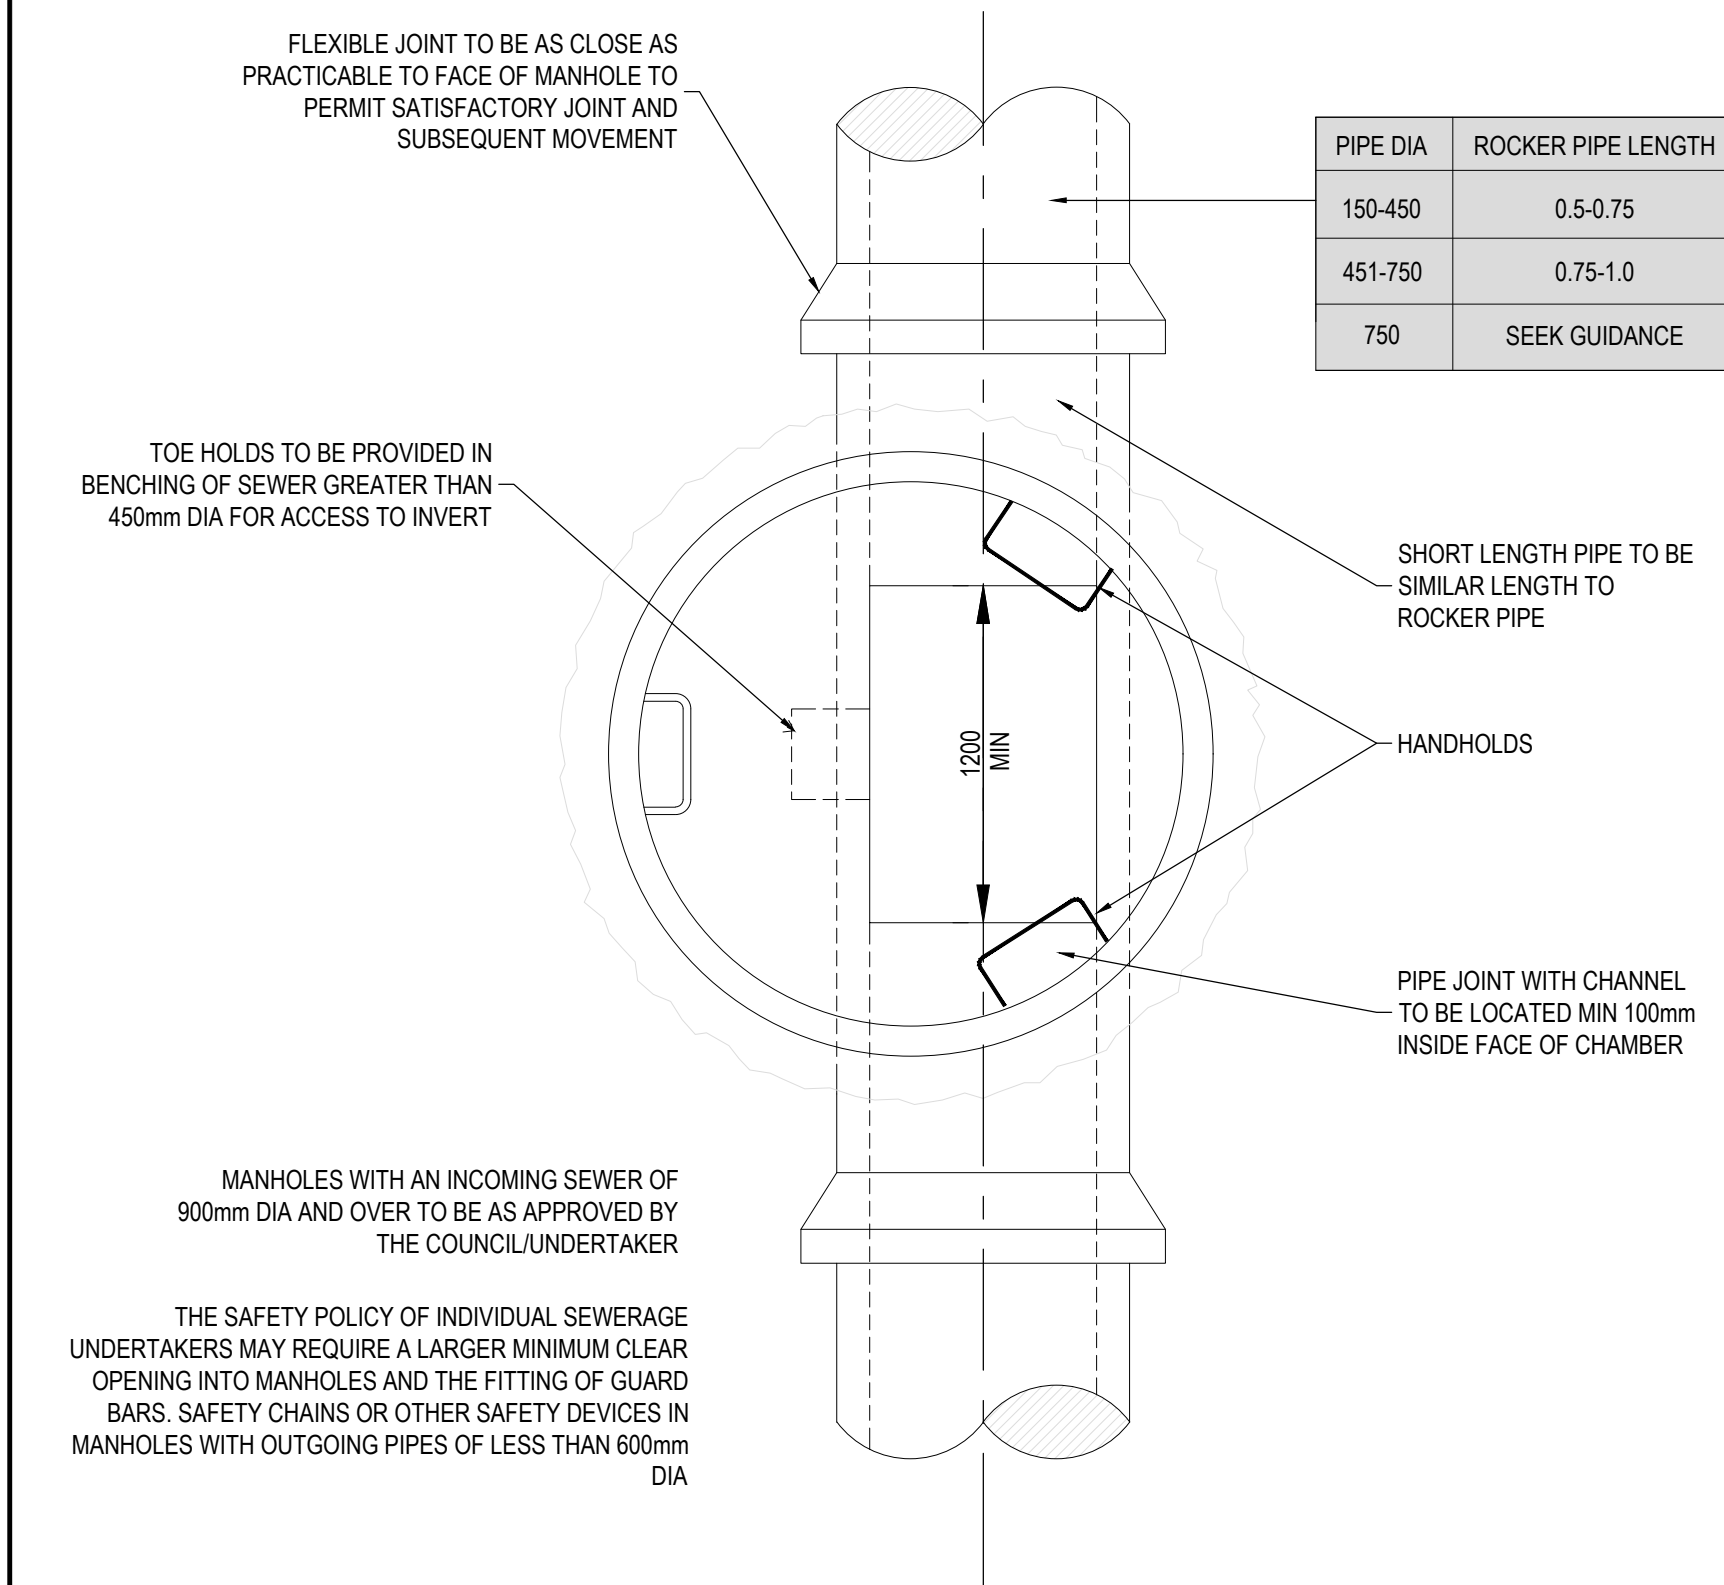
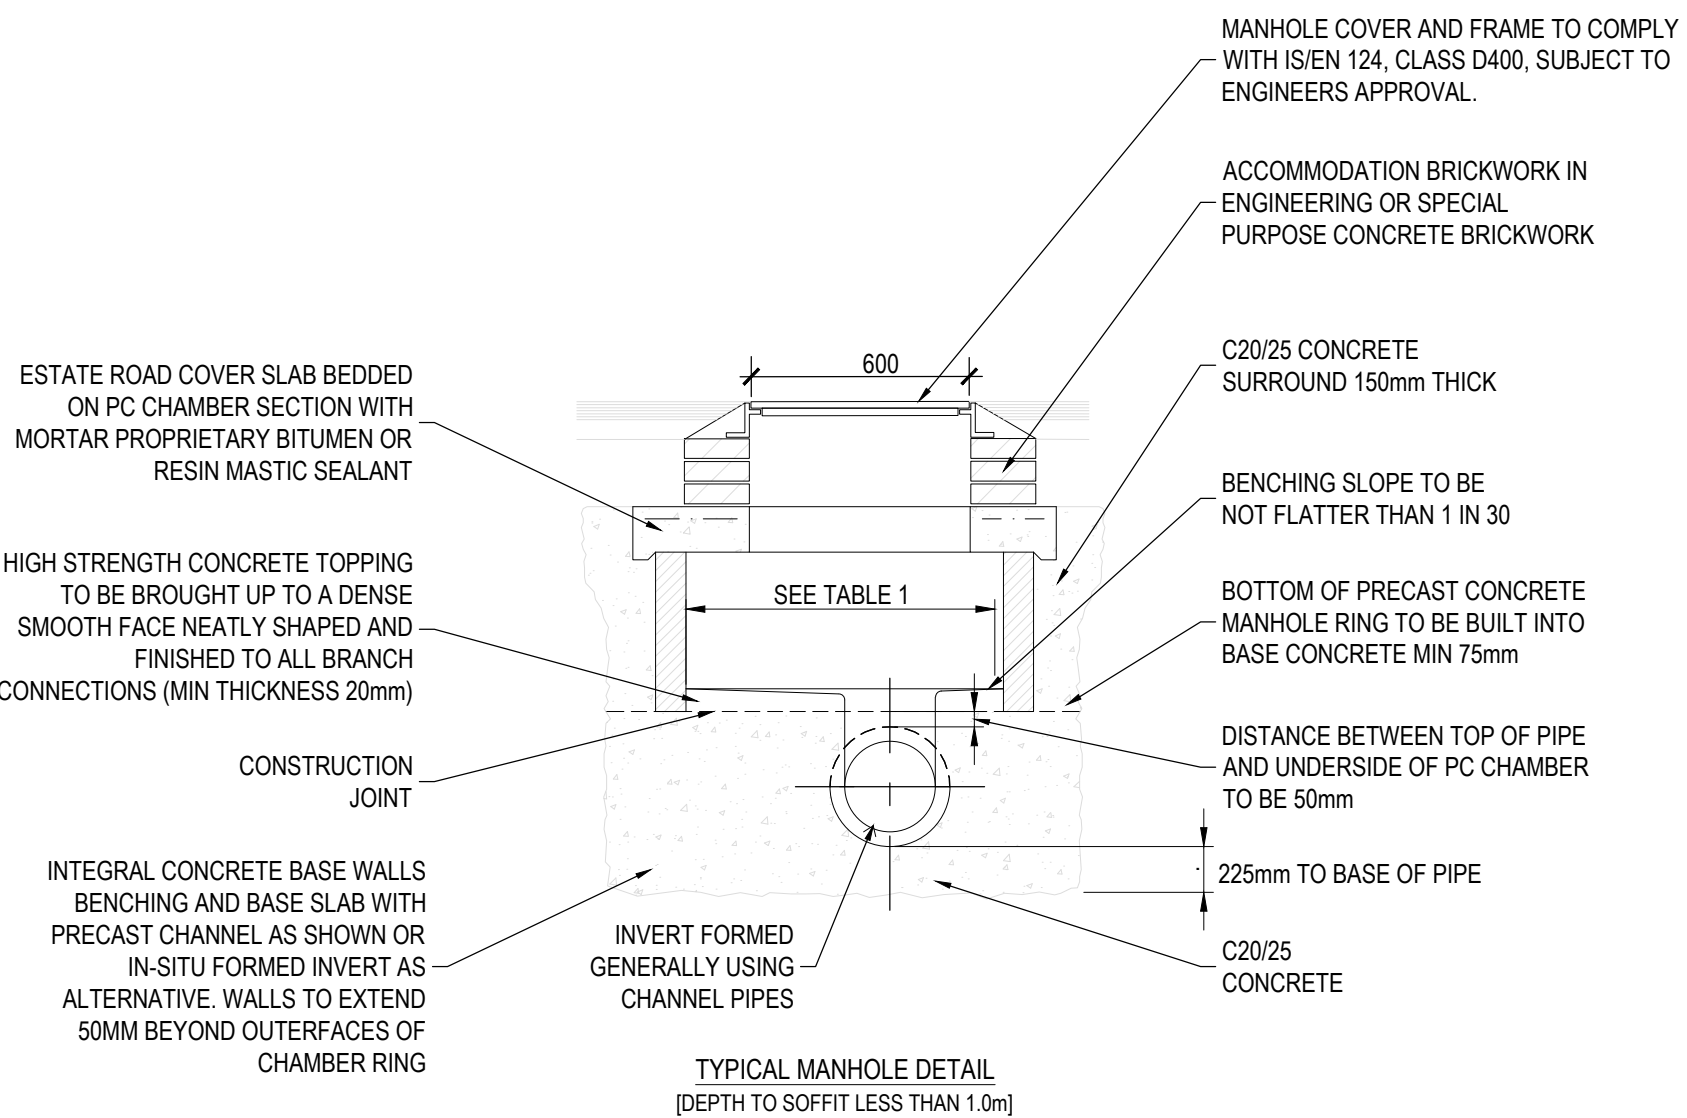
[illegible]

- ALL REINFORCED CONCRETE ON THIS DRAWING SHALL BE: C25/30 WITH COVER = 50mm MIN. WITH A MINIMUM CEMENT CONTENT OF 280 kg/m³, MAXIMUM W/C RATIO OF 0.65 AND SLUMP CLASS S2.
2. SURFACE FINISHES FOR CONCRETE:
 - CLASS F1 FOR ALL CONCRETE 100mm OR MORE BELOW GROUND LEVEL.
 - CLASS F3 FOR ALL EXPOSED CONCRETE ABOVE 100mm BELOW GROUND LEVEL.
3. ALL EXPOSED CORNERS ON CONCRETE SHALL BE CHAMFERED WITH 25 x 25mm CHAMFERS.
4. ALL STRUCTURAL CONCRETE (HEADWALLS, RC MANHOLES, PETROL INTERCEPTOR SLABS) TO RECEIVE MC DUR 1680 (OR SIMILAR APPROVED TAR MODIFIED EPOXY RESIN) TO ALL BURIED SURFACES, TO FINISH 100mm BELOW GROUND LEVEL.
5. ALL SEWERS SHALL BE PRESSURE TESTED PRIOR TO BACKFILLING.
6. RIGID PIPES SHALL MEAN CAST OR SPUN IRON

ALL WORKS TO BE UNDERTAKEN IN ACCORDANCE WITH

- TII SPECIFICATION FOR ROADWORKS
- GREATER DUBLIN CODE OF PRACTICE FOR DRAINAGE WORKS
- RECOMMENDATIONS FOR SITE DEVELOPMENT WORKS

FOR DETAILS OF HOUSE SEWER MANHOLES, REFER TO FRONT WATER CONNECTION AND DEVELOPER SERIES STANDARD DETAILS.

TABLE 1TABLE 2

DISCIPLINE			SCALE
CIVIL			NTS
DRAWN	DESIGNED	CHECKED	APPROVED
MM	AM	AL	AL
DRAWING No 26019-MHT-XX-ZZ-DR-C-0700			ISSUE P02