




Legend


-  Limerick WWTP Location
- River Waterbodies Risk
-  At Risk
 -  Not at Risk
 -  Review
 -  Unassigned

- Transitional Waterbodies Risk
-  At Risk
 -  Not at Risk
 -  Review
 -  Unassigned

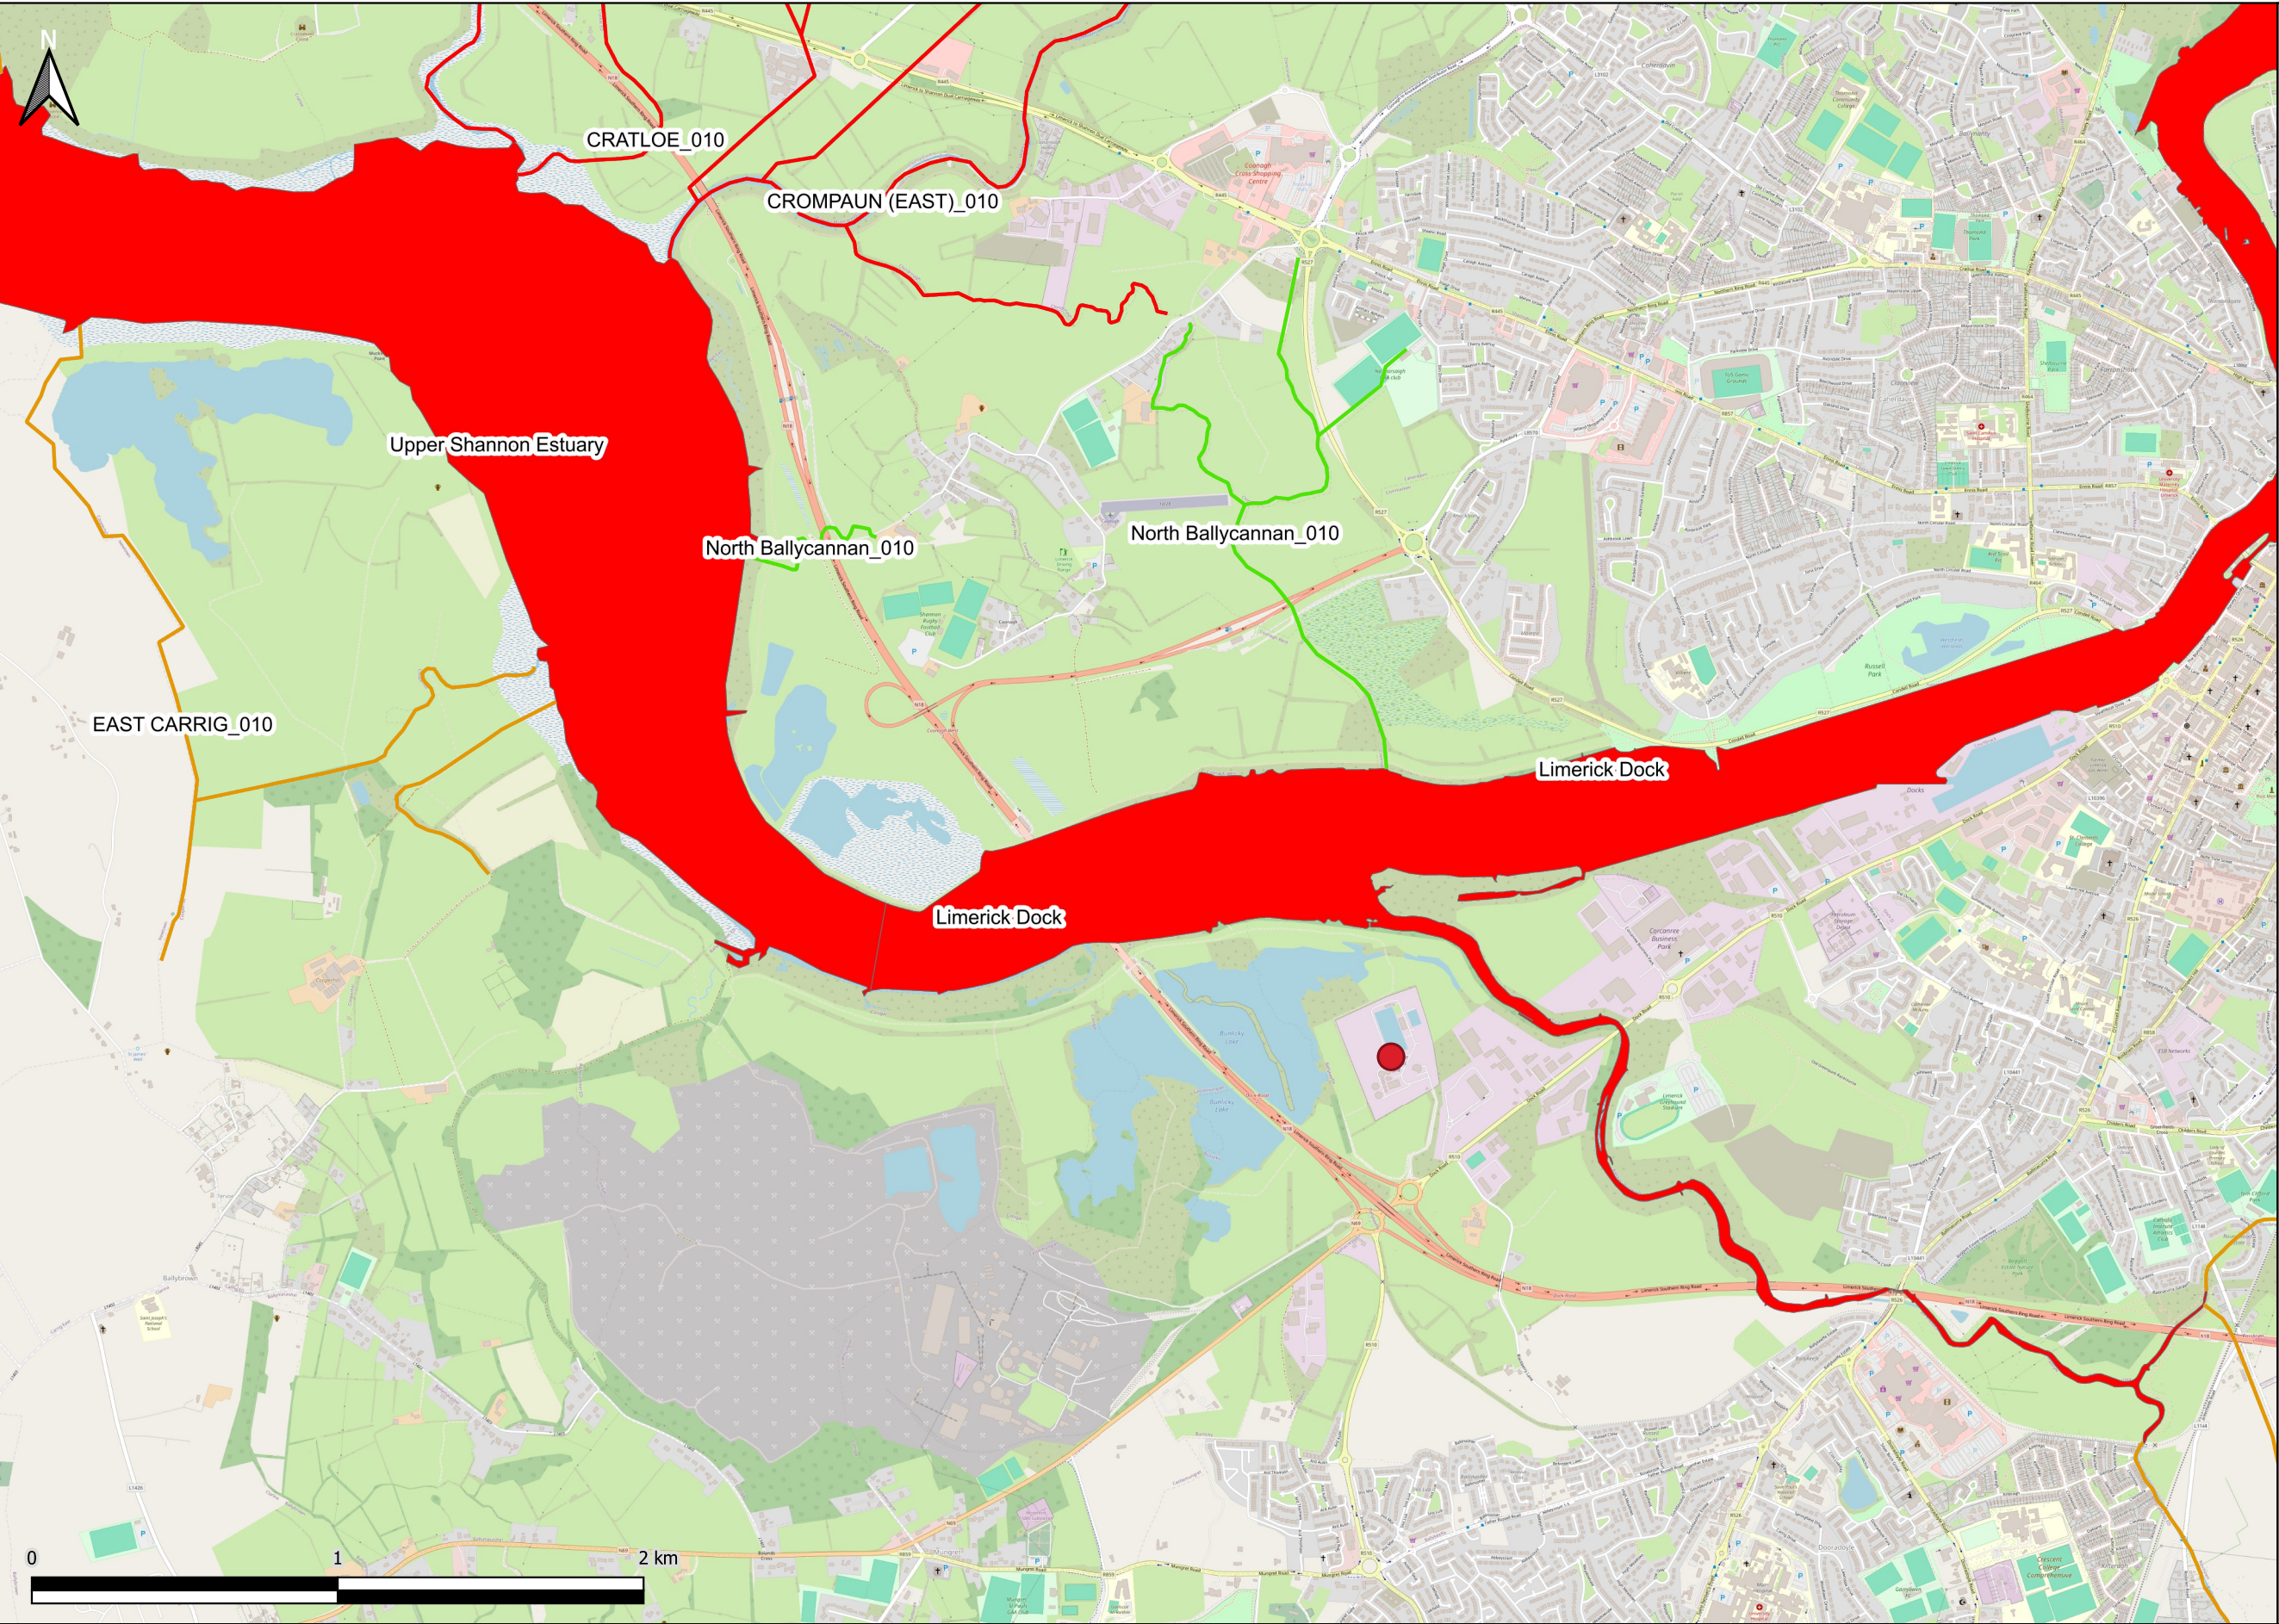

Comhairle Cathrach
& Contae **Luimnigh**
Limerick City
& County Council

Key Plan

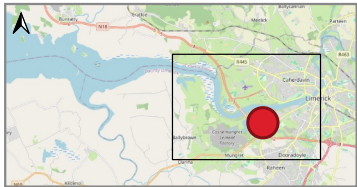

Client:



Project:

**Limerick Wastewater Treatment
Plant Upgrade and Regional
Bioresource Centre**

Drawn: SM Date: 04.11.2025
Checked: OOB Scale: 1:35000
Approved: PJ Sheet: A3

Consultant:



Egis Engineering Ltd.
Unit 14C, N5 Business Park,
Moneen Rd,
Castlebar, Co. Mayo,
F23 Y339

Map Figure Title:

**16.2 Surface Water Risk
Latest Status**

Status: S3 Rev: P01 Sheet: 1 of 1

Map Figure No.:
20702-JBB-00-XX-DR-Y-00244