


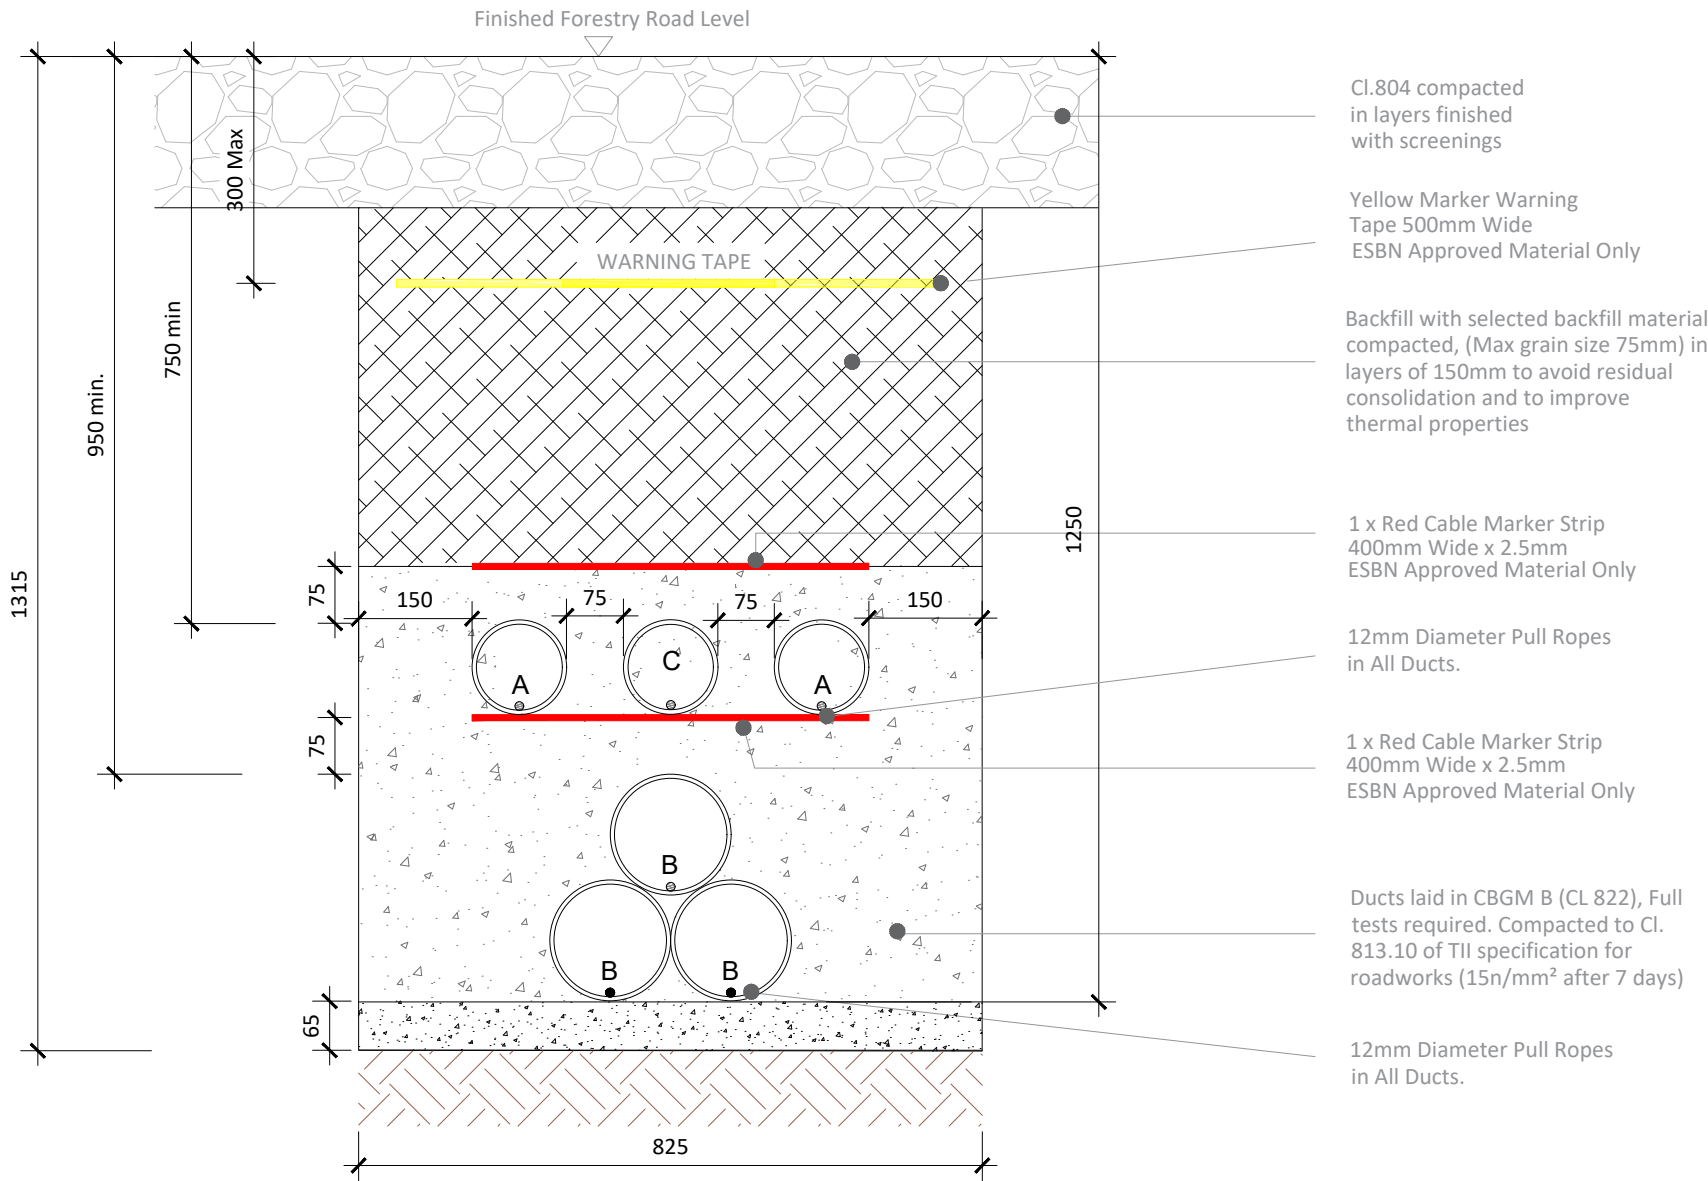

A = 125mm: Outer Diameter HDPE ESB Approved Duct, SDR=17.6
B= 160mm : Outer Diameter HDPE ESB Approved Duct, SDR= 21
C = 125mm: ECC Earth Continuity Conductor

Section Through Forestry Road

SCALE 1:10

- Note:
- This drawing is to be read in conjunction with relevant drawings, specifications and reports
 - Dimensions are in millimeters, unless noted otherwise
 - Drawings are not to be scaled use figured dimensions only

ALL REINSTATEMENT WORKS ARE TO BE IN ACCORDANCE WITH LANDOWNERS REQUIREMENTS



Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

CLIENT



PROJECT

Lissinagroagh Wind Farm
110 kV Grid Connection

PROJECT NUMBER
05-773

SHEET NUMBER
05773-DR-123

SHEET TITLE

Ducting through Forestry Road

DRAWING STATUS
For Planning

ISSUE/REVISION

ISSUE/REVISION		
P01	21.04.26	Issued for Planning
P00	12.01.26	Issued for Planning
I/R	DATE	DESCRIPTION