


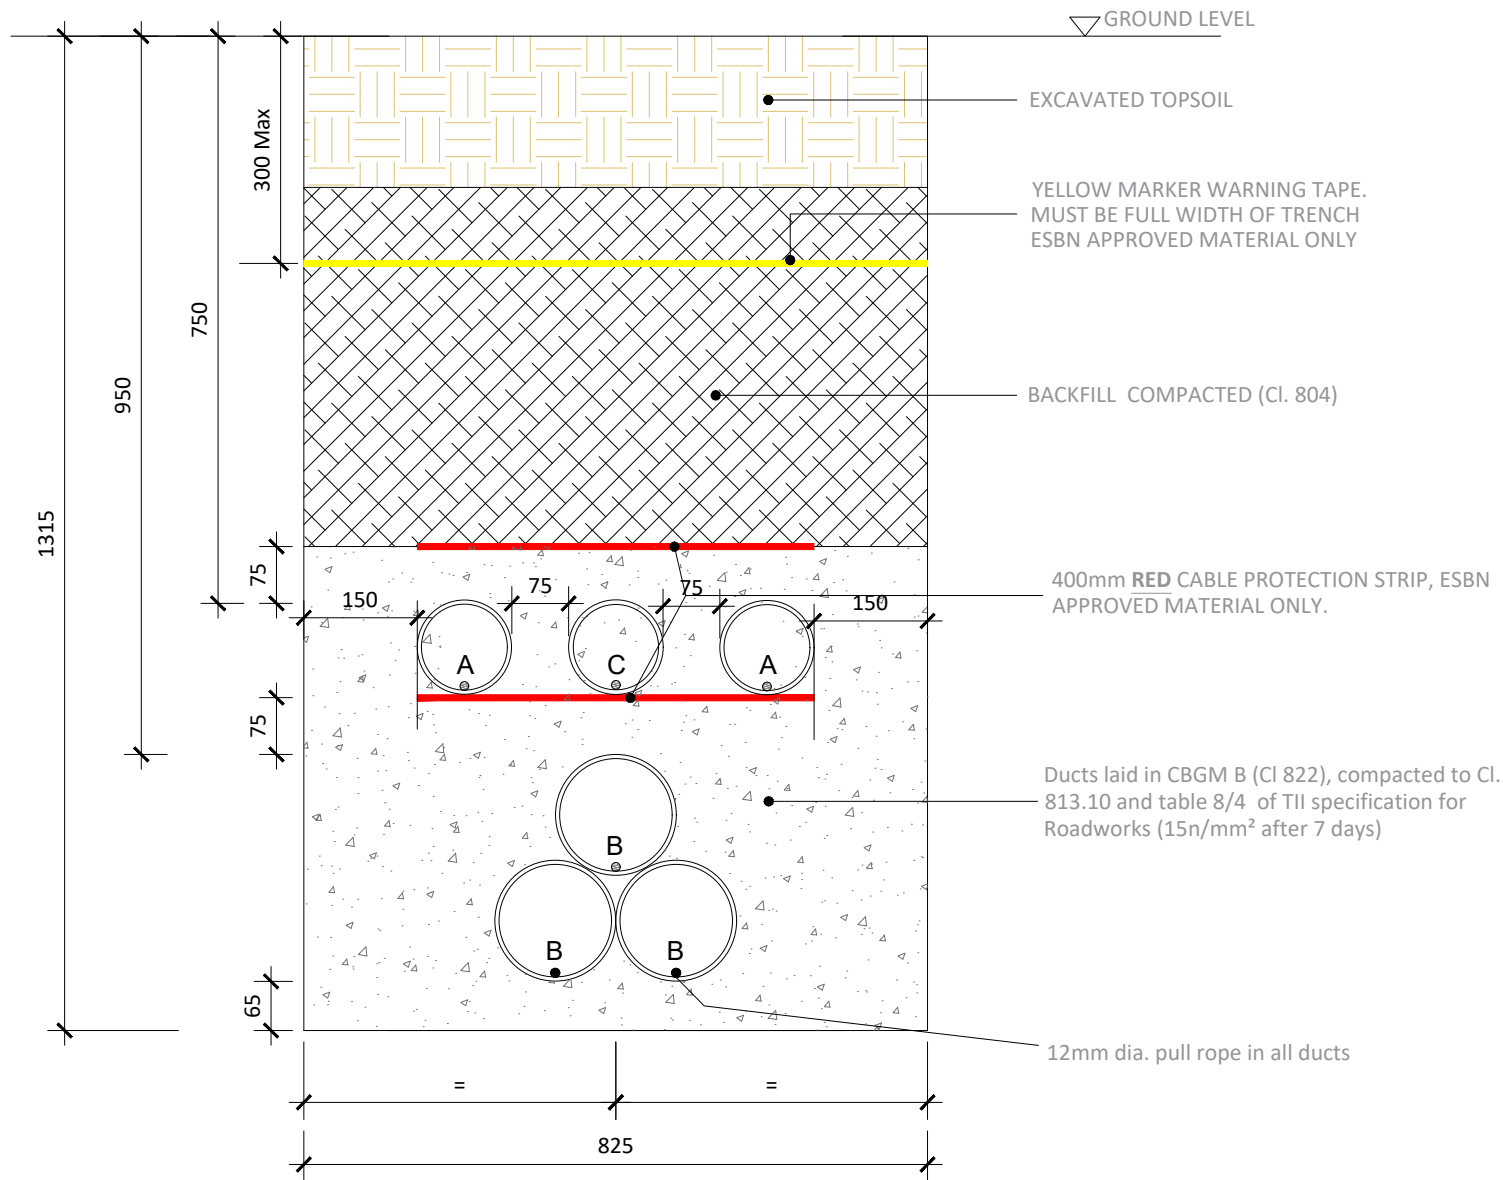

A = 125mm: Outer Diameter HDPE ESB Approved Duct, SDR=17.6  
B = 160mm : Outer Diameter HDPE ESB Approved Duct, SDR= 21  
C = 125mm: ECC Earth Continuity Conductor

Section Through Off Road Sections

SCALE 1:10

- Note:
- This drawing is to be read in conjunction with relevant drawings, specifications and reports
  - Dimensions are in millimeters, unless noted otherwise
  - Drawings are not to be scaled use figured dimensions only

ALL REINSTATEMENT WORKS ARE TO BE IN ACCORDANCE WITH LANDOWNER REQUIREMENTS

Reinstatement details based on Guidelines for Managing Openings in Public Roads - SD14



Head Office  
Beenreigh,  
Abbeydorney,  
Tralee, Co. Kerry  
Ireland  
Tel: 00353 66 7135710

CLIENT



PROJECT

Lissinagroagh Wind Farm  
110kV Grid Connection

PROJECT NUMBER  
05-773

SHEET NUMBER  
05773-DR-125

SHEET TITLE

Ducting through Off Road Sections

DRAWING STATUS  
For Planning

ISSUE/REVISION

|     | DATE     | DESCRIPTION         |
|-----|----------|---------------------|
| P02 | 21.04.26 | Issued for Planning |
| P01 | 20.04.26 | Issued for Planning |
| P00 | 12.01.26 | Issued for Planning |
| I/R | DATE     | DESCRIPTION         |