




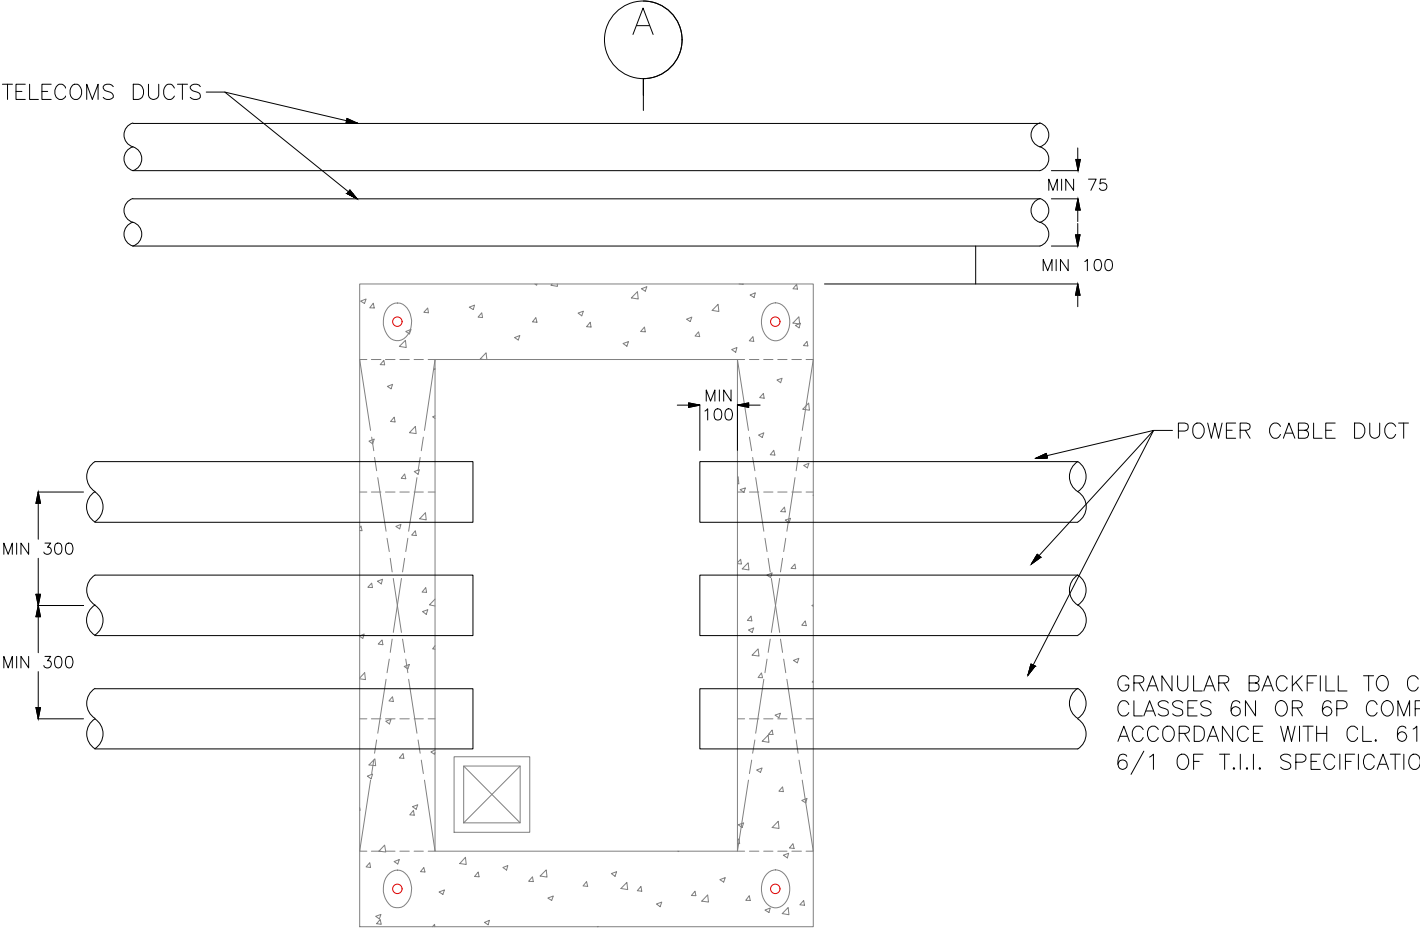

PLAN — TRANSITION CHAMBER  
SCALE 1:20 (DUCT SETTING OUT)

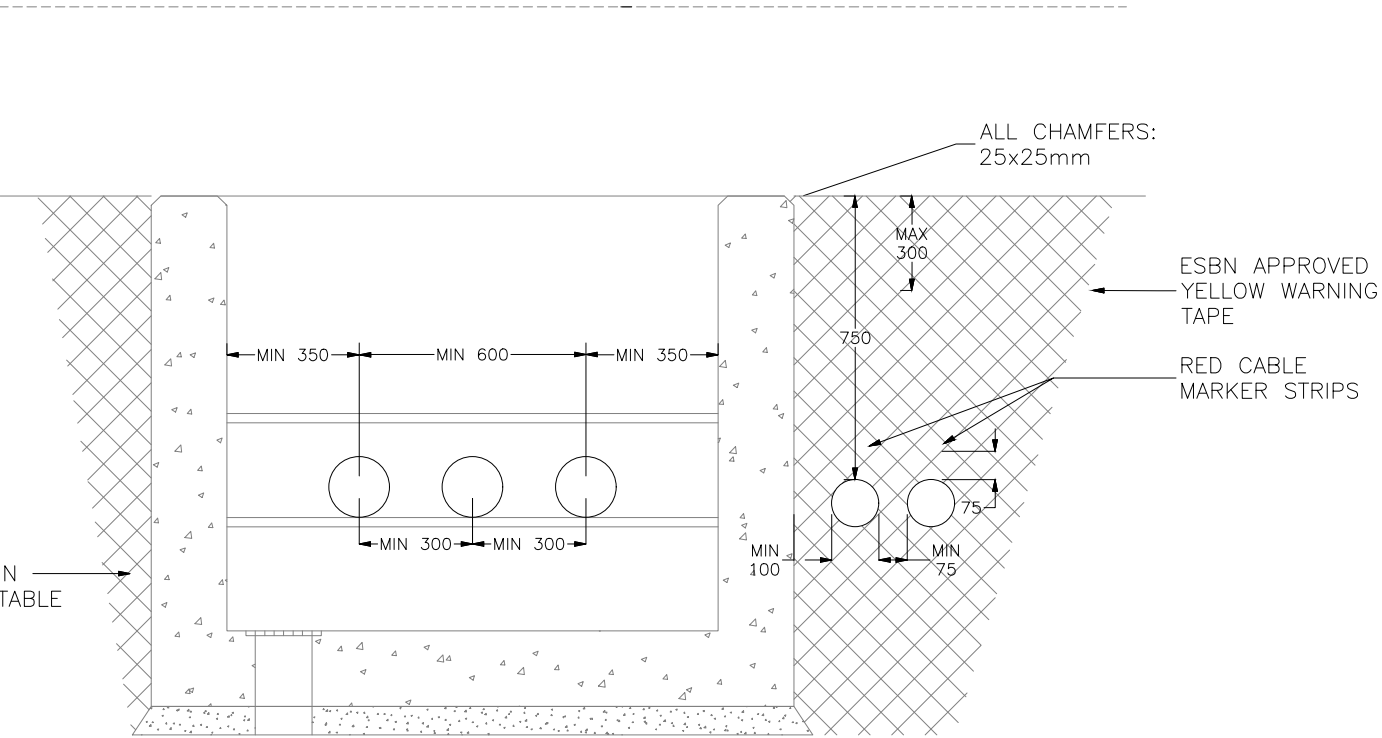

SECTION A  
SCALE 1:20

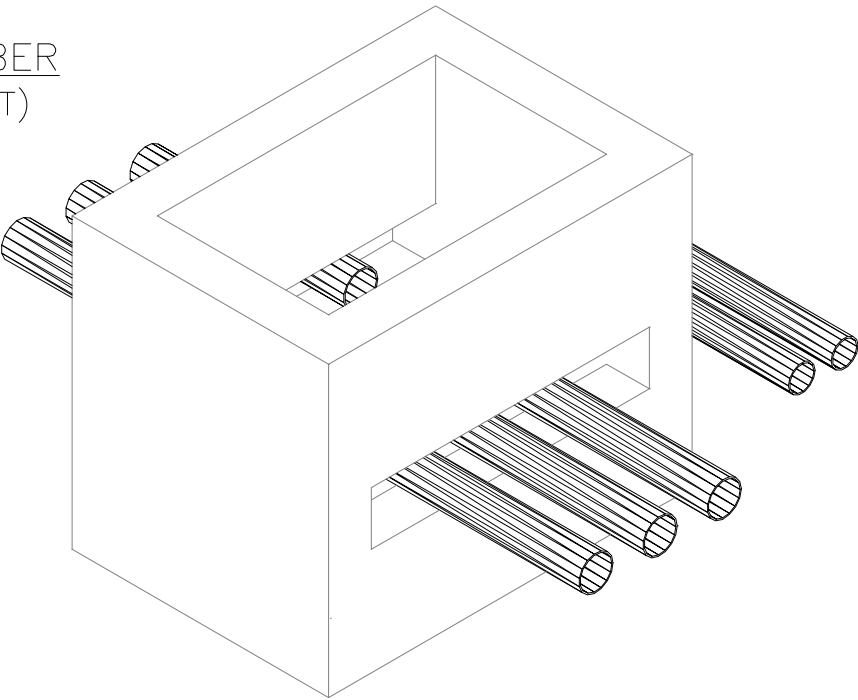

- NOTES:**
- 1. This drawing is to be read in conjunction with relevant drawings, specifications and reports.
  - 2. Dimensions are in millimetres, unless noted otherwise.
  - 3. Drawings are not to be scaled use figured dimensions only.
  - 4. Telecommunication ducts not to be routed through Transition chamber
  - 5. If Transition chamber is used to interface with a HDD section, Then the telecoms duct SDR 17.6 should be chamfered when coupled with SDR 11 ducts



Head Office  
Beenreigh,  
Abbeydorney,  
Tralee, Co. Kerry  
Ireland  
Tel: 00353 66 7135710

CLIENT



PROJECT

Lissinagroagh Wind Farm  
110kV Grid Connection

PROJECT NUMBER  
05-773

SHEET NUMBER  
05773-DR-143

SHEET TITLE

Transition Chamber Details

DRAWING STATUS  
For Planning

ISSUE/REVISION

| ISSUE/REVISION |          |                     |
|----------------|----------|---------------------|
|                |          |                     |
| P01            | 21.04.26 | Issued for Planning |
| P00            | 12.01.26 | Issued for Planning |
| I/R            | DATE     | DESCRIPTION         |