



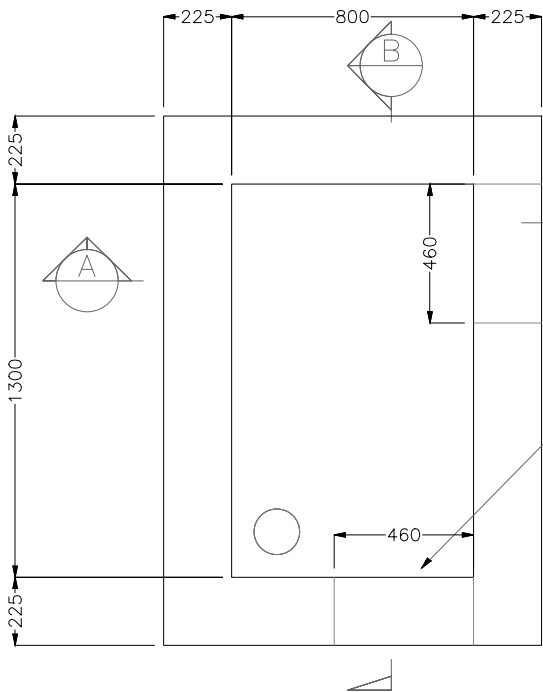


WALL OPENING 460x325 MAX. ACTUAL SIZE TO BE FORMED TO SUIT DUCT ENTRIES. VOIDS TO BE SEALED AND SURFACES MADE GOOD WITH CLASS 1 MORTAR.

- NOTES:**
- 1. This drawing is to be read in conjunction with relevant drawings, specifications and reports.
 - 2. Dimensions are in millimeters, unless noted otherwise.
 - 3. Drawings are not to be scaled use figured dimensions only.
 - 4. All material and workmanship to be in accordance with the NRA./TII specification for Roadworks, May 2005 and subsequent revisions
 - 5. Reinforced concrete to be a minimum grade C32/40, Sulphate resisting cement to be used where aggressive soil conditions apply.
 - 6. Carriageway covers and frames to be to B.S. 124.
 - 7. All covers to have ESB logo incorporated in them to the approval of Eirgrid
 - 8. Brickwork to be class B Engineering, beds and Joints to be class 1 mortar
 - 9. Final position of Link Box to be agreed with Eirgrid prior to installation

Link Box Chamber Detail - Plan
SCALE 1:20

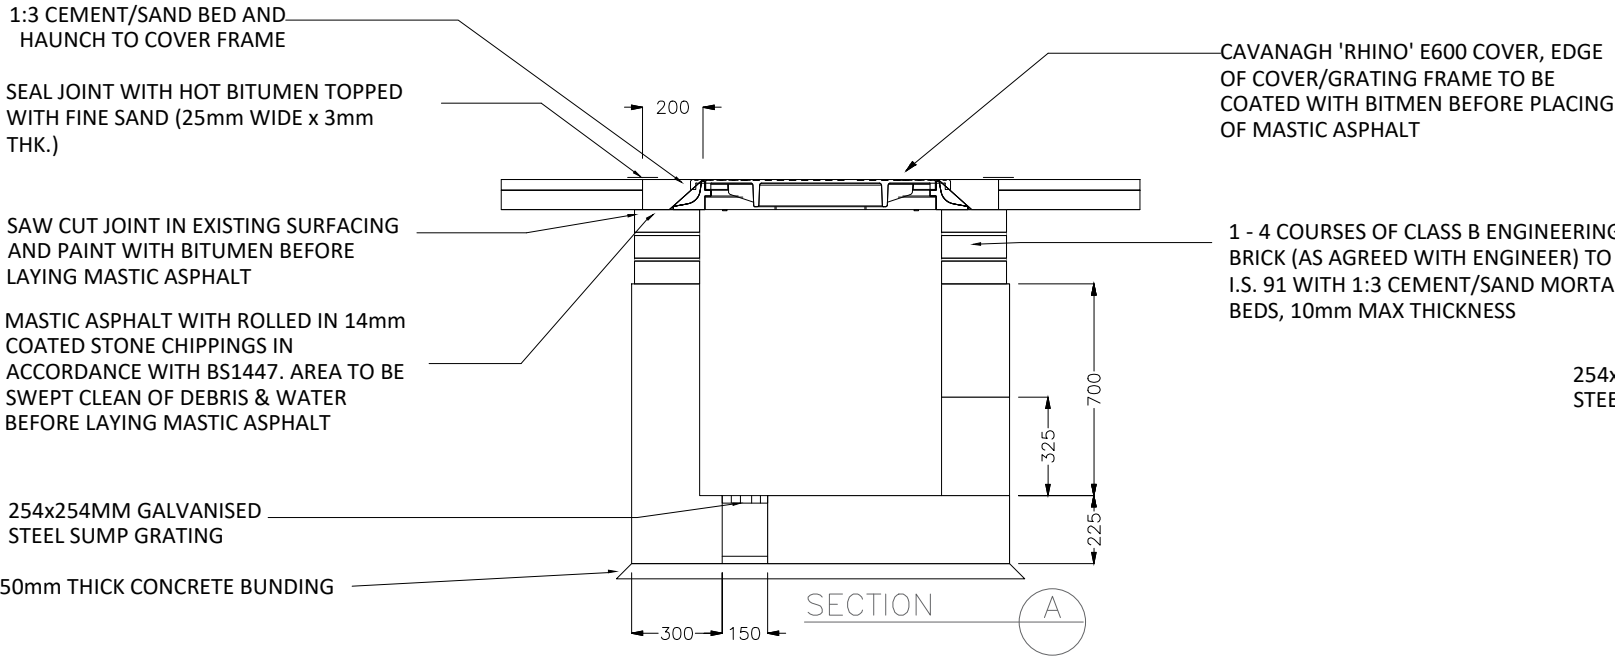

Link Box Chamber Detail - Section A-A
SCALE 1:20

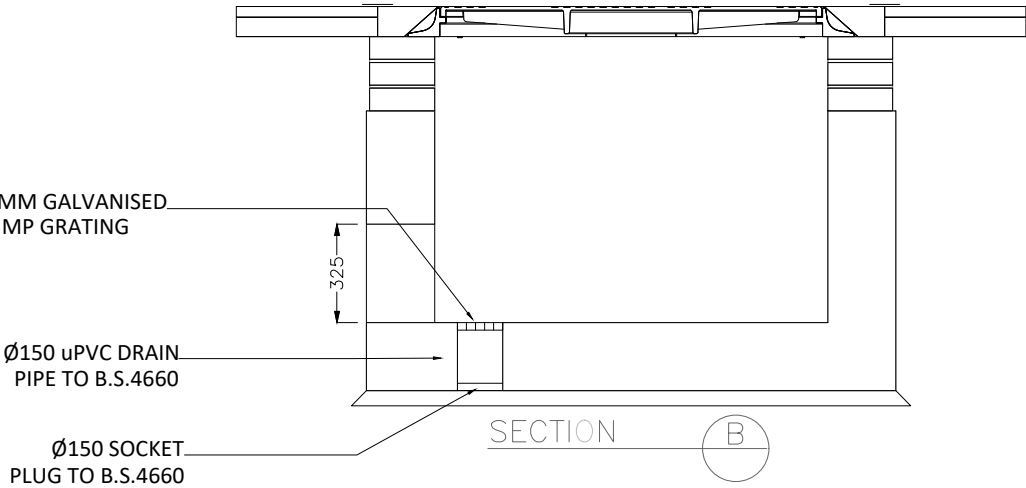

Link Box Chamber Detail - Section B-B
SCALE 1:20



Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

CLIENT



PROJECT

Lissinagroagh Wind Farm
110kV Grid Connection

PROJECT NUMBER
05-773

SHEET NUMBER
05773-DR-146

SHEET TITLE

Link Box Chamber Details

DRAWING STATUS
For Planning

ISSUE/REVISION

ISSUE/REVISION		
P01	21.04.26	Issued for Planning
P00	12.01.26	Issued for Planning
I/R	DATE	DESCRIPTION