

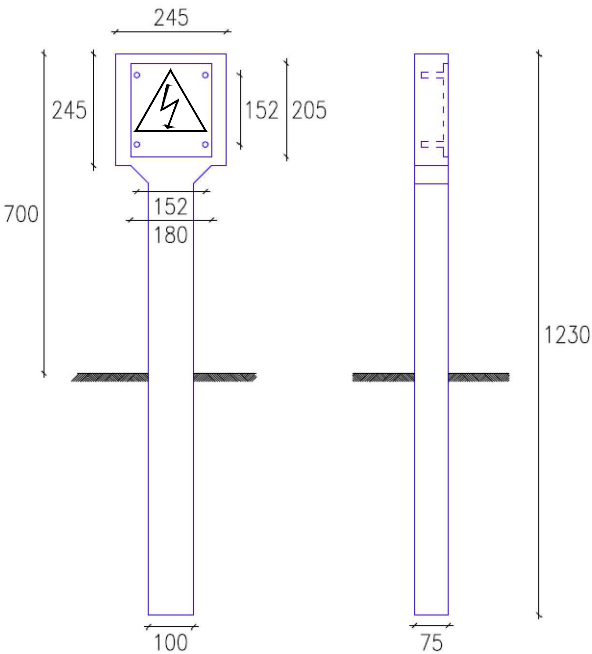


Note:
Marker posts will be used on non-roadway routes to delineate the duct route and joint bay positions. Corrosion proof aluminium triangular danger sign, with 700mm base, and with centred lightning symbol, on engineering grade fluorescent yellow background shall be installed in adequately sized concrete foundations. Marker posts shall also be placed in the event that burial depth is not to standard.

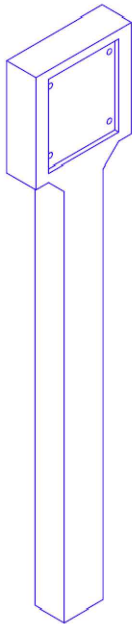

Typical ESB Marker Post Detail

Not to Scale

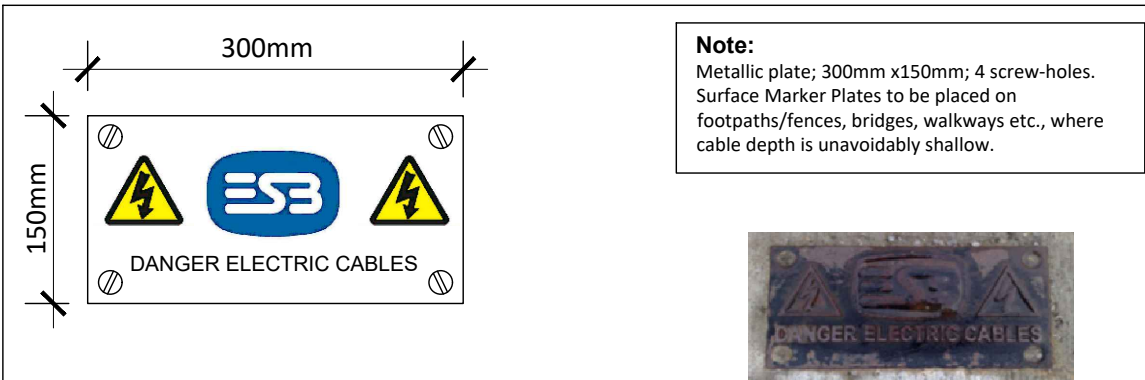

Typical Surface Marker Plate

Typical ESB Marker Plate Detail

Not to Scale

- Note:**
- This drawing is to be read in conjunction with relevant drawings, specifications and reports.
 - Dimensions are in millimeters, unless noted otherwise.
 - Drawings are not to be scaled use figured dimensions only.



Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

CLIENT



PROJECT

Lissinagroagh Wind Farm
110kV Grid Connection

PROJECT NUMBER
05-775

SHEET NUMBER
05775-DR-148

SHEET TITLE

Typical 110kV UGC -
ESB Marker Posts / Plates

DRAWING STATUS
For Planning

ISSUE/REVISION

ISSUE/REVISION		
P01	21.04.26	Issued for Planning
P00	12.01.26	Issued for Planning
I/R	DATE	DESCRIPTION