


ISO A1 594mm x 841mm

Project Management Initials: Designer: LP Checked: AC Approved: AC

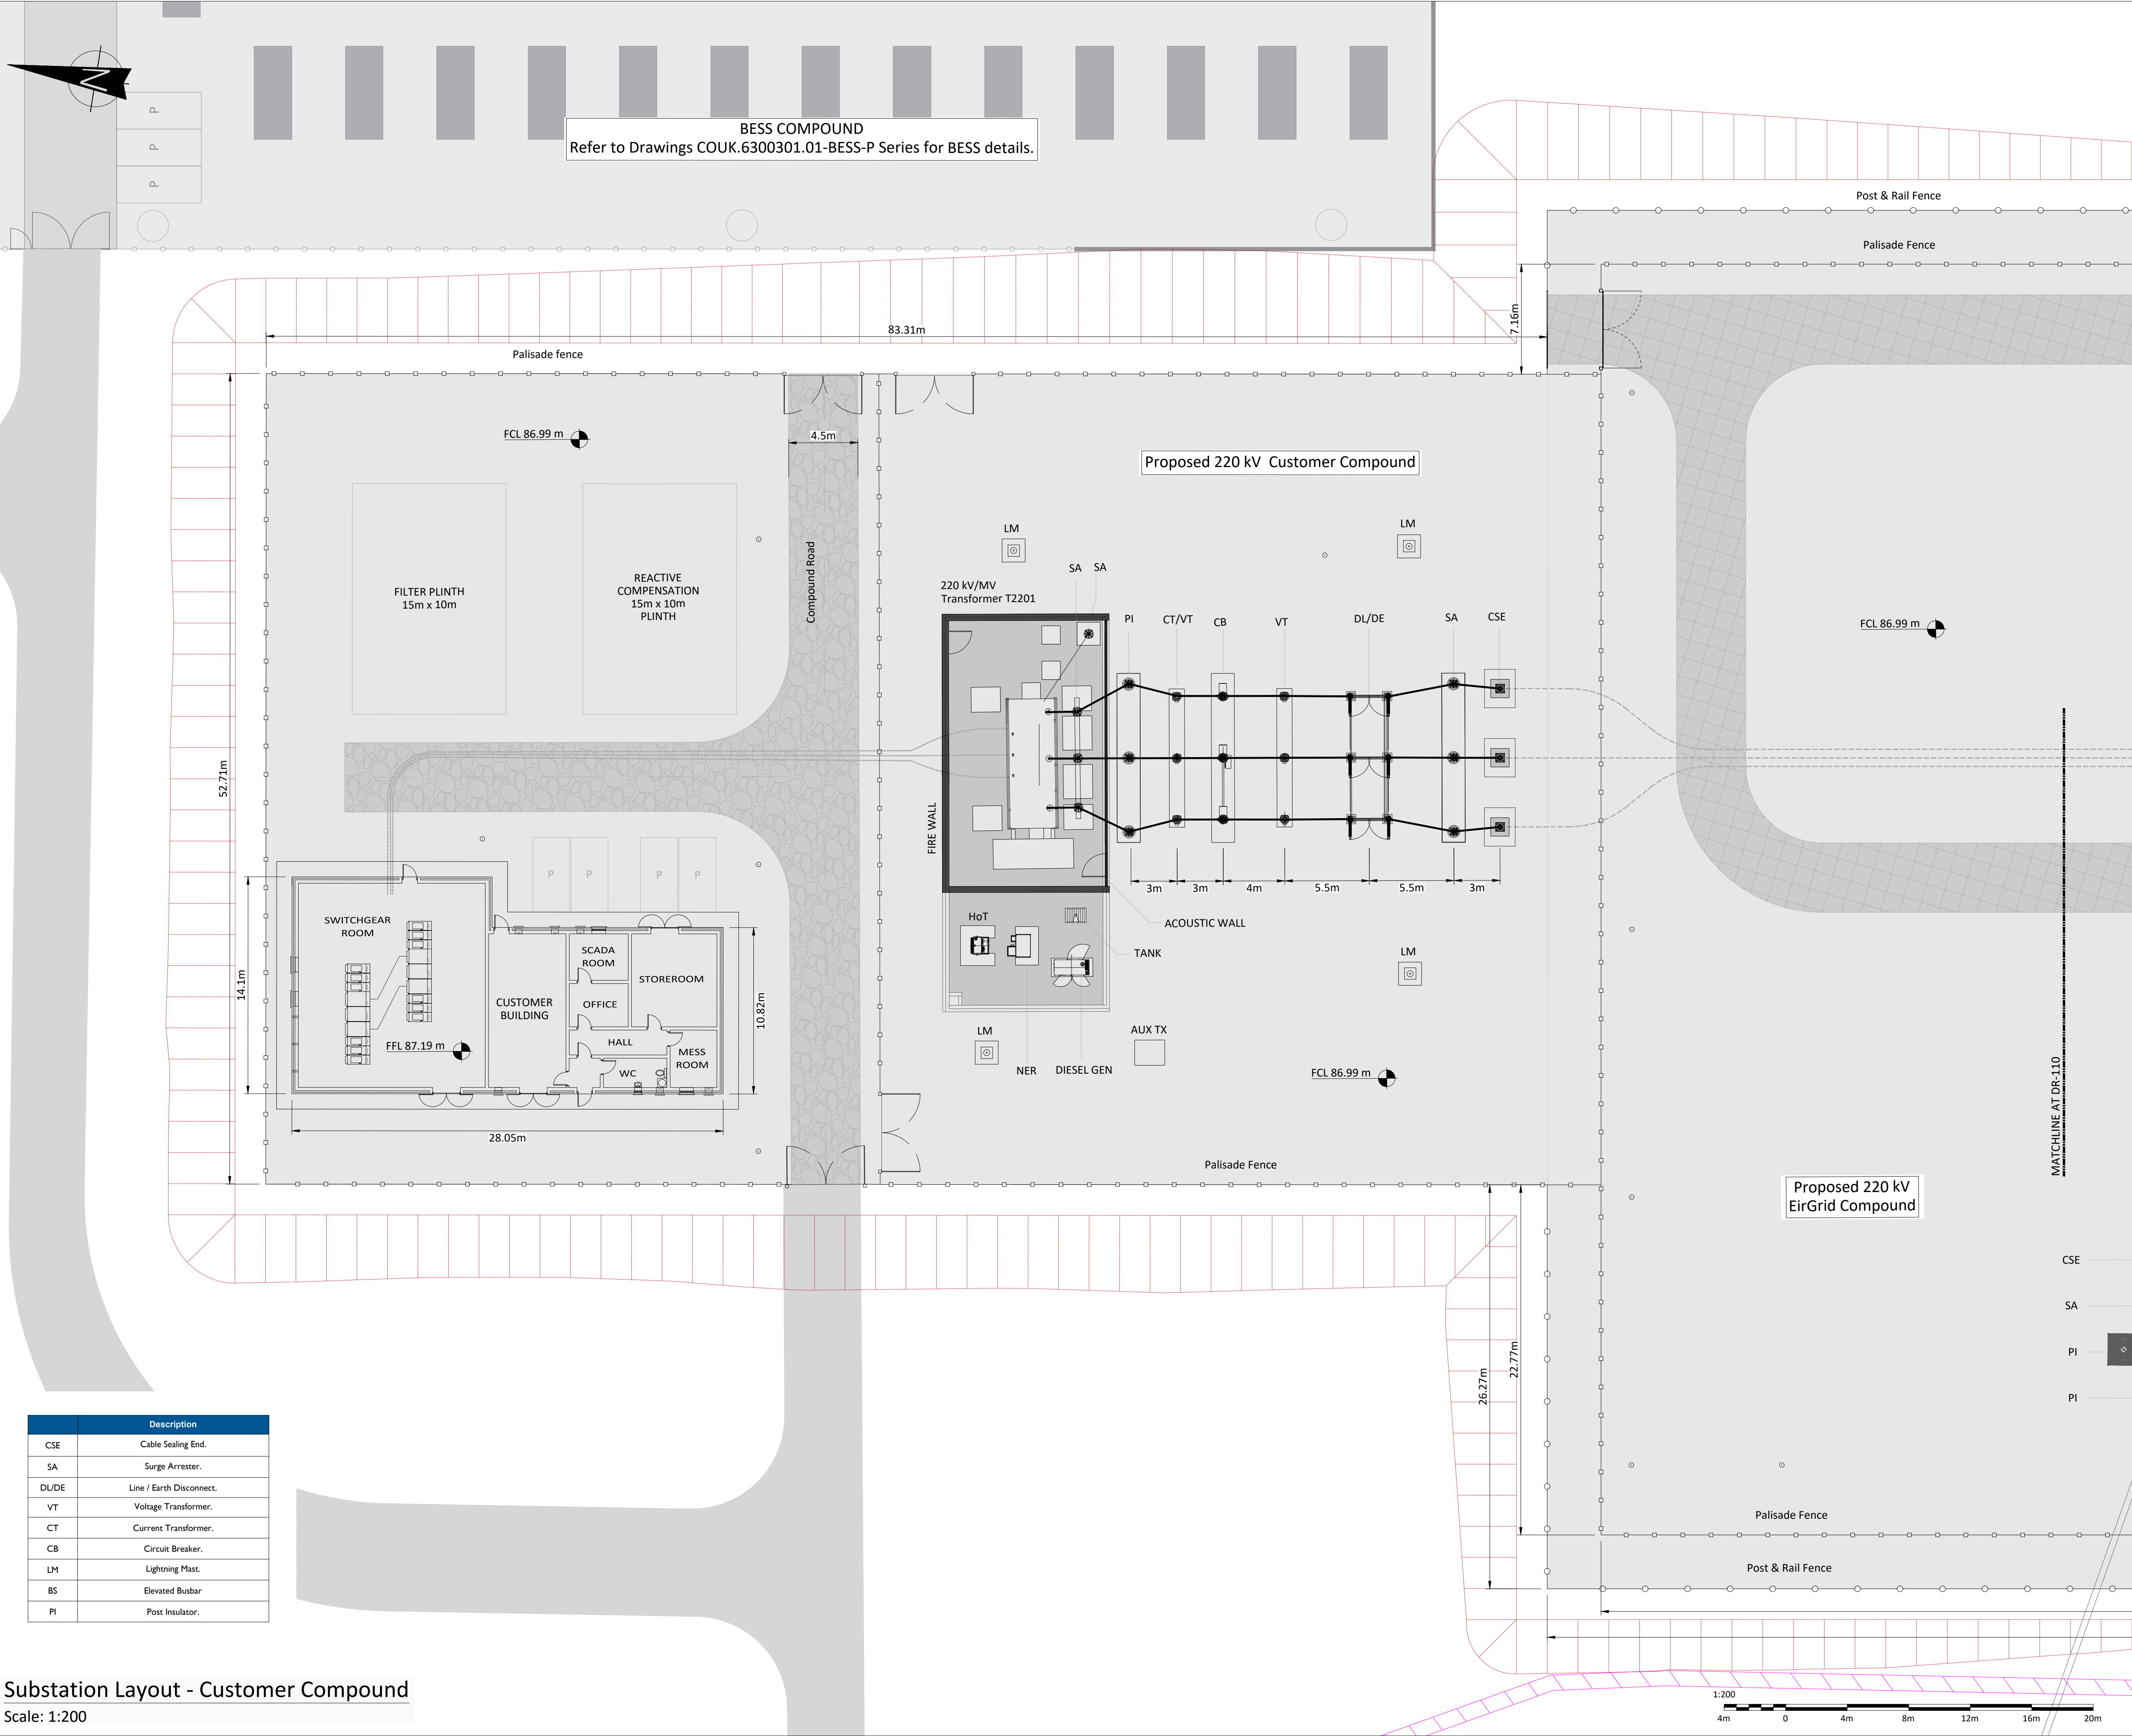

	Description
CSE	Cable Sealing End.
SA	Surge Arrester.
DL/DE	Line / Earth Disconnect.
VT	Voltage Transformer.
CT	Current Transformer.
CB	Circuit Breaker.
LM	Lightning Mast.
BS	Elevated Busbar
PI	Post Insulator.

Substation Layout - Customer Compound

Scale: 1:200

Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

Regional Office
Basepoint Business Centre
Stroudley Road, Basingstoke,
Hampshire,
RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT

East Limerick

Substation Development

CLIENT

CONSULTANTS

- NOTES: -
- This drawing is to be read in conjunction with relevant engineering drawings, specifications and reports.
 - Dimensions are in meters, & coordinate system is ITM, unless noted otherwise.
 - Drawings are not to be scaled use figured dimensions only.
 - Drainage shall be provided to ensure that surface water runoff is directed away from the public road.

LEGEND: -

Proposed Access Track	
EirGrid Internal Road - Asphalt Road	
Customer internal Road - Concrete Road	
Compound Stone	
Proposed 220 kV New Infrastructure	
Site Boundary	
Cut Area	
Drain to be infilled	
Final Compound Level Shown thus	
Final Floor Level Shown thus	
Lightning Mast	
Lamp Post	

PROGRESS PRINT

NOT FOR CONSTRUCTION

ISSUE/REVISION		
PO	02.09.2026	Issued for Planning
I/R	DATE	DESCRIPTION

PROJECT NUMBER

300-101309

SHEET TITLE

Substation Layout
Customer Compound
Sheet 1 of 2

SHEET NUMBER

300101309-O-DR-109