



ISO A2 420mm x 594mm

Project Management Initials: Designer: LP Checked: AC Approved: AC

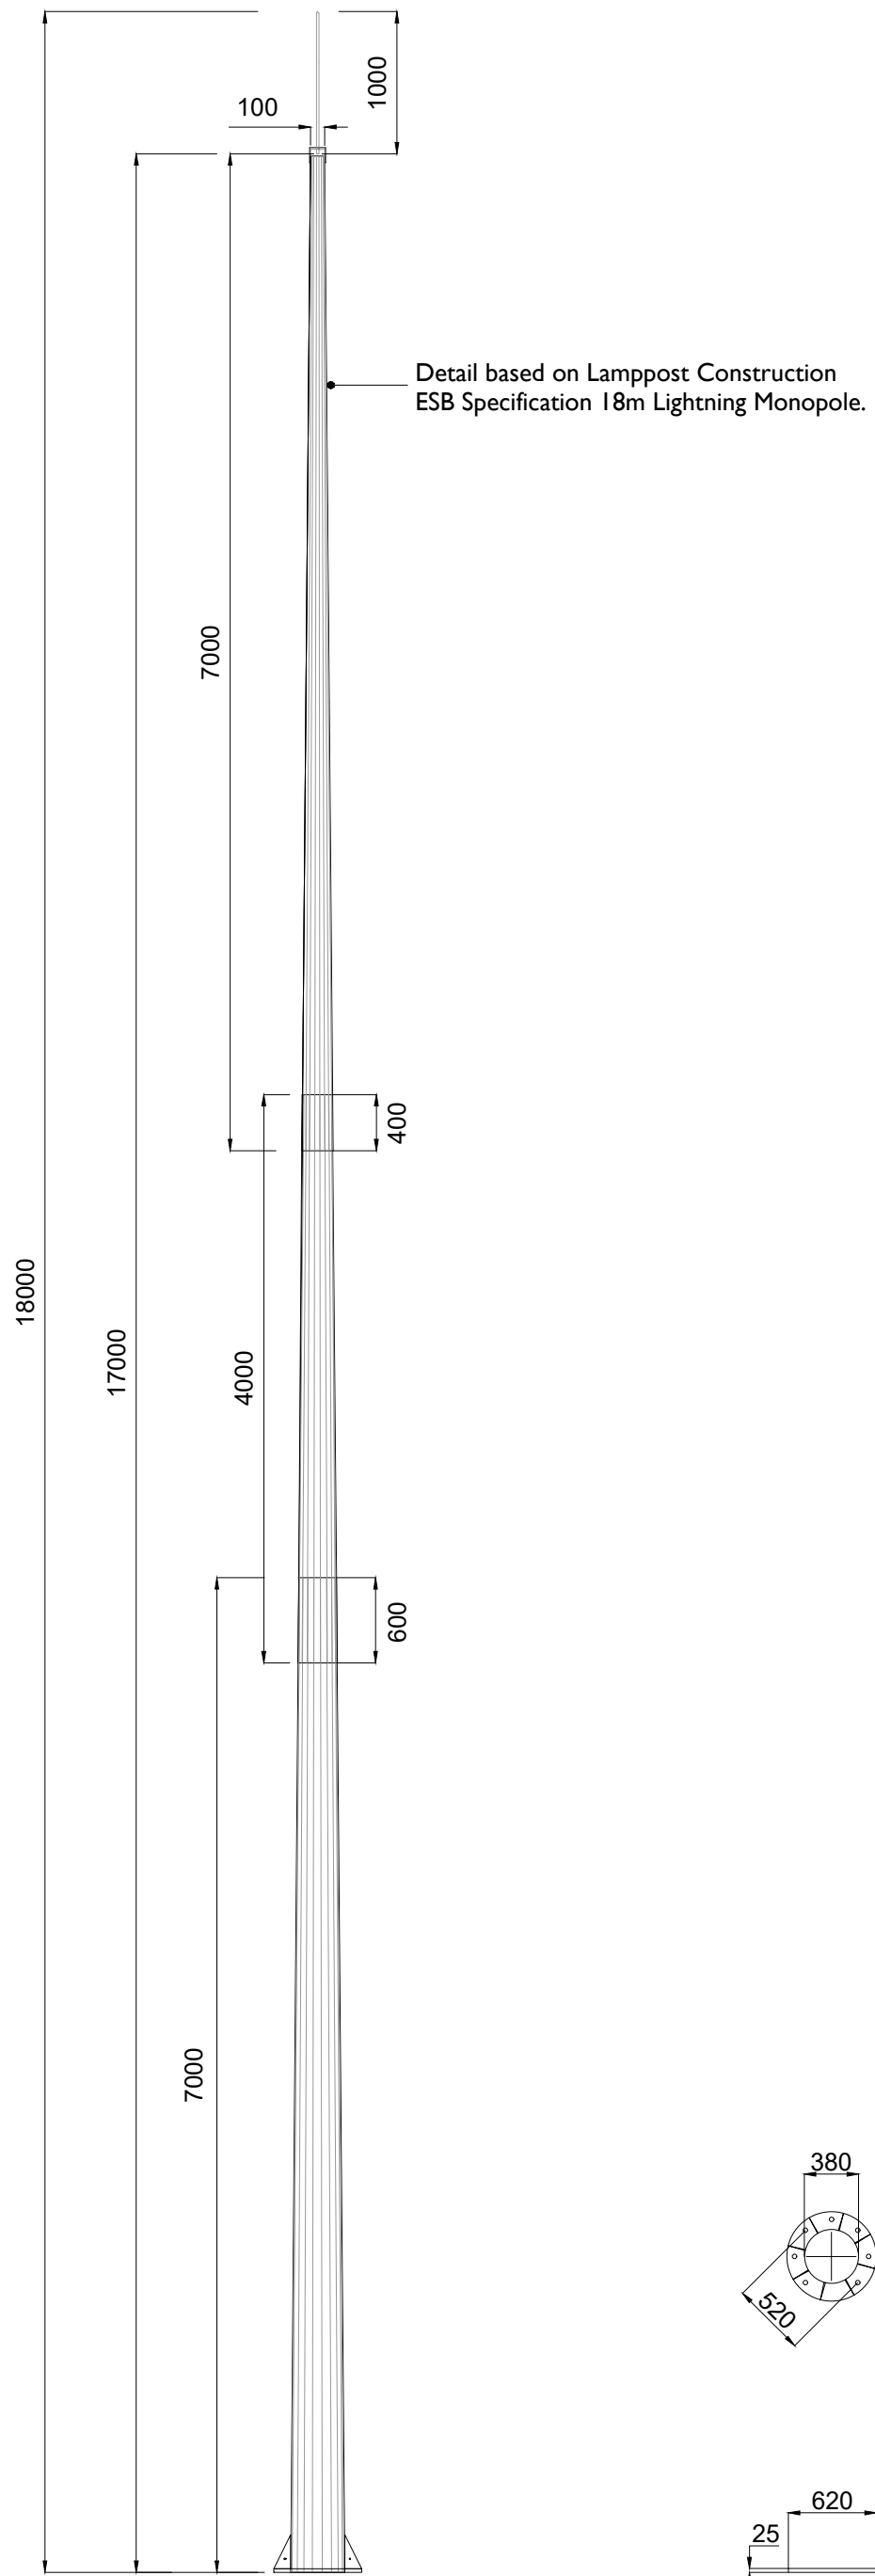


Lightning Mast Elevation and Details

Scale: 1:50

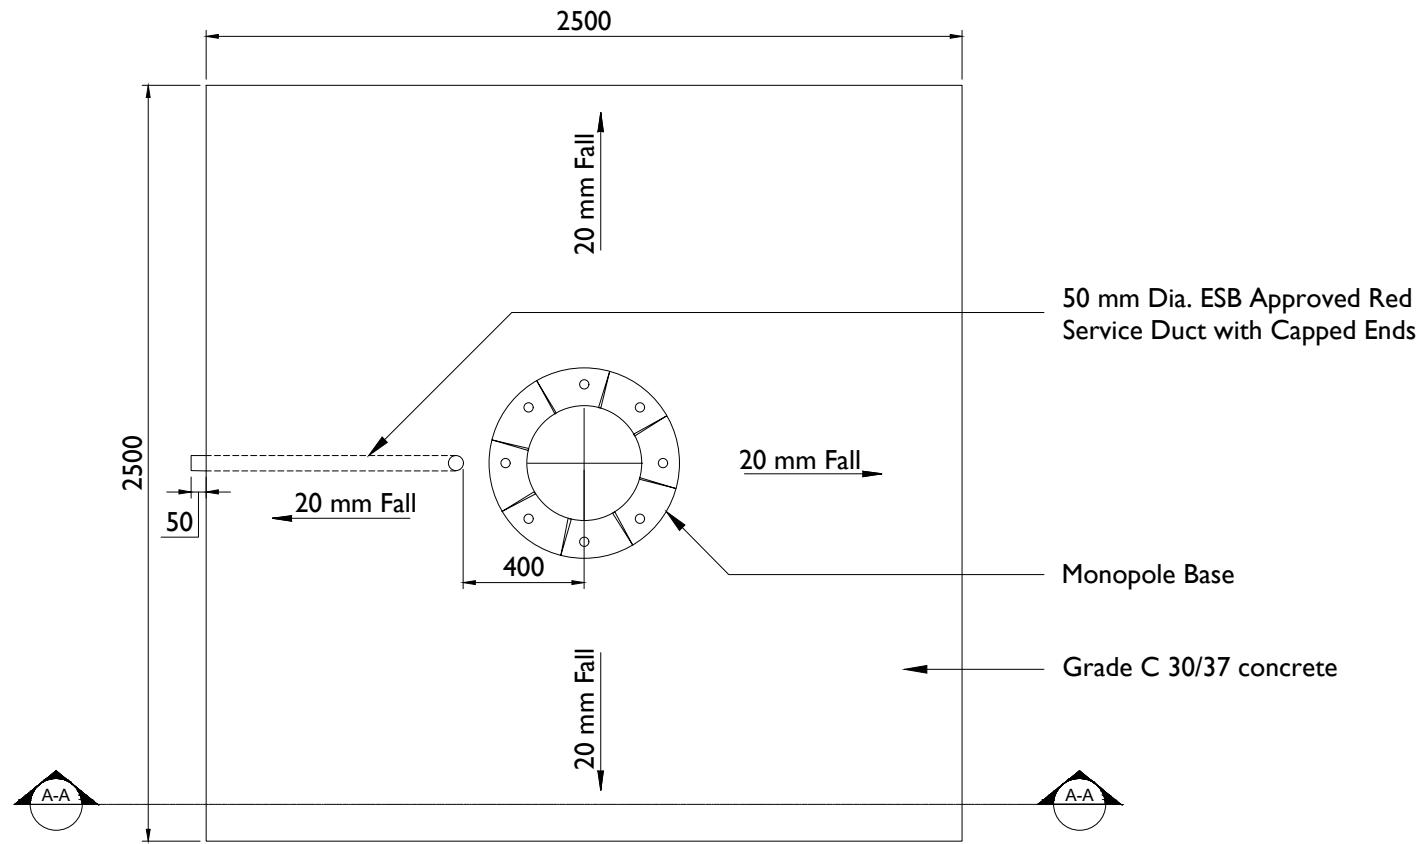


Plan View

Scale: 1:25

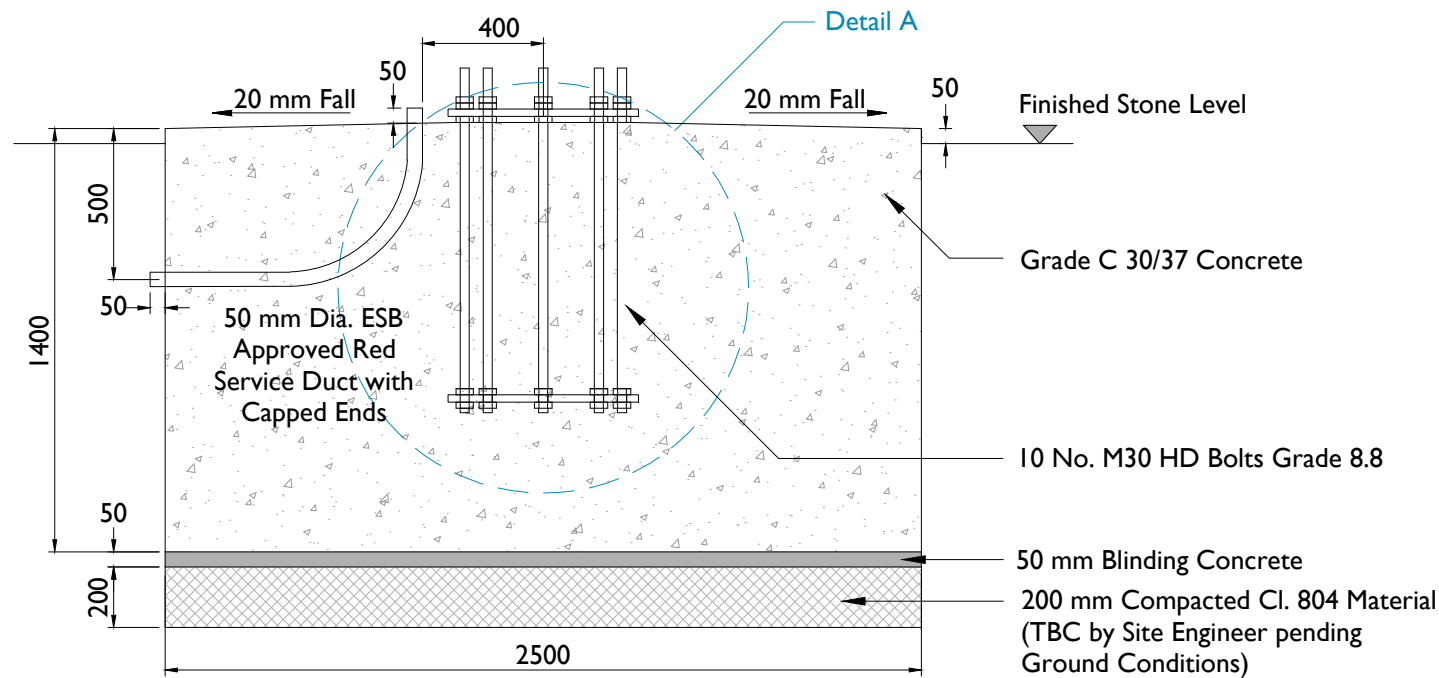


Section A-A : Foundation Detail

Scale: 1:25

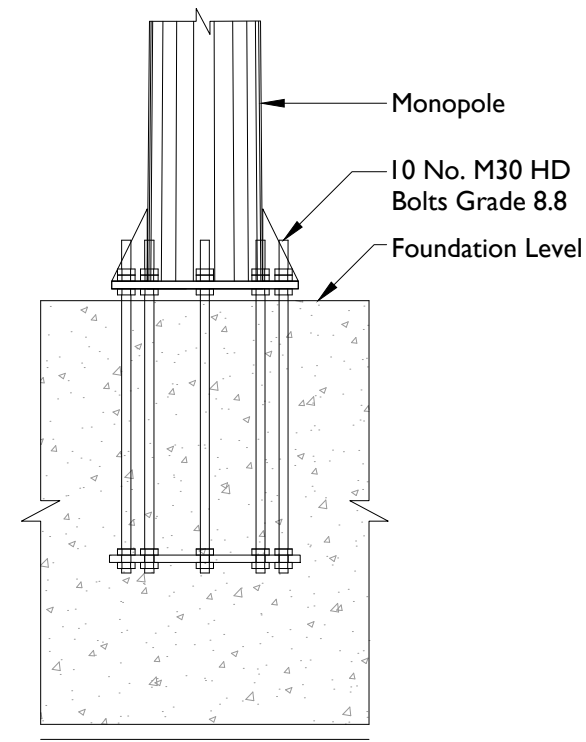

Monopole Base Plate To HBD Connection

Scale: 1:25

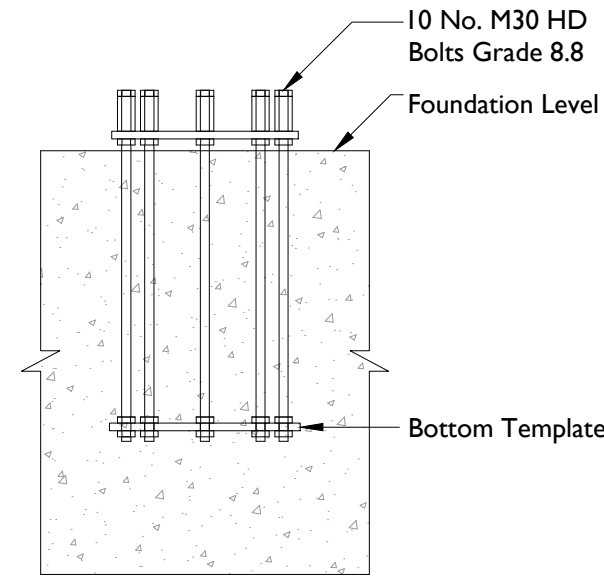

Detail A

Scale: 1:25

- GENERAL NOTES:
1. ALL drawings to be read in conjunction with the Specification and all Engineers and Architects Drawings.
  2. All concrete to be in accordance with I.S. EN 206-1:2002 with the Mix Designs shown in Table 1.
  3. Concrete finishes to be in accordance with Table 6.1 of the ESB Specification CS17-S01-005.
  4. ALL Reinforcement shall be in accordance with BS4449 and scheduled in accordance with BS.8666. 300 mm Laps for A142 Mesh 600 mm Min Laps for A393 Mesh.
  5. Refer always to relevant Earth Grid drawing prior to excavations & concrete pours.
  6. Geometrical tolerances to be in accordance with Table 6.2 of ESB Specification CS17-S01-005
- FOUNDATION NOTES:
7. Ground to have a minimum Bearing Capacity of 100 kN/m<sup>2</sup>.
  8. Formation level and Foundations to be inspected and approved by the Engineer prior to any Concrete being poured.
  9. All Foundations are to be blinding immediately after excavation with 50 mm of C16/20 Concrete Blinding.
  10. Refer always to the relevant Earth Work Drawings prior to Excavations & Concrete pours.

- This drawing is to be read in conjunction with relevant engineering drawings, specifications and reports.
- Dimensions are in millimeters, unless noted otherwise.
- Drawings are not to be scaled use figured dimensions only.

| NO  | DATE       | DESCRIPTION         |
|-----|------------|---------------------|
| P0  | 02.09.2026 | Issued for Planning |
| I/R | DATE       | DESCRIPTION         |