
ISO A1 594mm x 841mm

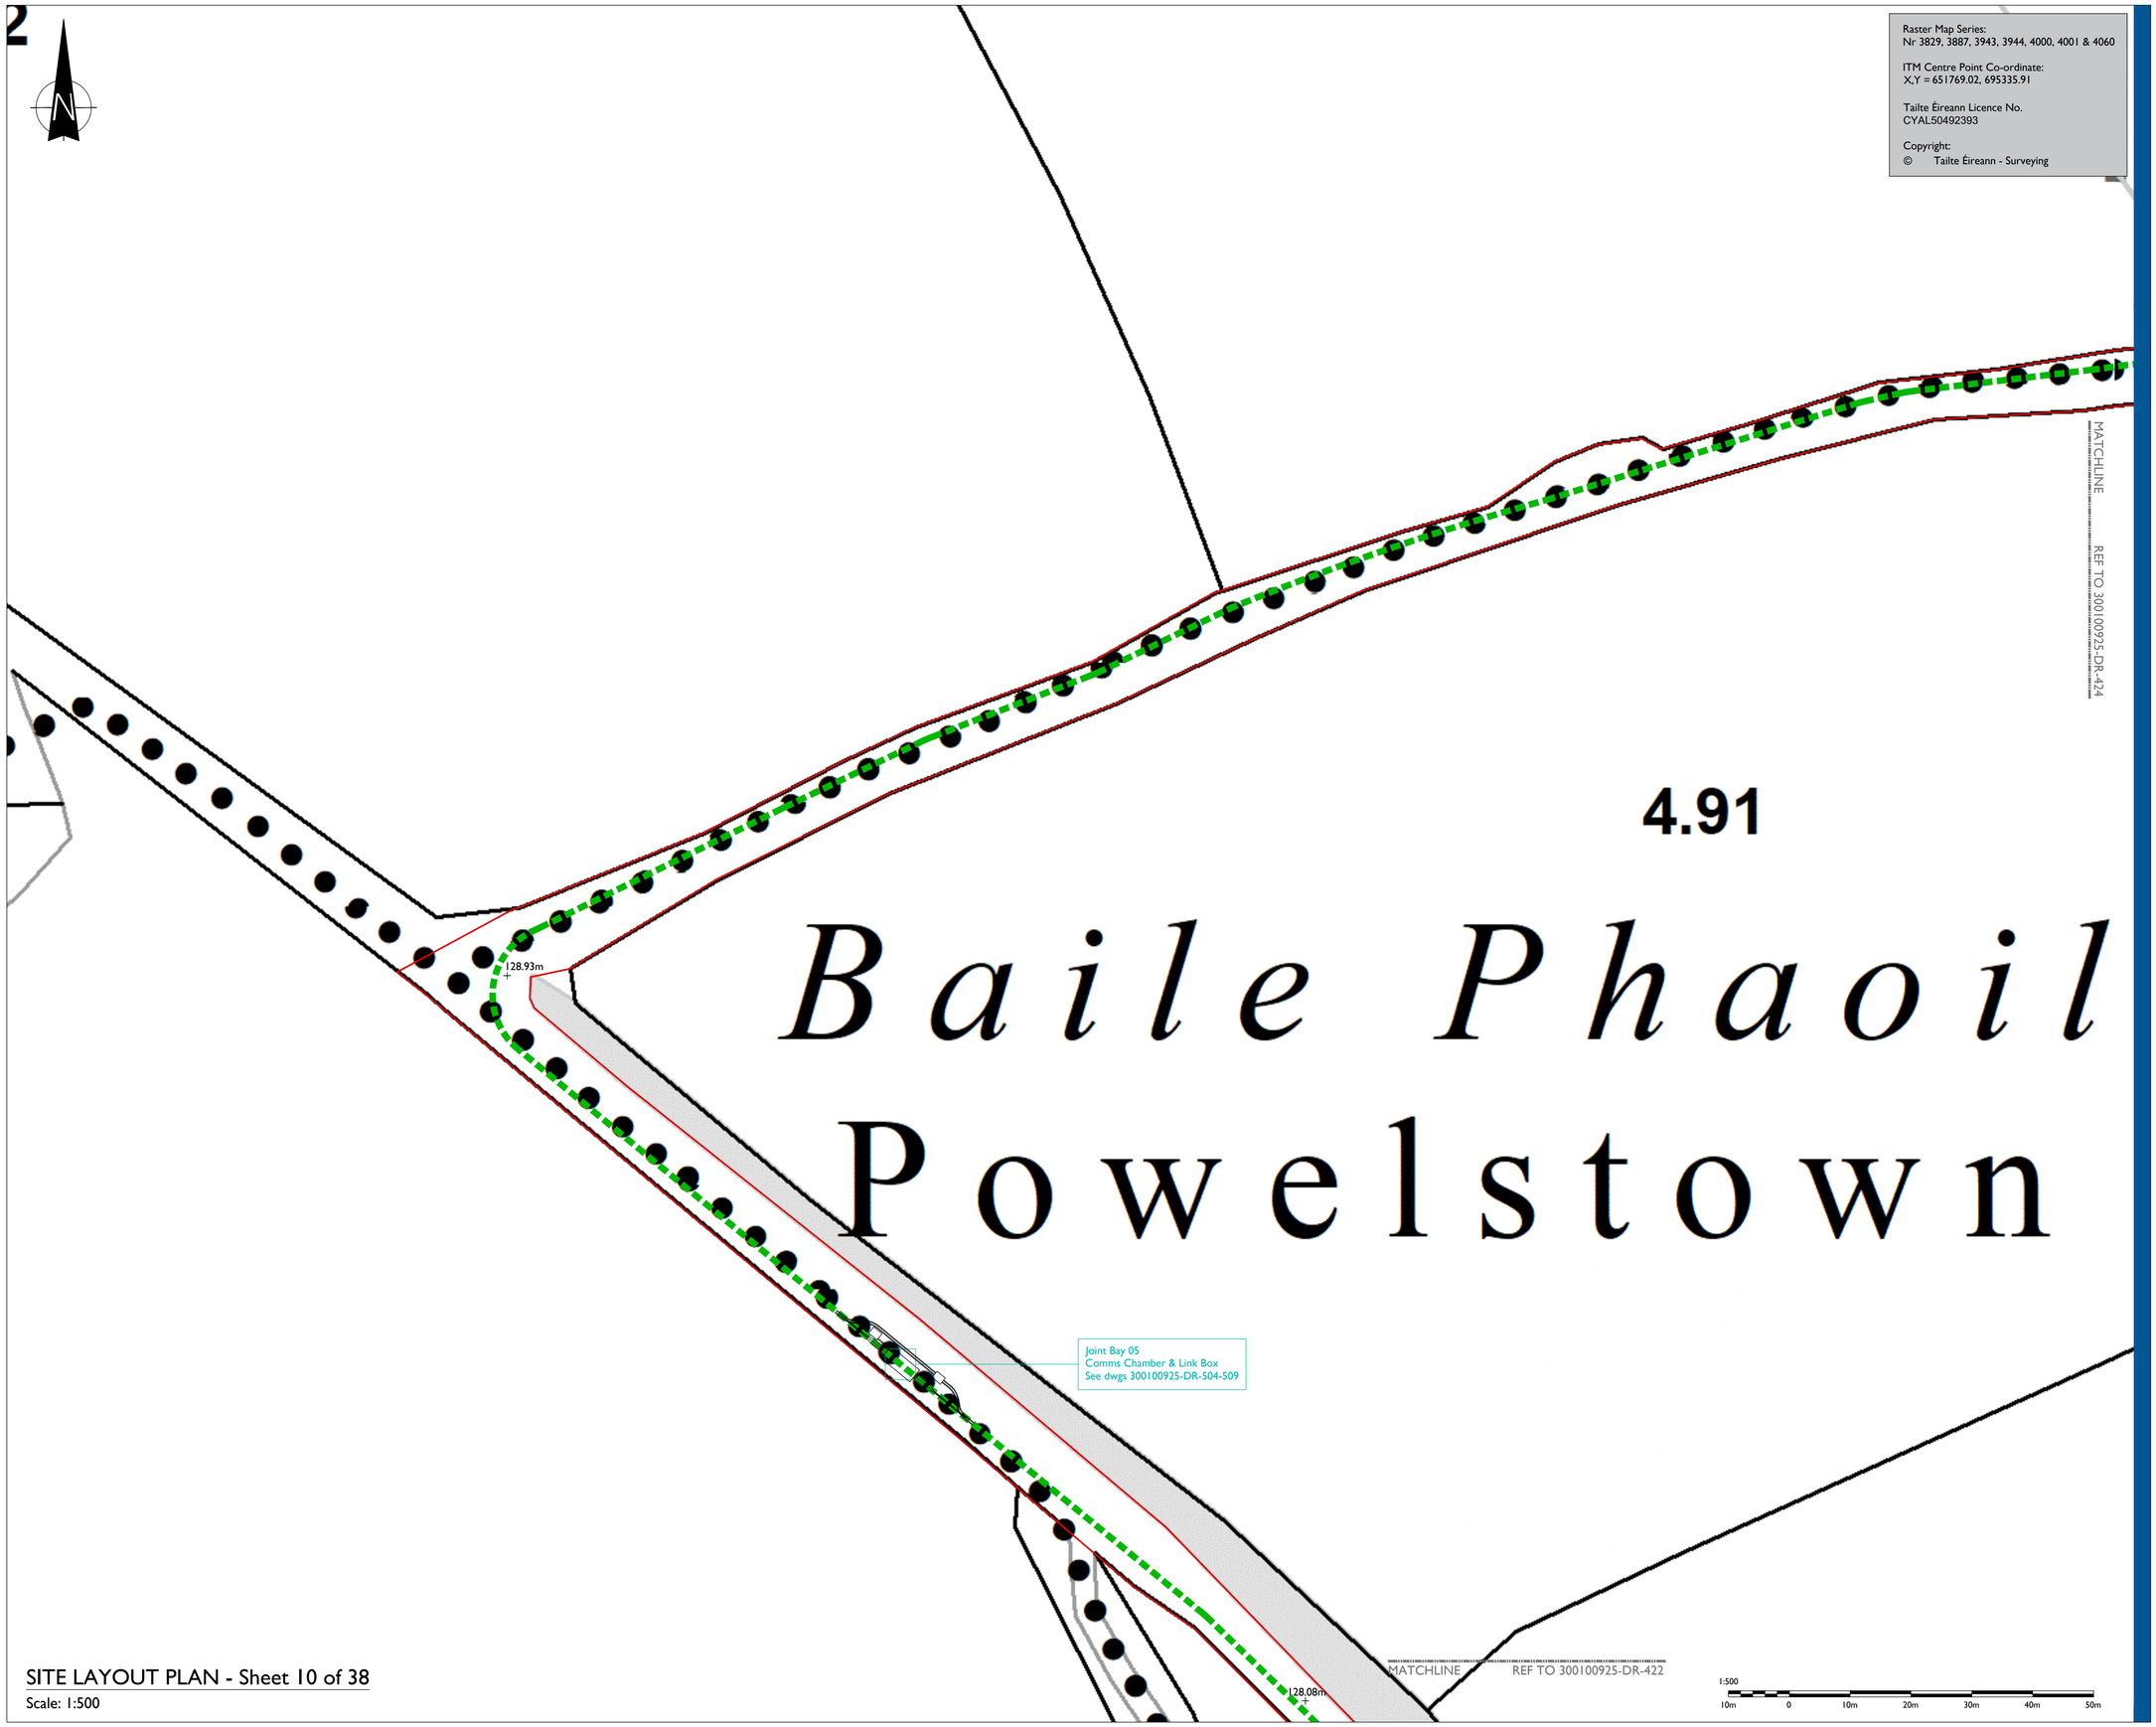

SITE LAYOUT PLAN - Sheet 10 of 38

Scale: 1:500

Project Management Initials: Designer: GD Checked: TOC Approved: KC

tli GROUP

Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

Regional Office
Basepoint Business Centre
Stroudley Road, Basingstoke,
Hampshire,
RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT

Cappakeel Solar Farm 110kV

UGC Grid Connection

CLIENT

Perigus Energy

CONSULTANTS

NOTES: -

- This drawing is to be used only for the purpose of the planning application and is subject to detailed design.
- Position of underground cable and location of joint bays, links boxes and comms chambers may vary depending on site conditions.
- Position of link boxes and comms chambers is to be agreed onsite with EirGrid.
- Additional watercourses and other services may be encountered on the route.
- The property boundaries shown (while an accurate representation) are for information purposes only. Precise digital boundaries will be obtained from PRAI & mapped in advance of any formal Section 53 Wayleave or Deed A/Deed B being served on the landowner.
- Existing Utilities indicated on drawings are those that are crossed over / under by the proposed UG Grid Connection Cable or are those existing Utilities that run parallel to and in the vicinity of the proposed UG Grid Connection Cable.

LEGEND: -

Proposed 110kV UGC Route shown thus

Planning Boundary shown thus

Existing Uisce Éireann shown thus

110kV Joint Bay, Comms Chamber & Link Box shown thus

Spot Heights shown thus 46.52m

ISSUE/REVISION

I/R	DATE	DESCRIPTION
P3	16.06.26	Issued for Planning
P2	20.03.26	Issued for Planning
P1	18.12.25	Issued for Planning

PROJECT NUMBER

300-100925

SHEET TITLE

Site Layout Plan -
Sheet 10 of 38

SHEET NUMBER

300100925-DR-423