
ISO A1 594mm x 841mm

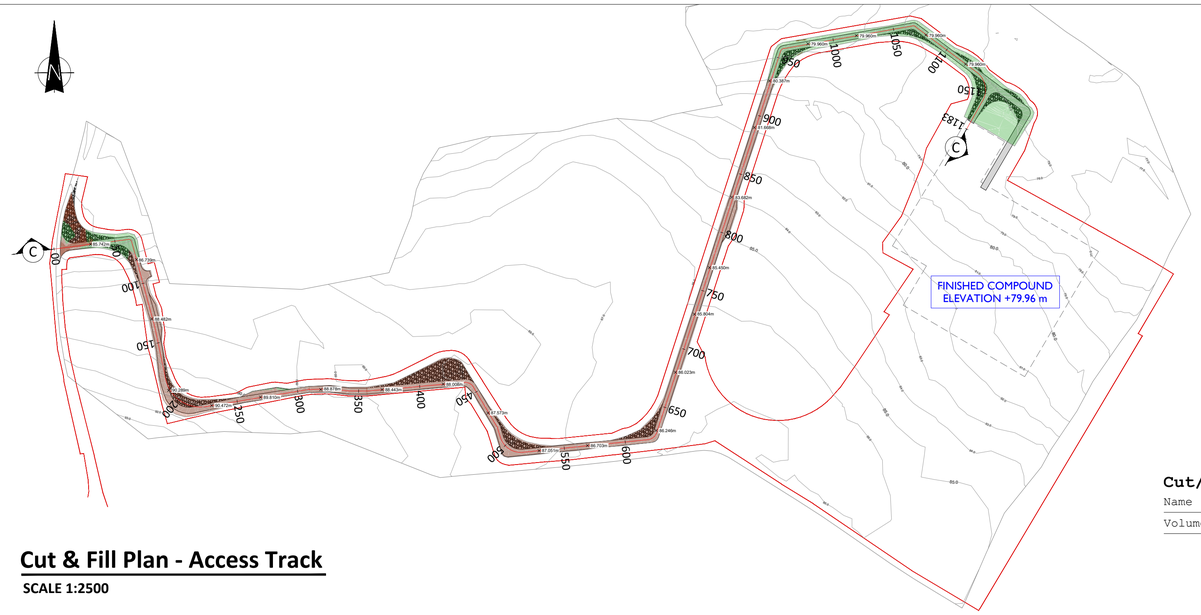



Cut/Fill Summary

Name	Cut Factor	Fill Factor	2D Area	Cut	Fill	Net
Volume Access Track	1.000	1.000	12687.151sq.m	3906.433 Cu. M.	4003.316 Cu. M.	96.883 Cu. M.<Fill>

Cut & Fill Plan - Access Track

SCALE 1:2500

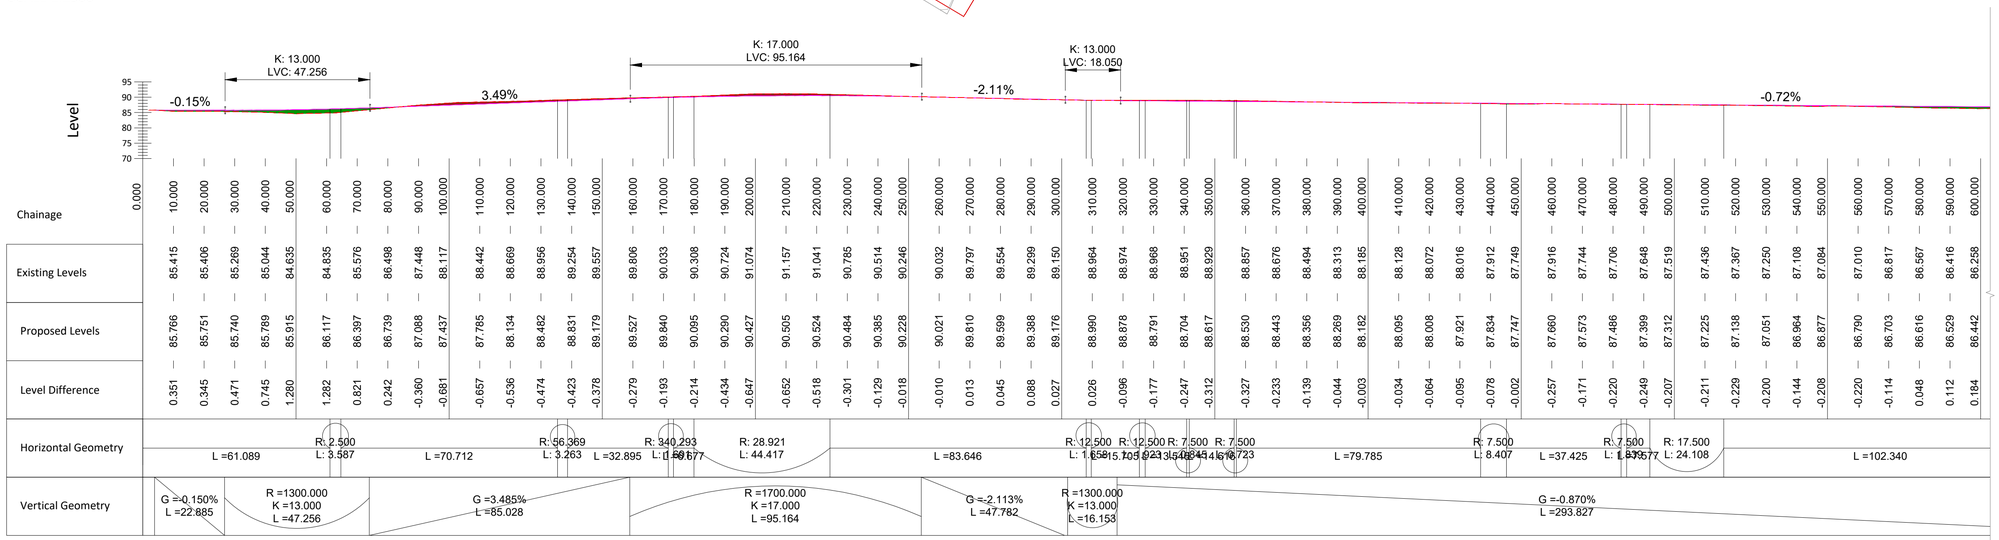

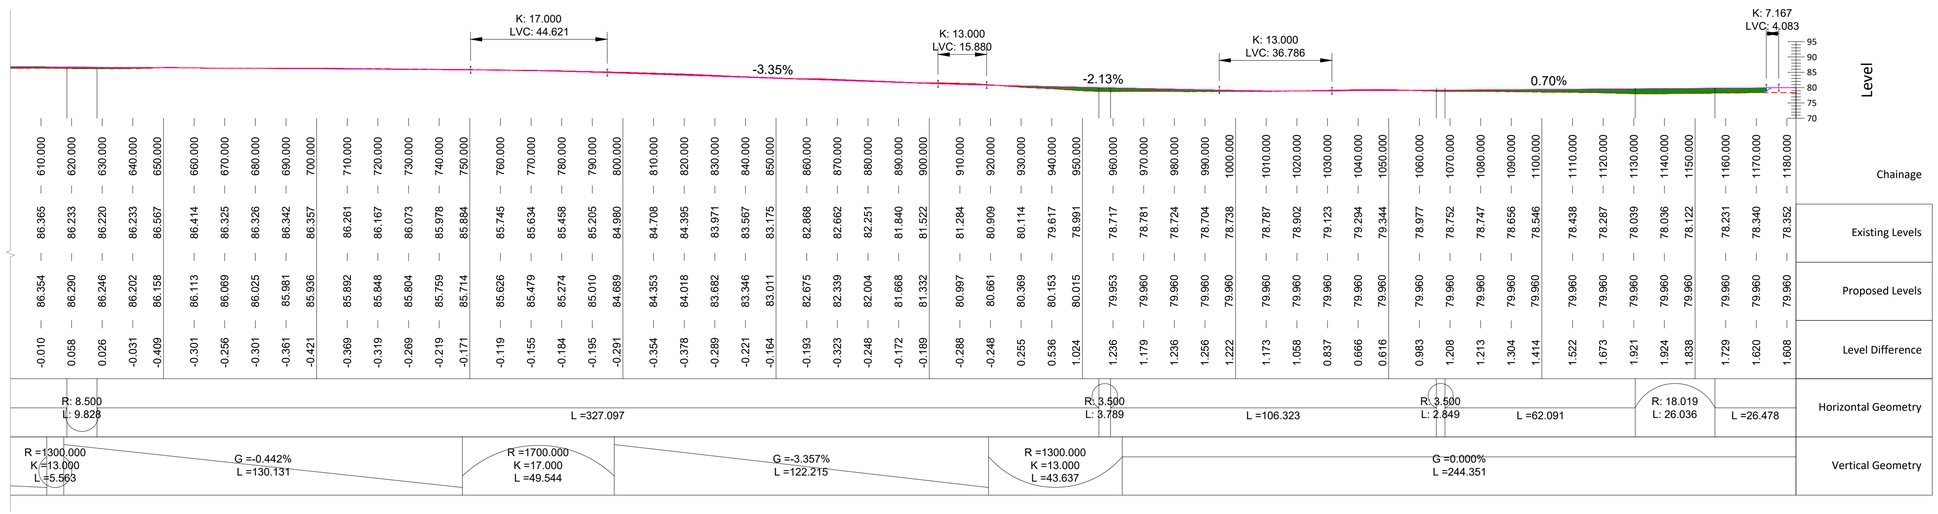

Long Section C - C - Access Track

SCALE 1:1000

Project Management Initials: Designer: LP Checked: BG Approved: AC

tli GROUP

Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

Regional Office
Basepoint Business Centre
Stroudley Road, Basingstoke,
Hampshire,
RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT

Cappakeel Solar Farm

110 kV Substation

CLIENT

Perigus Energy

CONSULTANTS

NOTES: -

Cut & Fill Volumes are approximate for preliminary design only.
Detailed Material Classification & Geotechnical Design to be completed at design phase.
Unless otherwise stated, all elevations are in meters above Malin Head Datum (OD Malin).

Substation Finished Compound Elevation: 79.96m

Cut Volume = 3,906 m³
Fill Volume = 4,003 m³

LEGEND: -

- Cut Area
- Fill Area
- Substation Boundary
- Existing Ground Profile
- Proposed Access Track Profile
- Proposed Red Line Boundary
- Access Road
- Temporary Hardcore Surface

ISSUE/REVISION

I/R	DATE	DESCRIPTION
P1	16.06.26	Issued for Planning
P0	20.03.2026	Issued for Planning

PROJECT NUMBER

300-100925

SHEET TITLE

Cut & Fill Details

SHEET NUMBER

300100925-DR-101B