
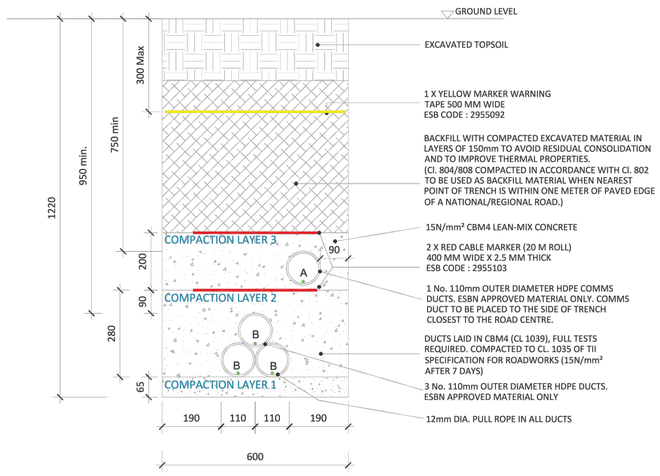


A =110mm:Outer diameter HDPE ESB Approved Duct, SDR=17.6;

B =110mm:Outer diameter HDPE ESB Approved Duct, SDR=17.6;


TYPICAL SECTION THROUGH OFF ROAD / GRASSLAND

Scale 1:10

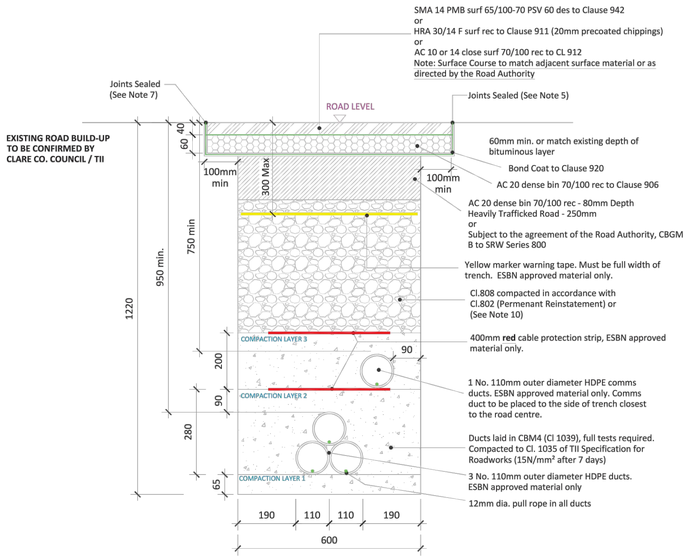

TYPICAL SECTION THROUGH CABLE TRENCH IN PUBLIC ROADS

Scale 1:10

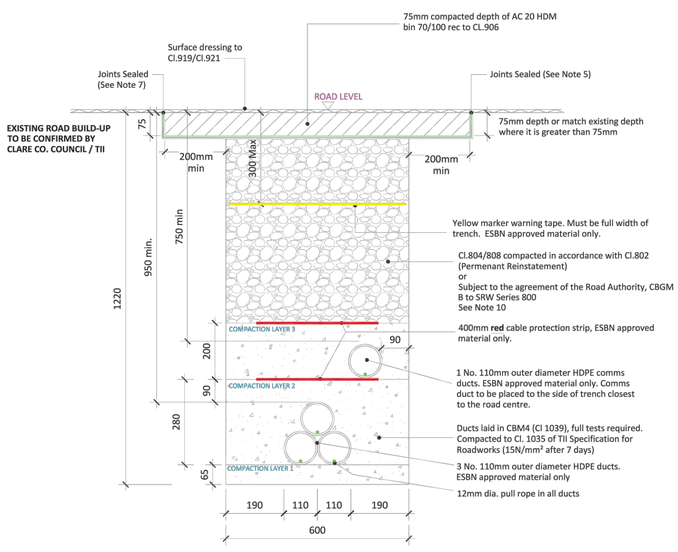

TYPICAL SECTION THROUGH CABLE TRENCH IN UNBOUND ROADS

Scale 1:10

If Applicable : Ordnance Survey Ireland Licence No. CYAL50368274 © Ordnance Survey Ireland and Government of Ireland
OSI-3771,3772,3773,3829,3830,3831,3887,3888,3889

FEHILY TIMONEY

Cork | Dublin | Carlow

www.fehilytimoney.ie

No part of this document may be reproduced or transmitted in any form or stored in any retrieval system of any nature without the written permission of Fehily Timoney & Company as copyright holder except as agreed for use on the project for which the document was originally issued. Do not scale. Use figured dimensions only. If in doubt - Ask!

Rev.	Description	App By	Date
A	ISSUE FOR PLANNING	JH	15.04.24

PROJECT
CAPPAKEEL SOLAR FARM

CLIENT
PERIGUS ENERGY IRELAND MIDCO LIMITED

SHEET
CABLE TRENCE TYPICAL DETAILS

Date 15.04.24	Project number P23-226	Scale (@ A1-) As Shown
Drawn by CS	Drawing Number P23-226-0700-0001	Rev A
Checked by JOD		

O:\ACAD\2023\P23-226\P23-226-0700-0001

1 July 2026