

ISO A1 594mm x 841mm

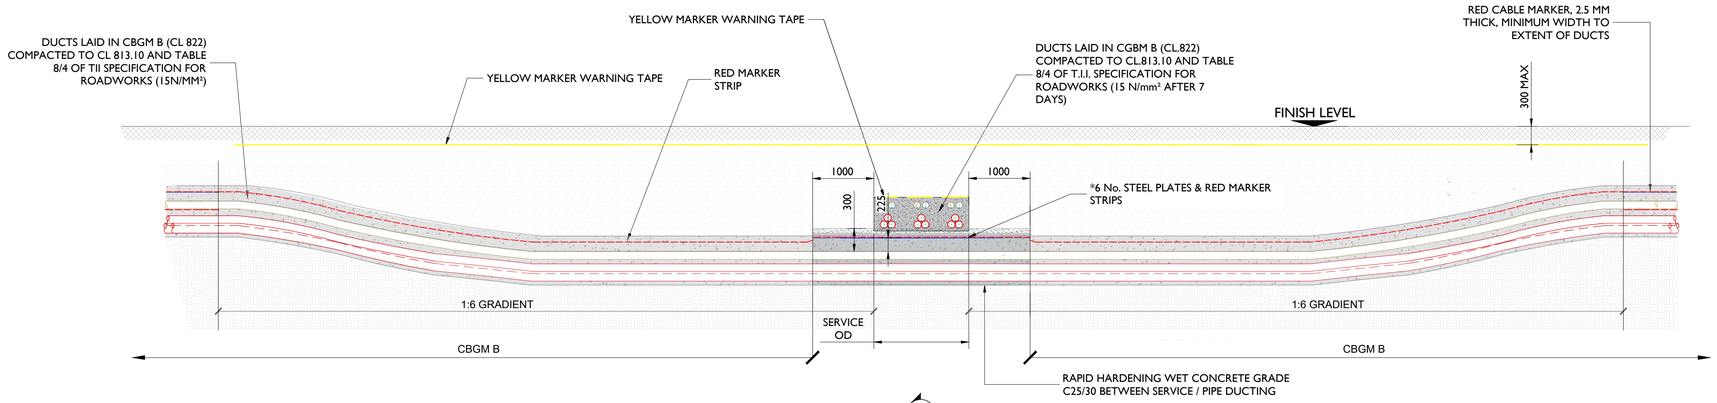

SECTION A-A

SCALE: 1:50

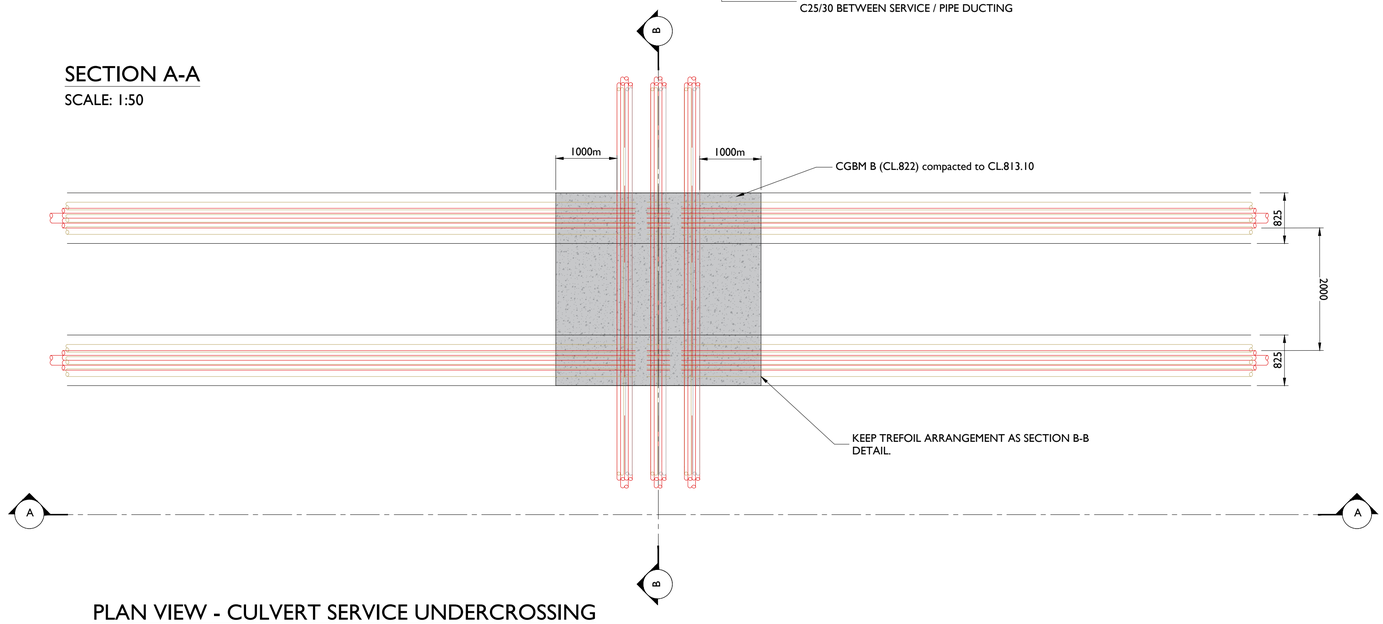

PLAN VIEW - CULVERT SERVICE UNDERCROSSING


SCALE: 1:50

GENERAL NOTES:

1. THIS DRAWING IS SUBJECT TO DESIGN APPROVAL AND IS NOT TO BE USED FOR CONSTRUCTION.
2. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DOCUMENTATION.
3. DO NOT SCALE FROM THIS DRAWING USE ONLY PRINTED DIMENSIONS
4. ALL DIMENSIONS ARE IN MILLIMETRES, ALL CHAINAGES, LEVELS AND CO-ORDINATES ARE IN METRES UNLESS DEFINED OTHERWISE.
5. NO EXCAVATION SHALL COMMENCE UNTIL THE CONTRACTOR HAS CONSULTED UP TO DATE SERVICES DRAWINGS AND CARRIED OUT AN ELECTROMAGNETIC LOCATOR (EML) SCAN.
6. HAND DIG ONLY WITHIN 500MM OF EXISTING SERVICES.
7. IF COMPACTING CBGM B COULD CAUSE DAMAGE TO THE CULVERT / SERVICE BELOW, USE RAPID HARDENING CEMENT GRADE C25/30 FOLLOWING ENGINEERS PRIOR APPROVAL.
8. FOR STANDARD TRENCH CROSS SECTION DRAWINGS AND MINIMUM HORIZONTAL SEPARATION TO EXISTING SERVICES, SEE 300101121-U-DR-151 (TREFOIL)
9. WHERE DEPTHS EXCEED 2500MM TO THE TOP OF DUCT THE CONTRACTOR SHALL CONSULT THE CABLE SYSTEM DESIGN ENGINEER FOR PHASE SPACING REQUIREMENTS.
10. BACKFILL AS PER GUIDELINES FOR THE OPENING, BACKFILLING AND REINSTATEMENT OF OPENINGS IN PUBLIC ROADS (2015).
11. ESB'S PREFERENCE IS TO CROSS UNDER EXISTING SERVICES WHERE POSSIBLE.
12. BACKFILL AS PER GUIDELINES FOR THE OPENING, BACKFILLING AND REINSTATEMENT OF OPENINGS IN PUBLIC ROADS (2015)
13. THE CONTRACTOR IS RESPONSIBLE FOR THE DESIGN AND CONSTRUCTION OF ALL TEMPORARY WORKS. THE CONTRACTOR SHALL APPOINT A TEMPORARY WORKS DESIGNER, AND SUBMIT TEMPORARY WORKS DESIGN TO PSDP FOR REVIEW.
14. 225MM MINIMUM CONCRETE OVER DUCTS WHERE THEY TRANSITION FROM STANDARD CROSS SECTION AND WHERE THEY ARE AT LESS THAN STANDARD COVER TO GROUND LEVEL.
15. REPLACE EXISTING SERVICE MARKER TAPE OVER YELLOW MARKER TAPE.
16. THE OWNER OF THE EXISTING UTILITY BEING CROSSED MUST BE CONSULTED IN ADVANCE OF WORKS COMMENCING AS PER THEIR GUIDELINES.
17. THE CONTRACTOR SHALL RECORD DETAILED AS-BUILT INFORMATION AS PER THE SPECIFICATION. AT ALL CROSSING LOCATIONS THESE RECORDS SHALL INCLUDE PHOTOGRAPHIC EVIDENCE CLEARLY DEMONSTRATING THAT MINIMUM SERVICE CLEARANCES AND DUCT SEPARATIONS HAVE BEEN ACHIEVED.
18. WHERE DUCT FOR EARTH CONTINUITY CONDUCTOR (ECC) IS REQUIRED FOR SINGLE POINT BONDED SECTIONS, ATTACH THE 125MM ECC DUCT TO THE A DUCT AND UPDATE THE TRENCH WIDTH ACCORDINGLY.

SECTION B-B

SCALE: 1:20

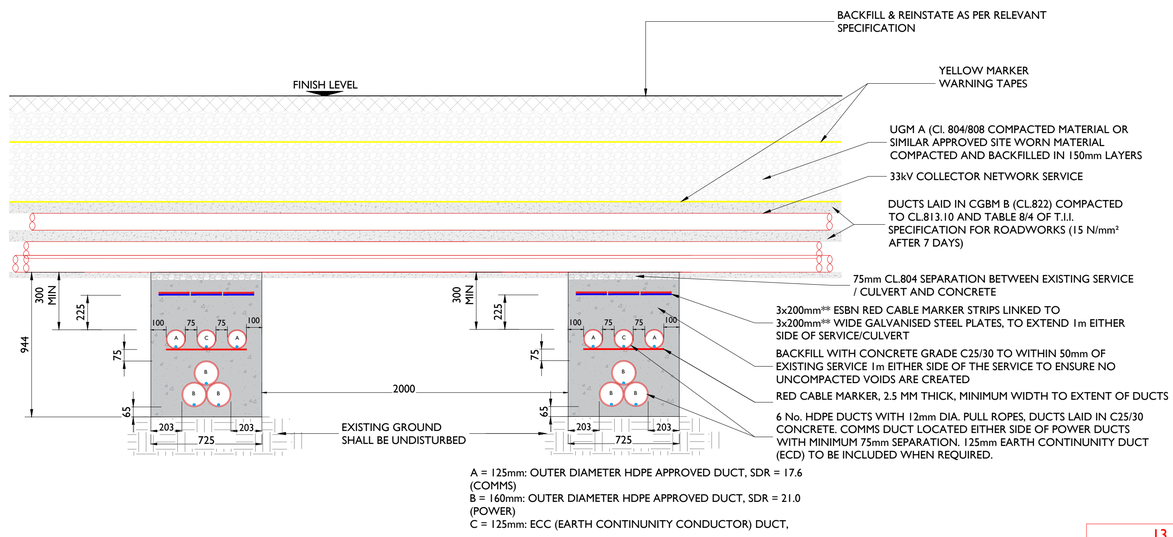

A = 125mm: OUTER DIAMETER HDPE APPROVED DUCT, SDR = 17.6 (COMMS)
B = 160mm: OUTER DIAMETER HDPE APPROVED DUCT, SDR = 21.0 (POWER)
C = 125mm: ECC (EARTH CONTINUNITY CONDUCTOR) DUCT,

13.10.2026
ISSUED FOR PLANNING

Project Management Initials: Designer: AR Checked: POS Approved: DB

tli GROUP

Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

PROJECT

Rooaunalaghta Green Energy Project

CLIENT

ROOAUNALAGHTA Green Energy

CONSULTANTS

TOBIN CONSULTING ENGINEERS

NOTES: -

- This drawing is to be read in conjunction with relevant engineering drawings, specifications and reports.
- Dimensions are in millimeters, & coordinate system is ITM, unless noted otherwise.
- Drawings are not to be scaled use figured dimensions only.

LEGEND: -

- 160mm Ø HDPE POWER DUCT WITH 12mm DIAMTER PULL ROPE
- 125mm Ø HDPE COMMUNICATION DUCT WITH 12mm DIAMTER PULL ROPE
- 63mm Ø HDPE EARTH CONTINUITY CONDUCTOR WITH12mm DIAMTER PULL ROPE
- RED MARKER STRIP OR STEEL PLATES
- YELLOW MARKER WARNING TAPE
- 6mm GALVANISED STEEL PLATE
- EXISTING SERVICE TAPE

ISSUE/REVISION

P0	13.10.26	Issued for Planning
N0	26.08.26	Issued for Information
I/R	DATE	DESCRIPTION

PROJECT NUMBER

300101121

SHEET TITLE

Double Trench Section - Undercrossing 33kV Network Service

SHEET NUMBER

300101121-U-DR-154