
Project Management Initials: Designer: KM Checked: SG Approved: LS

LEGEND

- PROPOSED SITE BOUNDARY.....
- PROPOSED HDPE WATERMAIN.....
- PROPOSED PRIVATE WATERMAIN CONNECTION.....
- EXISTING WATERMAIN.....
- EXISTING FIRE HYDRANT.....
- PROPOSED SLUICE VALVE.....
- PROPOSED FIRE HYDRANT WITH 6m BUILDING CLEARANCE AND 46m HYDRANT COVERAGE..
- PROPOSED SCOUR VALVE.....
- PROPOSED AIR VALVE.....
- PROPOSED BULK METER.....

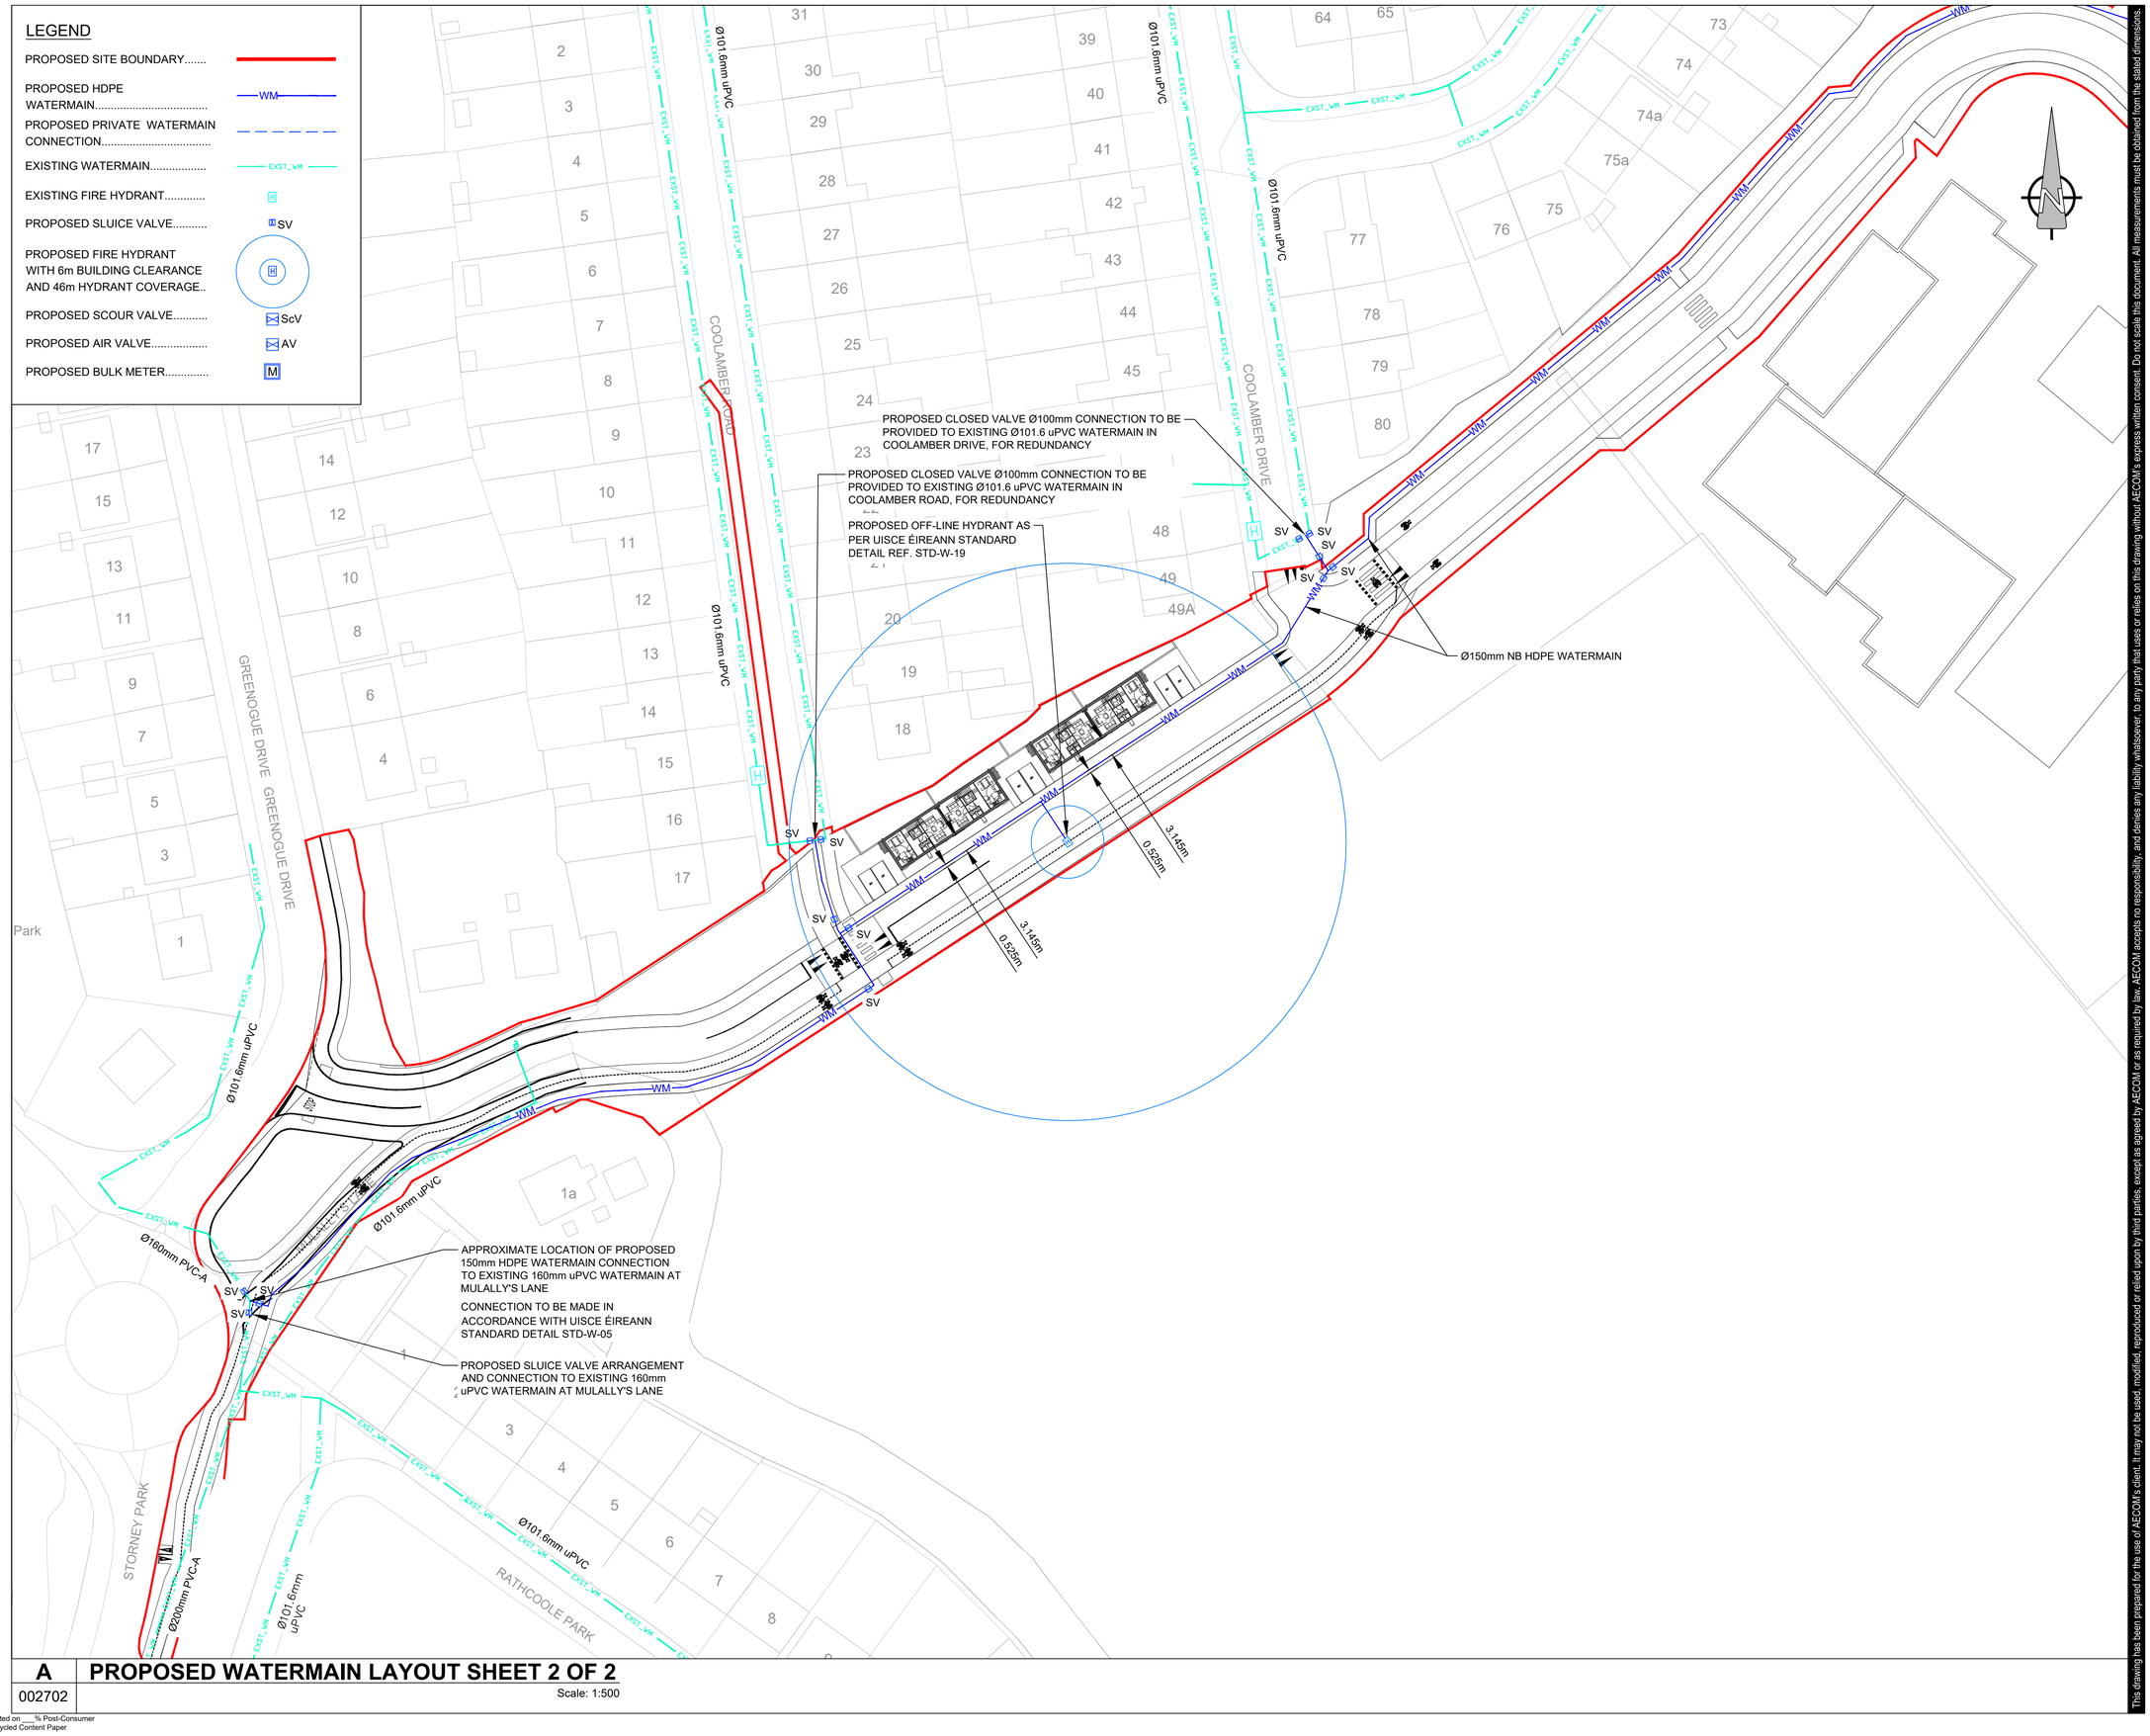

A PROPOSED WATERMAIN LAYOUT SHEET 2 OF 2

002702 Scale: 1:500

Last saved by: STUART.WILLIAMS(2026-10-05) Last Plotted: 2026-10-05
Filename: C:\USERS\KARL.MULLIGAN\ONEDRIVE - AECOM\SDCC RATH - GENERAL\900_CAD_GIS\904_CE\01_WIP\02_SHEETS\RATH-ACM-XX-00-DR-C-002702 - PROPOSED WATERMAIN LAYOUT SHEET 2 OF 2.DWG

Printed on ___% Post-Consumer Recycled Content Paper

AECOM

PROJECT

SDCC RATHCOOLE

CLIENT

SOUTH DUBLIN COUNTY COUNCIL

CONSULTANT


AECOM
ONE BURLINGTON PLAZA,
BURLINGTON ROAD,
DUBLIN 4, D04 RH96, IRELAND
Tel: +353 (0)1 238 3100
Fax: +353 (0)1 238 3199
www.aecom.com

NOTES

1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT ARCHITECTURAL AND ENGINEERING DRAWINGS, ANY DISCREPANCIES, ERRORS OR OMISSIONS TO BE BROUGHT TO THE ATTENTION OF THE DESIGNER.
2. ALL DIMENSIONS TO BE CHECKED BY THE CONTRACTOR ON SITE PRIOR TO COMMENCEMENT OF WORKS.
3. AECOM LIMITED TO BE INFORMED BY THE CONTRACTOR OF ANY DISCREPANCIES PRIOR TO THE COMMENCEMENT OF WORKS ON SITE.
4. DIMENSIONS OF ALL BOUNDARIES AND ADJOINING ROADS TO BE CHECKED ON SITE PRIOR TO COMMENCEMENT OF WORKS.
5. DO NOT SCALE, ALL MEASUREMENTS AND COORDINATES TO BE CHECKED ON SITE.
6. THE DEVELOPMENT SHALL HAVE A BULK WATER METER (EXACT LOCATION TO BE AGREED WITH UISCE ÉIREANN) IN ACCORDANCE WITH UISCE ÉIREANN CODE OF PRACTICE SECTION 3.15.4.
7. EACH HOUSE UNIT SHALL HAVE AN APPROVAL BOUNDARY BOX (REFER TO APPENDIX A OF THE UISCE ÉIREANN CODE OF PRACTICE FOR WATER INFRASTRUCTURE) WITH INTEGRAL STOPCOCK AND SUITABLE FOR THE RECEPTION OF A WATER METER (REFER TO UISCE ÉIREANN CODE OF PRACTICE FOR WATER INFRASTRUCTURE SECTION 3.14).
8. ALL PROPERTIES SHALL HAVE METERS INSTALLED INTERNALLY WITHIN THE PREMISES IN ACCORDANCE WITH THE BUILDING CONTROL AUTHORITY'S REQUIREMENTS AND SUBJECT TO REVIEW BY UISCE ÉIREANN AS PER UISCE ÉIREANN CODE OF PRACTICE FOR WATER INFRASTRUCTURE SECTION 3.15.2.
9. ALL PROPOSED WATERMAIN PIPEWORK TO BE HDPE WITH MINIMUM PE80 RATING IN ACCORDANCE WITH UISCE ÉIREANN CODE OF PRACTICE FOR WATER INFRASTRUCTURE.
10. THE MINIMUM PIPE DIAMETER PROPOSED IS 100mm.
11. ALL WATERMAINS WILL HAVE A MINIMUM COVER OF 900mm. ALL SERVICE PIPES CONNECTING PROPERTIES WILL HAVE MINIMUM COVER OF 750mm.
12. HYDRANTS SHALL BE DOUBLE FLANGED DRILLED TO PN16 AND SHALL COMPLY WITH BS EN 14339, IS EN 1074 PART 6 AND 135 750. REFER TO UISCE ÉIREANN CODE OF PRACTICE FOR WATER INFRASTRUCTURE SECTION 3.16.5.
13. SLUICE VALVES HAVE BEEN PROVIDED SO THAT INDIVIDUAL SECTIONS CAN BE ISOLATED & WILL COMPLY TO BS 5163. THE DEPTH OF THE SLUICE VALVE SPINDLE CAP BELOW FINISHED GROUND WILL NOT EXCEED 300mm.
14. ALL WATERMAIN DETAILS TO BE IN ACCORDANCE WITH THE UISCE ÉIREANN INFRASTRUCTURE STANDARD DETAILS AND CODE OF PRACTICE FOR WATER INFRASTRUCTURE.
15. PROPOSED COMMERCIAL UNITS TO BE SERVED BY A PRIVATE SERVICE CONNECTION AND BULK FLOW METER IN ACCORDANCE WITH STD-W-26 AND SECTION 3.15.3 OF THE UISCE ÉIREANN CODE OF PRACTICE.

AECOM
PLANNING

KEY PLAN



ISSUE/REVISION

I/R	DATE	DESCRIPTION
1	09.10.2026	PLANNING ISSUE
0	07.08.2026	PLANNING ISSUE

PROJECT NUMBER

60739527

SHEET TITLE

PROPOSED WATERMAIN LAYOUT SHEET 2 OF 2

SHEET NUMBER

RATH-ACM-XX-00-DR-C-002702

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.