



199000 200000 201000 202000 203000 204000 205000 206000 207000 208000 209000 210000 211000 212000 213000

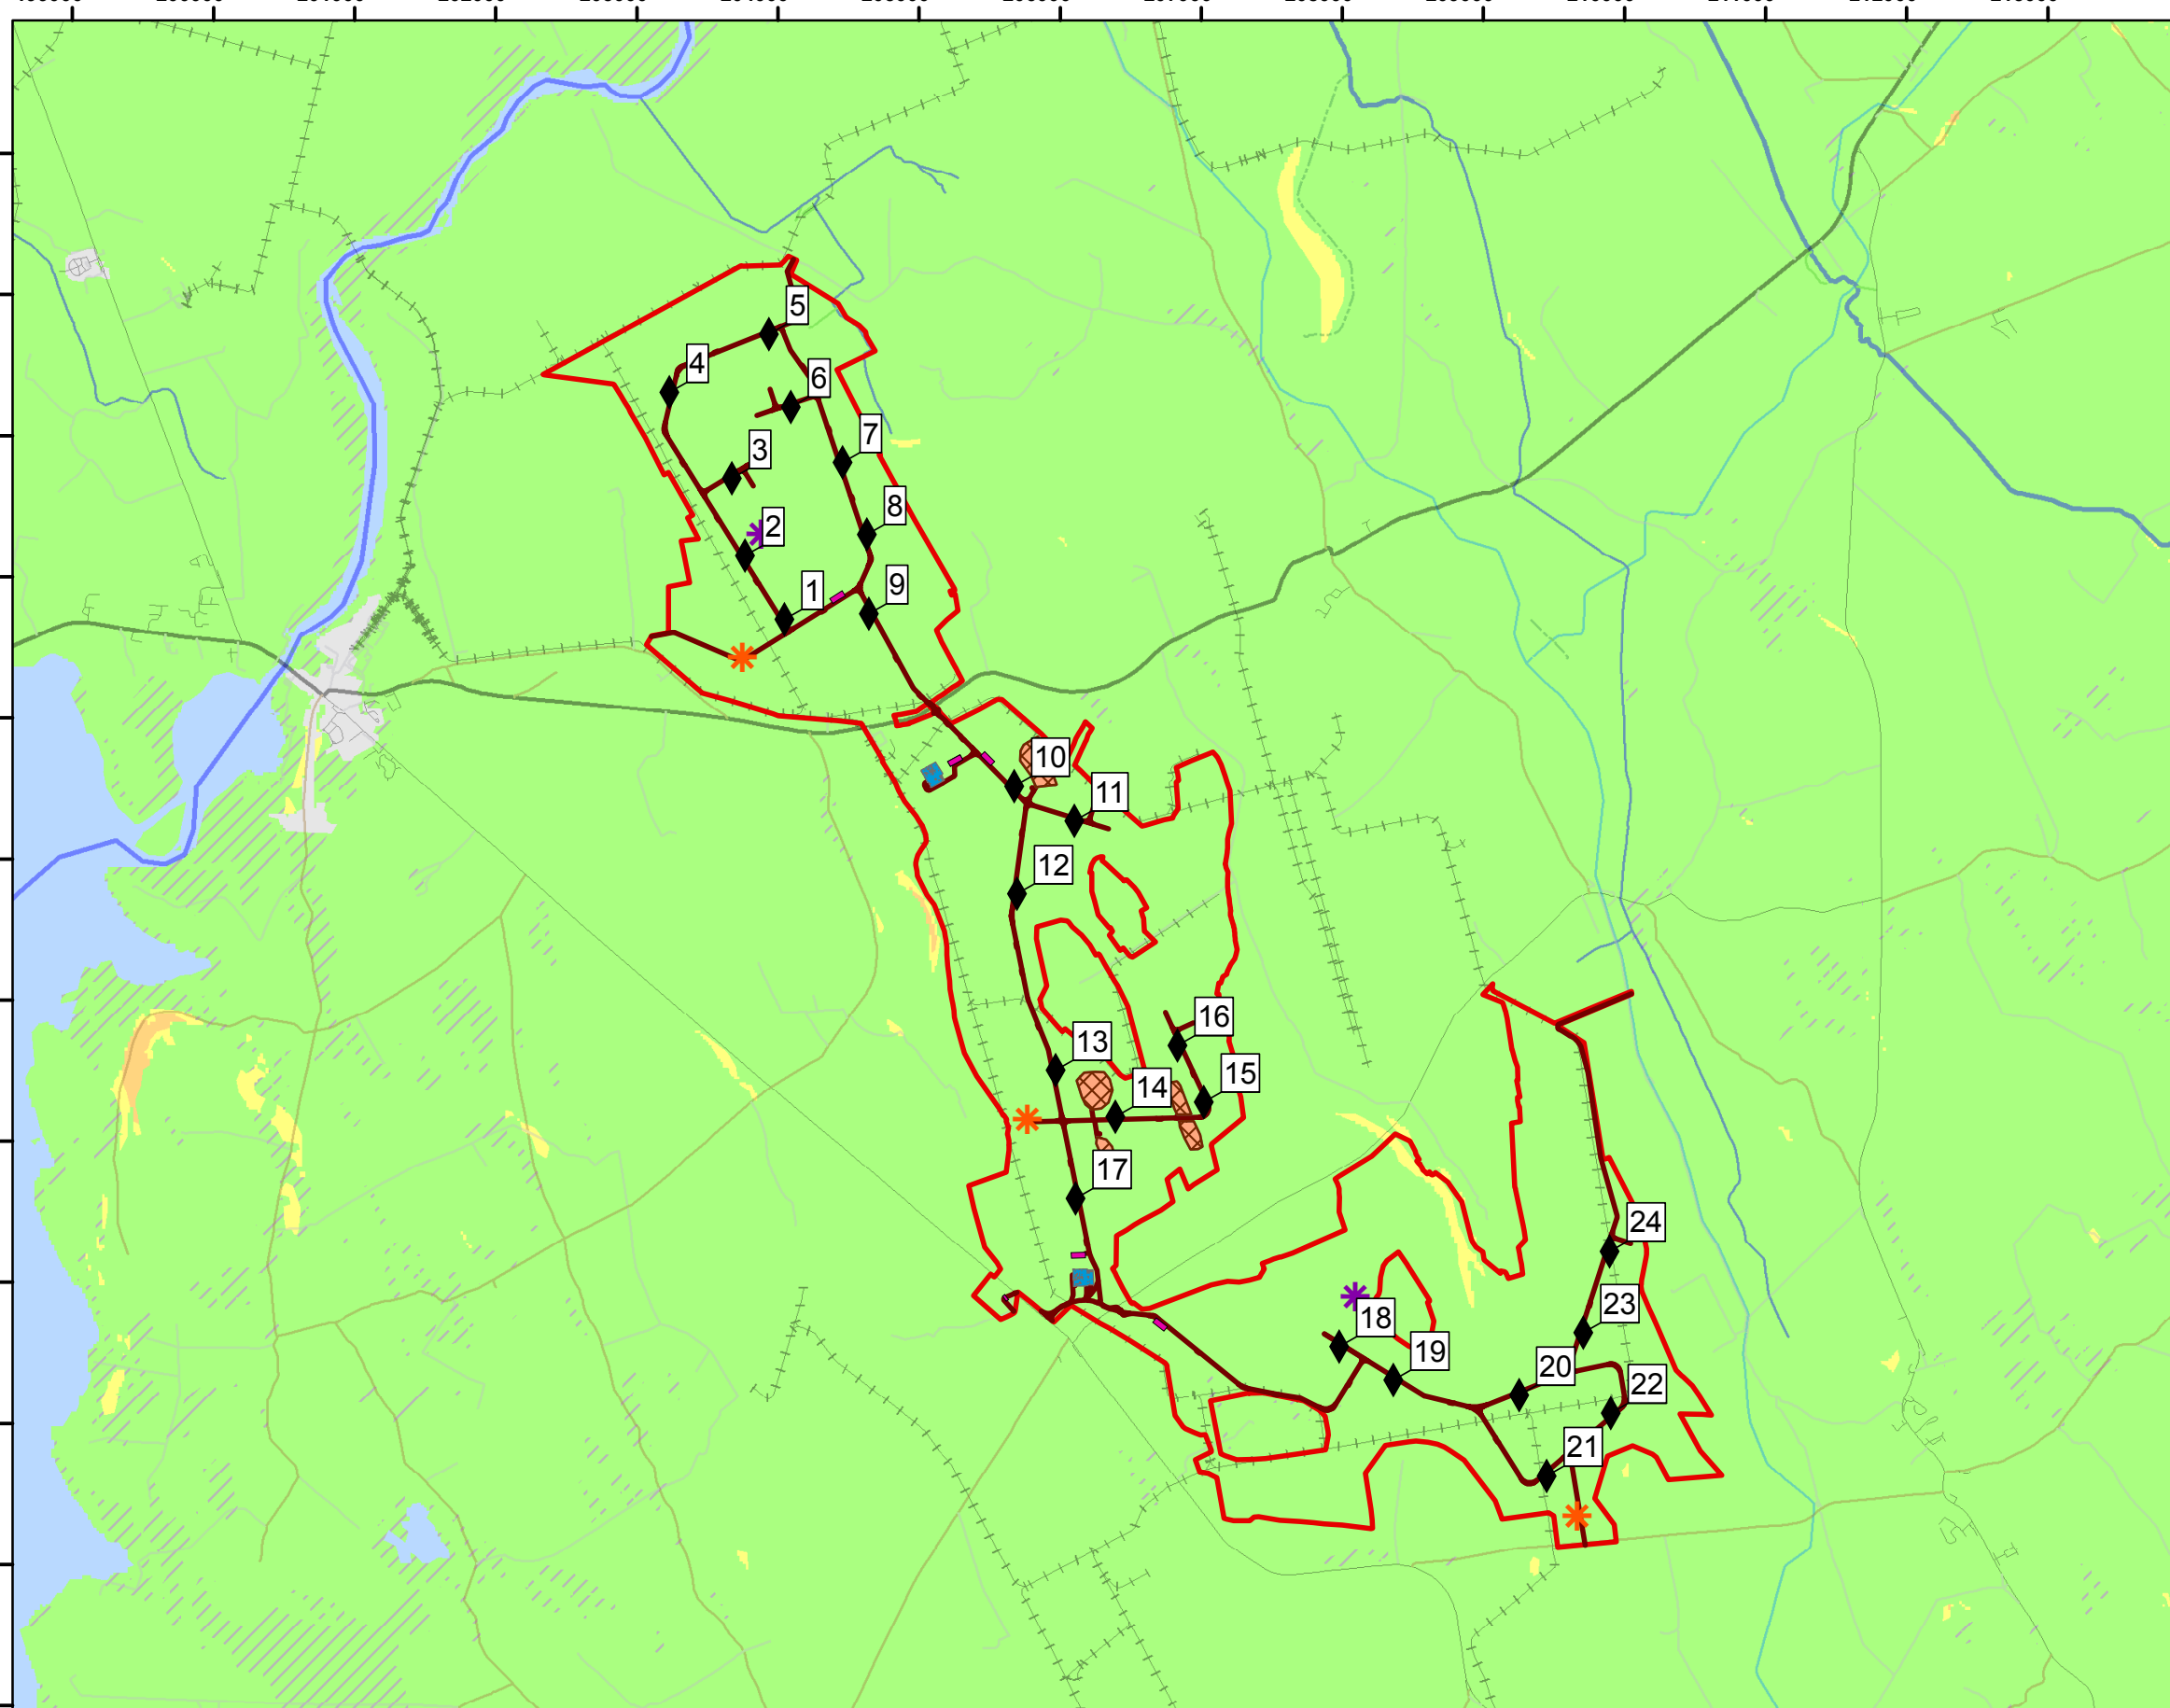

Legend

- Planning Application Boundary
 - ◆ Proposed Turbine Locations
 - ✱ Proposed Met Mast Locations
 - ✱ Existing Met Mast Locations
 - Road Layout
 - Proposed Substation Options
 - Borrow Pit Locations
 - Temporary Construction Compounds
- Landslide Susceptibility Classification**
- Low
 - Low (inferred)
 - Moderately Low
 - Moderately High
 - Made
 - Water

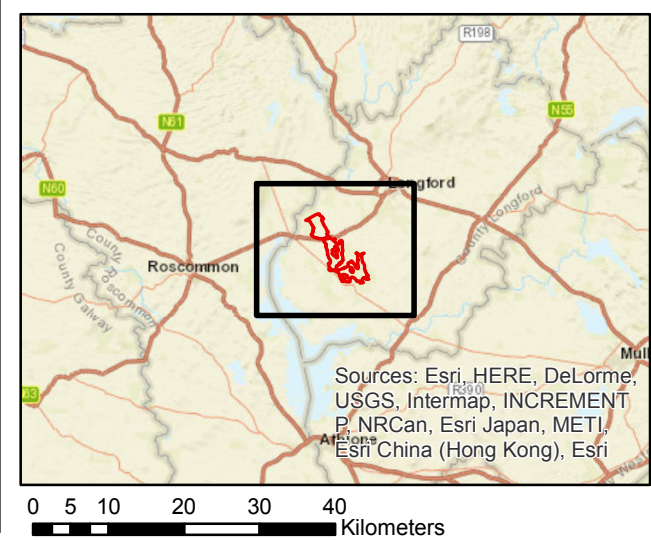

Derryadd Wind Farm



The constraints shown are draft only and subject to change. More detailed assessments, on-going studies and information received may result in changes to these constraints.

Coordinate System: IRENET 95 Irish Transverse Mercator
Source: Geological Survey of Ireland



Scale: 1:50,000 when reproduced A3 size



Figure No. 7.11

Local Landslide Susceptibility Rev.01

Drawn By: Ewa Młodawska

Checked by: Laura Burke

Date: 23/01/2019