
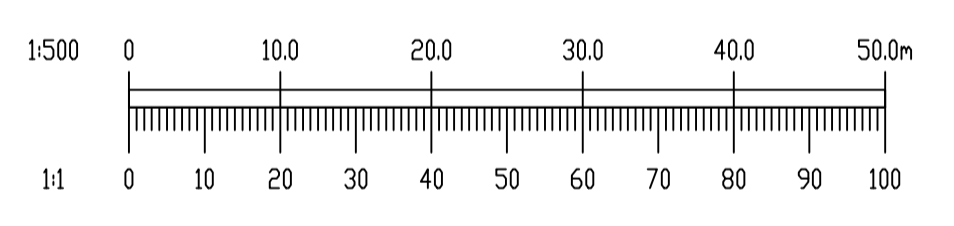


- NOTES:
- DO NOT SCALE. USE FIGURED DIMENSIONS ONLY.
 - THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT ARCHITECTURAL AND ENGINEERING DRAWINGS.

LEGEND WATER SUPPLY

- PROPOSED 150mm P.E. WATERMAIN
- PROPOSED 100mm P.E. WATERMAIN
- PROPOSED SLUCE VALVE
- PROPOSED HYDRANT
- PROPOSED HOUSE CONNECTION AND BOUNDARY BOX
- PROPOSED AIR VALVE
- PROPOSED SCOUR VALVE
- EXISTING WATERMAIN WITH PIPE SIZE
- EXISTING SLUCE VALVE
- EXISTING HYDRANT

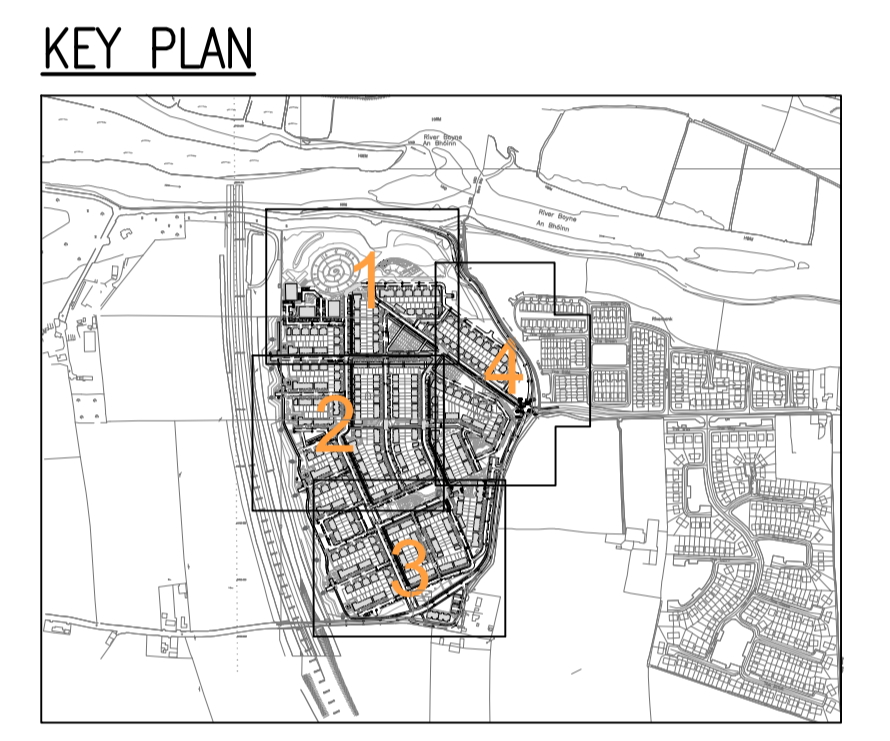

B	14/06/19	AMENDMENTS ON FOOT OF COMMENTS FROM IRISH WATER	GB	BW
A	14/05/19	IRISH WATER SUBMISSION	GB	BW
REV.	DATE	AMENDMENT	DRN	APPD

STATUS **FOR PLANNING ONLY
NOT FOR CONSTRUCTION**

Waterman Moylan
Engineering Consultants
BLOCK 8, EASTPOINT BUSINESS PARK, ALFIE BYRNE ROAD,
DUBLIN D03 H3F4 IRELAND. Tel: (01) 684 8900
Email: info@waterman-moylan.ie www.waterman-moylan.ie

CLIENT **TRAILFORD LTD**
ARCHITECT **NDBA ARCHITECTS**
PROJECT **PROPOSED RESIDENTIAL DEVELOPMENT,
RATHMULLAN,
DROGHEDA**

TITLE **PROPOSED WATER SUPPLY LAYOUT
SHEET 3 OF 4**

DRAWN C.Byrne	DESIGNED BW	APPROVED JG	DATE AUG. '19
SCALE 1:500	JOB NO. 18-014	DRG. NO. P043	REVISION B

NOTE: WATERMAIN MATERIAL TO BE PE 100 (SDR 11 OR 17) IN COMPLIANCE WITH SECTION 3.9 OF IRISH WATER, "WATER SUPPLY INFRASTRUCTURE CODE OF PRACTICE"

NOTE: AIR VALVE AND HYDRANTS COVERS, WHERE LOCATED IN GRASS AREAS, SHALL BE SURROUNDED BY A CONCRETE PLINTH IN COMPLIANCE WITH SECTION 3.18 OF IRISH WATER, "WATER SUPPLY INFRASTRUCTURE CODE OF PRACTICE"

NOTE: THRUST BLOCKS TO BE PROVIDED AT EACH BEND ALONG THE COURSE OF THE WATERMAIN IN COMPLIANCE WITH SECTION 4.6 OF IRISH WATER, "WATER SUPPLY INFRASTRUCTURE CODE OF PRACTICE"

NOTE: ENSURE DEPTH OF COVER TO WATERMAIN CROWN IS ACHIEVED IN COMPLIANCE WITH SECTION 3.11 OF IRISH WATER, "WATER SUPPLY INFRASTRUCTURE CODE OF PRACTICE"

NOTE: "METERS FOR APARTMENTS OR SIMILAR PROPERTIES WILL BE INSTALLED INTERNALLY WITHIN THE PREMISES IN ACCORDANCE WITH THE BUILDING CONTROLS AUTHORITY REQUIREMENTS AND SUBJECT TO REVIEW BY IRISH WATER" SEE SECTION 3.15.2 OF THE IRISH WATER CODE OF PRACTICE.

Bridge location for minor road over M1