
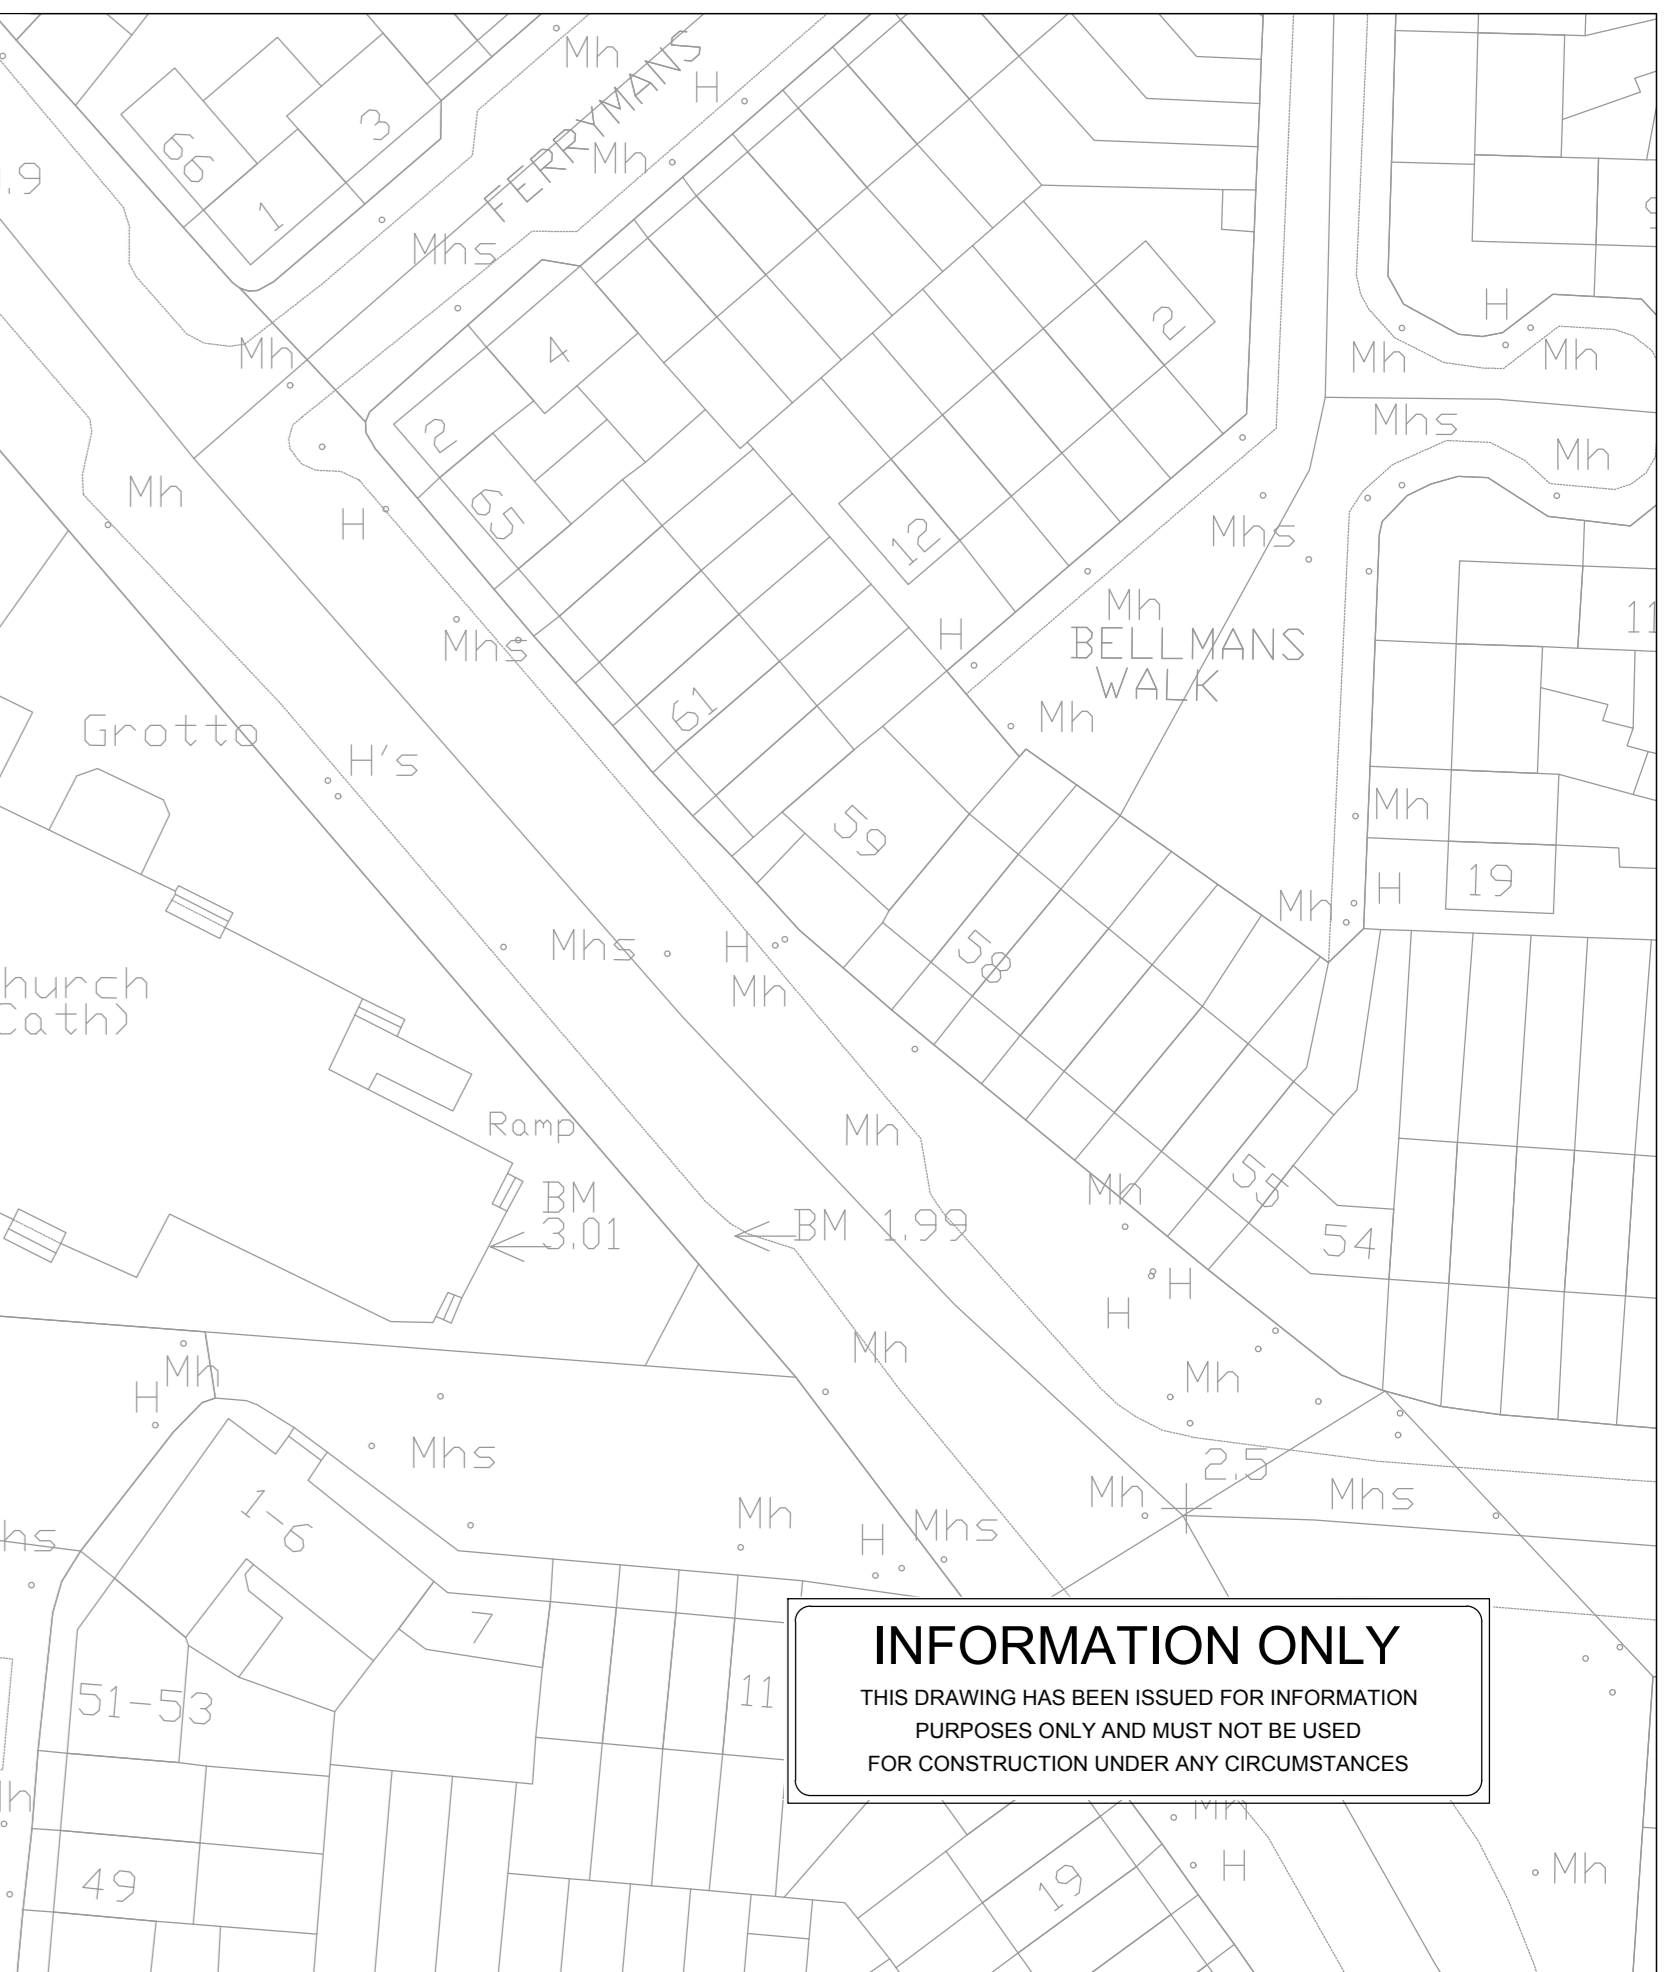


LEGEND:

- EXISTING WATERMAIN
- PROPOSED WATER SUPPLY TO TANK ROOM
- PROPOSED WATERMANS
- - - BASEMENT OUTLINE
- SLUICE VALVE
- HYDRANT
- FLOW METER

ALL WATERMANS, FITTINGS, CHAMBERS AND ANCILLARY WORKS INSTALLATION AND CONSTRUCTION DETAILS ARE TO COMPLY WITH IRISH WATER'S CODE OF PRACTICE FOR WATER INFRASTRUCTURE (IW-CDS-5020-01) AND STANDARD DETAILS (IW-CDS-5020-02)

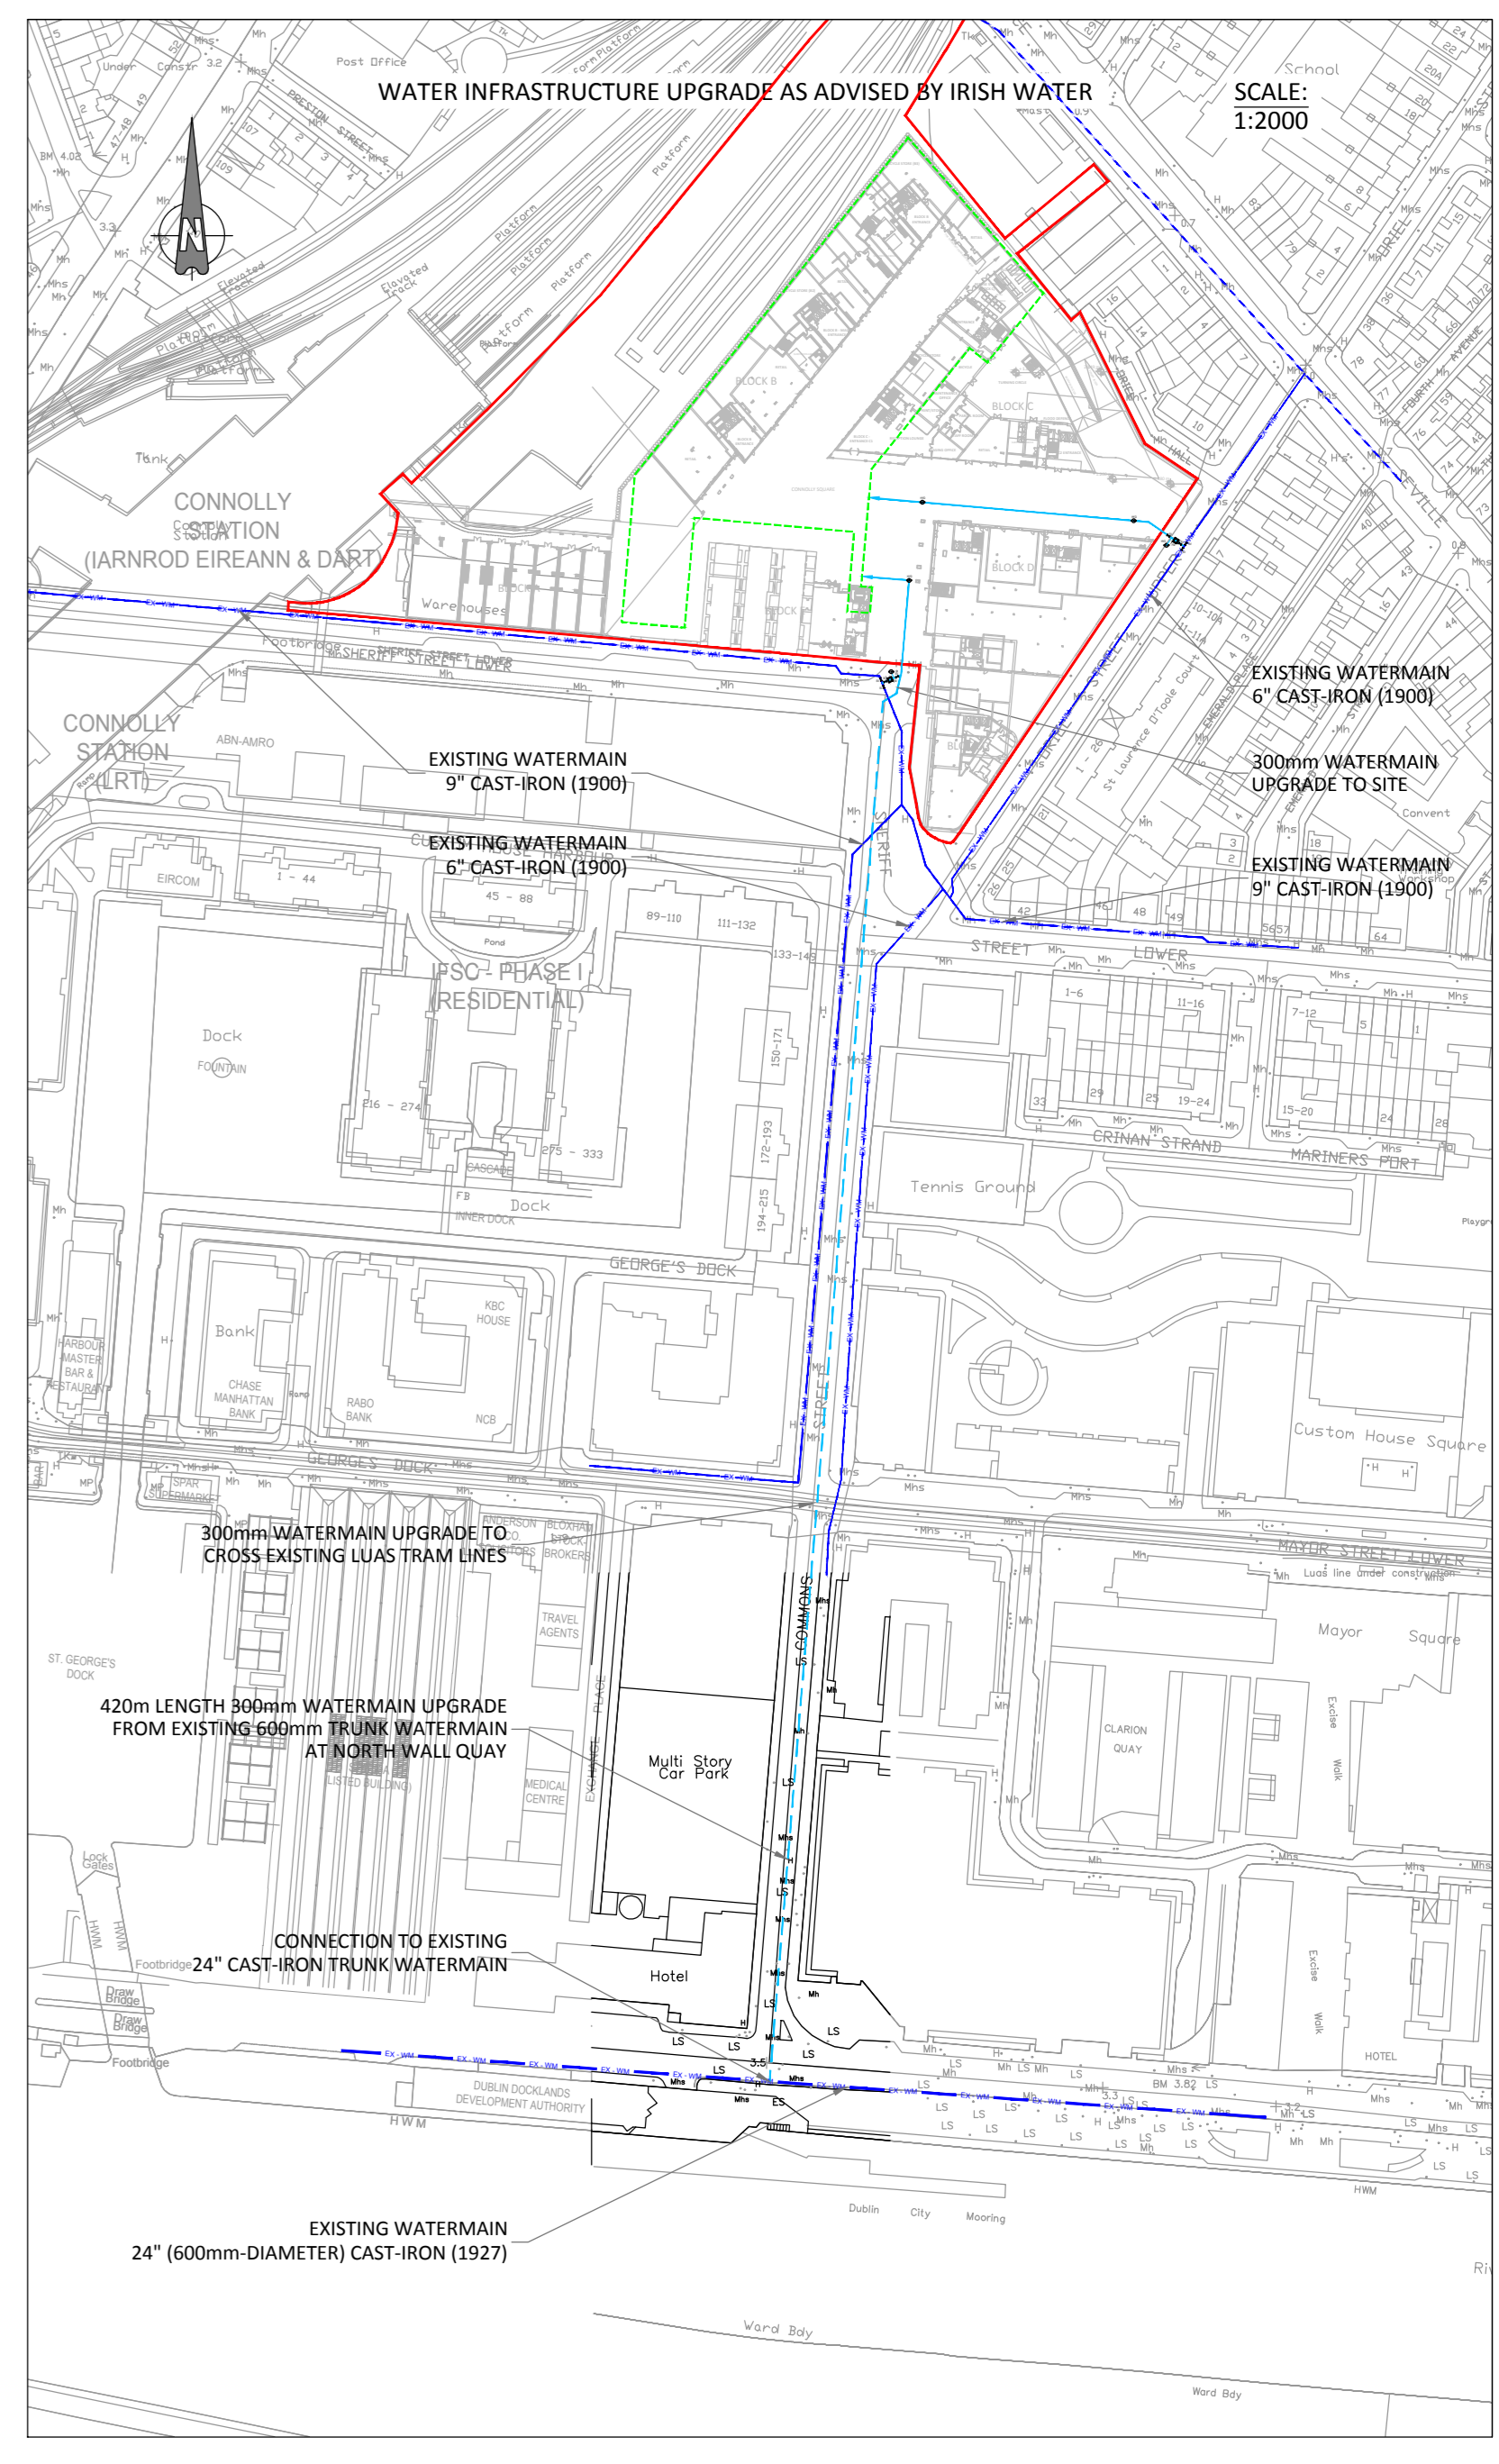

INFORMATION ONLY
 THIS DRAWING HAS BEEN ISSUED FOR INFORMATION PURPOSES ONLY AND MUST NOT BE USED FOR CONSTRUCTION UNDER ANY CIRCUMSTANCES

<p>OS Folio numbers: 3264-01 - Rev 30/03/2016 3264-02 - Rev 30/03/2016 3198-21 - Rev 30/03/2016 3198-22 - Rev 30/03/2016</p> <p>ORDNANCE SURVEY OF IRELAND LICENCE NO. EN0000819 © GOVERNMENT OF IRELAND</p>	<p>FOR SETTING OUT REFER TO ARCHITECT'S DRAWINGS. THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER ARCHITECTURAL AND ENGINEERING DRAWINGS AND ALL OTHER RELEVANT DRAWINGS AND SPECIFICATIONS. DO NOT SCALE THIS DRAWING. USE FIGURED DIMENSIONS ONLY. NO PART OF THIS DOCUMENT MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR STORED IN ANY RETRIEVAL SYSTEM OF ANY NATURE WITHOUT THE WRITTEN PERMISSION OF O'CONNOR SUTTON CROWN AS COPYRIGHT HOLDER EXCEPT AS AGREED FOR USE ON THE PROJECT FOR WHICH THE DOCUMENT WAS ORIGINALLY ISSUED.</p>	<table border="0" style="width: 100%;"> <tr> <th>Rev No.</th> <th>Date</th> <th>Revision Note</th> <th>Drn by</th> <th>Chkd by</th> </tr> <tr> <td>P01</td> <td>13.03.19</td> <td>SUITABLE FOR REVIEW/COMMENT</td> <td>FS</td> <td>NMM</td> </tr> <tr> <td>P02</td> <td>19.06.19</td> <td>SUITABLE FOR REVIEW/COMMENT</td> <td>NG</td> <td>NMM</td> </tr> <tr> <td>C01</td> <td>26.09.19</td> <td>STAGE COMPLETE - PLANNING</td> <td>FS</td> <td>NMM</td> </tr> </table>	Rev No.	Date	Revision Note	Drn by	Chkd by	P01	13.03.19	SUITABLE FOR REVIEW/COMMENT	FS	NMM	P02	19.06.19	SUITABLE FOR REVIEW/COMMENT	NG	NMM	C01	26.09.19	STAGE COMPLETE - PLANNING	FS	NMM	<table border="0" style="width: 100%;"> <tr> <th>Rev No.</th> <th>Date</th> <th>Revision Note</th> <th>Drn by</th> <th>Chkd by</th> </tr> <tr> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> <td> </td> <td> </td> </tr> </table>	Rev No.	Date	Revision Note	Drn by	Chkd by															
Rev No.	Date	Revision Note	Drn by	Chkd by																																							
P01	13.03.19	SUITABLE FOR REVIEW/COMMENT	FS	NMM																																							
P02	19.06.19	SUITABLE FOR REVIEW/COMMENT	NG	NMM																																							
C01	26.09.19	STAGE COMPLETE - PLANNING	FS	NMM																																							
Rev No.	Date	Revision Note	Drn by	Chkd by																																							
<p>Head Office: 9 Prussia Street, Dublin 7, D07 KT57</p> <p>TEL +353 (0)1 8682000 e: contactus@ocsc.ie w: www.ocsc.ie</p> <p>Dublin London Belfast Galway Cork</p>		<p>Client: OXLEY HOLDINGS LIMITED Project: CONNOLLY QUARTER</p> <p>Title: PROPOSED WATER SUPPLY LAYOUT PLAN</p> <p>Code Originator: Zone Level Type Role Number Status Revision 0635-OCSC-XX-XX-DR-C-0540-A1-C01 Date: 13.03.19 Scale: 1:500 @ A0 Drn by: FS Chkd by: NMM Aprvd by: TH</p>																																									