


- DRAWING NOTES:**
- DUCTING SHALL COMPLY WITH BS EN 50268-2-3:4 LATEST EDITION & SHALL BE SINGLE WALL, COULURED & MANUFACTURED FROM HIGH DENSITY POLYETHYLENE. THE NOMINAL EXTERNAL DIAMETER OF THE DUCT SHALL BE 107mm WITH A MINIMAL WALL THICKNESS OF 3mm. EACH LENGTH OF DUCT SHALL BE STAMPED WITH THE WORDS "PUBLIC LIGHTING" OR ALTERNATIVELY "STREET LIGHTING" IN 3mm BLACK LETTERING AT 300mm, AT ONE METRE INTERVALS. DUCT SHALL BE LAID WITH THIS LEGEND FACING UPWARDS. DUCT SHALL BE LAID IN A STRAIGHT LINE CLOSE TO THE LINE OF THE COLUMN LOCATIONS & SHALL CONTAIN A CONTINUOUS DRAW WIRE OF 3KN STRENGTH.
 - A MINIMUM DEPTH OF 450mm COVER IS REQUIRED IN URBAN PATHWAYS & A MINIMUM OF 600mm COVER IS REQUIRED FOR GRASS MARGINS, PEDESTRIAN WAYS, LANEWAYS & GATEWAY ENTRANCES & A MINIMUM DEPTH OF 750mm IS REQUIRED AT ROAD CROSSINGS OR IN CARRIAGEWAYS.
 - ALL EQUIPMENT TO BE SUITABLY IP RATED FOR THE ENVIRONMENT THEY ARE BEING INSTALLED.

- LEGEND OF SYMBOLS:**
- ESB MINI FILLER
 - ESB 125mm RED ESB DUCT
 - VIRGIN MEDIA DRAW PIT (795mm(L)x521mm(W))
 - 110mm PVC DUCT
 - IR4 - EIRCOM APPROVED CABLE DRAW PIT (915mm(L)x445mm(W))
 - EIR - 100mm EIRCOM DUCT
 - LV CABLE DRAW PIT (900mm(L)x900mm(W))
 - 100mm PVC DUCT

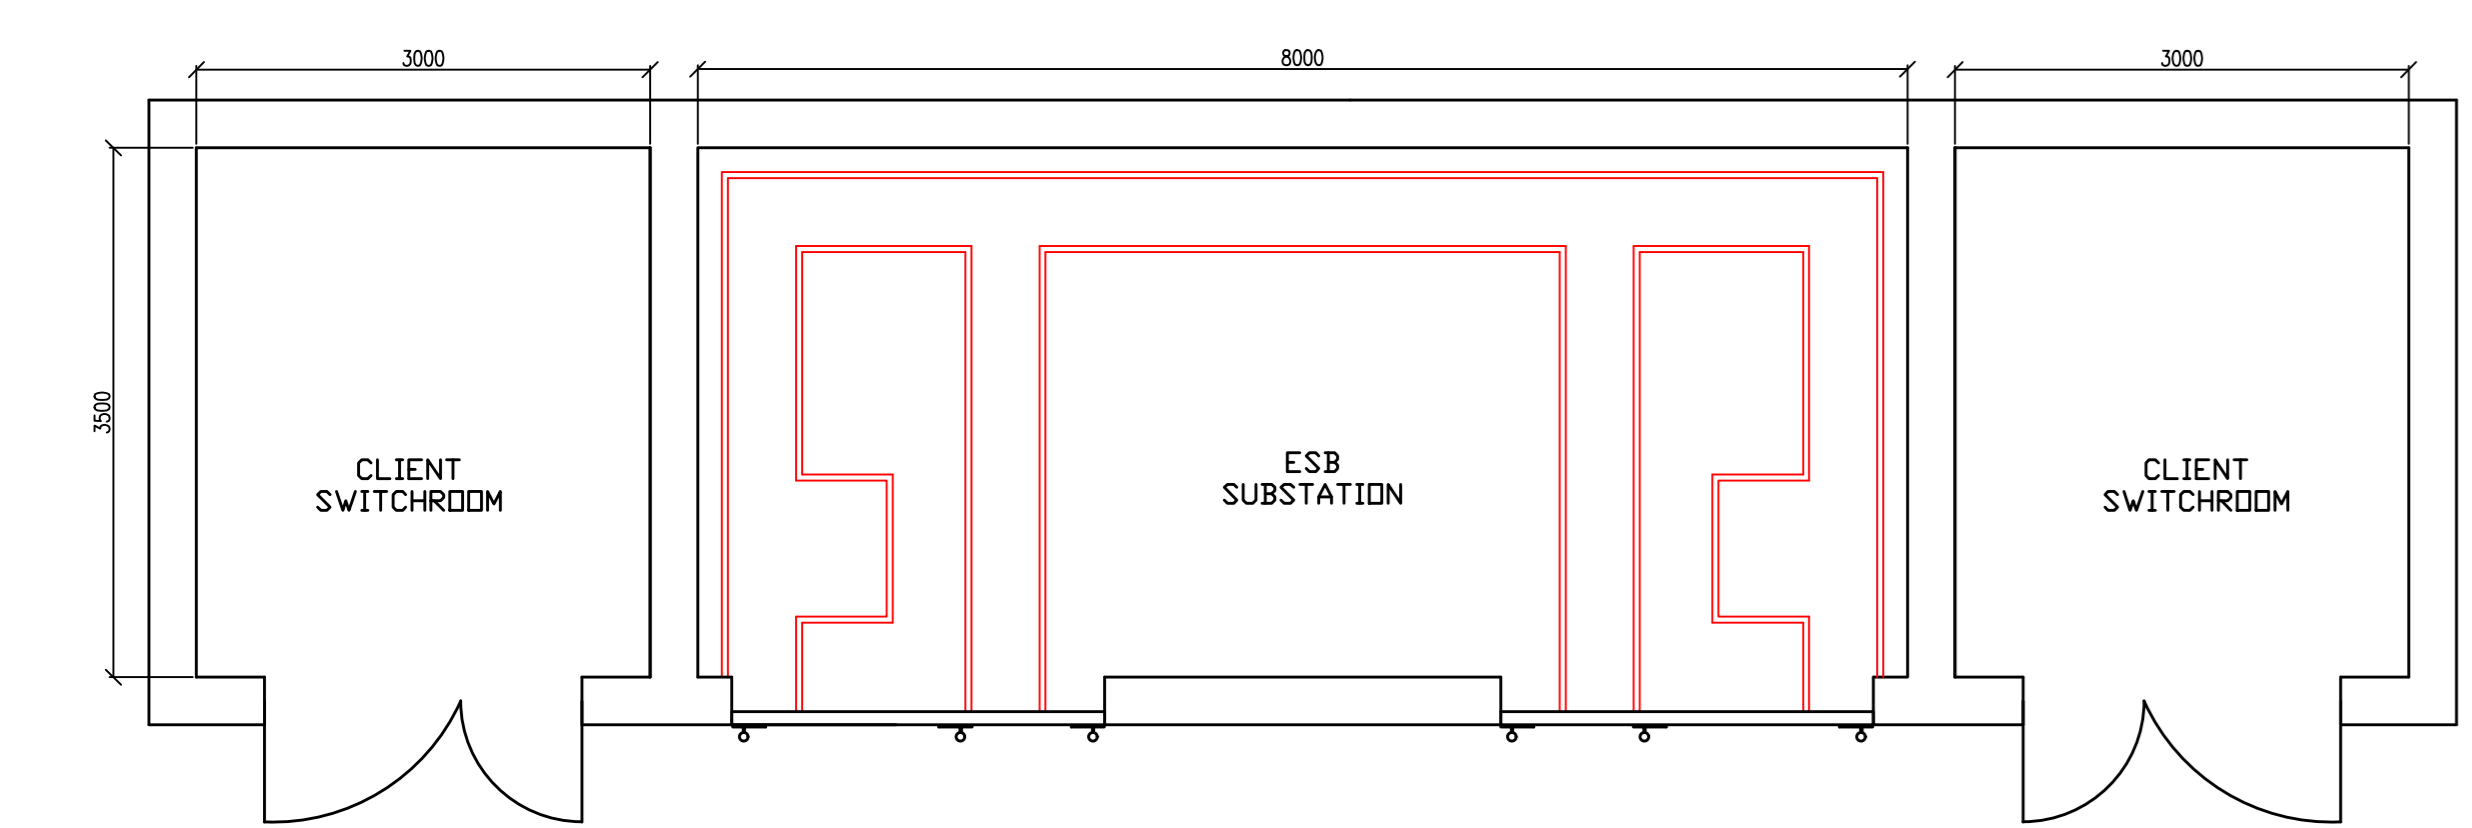

- FOR SETTING OUT REFER TO ARCHITECT'S DRAWINGS.
- THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER ARCHITECTURAL AND ENGINEERING DRAWINGS AND ALL OTHER RELEVANT DRAWINGS AND SPECIFICATIONS.
- DO NOT SCALE THIS DRAWING. USE FIGURED DIMENSIONS ONLY.
- NO PART OF THIS DOCUMENT MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR STORED IN ANY RETRIEVAL SYSTEM OF ANY NATURE WITHOUT THE WRITTEN PERMISSION OF O'CONNOR SUTTON CROIN AS COPYRIGHT HOLDER EXCEPT AS AGREED FOR USE ON THE PROJECT FOR WHICH THE DOCUMENT WAS ORIGINALLY ISSUED.

Rev No.	Date	Revision Note	Drn by	Chkd by
P01	26.08.19	ISSUED FOR PLANNING	C.T.	M.D.
P02	29.08.19	REVISED FOR PLANNING	C.T.	M.D.
P03	02.10.19	REVISED BACKGROUND	S.MCN	D.C.

Rev No.	Date	Revision Note	Drn by	Chkd by



Head Office:
9 Prussia Street,
Dublin 7,
D07 KT57

TEL +353 (0)1 8682000

e: contactus@ocsc.ie
w: www.ocsc.ie

Dublin | London | Belfast | Galway | Cork | Birmingham



Client: CREKAV TRADING GP LIMITED
Project: ST. PAULS RESIDENTIAL DEVELOPMENT

Title: MECHANICAL & ELECTRICAL
SITE SERVICES PLAN

Code [Originator] Zone | Level | Type | Role | Number | Status | Revision
N324-OCSC-XX-XX-DR-ME-0001|S8|P03

Date: 26.08.19 Scale: 1:500 @ A0 Drn by: B.M. Chkd by: M.F. Aprvd by: M.D.