



ISO A1 594mm x 841mm


Project Management Initials: Designer: CH Checked: GD Approved: RG

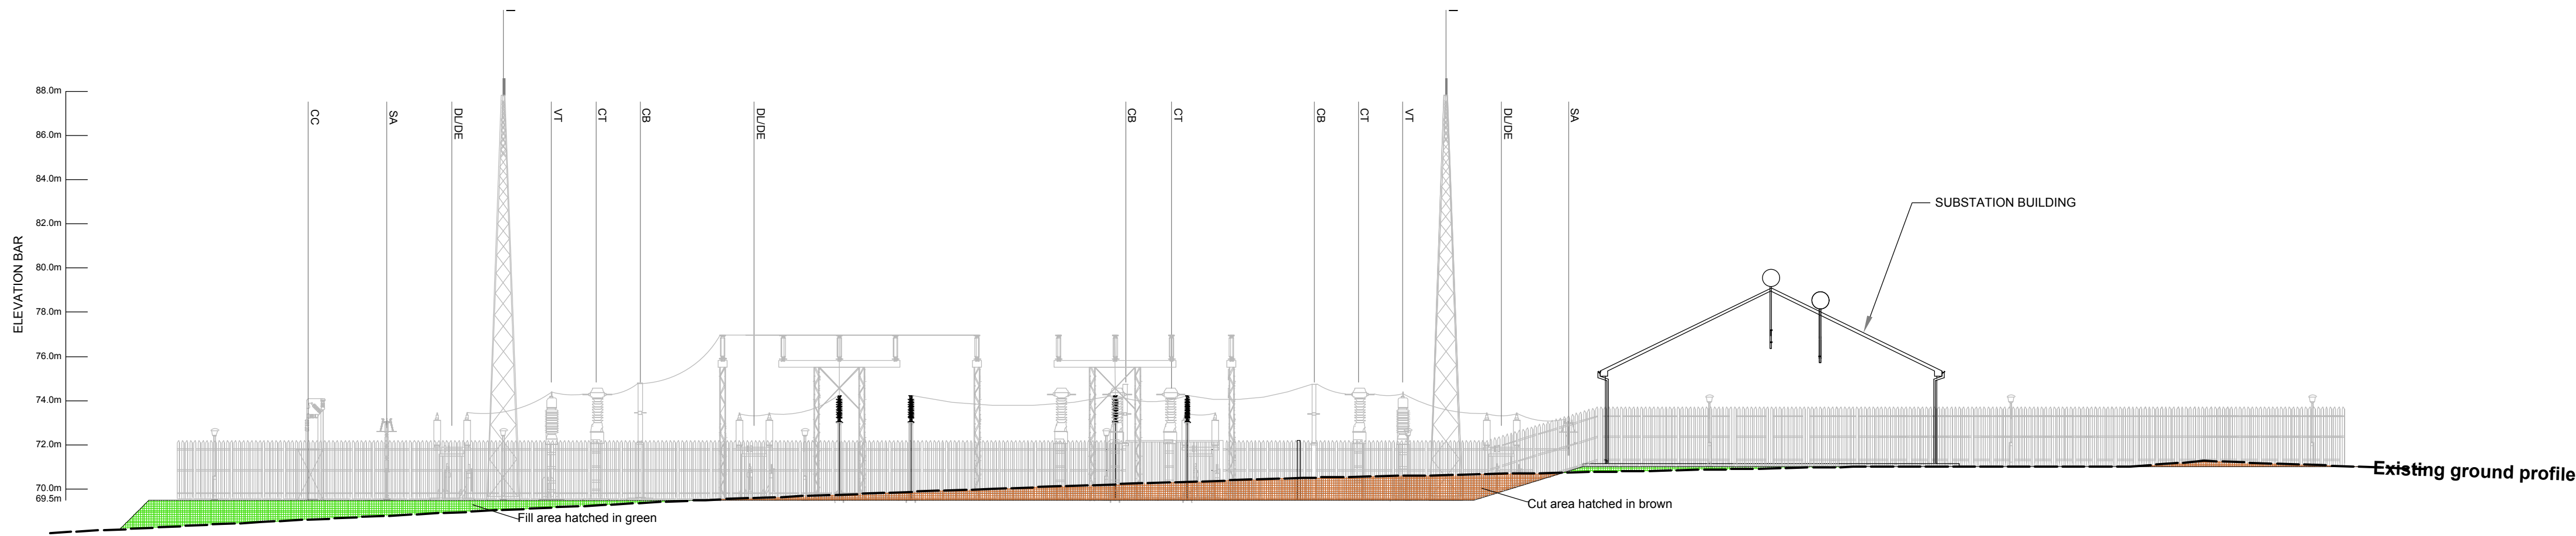


South Elevation
SCALE 1:200

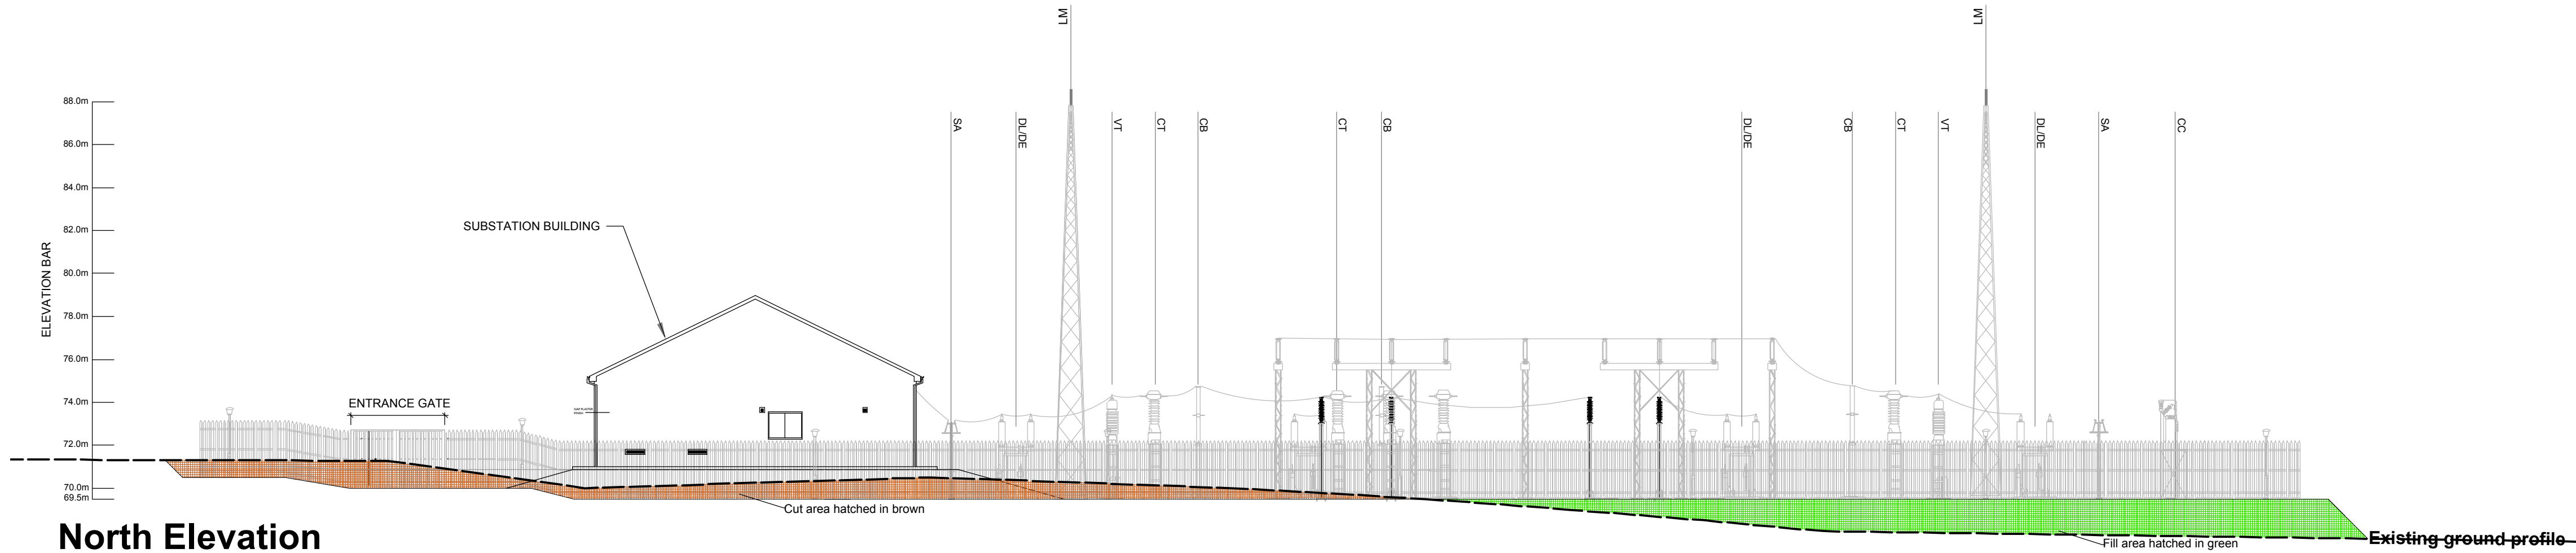

North Elevation
SCALE 1:200

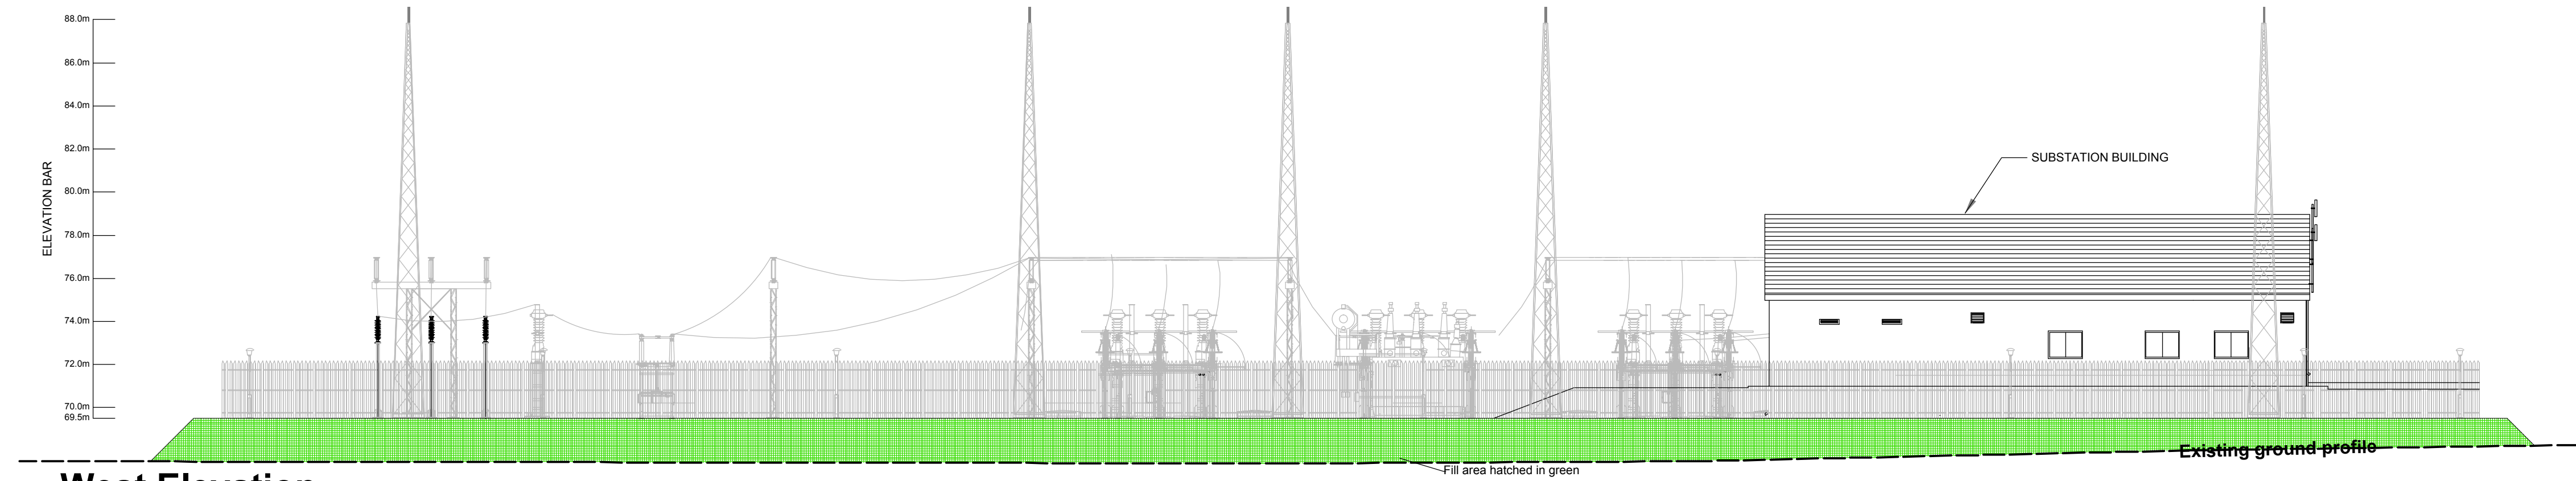

West Elevation
SCALE 1:200

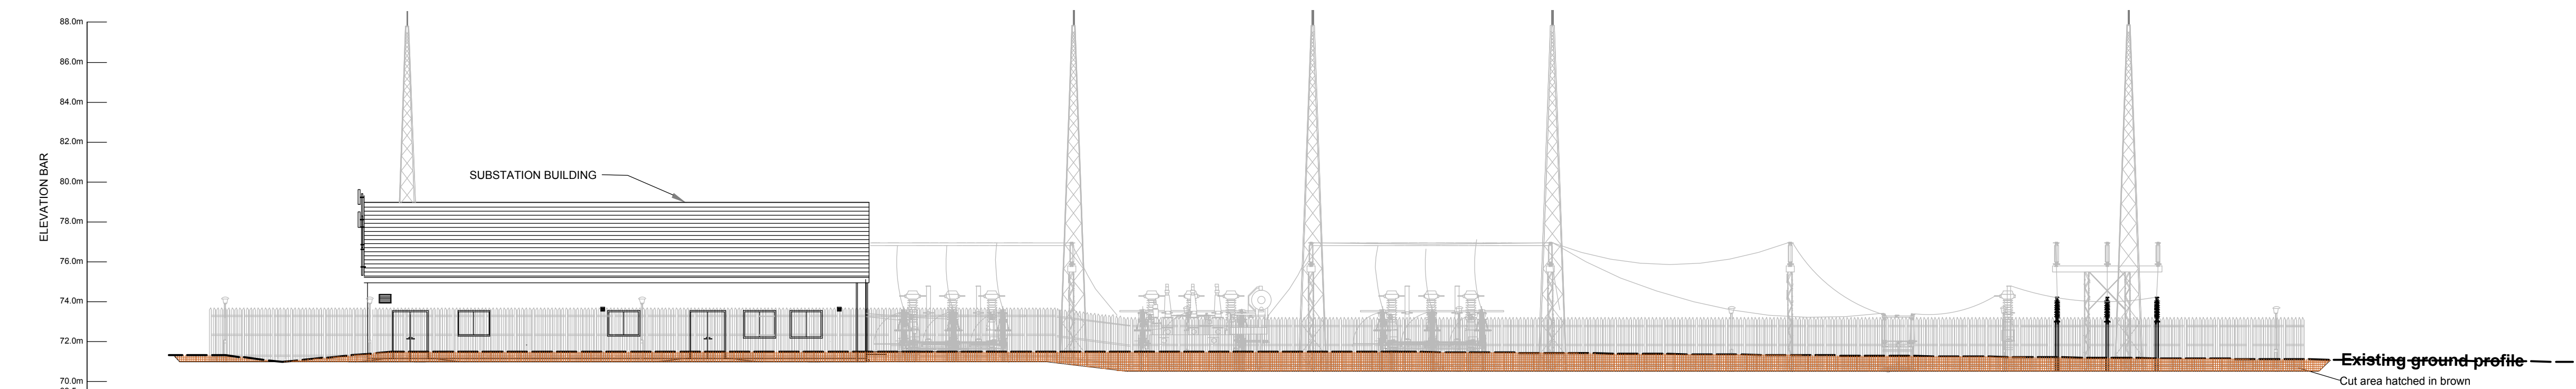

East Elevation
SCALE 1:200



Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

Regional Office
Basepoint Business Centre
Stroudley Road, Basingstoke,
Hampshire,
RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT

Mountphilips Substation for
Upperchurch Windfarm Grid
Connection

CLIENT



CONSULTANTS

NOTES: -

1. Layout and Arrangements of Substation Building and Electrical Equipment is shown indicatively and for illustration purposes only.
2. Dimensions shown are as per current Eirgrid Specifications at the time of submission. Dimensions may vary at time of construction to reflect any revisions to Eirgrid Specifications.
3. Final Specifications of Buildings and Electrical Equipment is to be as per Eirgrid and ESB Specifications.
4. The Elevation of the Compound will be depicted by localized Topography such that Cut/Fill Earthworks associated with the construction of the Compound are balanced.

LEGEND: -

	Description
G	Gantry.
SA	Surge Arrester.
DL/DE	Line / Earth Disconnect.
DT/DEM1	Trafo / Earth Disconnect.
VT	Voltage Transformer.
CT	Current Transformer.
CB	Circuit Breaker.
DA	Busbar Disconnect.
PI	Post Insulator.
LM	Lighting Mast.
SA1/SB1	Sectionaliser Disconnect
CC	Cable Chair
LS	Lamp Standard

ISSUE/REVISION

02	12.12.19	Issued for Planning
01	19.08.19	Issued for Information
00	29.07.19	Issued for Information
I/R	DATE	DESCRIPTION

PROJECT NUMBER

05-664

SHEET TITLE

Loop-In Substation Compound
Elevations

SHEET NUMBER

05654-203