



- NOTES:**
- This drawing is to be read in conjunction with relevant drawings, specifications and reports.
 - Dimensions are in millimetres, unless noted otherwise.
 - Drawings are not to be scaled use figured dimensions only.

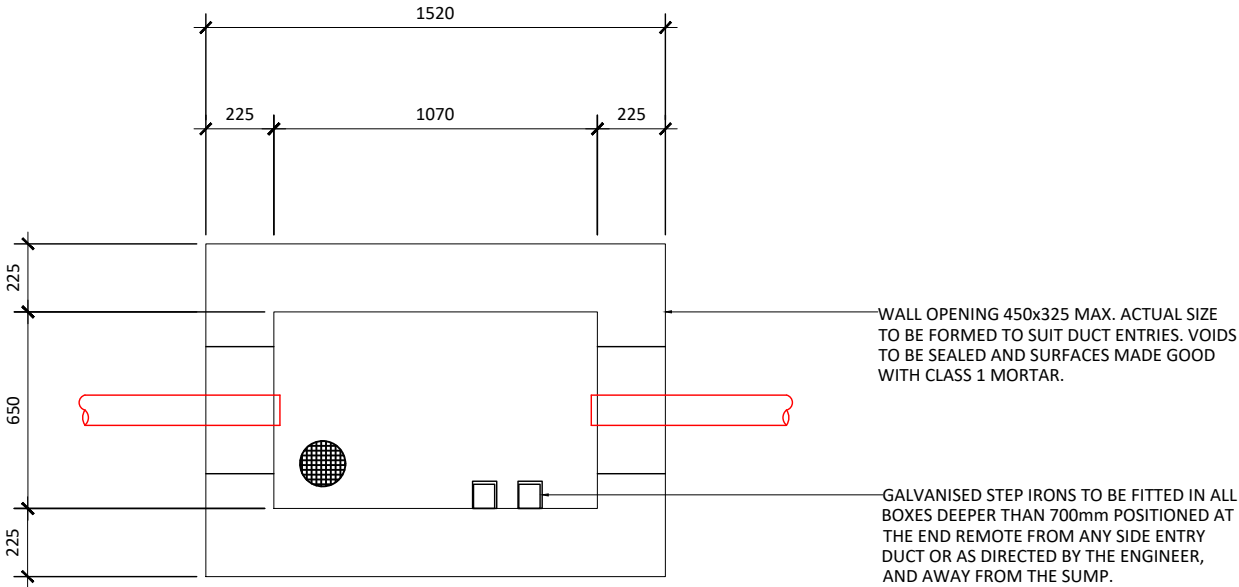

Plan View - Typical Communications Chamber

SCALE 1:25

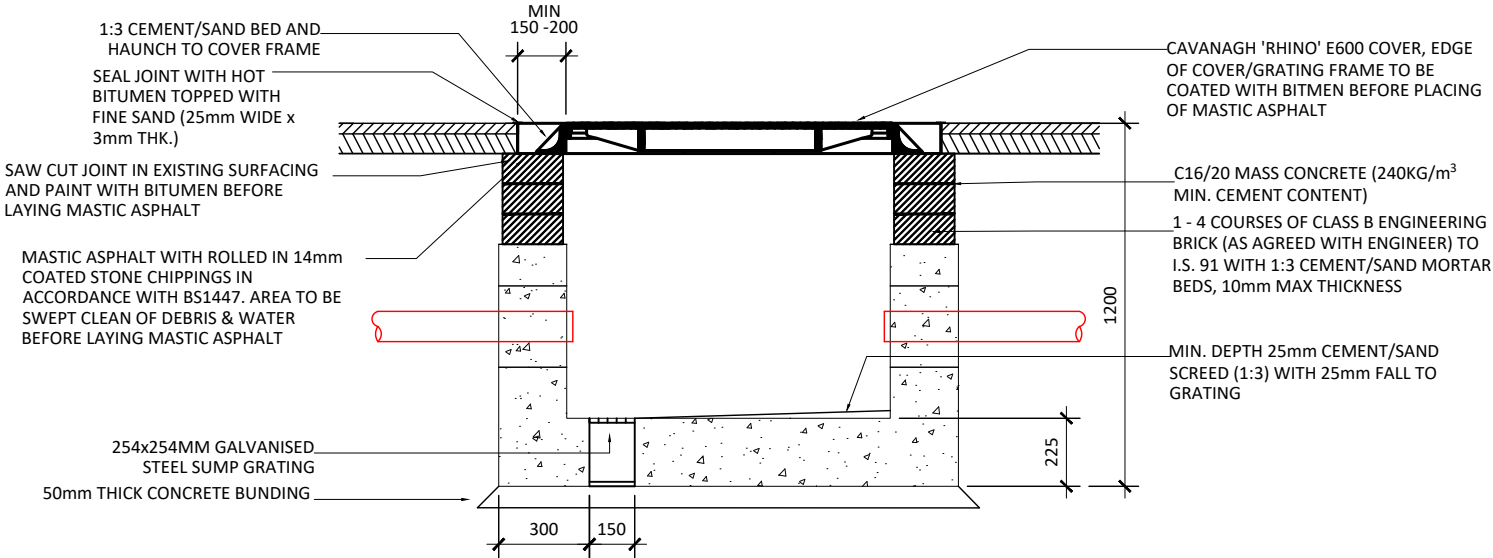

Section Through Typical Communications Chamber

SCALE 1:25



Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710



CLIENT

PROJECT
110kV Underground Cabling
for Upperchurch Wind Farm Grid Connection

PROJECT NUMBER
05-652

SHEET NUMBER
05652-532

SHEET TITLE
**Typical Communications
Chamber Details**

DRAWING STATUS
For Planning

ISSUE/REVISION		
02	25.06.19	Issued for Planning
01	12.03.19	Issued for Information
00	06.03.19	Issued for Information
I/R	DATE	DESCRIPTION