


ISO A1 594mm x 841mm

Project Management Initials: Designer: GD Checked: SK Approved: RG

TLI Group Bridge Ref: Bridge 15
Watercrossing Ref: W53
Tipperary Co. Co. Ref:

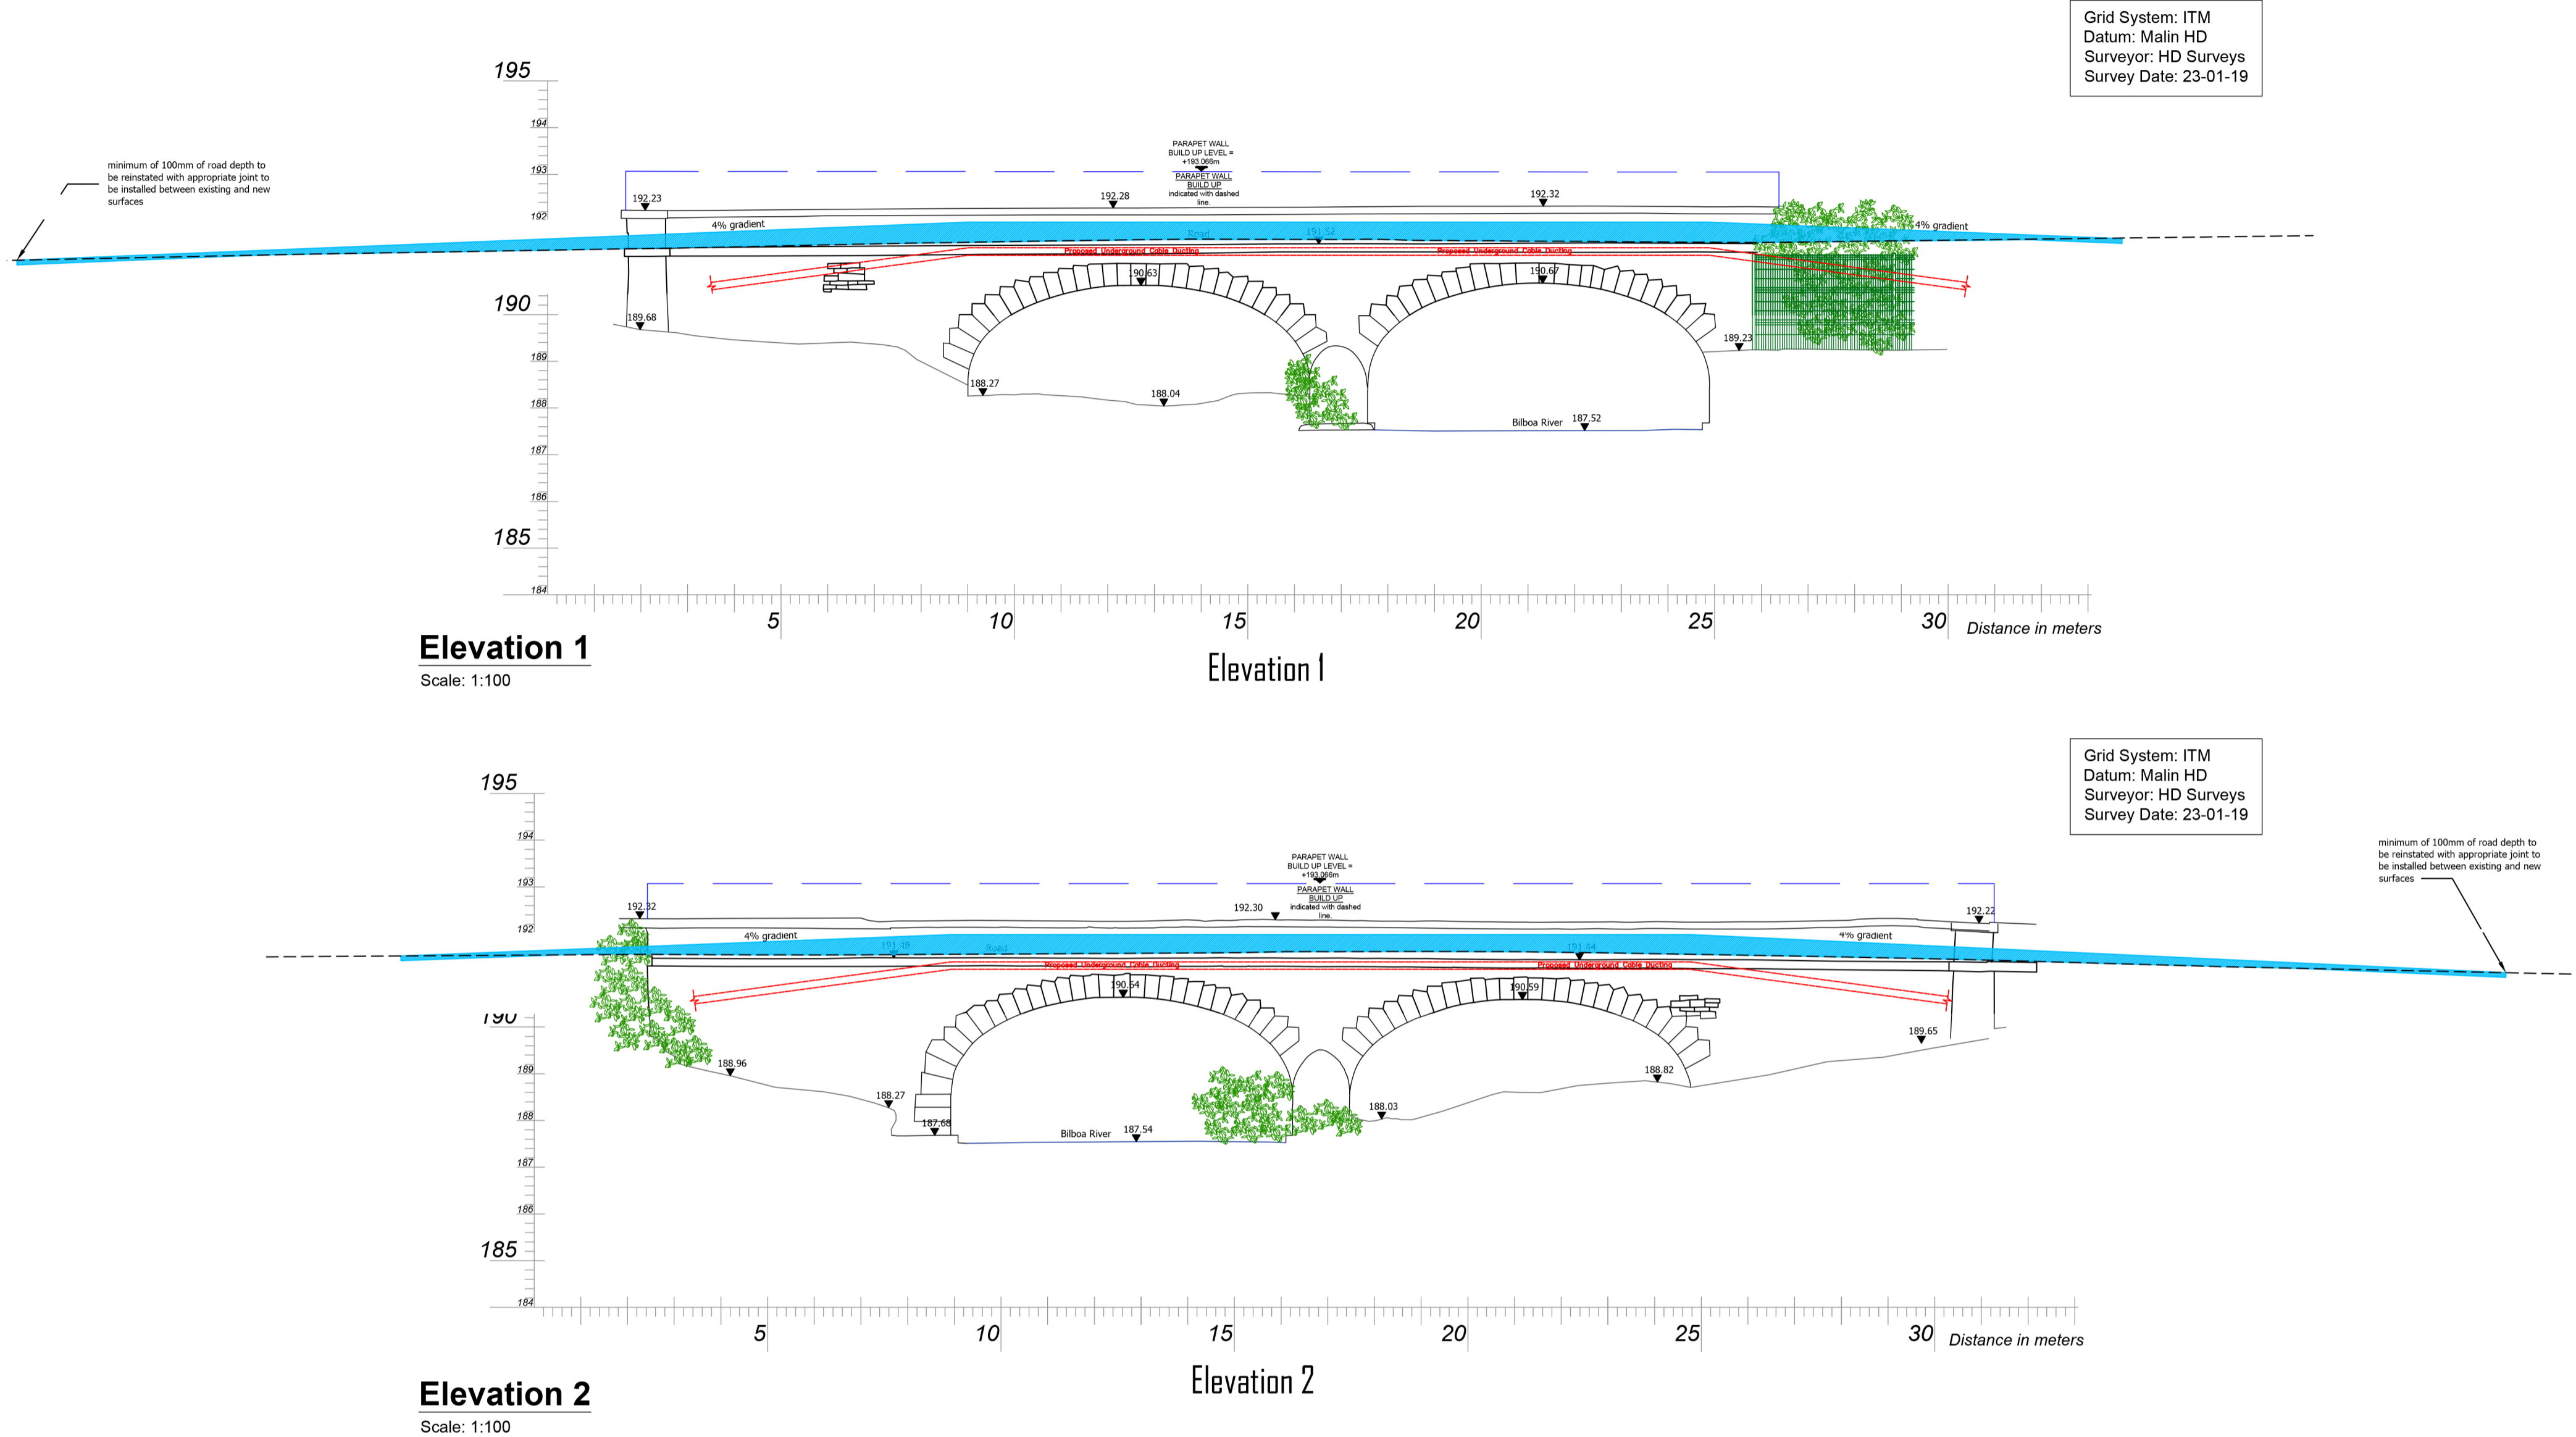

tli GROUP

Head Office
Beenreigh,
Abbeydorney,
Trillick, Co. Kerry
Ireland
Tel: 00353 66 7135710

Regional Office
Basepoint Business Centre
Stroudley Road, Basingstoke,
Hampshire,
RG24 8UP, UK
Tel: 00 44 1256406664

PROJECT

110kV Underground Cabling
for Upperchurch Wind Farm
Grid Connection

CLIENT



CONSULTANTS

- NOTES: -
- No structural bridge surveys have been carried out and the proposal s are subject to detailed design.
 - Bridge crossing designs will be submitted to Tipperary Co. Council for review.
 - Drawings are in compliance with ESN specification requirements for shallow formation, bridge crossings, etc.

- LEGEND: -
- Proposed 110kV Underground Cable
 - Proposed Parapet Wall Build-Up

ISSUE/REVISION

I/R	DATE	DESCRIPTION
01	25.06.19	Issued for Planning
00	12.03.19	Issued for Information

PROJECT NUMBER

05-652

SHEET TITLE

Bridge 15 (W53)
Crossing Details:
Elevations - Sheet 2 of 2 - Option 1

SHEET NUMBER

05652-537

- Notes:
- This drawing is to be used only for the purpose of issue that it was issued and is subject to amendment.
 - This drawing is to be read in conjunction with all other relevant information.
 - Do not scale from this drawing, use only printed dimensions.
 - All dimensions are in millimetres. All chainages, levels and coordinates are in metres unless defined otherwise.
 - The existing utility service information shown on this plan is a general guide and the accuracy thereof cannot be guaranteed. no liability is accepted for any discrepancy, omission or deviation and the actual position of individual services must be verified and established on site before commencing the works.
 - No excavation shall commence until the contractor has consulted up to date services drawings and carried out an electromagnetic locator (eml) scan.
 - Hand dig only within 500mm of existing services.
 - All co-ordinates are referenced to ITM.