
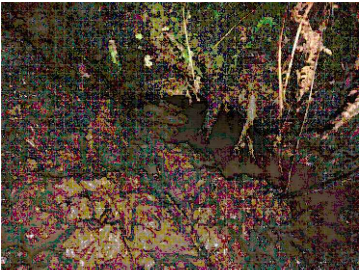

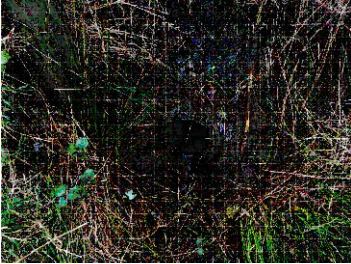



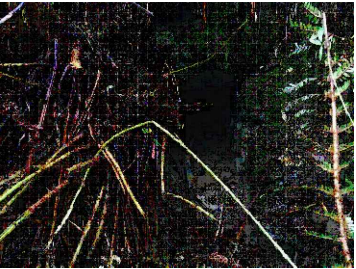
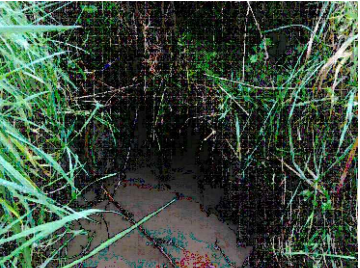


Culvert Crossing Schedule						
Culvert No.	Watercourse Ref No.	Dimensions (mm)	Material	Approx. Cover (mm)	Proposed Crossing Methodology	Photo
37.	W55	400 wide x 300 high	Masonry Box	600	UNDERCROSSING	
38.	W56	200 Ø	Concrete	1600	OVERCROSSING	
39.	W57	500 wide x 600 high	Masonry Box	1000	UNDERCROSSING	
40.	W58	200 Ø	Concrete	900	UNDERCROSSING	
41.	W59	800 Ø 700 wide x 1200 high	1. Concrete 2. Masonry Box	1. 1200 2. 800	UNDERCROSSING	
42.	W60	400 wide x 400 high	Masonry Box	500	UNDERCROSSING	
43.	W61	600 wide x 800 high	Masonry Box	400	UNDERCROSSING	
44.	W62	500 wide x 500 high	Masonry Box	1500	OVERCROSSING	
45.	W63	400 Ø	Concrete	500	UNDERCROSSING	



Head Office  
Beenreigh, Abbeydorney,  
Tralee, Co. Kerry, Ireland  
Tel: 00353 66 7135710

PROJECT

110kV Underground Cabling  
for Upperchurch Wind Farm  
Grid Connection

CLIENT



CONSULTANTS

NOTES: -

- No structural surveys have been carried out and the proposals are subject to detailed design.
- Crossings are in compliance with ESBN & EirGrid specification requirements for shallow formation, min depth, etc.
- Additional culverts may be encountered on the route.

LEGEND: -

ISSUE/REVISION

01	25.06.19	Issued for Planning
00	13.03.19	Issued for Information
I/R	DATE	DESCRIPTION

PROJECT NUMBER

05-652

SHEET TITLE

Proposed Culvert Crossings  
Sheet 5 of 6

SHEET NUMBER

05652-542