


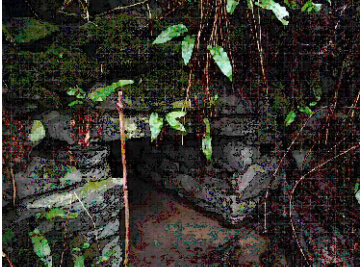


Culvert Crossing Schedule						
Culvert No.	Watercourse Ref No.	Dimensions (mm)	Material	Approx. Cover (mm)	Proposed Crossing Methodology	Photo
46.	W64	500 wide x 500 high	Masonry Box	1000	UNDERCROSSING	
47.	W65	700 Ø	Concrete	1200	UNDERCROSSING	
48.	W66	200 Ø	Concrete	400	UNDERCROSSING	
49.	W67	500 Ø	Concrete	1000	UNDERCROSSING	
50.	W68	500 Ø	Concrete	600	UNDERCROSSING	

PROJECT

110kV Underground Cabling
for Upperchurch Wind Farm
Grid Connection

CLIENT



CONSULTANTS

NOTES: -

- No structural surveys have been carried out and the proposals are subject to detailed design.
- Crossings are in compliance with ESBN & EirGrid specification requirements for shallow formation, min depth, etc.
- Additional culverts may be encountered on the route.

LEGEND: -

ISSUE/REVISION

01	25.06.19	Issued for Planning
00	13.03.19	Issued for Information
I/R	DATE	DESCRIPTION

PROJECT NUMBER

05-652

SHEET TITLE

Proposed Culvert Crossings
Sheet 6 of 6

SHEET NUMBER

05652-543