


- NOTES:**
- LIGHTING TO BE CONTROLLED BY A COMBINATION OF TIMER SWITCHES AND PHOTOCELLS. THE PHOTOCELLS TO BE MOUNTED ON THE TOP OF EACH LUMINAIRE AND THE TIMER SWITCHES INSTALLED IN THE MINI PILLARS.
 - LIGHTING TO BE SWITCHED OFF DURING NON-OPERATIONAL HOURS IN ACCORDANCE WITH PLANNING CONDITIONS AND THAT THE LIGHTING TO ONLY BE TRIGGERED BY SECURITY PERSONAL IN THE CASE OF TRESPASSERS ONTO THE SITE.
 - THE COLOUR TEMPERATURE OF THE LIGHT TO BE 2700K OR LESS.
 - THE LIGHTING CLASS ALONG THE PATHWAY TO BE IN ACCORDANCE WITH P5 CLASS.
- EXISTING LIGHTS TO BE UNINSTALLED, STORED AND REINSTALLED AFTER COMPLETION OF CIVIL WORKS, WHERE REQUIRED.
- EXISTING ASTRO-TURF PITCH POLE MOUNTED FLOODLIGHTS TO BE RELOCATED TO NEW LOCATION AS INDICATED.

- KEY**
- PROPOSED MINI PILLARS
 - EXISTING MINI PILLARS
 - PROPOSED LED LANTERN C/W PHOTOCELL MOUNTED ON 6m HIGH COLUMN
 - EXISTING CCTV
 - RECESSED IN-GROUND PATHWAY LIGHT
 - WALL WASHING LIGHT
 - POLE MOUNTED FLOODLIGHTS AT ASTRO-TURF PITCH

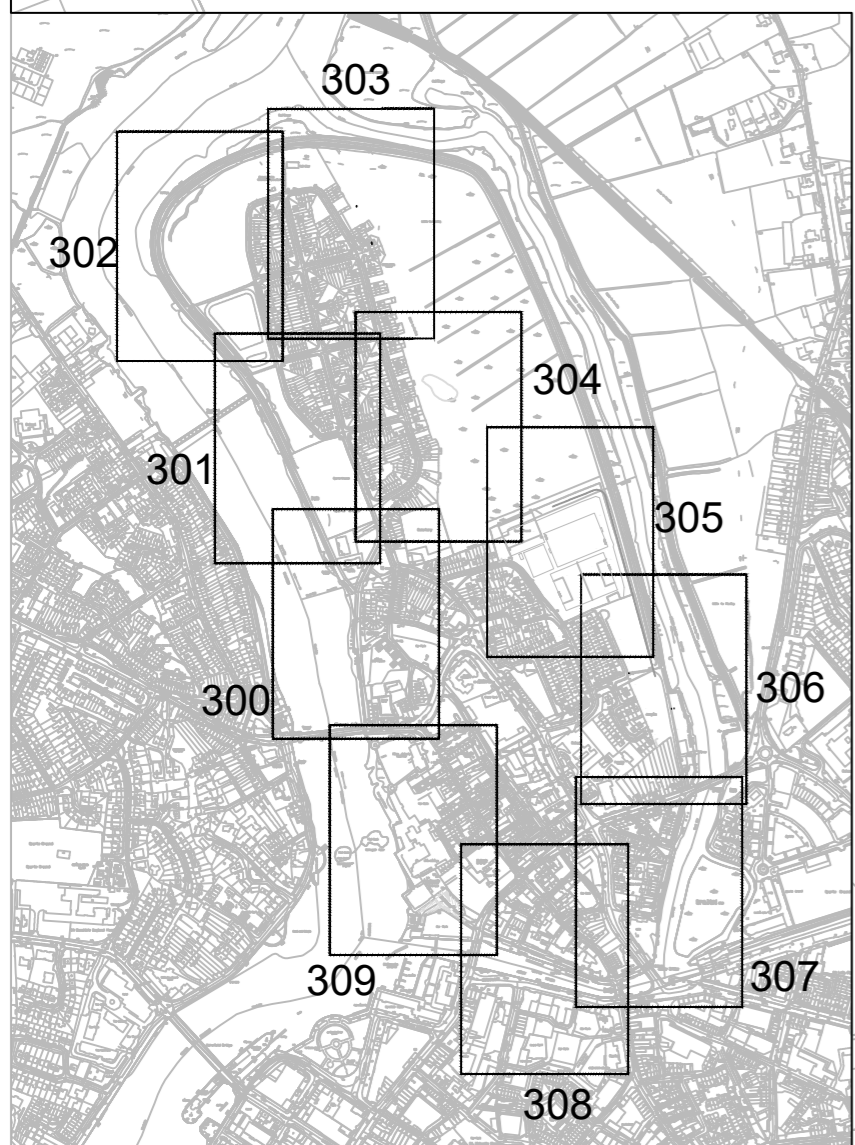

JBA consulting
 Nicholas de Jong Associates
 URBAN DESIGN

PL1	19/12/19	JT	KC	VA
Issue	Date	By	Chkd	Appd

Client
Comhairle Cathrach & Contae Luimnigh
Limerick City & County Council
OPW Óigheara nOibreacha Poblaithe Office of Public Works

Job Title
KING'S ISLAND
 FLOOD RELIEF SCHEME
 Scale at A1 1:500
 Discipline Infrastructure

ARUP
 Arup, 50 Ringsend Road
 Dublin, D04 T6X0
 Tel +353(0)1 233 4455 Fax +353(0)1 668 3169
 www.arup.ie

Drawing Title
KIFRS Public Lighting Layout
 Sheet 1 of 10
 Areas A1 & A2
 Job No **KIFRS** Drawing Status **Planning**
 Drawing No **KIFRS-E-300** Issue **PL1**