




14m Minimum AREA REQUIRED TO POSITION CABLE INSTALLATION MACHINERY. THIS GROUND MUST BE CAPABLE OF CARRYING APPROX. 10TONS

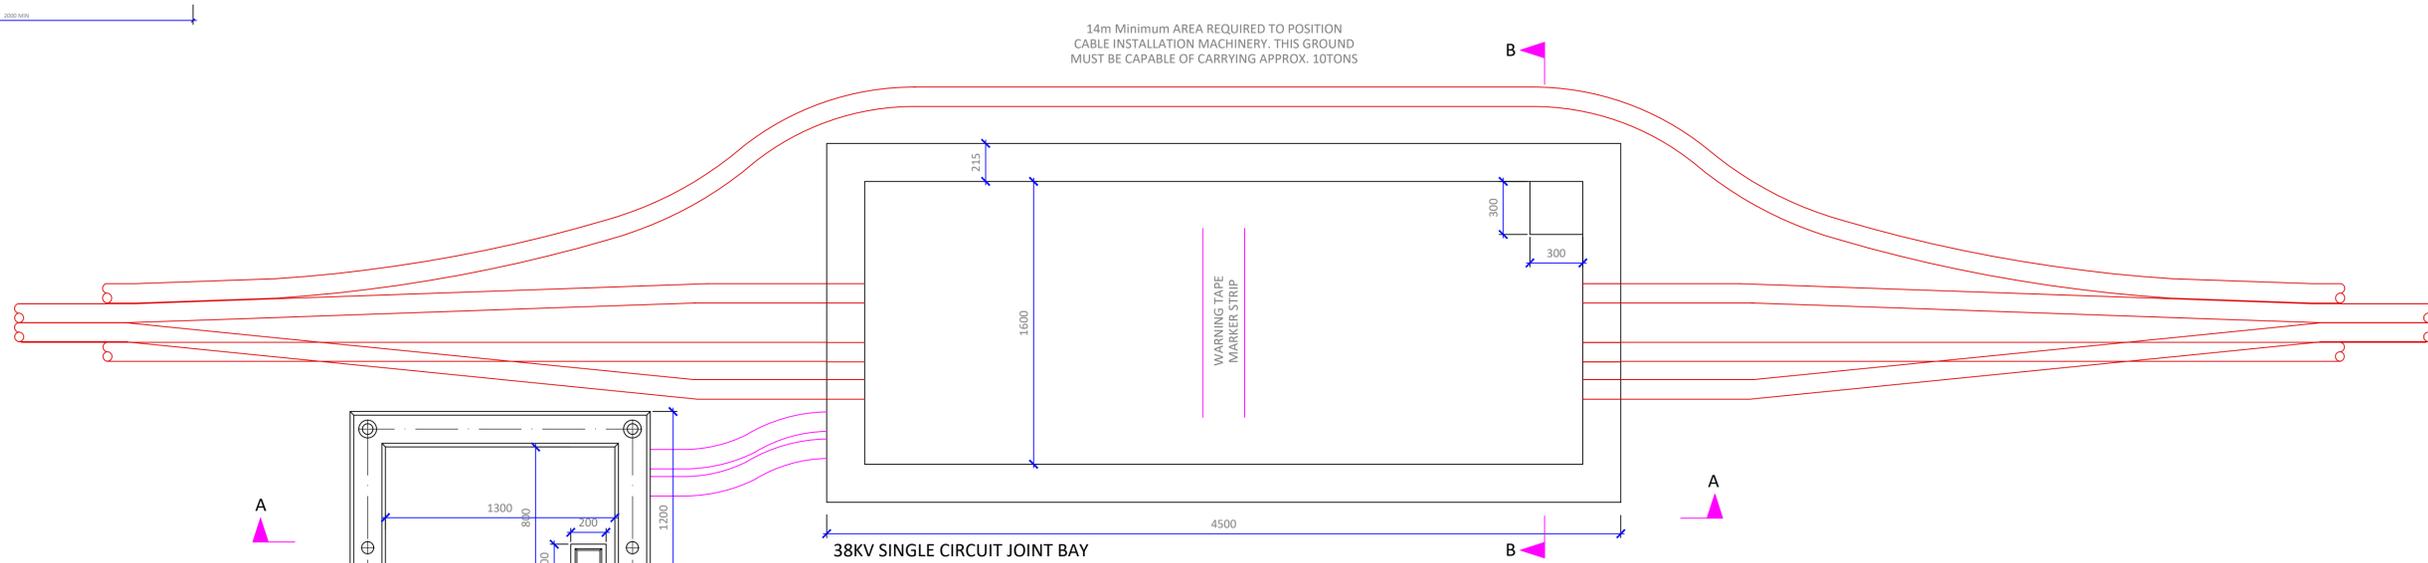

Typical Plan of Joint Bay 38kV Ducting
SCALE 1:20

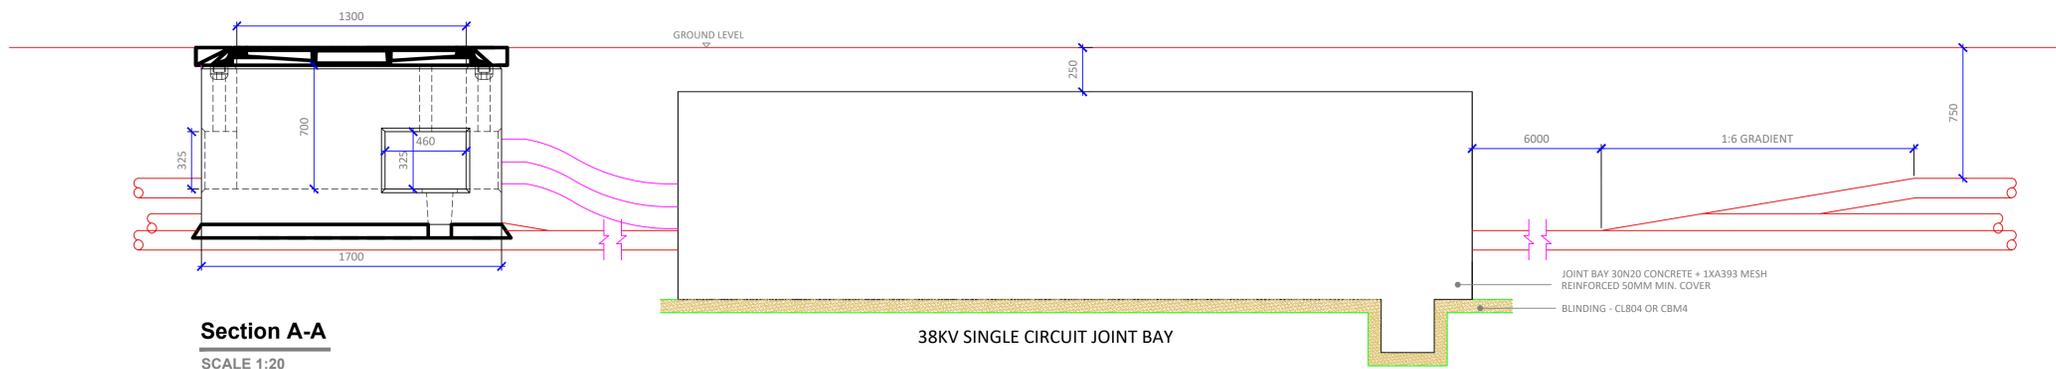

Section A-A
SCALE 1:20

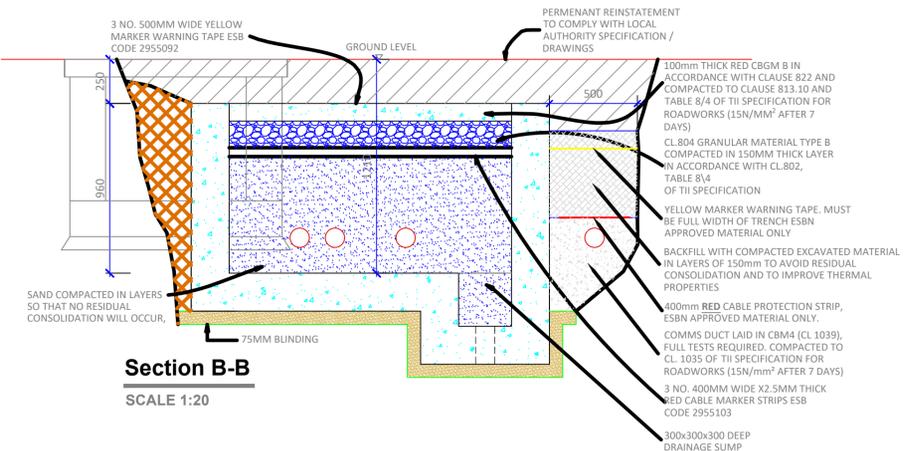

Section B-B
SCALE 1:20

NOTES:

- This drawing is to be used only for the purpose of issue that it was issued and is subject to amendment.
- This drawing is to be read in conjunction with relevant drawings, specifications and reports
- Dimensions are in millimeters, unless noted otherwise
- Drawings are not to be scaled use figured dimensions only
- Suitability of standard joint bay foundations can only be confirmed following ground investigation. Standard foundations are based on the formation at the base of the excavation shown being suitable for a minimum bearing pressure of 100N/m2. Where this is not achievable and where peat is encountered, the contractor shall refer to the Engineer for guidance.

ISSUE/REVISION		
NO	DATE	DESCRIPTION
P02	18.12.19	Issued For Information
P01	05.12.19	Issued For Information
I/R	DATE	DESCRIPTION