



**End Mast
Type 54D (12M)
or similar
approved by ESB**

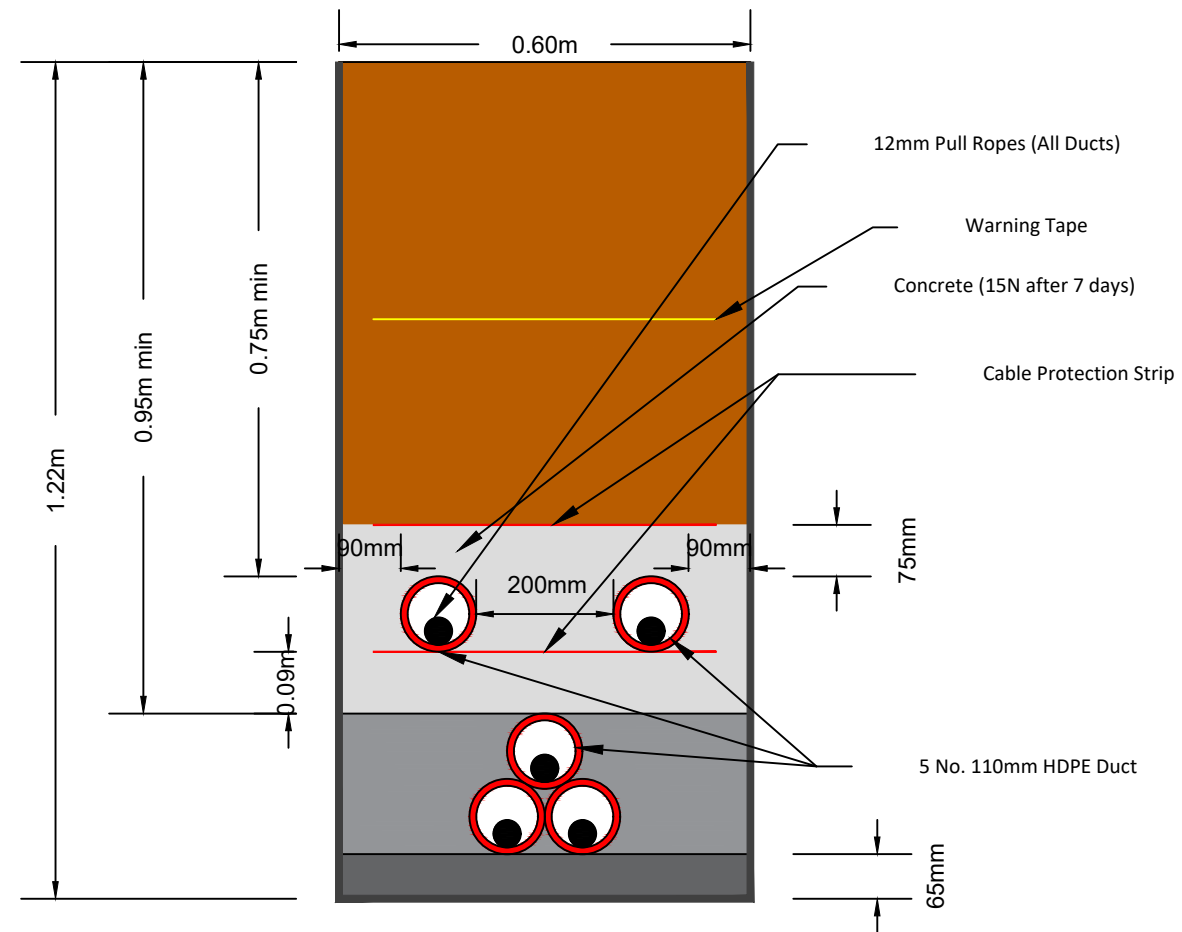


38kV Single Circuit Standard Trench Cross-Section


NOTES:
All dimensions in metres.
Do not scale from drawing.
For any discrepancies found please consult with design office.
This drawing should be read in conjunction with all contract drawings, documents and specifications.

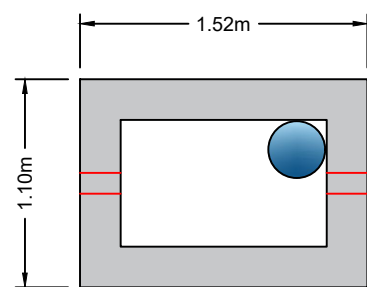

PLAN VIEW

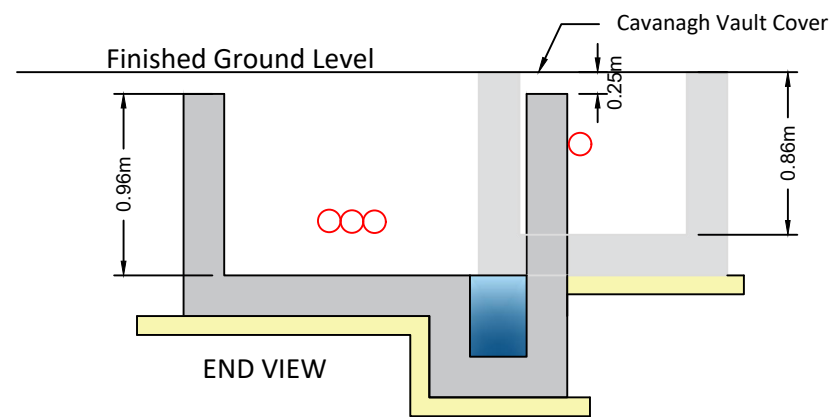

END VIEW

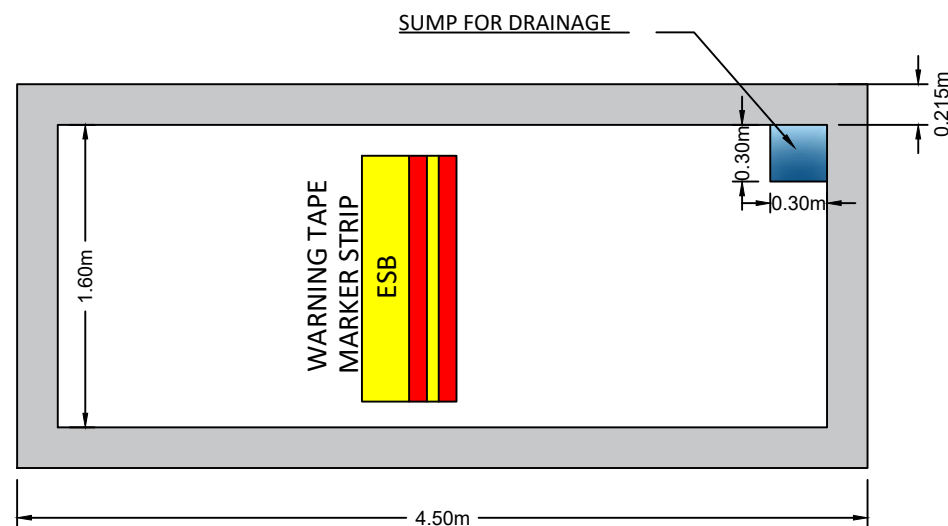

SUMP FOR DRAINAGE

WARNING TAPE
MARKER STRIP
ESB

38kV Single Circuit Joint Bay

| Rev | By | Date | Description |
|-----|----|------|-------------|
| | | | |
| | | | |
| | | | |
| | | | |

Drawing Status: PLANNING
NOT CERTIFIED FOR CONSTRUCTION

Project Title: Longview Estates Development

Drawing Title: Proposed ESB 38kV Diversion Details

Client: Longview Estate Ltd



M.H.L. & Associates Ltd.
Consulting Engineers

Carraig Mór House,
10 High Street,
Douglas Road,
Cork
Tel: 021-4840234
Fax: 021-4840215
E-Mail: info@mhl.ie

| | | |
|---------------------------|------------------------------------|-----------------------|
| Designed: SM | Drawn: SFM | Checked: KM |
| Scale: N.T.S | Date: Nov 2019 | |
| Job No: 17066HD | Drawing No: LHD_ESBD_P02 | Revision: |