


NOTES:
 All dimensions in metres.
 Do not scale from drawing.
 For any discrepancies found please consult with design office.
 This drawing should be read in conjunction with all contract drawings, documents and specifications.

- Legend:**
- ESB Underground Cable
 - - - ESB Existing Overhead Cable
 - - - ESB Existing Overhead Cable to be Removed
 - ESB Mast

Pre-Cast Transition Chamber in accordance with ESB Drawing PE424-D7001-048-001-000

Scale - 1:500 @ A3

Section A-A

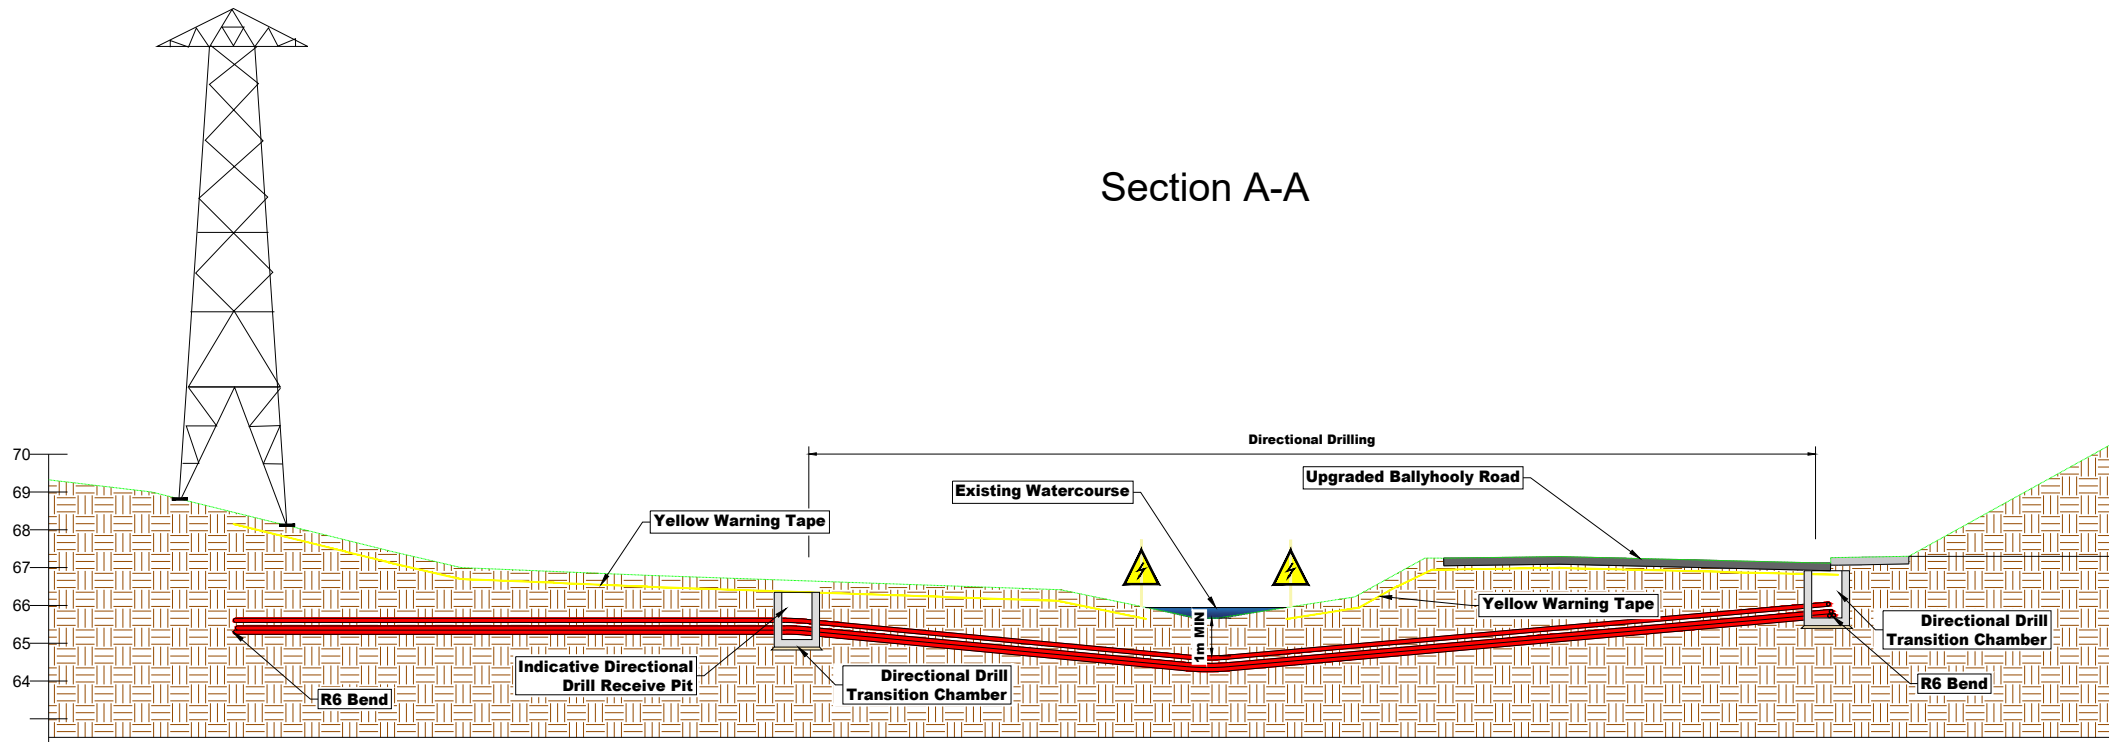

Existing	69.32	68.44	67.21	66.83	66.65	66.48	65.75	66.47	67.29	67.17	67.73	70.32
Cable Depth	65.66	66.66	66.66	65.66	65.63	65.17	64.70	65.02	65.46	65.90	66.32	66.55
Level Difference	3.66	2.78	1.55	1.17	1.02	1.31	1.05	1.45	1.83	1.27	0.00	0.00
Chainage	0.000	5.000	10.000	15.000	20.000	25.000	30.000	35.000	40.000	45.000	50.000	54.680

Scale
1:200 @ A3

Rev	By	Date	Description

Drawing Status: PLANNING
NOT CERTIFIED FOR CONSTRUCTION

Project Title: Longview Estates Development

Drawing Title: Proposed ESB 38kV Diversion Details

Client: Longview Estate Ltd

M.H.L. & Associates Ltd.
Consulting Engineers

Carrig Mór House,
 10 High Street,
 Douglas Road,
 Cork

Tel: 021-4840234
 Fax: 021-4840215
 E-Mail: info@mhl.ie

Designed: SM	Drawn: SFM	Checked: KM
Scale: As Shown	Date: Nov 2019	
Job No: 17066HD	Drawing No: LHD_ESBD_P03	Revision: