



1. ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. RODDING EYE CHAMBER SHALL BE COVERED WITH APPROVED HEAVY DUTY METAL COVERS TO IS 261 AND BS 5834. COVER AND FRAME SHALL BE SUITABLE FOR ROAD AND TRAFFIC CONDITIONS AND IS SUBJECT TO REVIEW BY IRISH WATER.
3. ALL CHAMBERS TO BE CHECKED FOR UPLIFT BY THE DEVELOPER BASED ON GROUND CONDITIONS WITHIN THE SITE. SHOULD ANTI FLOATATION MEASURES BE REQUIRED THEY SHALL BE SUBJECT TO REVIEW BY IRISH WATER.
4. ALL CONCRETE TO BE IN ACCORDANCE WITH IS EN 206.
5. MANHOLE DETAILS TO BE IN ACCORDANCE WITH STD-WW-09, 10 AND 11

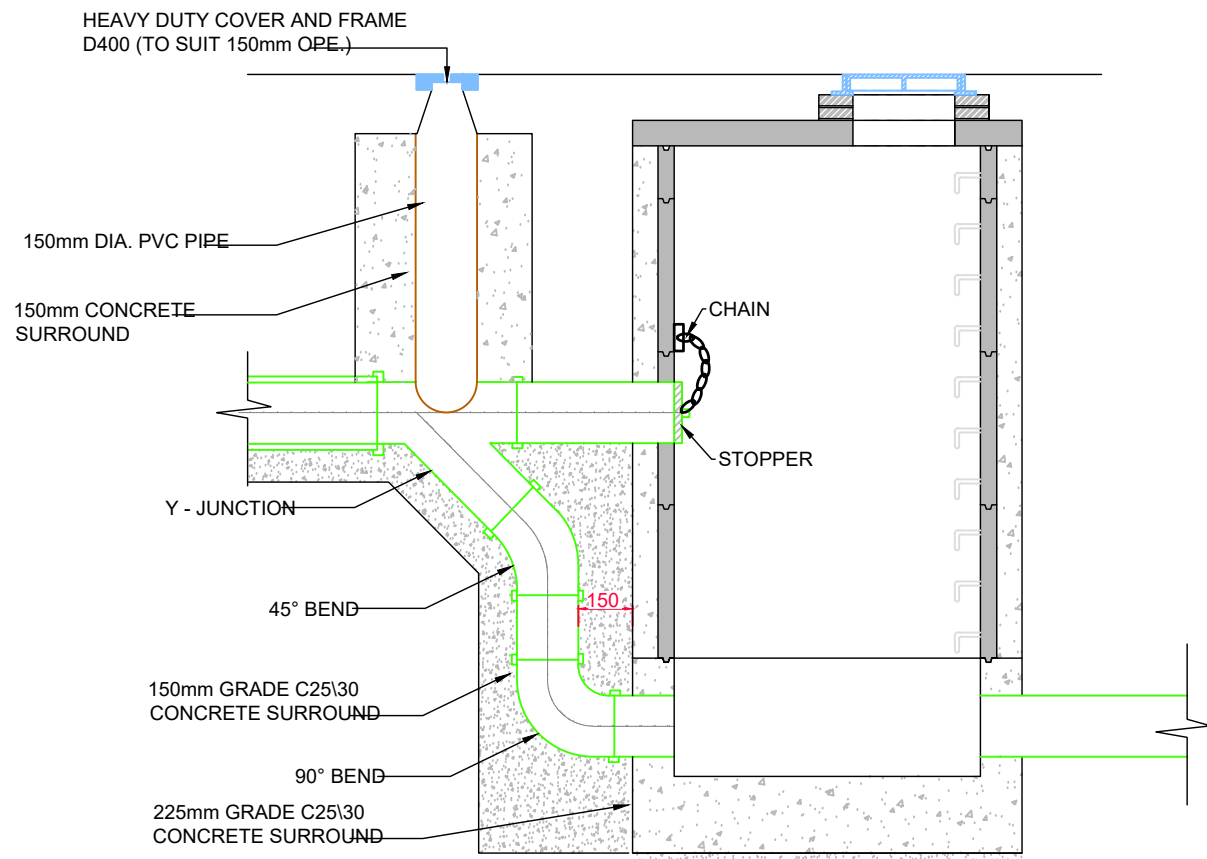


TYPE No. 1

150mm - 450mm DIA. (INCL.) DROP GREATER THAN 1700mm
 500mm - 900mm DIA. (INCL.) DROP GREATER THAN 2300mm

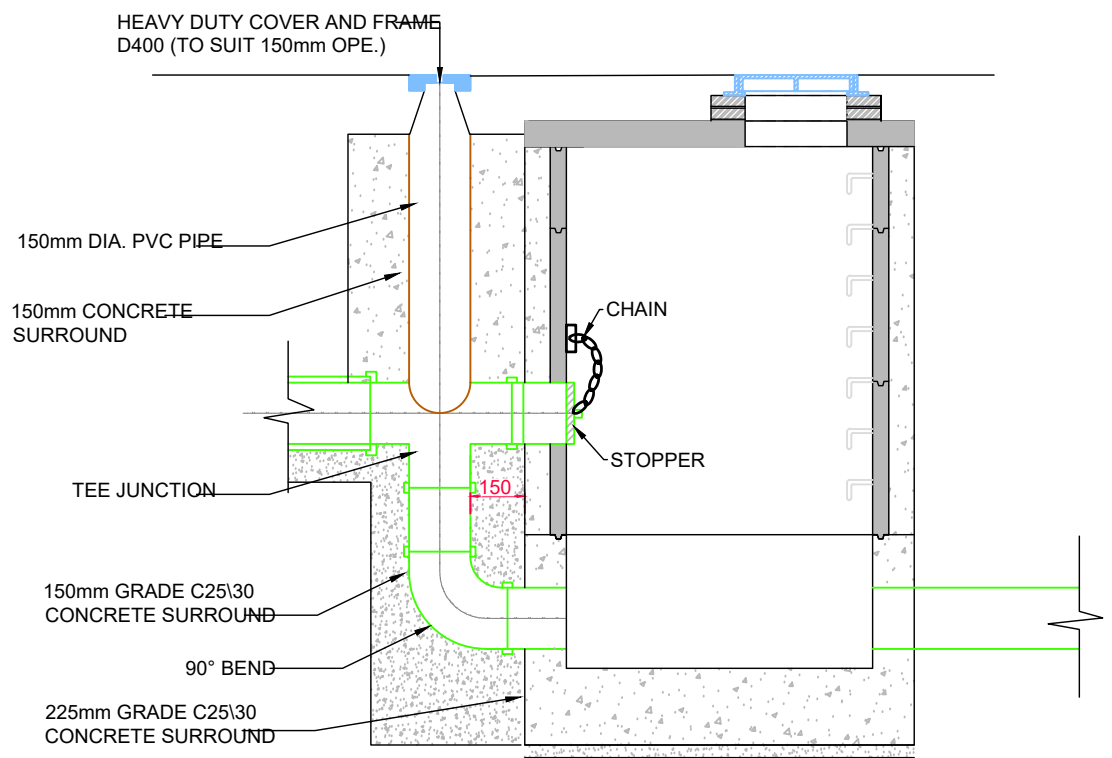

TYPE No. 2

150mm - 450mm DIA. (INCL.) DROP GREATER THAN 900 AND LESS THAN 1700mm
 500mm - 900mm DIA. (INCL.) DROP GREATER THAN 1300mm AND LESS THAN 2300mm

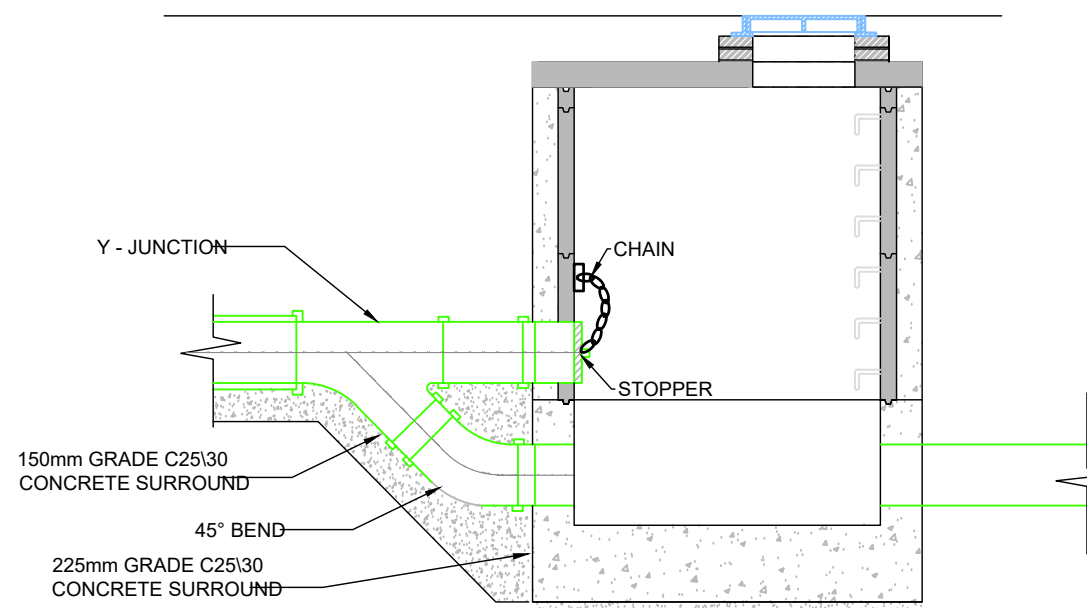

TYPE No. 3

150mm - 450mm DIA. (INCL.) DROP GREATER THAN 600mm AND LESS THAN 900m
 500mm - 900mm DIA. (INCL.) DROP GREATER THAN 600mm AND LESS THAN 1300mm

Rev/By	Date	Description

Drawing Status: PLANNING
NOT CERTIFIED FOR CONSTRUCTION

Project Title: Longview Estates Development

Drawing Title: Manhole Details
 Back-Drop Manhole

Client: Longview Estates Ltd

M.H.L. & Associates Ltd.
Consulting Engineers
 Carrig Mór House,
 10 High Street,
 Douglas Road,
 Cork
 Tel: 021-4840214
 Fax: 021-4840215
 E-Mail: info@mhl.ie

Designed: SM	Drawn: SFM	Checked: KM
Scale: N.T.S	Date: Nov 2019	
Job No: 17066HD	Drawing No: LHD_SCD_P06	Revision:

**Manhole Detail as per
 STD-WW-12**