

Notes:


- 1. This Drawing should be read in conjunction with External Site Lighting Report.

Symbols Reference:

- XL1 Public Roadway Lighting c/w 20W LED Light, source fixed to a 6m galvanised steel, hex-cross section column, Lower/Raise Type to Dun Laoghaire-Rathdown Co. Co., Public Lighting Standard (Thorn Isaro Pro).
XL2 Public Lighting Lantern c/w 14W LED Light, source fixed to a 6m galvanised steel, hex-cross section column, Lower/Raise Type to Dun Laoghaire-Rathdown Co. Co., Public Lighting Standard (Thorn Isaro Pro).
XL3 3.6m Wand Type External Light Fitting.
XL4 Wall Mounted Light Fitting.
XL5 Recessed Downlight.
XL6 4.2m Post Top Lantern with Louvre.
XL7 Recessed Low Level Indirect Wall Mounted Light Fitting.
XL8 900mm High Ballard.
XL9 Public Roadway Lighting c/w 89W LED Light, source fixed to a 6m galvanised steel, hex-cross section column, Lower/Raise Type to Dun Laoghaire-Rathdown Co. Co., Public Lighting Standard (Thorn Isaro Pro).
Site Boundary.
Dún Laoghaire-Rathdown County Council - Taken in Charge - Parks.
Dún Laoghaire-Rathdown County Council - Taken in Charge - Roadway.
Outline of Apartment Block.
Private Development Areas.




Thorn Isaro Pro

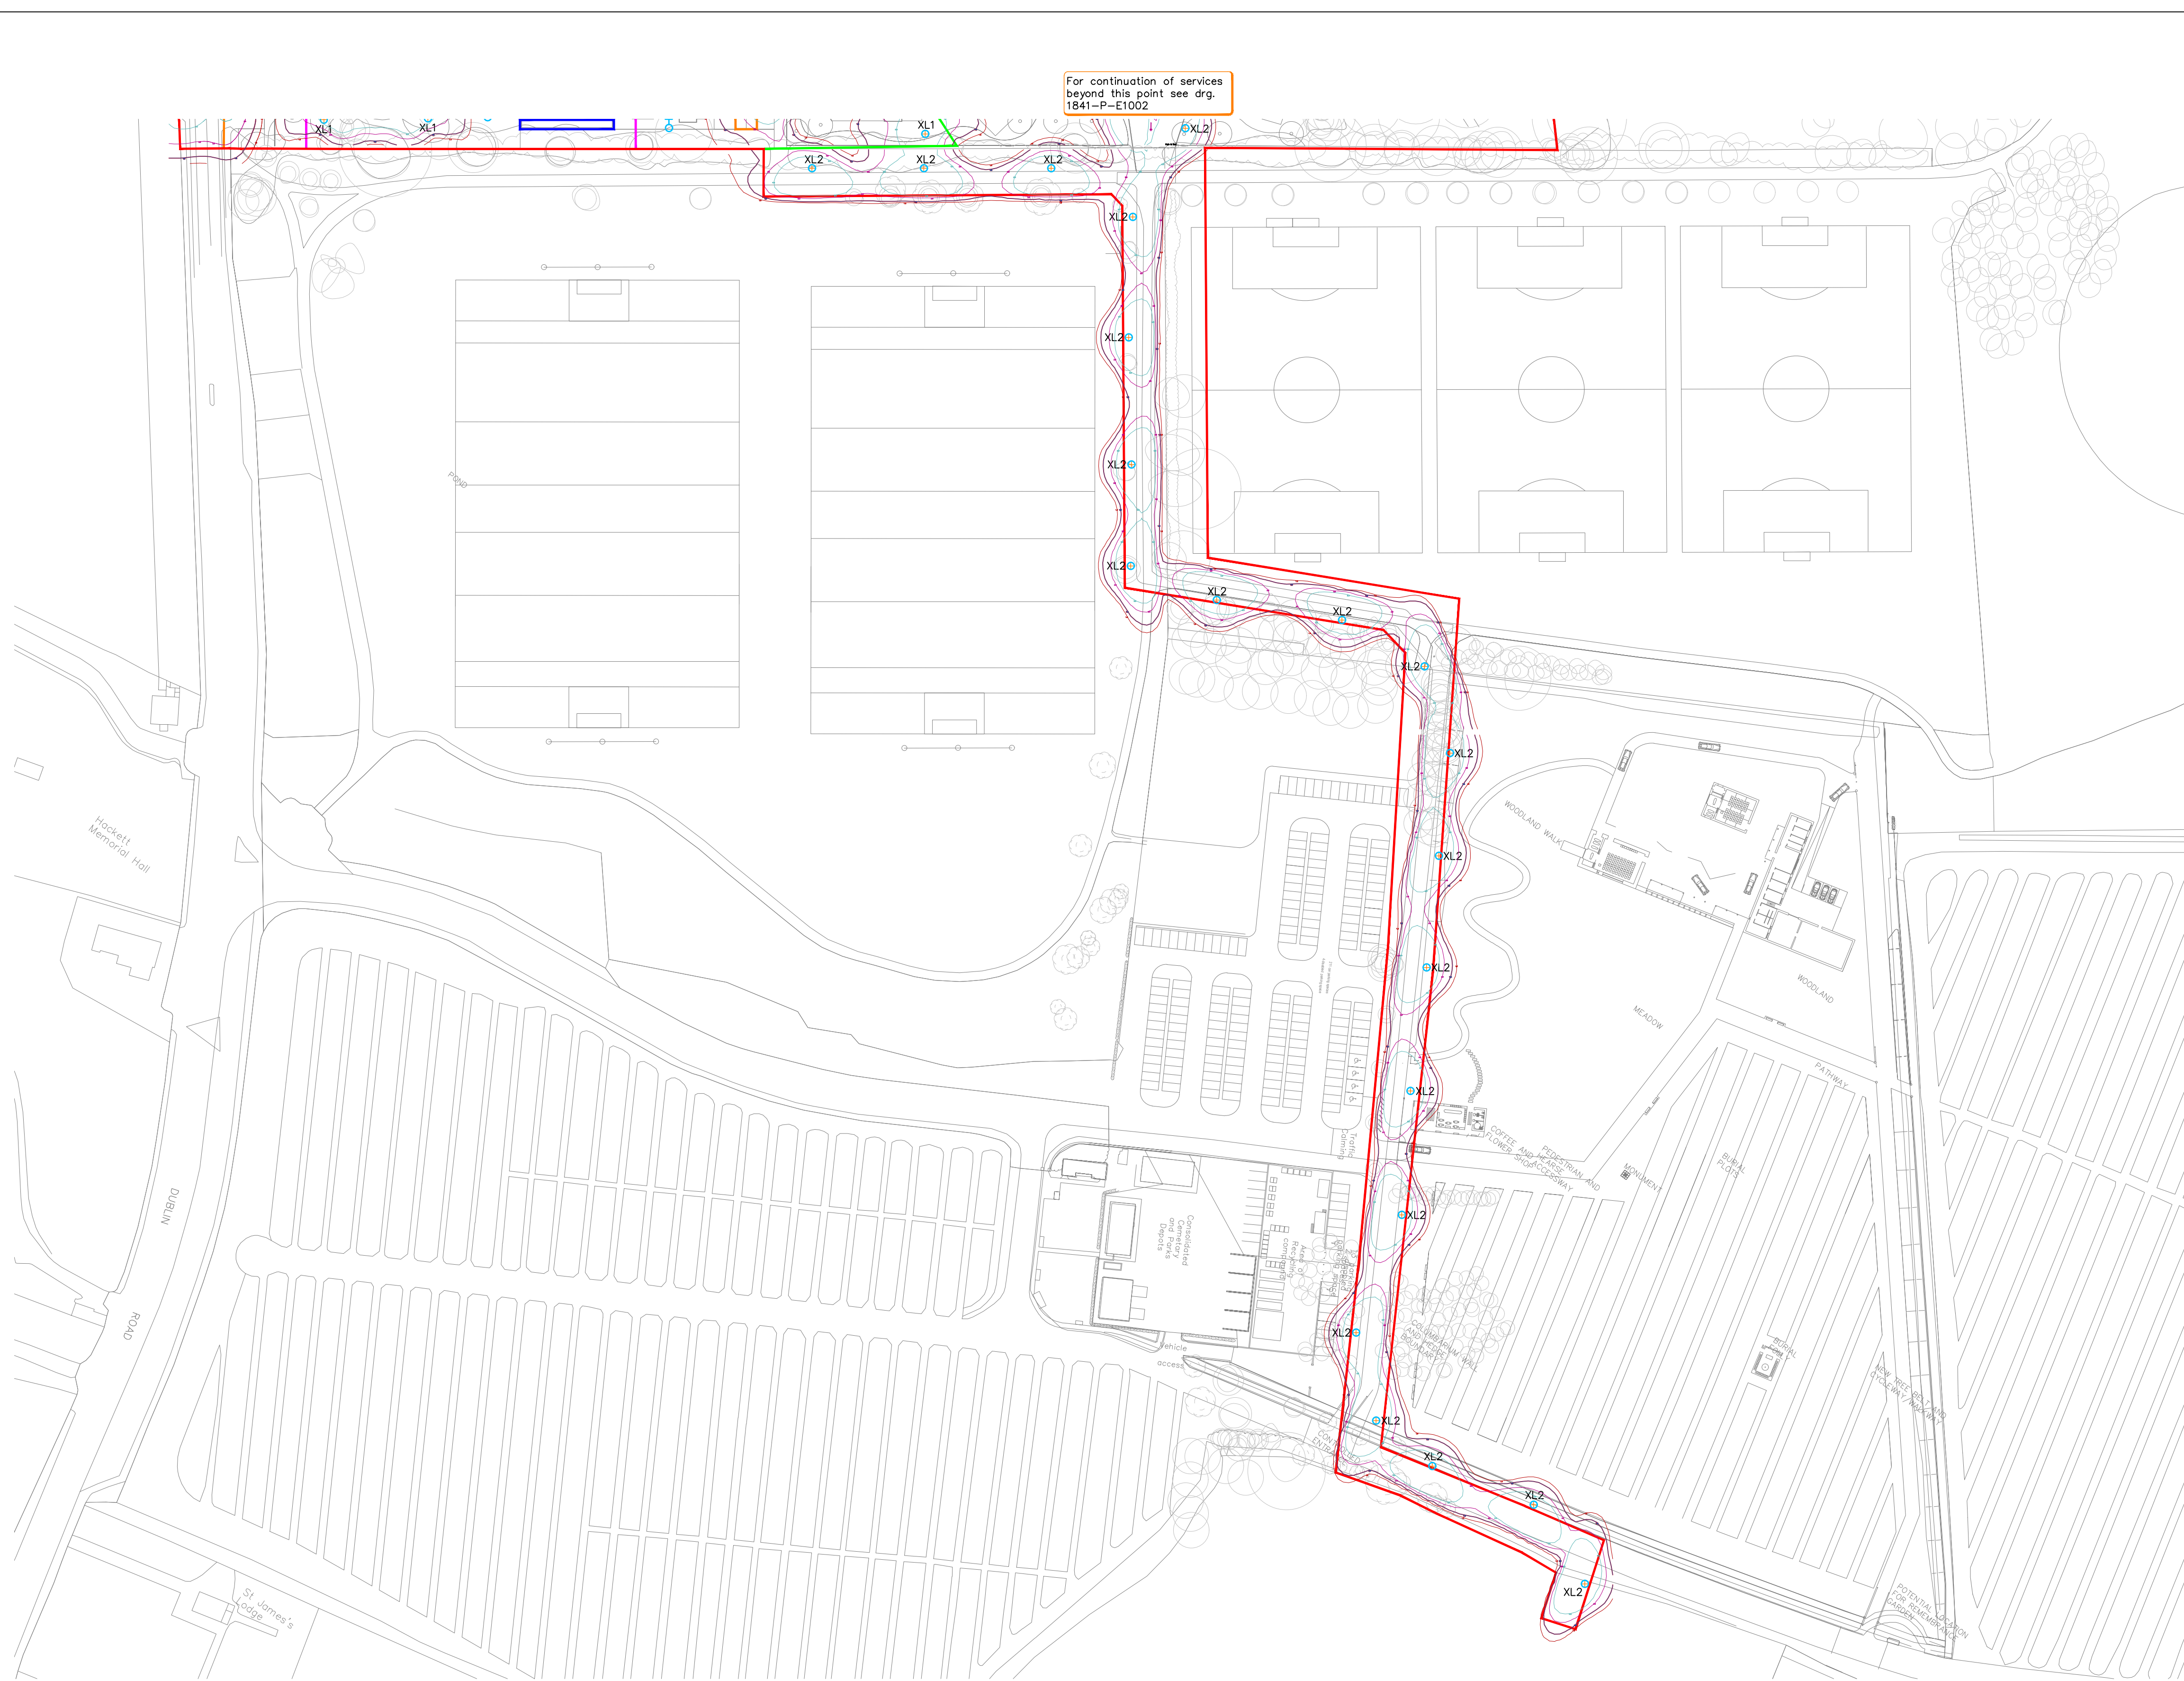

For continuation of services beyond this point see drg. 1841-P-E1002

ISSUED FOR PLANNING

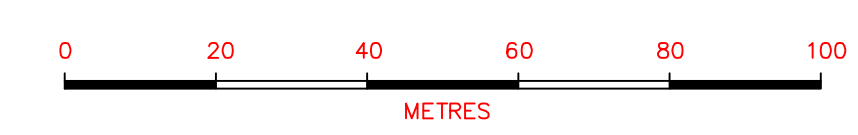

Revision table with columns for Issue (P-Preliminary, T-Tender, CN-Construction, A-Approval, I-Information), Date, Checked, and Revision. Includes a row for 'Issued for Planning' on 24-01-2020.

HOMAN O'BRIEN Consulting Engineers contact information, logo for Comhairle Contae Dublin (dlr), and project details for Shanganagh Castle Residential Dev. including architect ABK Architects.