


KEY PLAN (NTS)

LEGEND

Proposed Route for 220kV CIRCUIT 1	
Proposed Route for 220kV CIRCUIT 2	
Lands in Applicant's Control	
Application Site Boundary	
Proposed Development	
Permitted Development	
Existing ESB Wayleave	
Permitted Attenuation Pond	
Proposed 4 m Wide Access Path Refer to Details on Drawing Proj_G-CSE-00-XX-DR-C-2550	
Proposed Surface Water	
Proposed Foul Sewer	
Proposed Watermain	
Permitted Watermain	
Permitted Surface Water	
Permitted Foul Sewer	
Existing Surface water	
Existing HV ESB ducts (Wayleave)	

NOTE:
The Services indicate in the cross Section as "Permitted" have been granted permission under the Planning Ref No. PL06F. 248544 and Fingal County Council Ref No. FW17a/0025

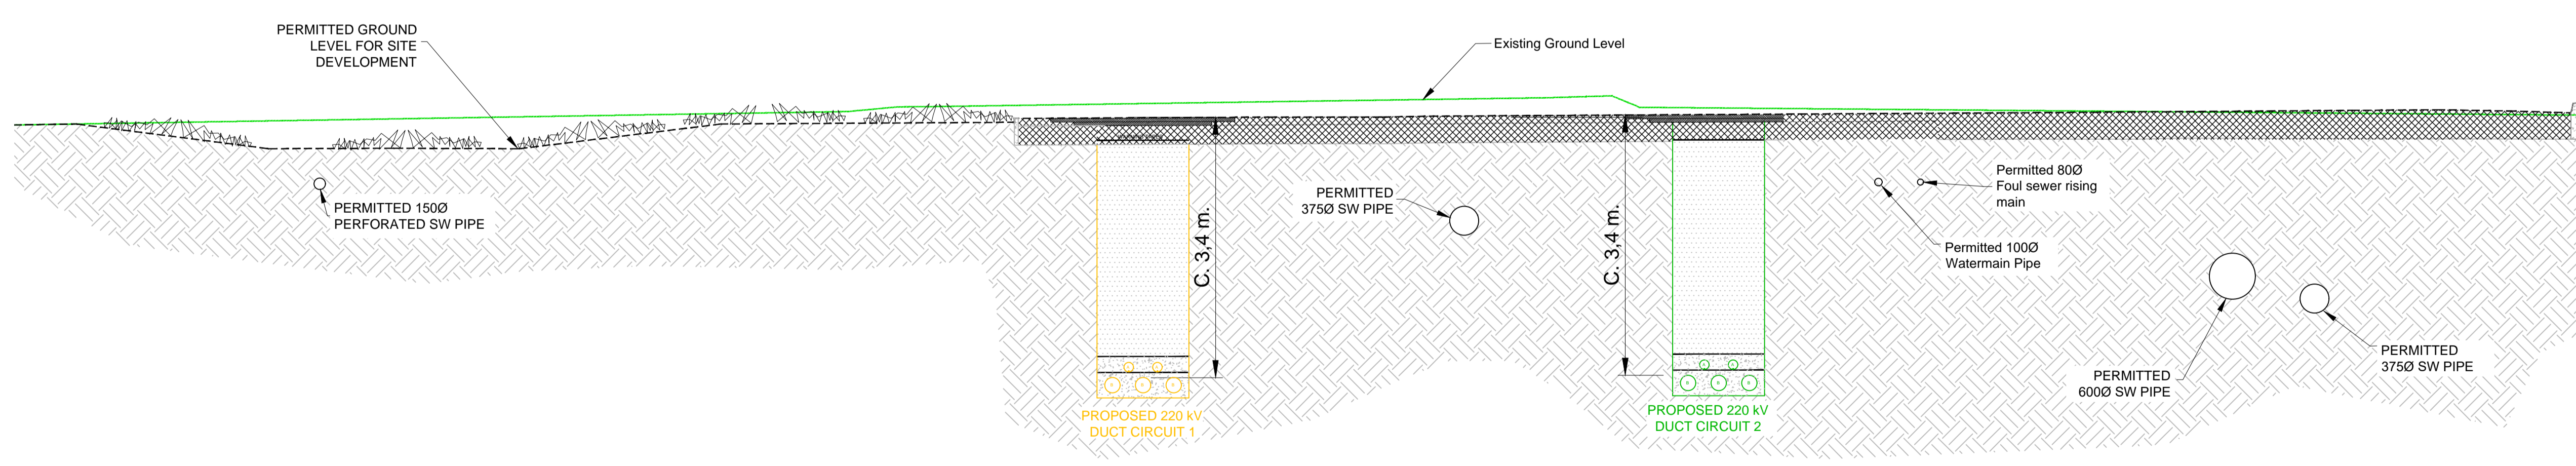

SECTION 1-1
SCALE 1:50

P09	ISSUED FOR PLANNING	ZS	HF	28/02/2020
Rev	Description	Drawn	Checked	Date

Clifton Scannell Emerson Associates Limited
Consulting Engineers,
Sailfort Lodge,
Castledawson Avenue,
Blackrock, Co. Dublin,
Ireland, A94 P768
T: +353 1 288 5006
F: +353 1 283 3466
E: info@csea.ie
W: www.csea.ie

Client	CRUISERATH 220 kV SUBSTATION & TRANSMISSION LINE
Project	PROPOSED 220 kV ROUTE LAYOUT PLAN & SECTION - SHEET 1 OF 6
Dwg. Title	
Drawn By	LT
Date	12/08/2019
Checked By	HF
Scale	1:500 @ A1
CSEA Job No.	17_014
Project Code	PROJ_G - CSE - 00 - XX - DR - C - 2221
Originator	
Zone/Phase	
Level	
Type	
Role	
Dwg. No.	

S2	FOR INFORMATION
Status Code	Suitability Description
P09	PLANNING
Revision	Project Status