


KEY PLAN (NTS)

LEGEND

- Proposed Route for 220kV CIRCUIT 1: Yellow line
- Proposed Route for 220kV CIRCUIT 2: Green line
- Lands in Applicant's Control: Blue hatched area
- Application Site Boundary: Red line
- Permitted Development: Grey hatched area
- Existing ESB Wayleave: Yellow hatched area
- Permitted Attenuation Pond: Cyan area
- Proposed 4 m Wide Access Path: Blue grid pattern
- Existing HV ESB ducts (Wayleave): Dashed lines with 'ESB' labels

NOTE:
 The Services indicate in the cross Section as "Permitted" have been granted permission under the Planning Ref No. PL06F. 248544 and Fingal County Council Ref No. FW17a/0025

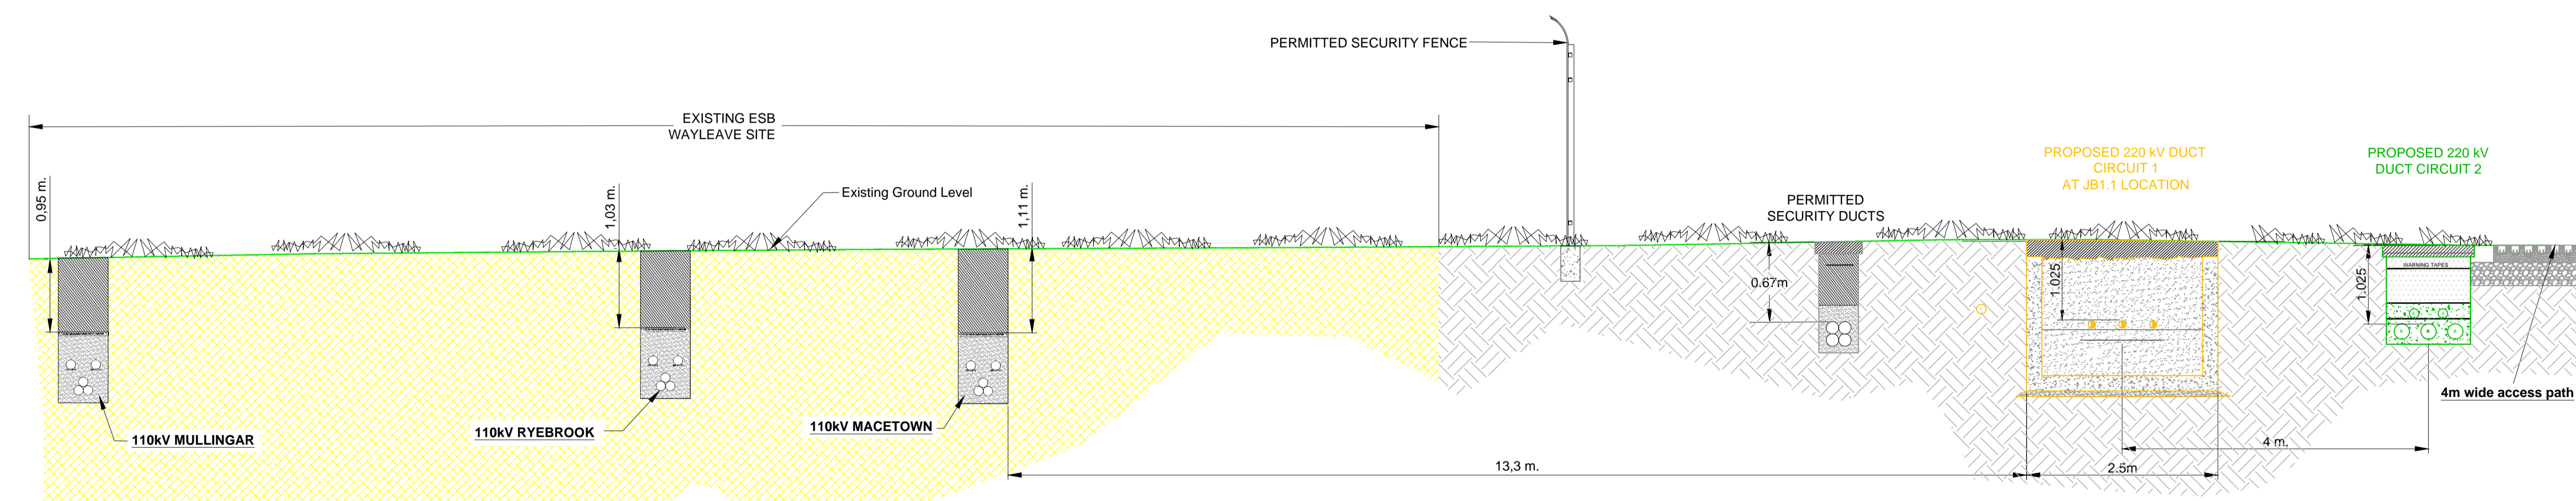

SECTION 2-2
 SCALE 1:50

P09	FOR PLANNING	ZS	HF	28/02/2020
Rev	Description	Drawn	Checked	Date

Clifton Scannell Emerson Associates
 Consulting Engineers, Salford Lodge, Castledawson Avenue, Blackrock, Co. Dublin, Ireland, A94 P768
 T: +353 1 288 5006
 F: +353 1 283 3466
 E: info@csea.ie
 W: www.csea.ie

Client: CRUISERATH 220 kV SUBSTATION & TRANSMISSION LINE				
Project: PROPOSED 220 kV ROUTE LAYOUT PLAN & SECTION - SHEET 2 OF 6				
Drawn By	LT	Date	12/08/2019	17_014
Checked By	HF	Scale	1:500 @ A1	CSEA Job No.
Project Code	Originator	Zone/Phase	Level	Type
PROJ_G - C - 00 - XX - DR - C - 2222				
S2	FOR INFORMATION			
Status Code	Suitability Description			
P09	PLANNING			
Revision	Project Status			