


KEY PLAN (NTS)

LEGEND

Proposed Route for 220kV CIRCUIT 1	
Proposed Route for 220kV CIRCUIT 2	
Application Site Boundary	
Proposed 4 m Wide Access Path Refer to Details on Drawing Proj_G-CSE-00-XX-DR-C-2550	
Existing SW Attenuation Pond	
Existing HV ESB ducts	
Existing HV ESB Overhead Lines	
Existing ESB Pylon	

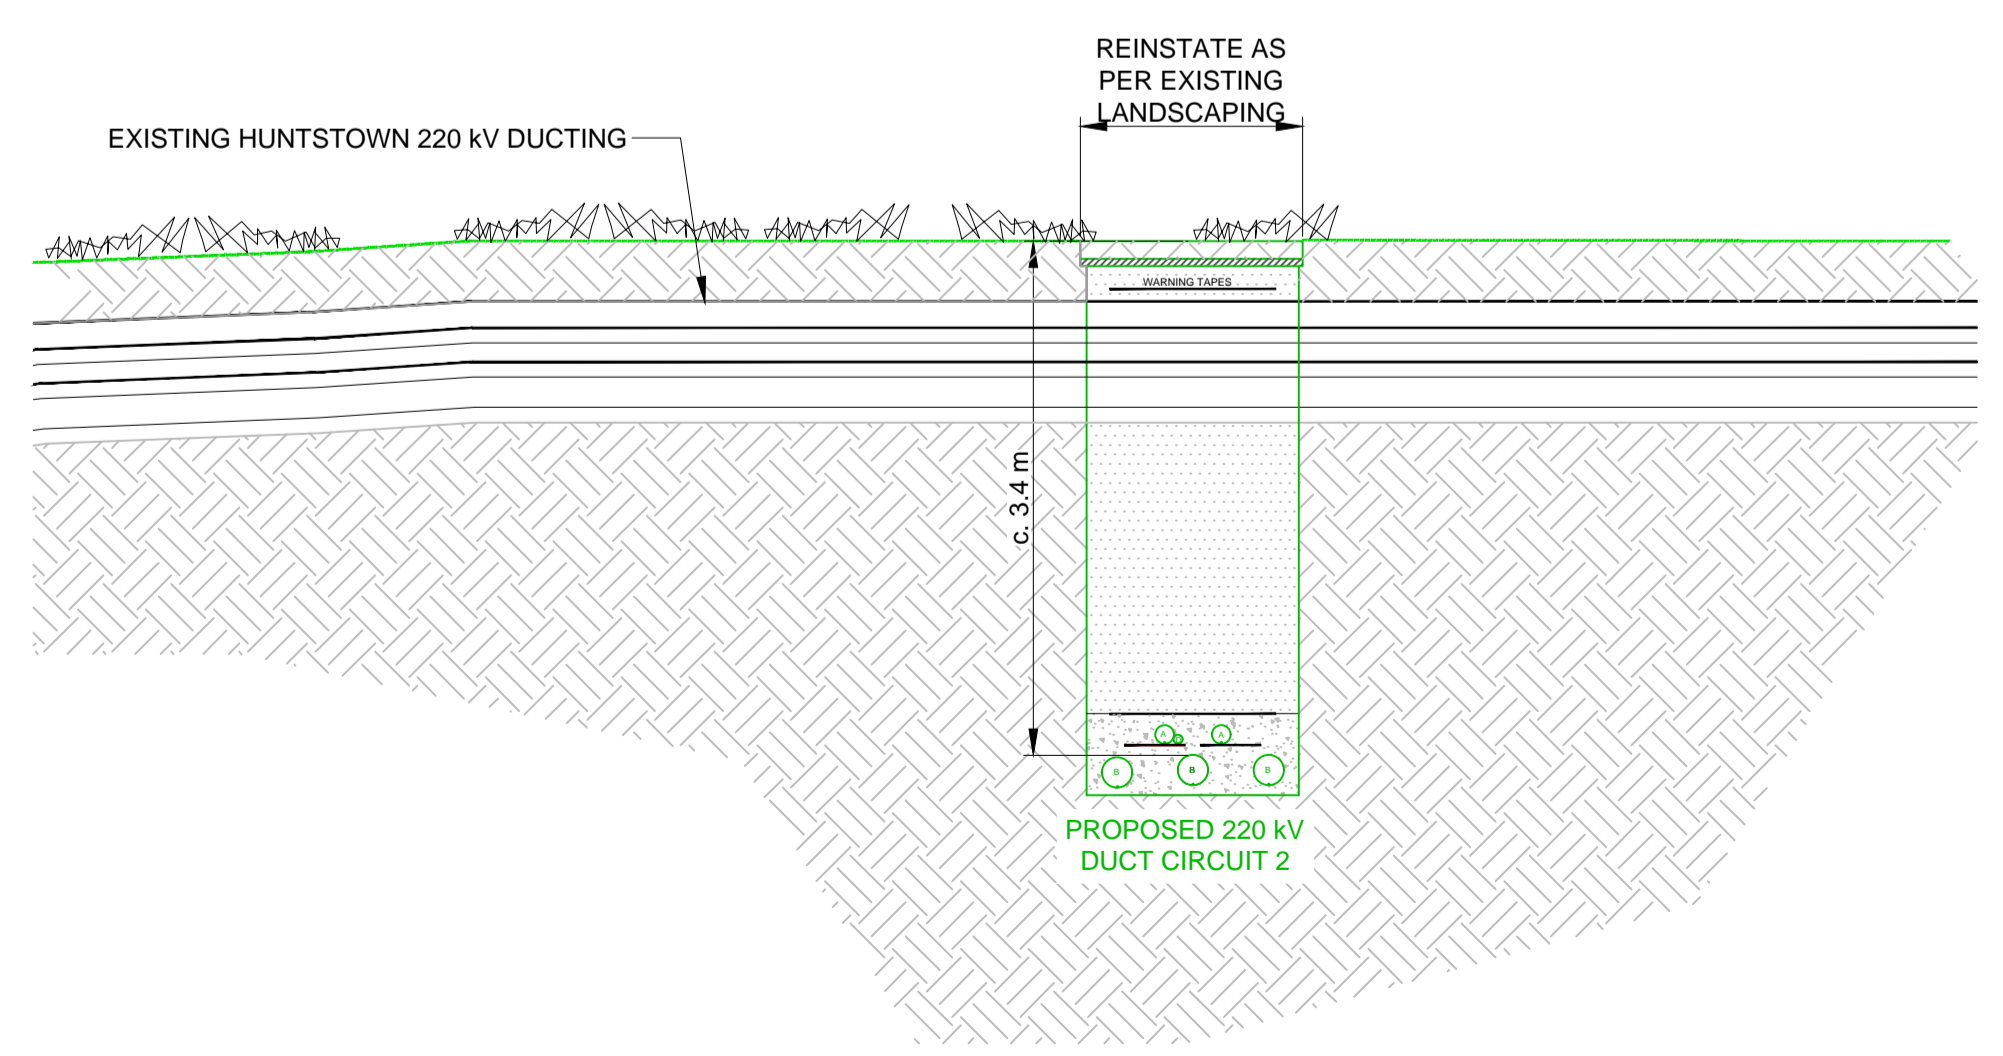

SECTION 6-6
SCALE 1:50

Rev	Description	Drawn	Checked	Date
P10	FOR PLANNING	ZS	HF	28/02/2020

Clifton Scannell Emerson Associates Limited
 Consulting Engineers, Surveyors, Architects, Planners, Environmental Engineers, Energy Engineers, Fire Engineers, Structural Engineers, Traffic Engineers, Transport Engineers, Water Engineers, Wind Engineers, and other disciplines.
 Clifton Lodge, Castleknock Avenue, Blackrock, Co. Dublin, Ireland, A94 P768
 T: +353 1 288 5006
 F: +353 1 283 3466
 E: info@csea.ie
 W: www.csea.ie

Client: **CRUISERATH 220 kV SUBSTATION & TRANSMISSION LINE**
 Project: **PROPOSED 220 kV ROUTE LAYOUT PLAN & SECTION - SHEET 6 OF 6**
 Dwg. Title: **PROPOSED 220 kV ROUTE LAYOUT PLAN & SECTION - SHEET 6 OF 6**
 Drawn By: **LT** Date: **12/08/2019** Scale: **1:500 @ A1** Job No.: **17_014**
 Checked By: **HF** Scale: **1:500 @ A1** CSEA Job No.: **17_014**

Project Code: **PROJ_G - CSE - 00 - XX - DR - C - 2226**
 Status Code: **S2** FOR INFORMATION
 Suitability Description: **P10** FOR INFORMATION
 Revision: **P10** Project Status: **PLANNING**