


Reinstatement Cross Section at Joint Bay 1
SCALE 1:10

NOTE:
 1. Refer to drawing Proj_G-CSE-00-XX-DR-C-2554 for Joint bay construction details
 2. Refer to drawing Proj_G-CSE-00-XX-DR-C-2555 for Link box construction details

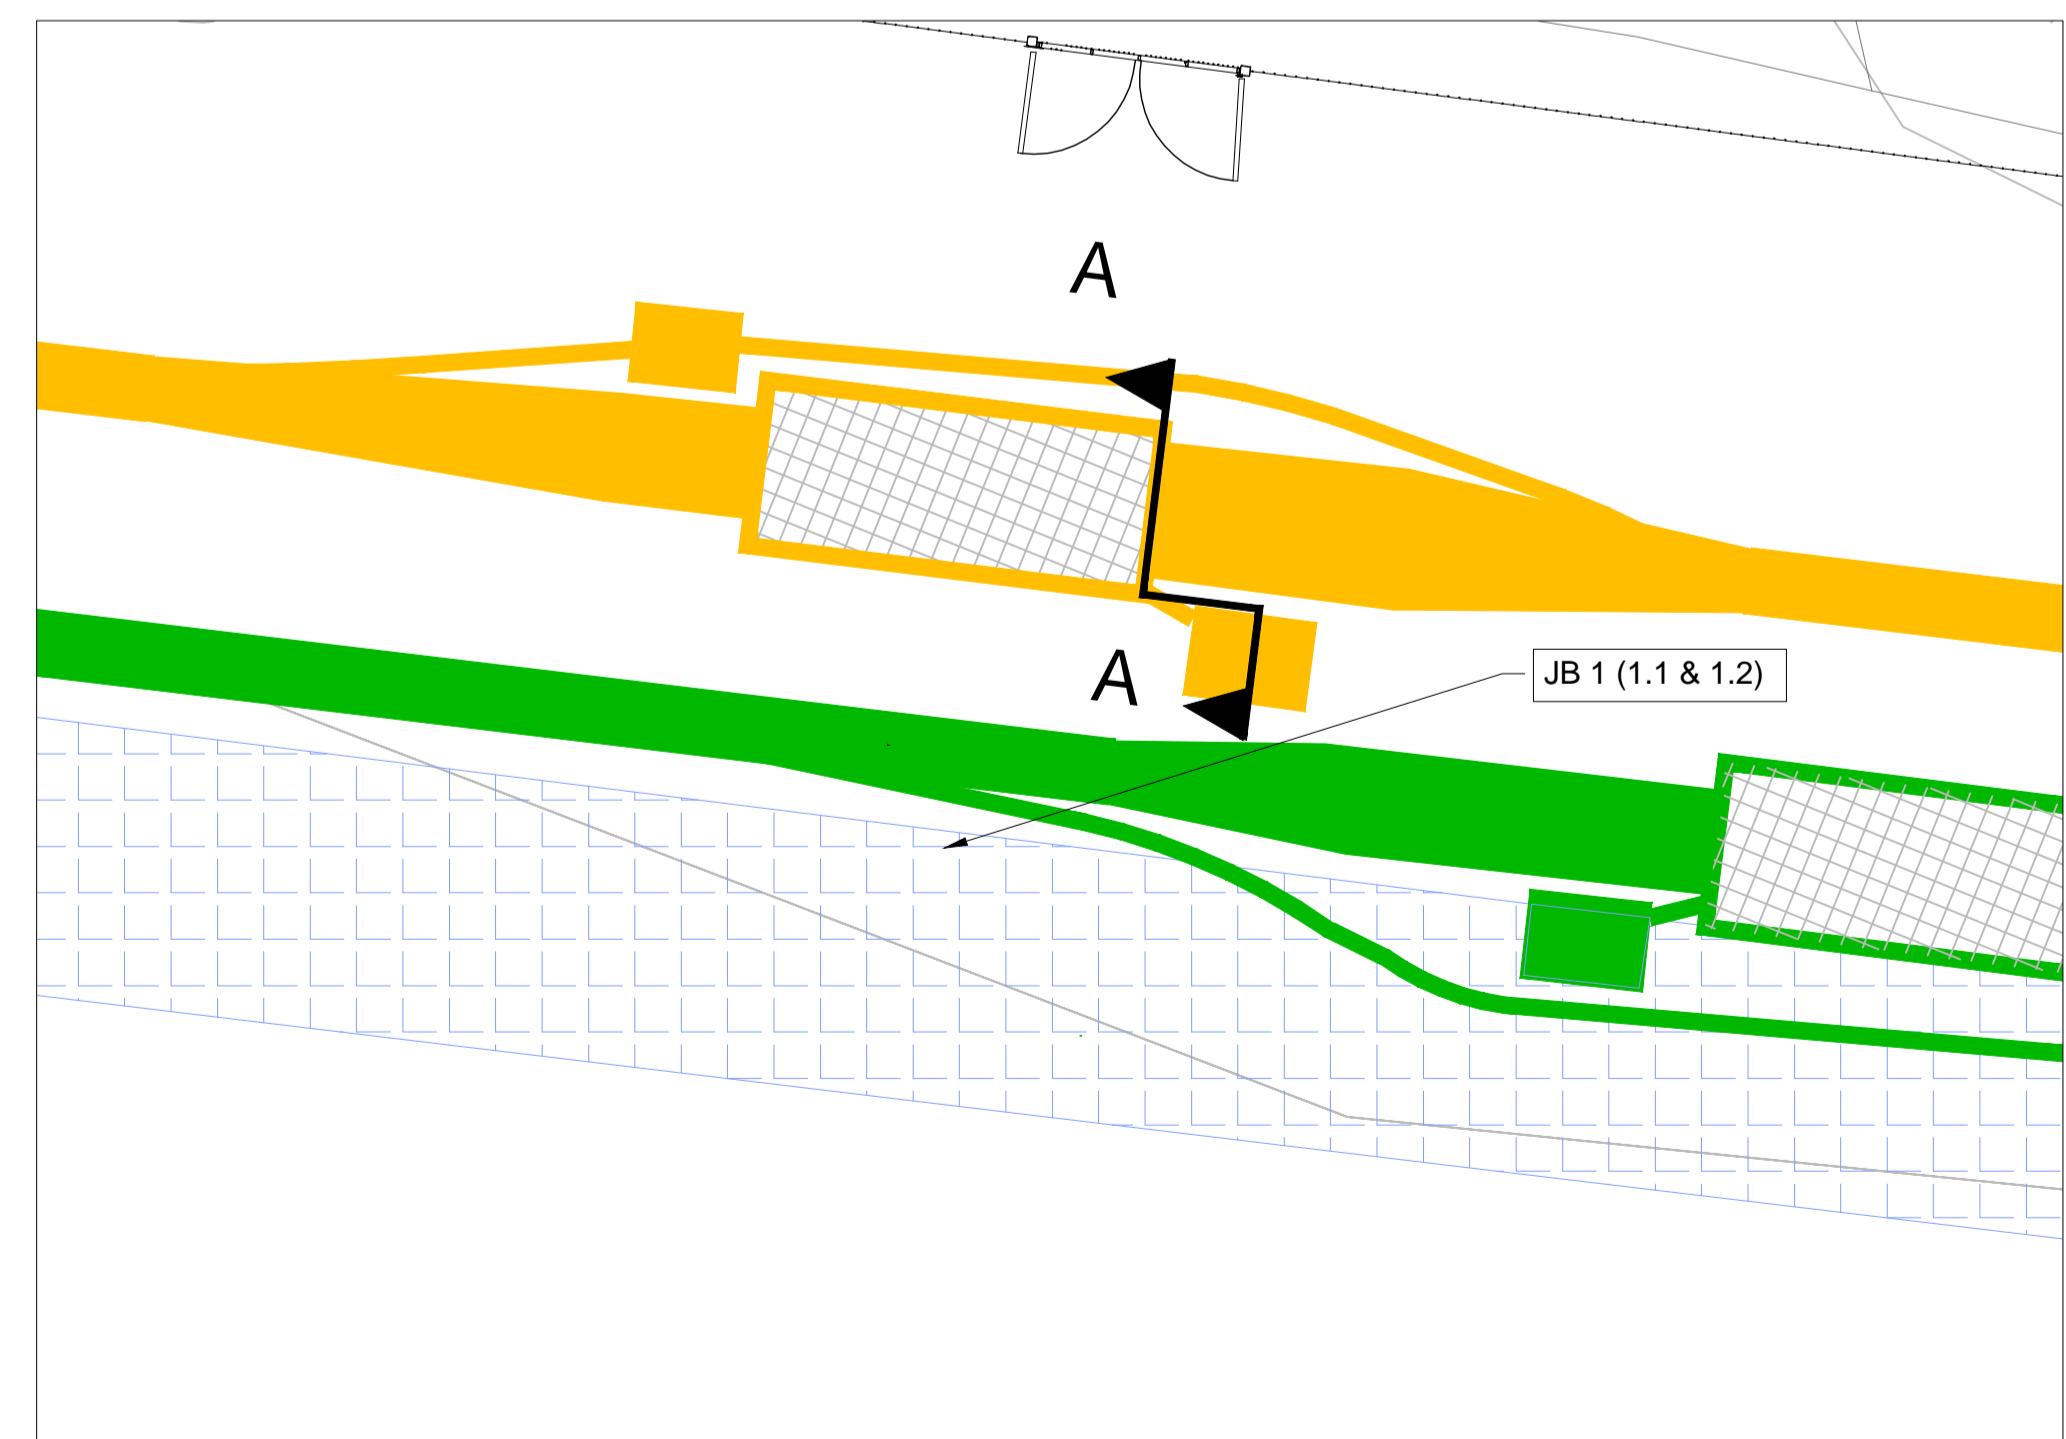

Section at Joint Bay 1
N.T.S.

LEGEND

- Proposed Route for 220kV CIRCUIT 1 ———
- Proposed Route for 220kV CIRCUIT 2 ———
- Proposed 4 m Wide Access Path
Refer to Details on Drawing Proj_G-CSE-00-XX-DR-C-2550
- Proposed Cables ☯

Rev	Description	Drawn	Checked	Date
P07	FOR PLANNING	ZS	HF	28/02/2020

Clifton Scannell Emerson Associates Limited
 Consulting Engineers,
 Salford Lodge,
 Castledawson Avenue,
 Blackrock, Co. Dublin,
 Ireland, A94 P768

T: +353 1 288 5006
 F: +353 1 283 3466
 E: info@csea.ie
 W: www.csea.ie

Client				
CRUISERATH 220 kV SUBSTATION & TRANSMISSION LINE				
Project				
TYPICAL REINSTATEMENT DETAILS SHEET 2 OF 2				
Dwg. Title				
Drawn By	LT	Date	14_08_2019	17_014
Checked By	HF	Scale	1:10 @ A1	CSEA Job No.
Project Code	Originator	Zone/Phase	Level	Type
PROJ_G - CSE - 00 - XX - DR - C - 2551				
S2 FOR INFORMATION				
Status Code	Suitability Description			
P07	PLANNING			
Revision	Project Status			