


Scale 1:10


-Road Surface Level Topsoil Reinstatement — -Marker tape shall be of non corrodible material of bright yellow/red and shall cover the width of Suitably Excavated Material, Reinstated / ducting in trench and Compacted In Layers of 150mm shall read "DANGER -ELECTRIC CABLE" Sand Surround or Peat If — Present at Location -37mm Outer Diameter HDPE Low Friction Duct for Fibre Optic Cable Earthing-Conductor

COLLECTOR CIRCUIT VERGE

Scale 1:10

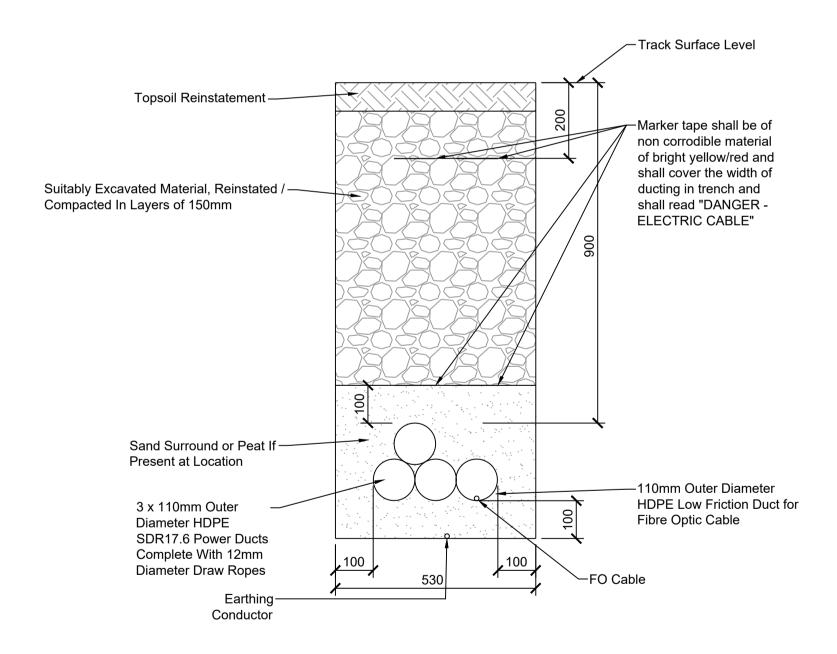

COLLECTOR CIRCUIT VERGE Scale 1:10

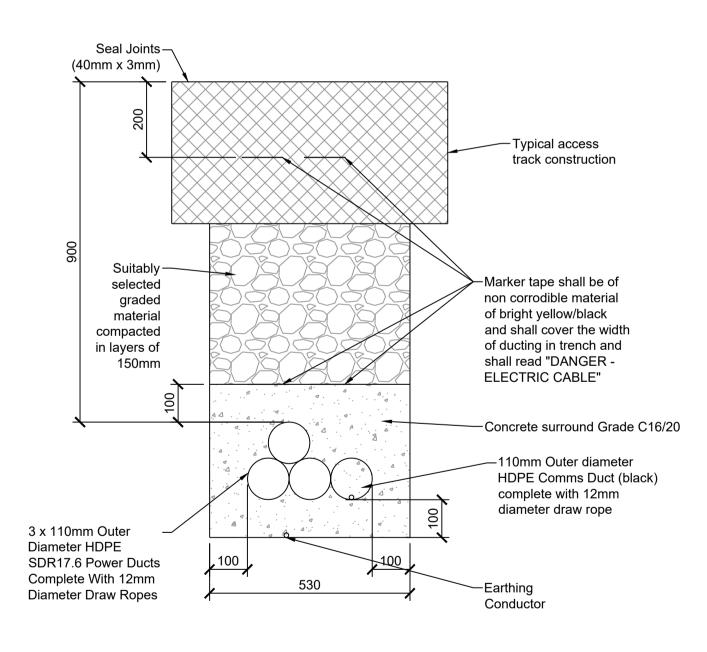

COLLECTOR CIRCUIT CENTRE Scale 1:10

If Applicable: Ordnance Survey Ireland Licence No. CYAL50221678 © Ordnance Survey Ireland and Government of Ireland



No part of this document may be reproduced or transmitted in any form or stored in any retrieval system of any nature without the written permission of Fehily Timoney & Company as copyright holder except as agreed for use on the project for which the document was originally issued. Do not scale. Use figured dimensions only. If in doubt - Ask!

Rev.	Description	Арр Ву	Date
Α	ISSUE FOR PLANNING	н	08.03.23

PROJECT	CLIENT							
BARNADIVANE WIND FARM UPDATED EIAR	BARNA WIND ENERGY (B.W.E.) LTD							
SHEET	Date	08.03.23	Project number P21-143	Scale (@ A1) 1:10				
TRENCH DETAILS FOR INTERNAL COLLECTOR CABLES	Drawn by	POR	Drawing Number		Rev			
	Checked by	СС	P21-143-0200-0007	Α				
O:\ACAD\2021\P21-143\P21-143-0200-0007								