


- NOTES:
- DO NOT SCALE. USE FIGURED DIMENSIONS ONLY.
 - THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT ARCHITECTURAL AND ENGINEERING DRAWINGS.
 - ALL PIPE MATERIALS TO BE IN ACCORDANCE WITH IRISH WATER STANDARDS AND SPECIFICATIONS.
 - ALL SERVICE CONNECTIONS TO BE 25# HDPE(SDR-17).
 - ALL WATERMANS UNDER ROADS OR AT ROAD CROSSINGS TO BE HDPE OR DUCTILE IRON.
 - HDPE DISTRIBUTION PIPES TO BE PE-100(SDR-17).
 - DUCTILE IRON PIPES TO IS EN 545 WITH C40 POWER RATING.
 - IT IS THE CONTRACTORS RESPONSIBILITY TO ENSURE THAT ALL WORKS ARE CONSTRUCTED IN ACCORDANCE WITH THE IRISH WATER CODE OF PRACTICE AND STANDARD DETAILS. THE CODE OF PRACTICE AND STANDARD DETAILS ARE AVAILABLE TO DOWNLOAD FROM THE IRISH WATER WEB SITE AT WWW.WATER.IE/CONNECTIONS/DEVELOPER-SERVICES/ WHERE THE DETAILS CONTAINED ON THIS DRAWING DIFFER FROM THE IRISH WATER CODE OF PRACTICE OR STANDARD DETAILS THIS MUST BE BROUGHT TO THE ATTENTION OF THE ENGINEER IMMEDIATELY. IRISH WATER STANDARDS WILL TAKE PRECEDENCE.

LEGEND

	SHD SITE BOUNDARY PHASE 2
	SITE BOUNDARY PHASE 1 APPROVED DEVELOPMENT ABP REF PL17.241988 UNDER CONSTRUCTION
	PROPOSED 225mm# HDPE WATERMAIN (SDR17 PE100)
	PROPOSED 180mm# HDPE WATERMAIN (SDR17 PE100)
	PROPOSED 110mm# HDPE WATERMAIN (SDR17 PE100)
	EXISTING WATERMAIN WATERMAIN
	PROPOSED SLUICE VALVE
	PROPOSED HYDRANT
	PROPOSED WATER METER
	PROPOSED AIR VALVE
	PROPOSED SCOUR VALVE
	PROPOSED BOUNDARY BOX AND CONNECTION

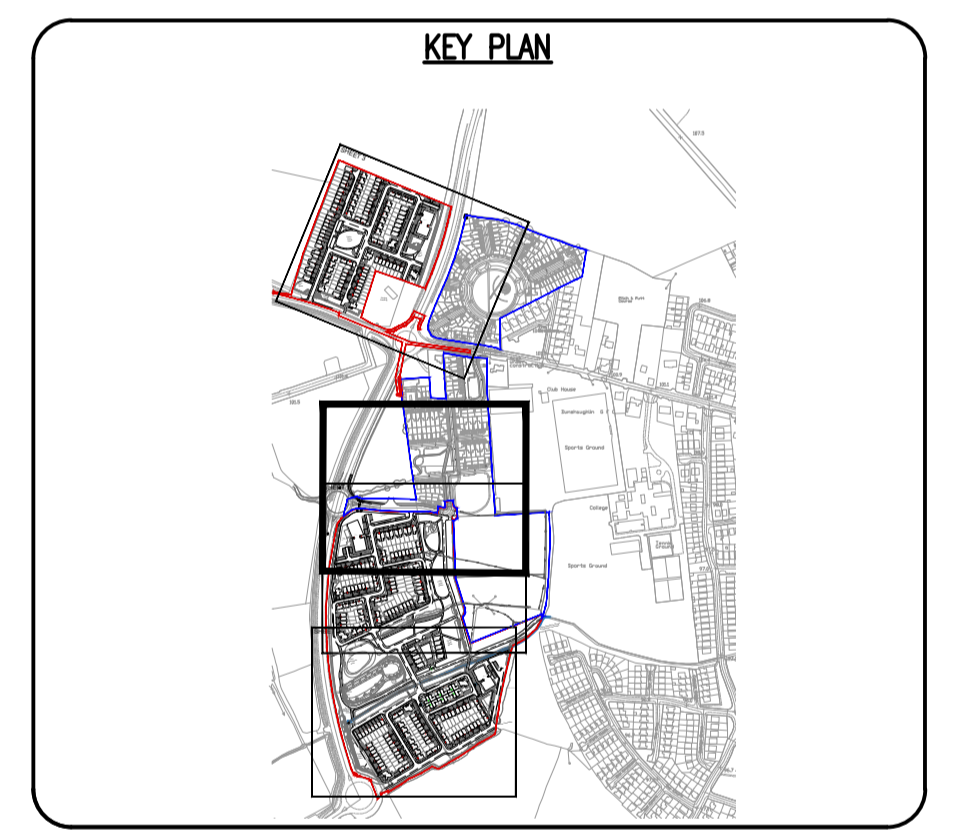

Ordnance Survey Ireland Licence No. EN 0006020
Ordnance Survey Ireland/Government of Ireland.

A	02/10/20	SHD APPLICATION ISSUE	MK	IS
~	18/03/20	SHD PRE-APPLICATION ISSUE	MK	IS
REV.	DATE	AMENDMENT	DRN	APPD

STATUS **FOR SHD APPLICATION**

Waterman Moylan
Engineering Consultants

BLOCK 5, EASTPOINT BUSINESS PARK, ALFIE BYRNE ROAD, DUBLIN D03 H3F4 IRELAND. Tel: (01) 664 8900
Email: info@waterman-moylan.ie www.waterman-moylan.ie

CLIENT	CASTELTHORN CONSTRUCTION ULC
ARCHITECT	O'MAHONY PIKE ARCHITECTS
PROJECT	PROPOSED PHASE 2 RESIDENTIAL DEVELOPMENT AT DUNSHAUGHLIN, CO. MEATH

TITLE
WATERMAIN LAYOUT SHEET 1 OF 3

DRAWN	DESIGNED	APPROVED	DATE
MK	KV	IS	MARCH 2020
SCALE	JOB NO.	DRG. NO.	REVISION
1:500 @ A1	12-081A	P311	A

© 2017. This drawing is copyright. No part of this document may be reproduced or transmitted in any form or stored in any retrieval system of any nature without the written permission of the consulting engineer or copyright holder except as agreed for use on the project for which the document was originally issued.