


**LEGEND:**

- PROPOSED SID APPLICATION SITE BOUNDARY
- LANDS IN THE OWNERSHIP OF THE APPLICANT/  
LANDOWNER.
- EXISTING WAYLEAVES
- EXISTING 110KV OVERHEAD LINE
- EXISTING 38KV OVERHEAD LINE



P05	SID ISSUE	DM	PM	05.11.2020
P04	SID ISSUE	DM	PM	03.11.2020
P03	EIRGRID REVIEW	DM	PM	13.10.2020
P02	DP01 ISSUE	DM	PM	07.09.2020
P01	FOR DISCUSSION	DM	PM	28.08.2020
Rev	Description	Drawn	Checked	Date

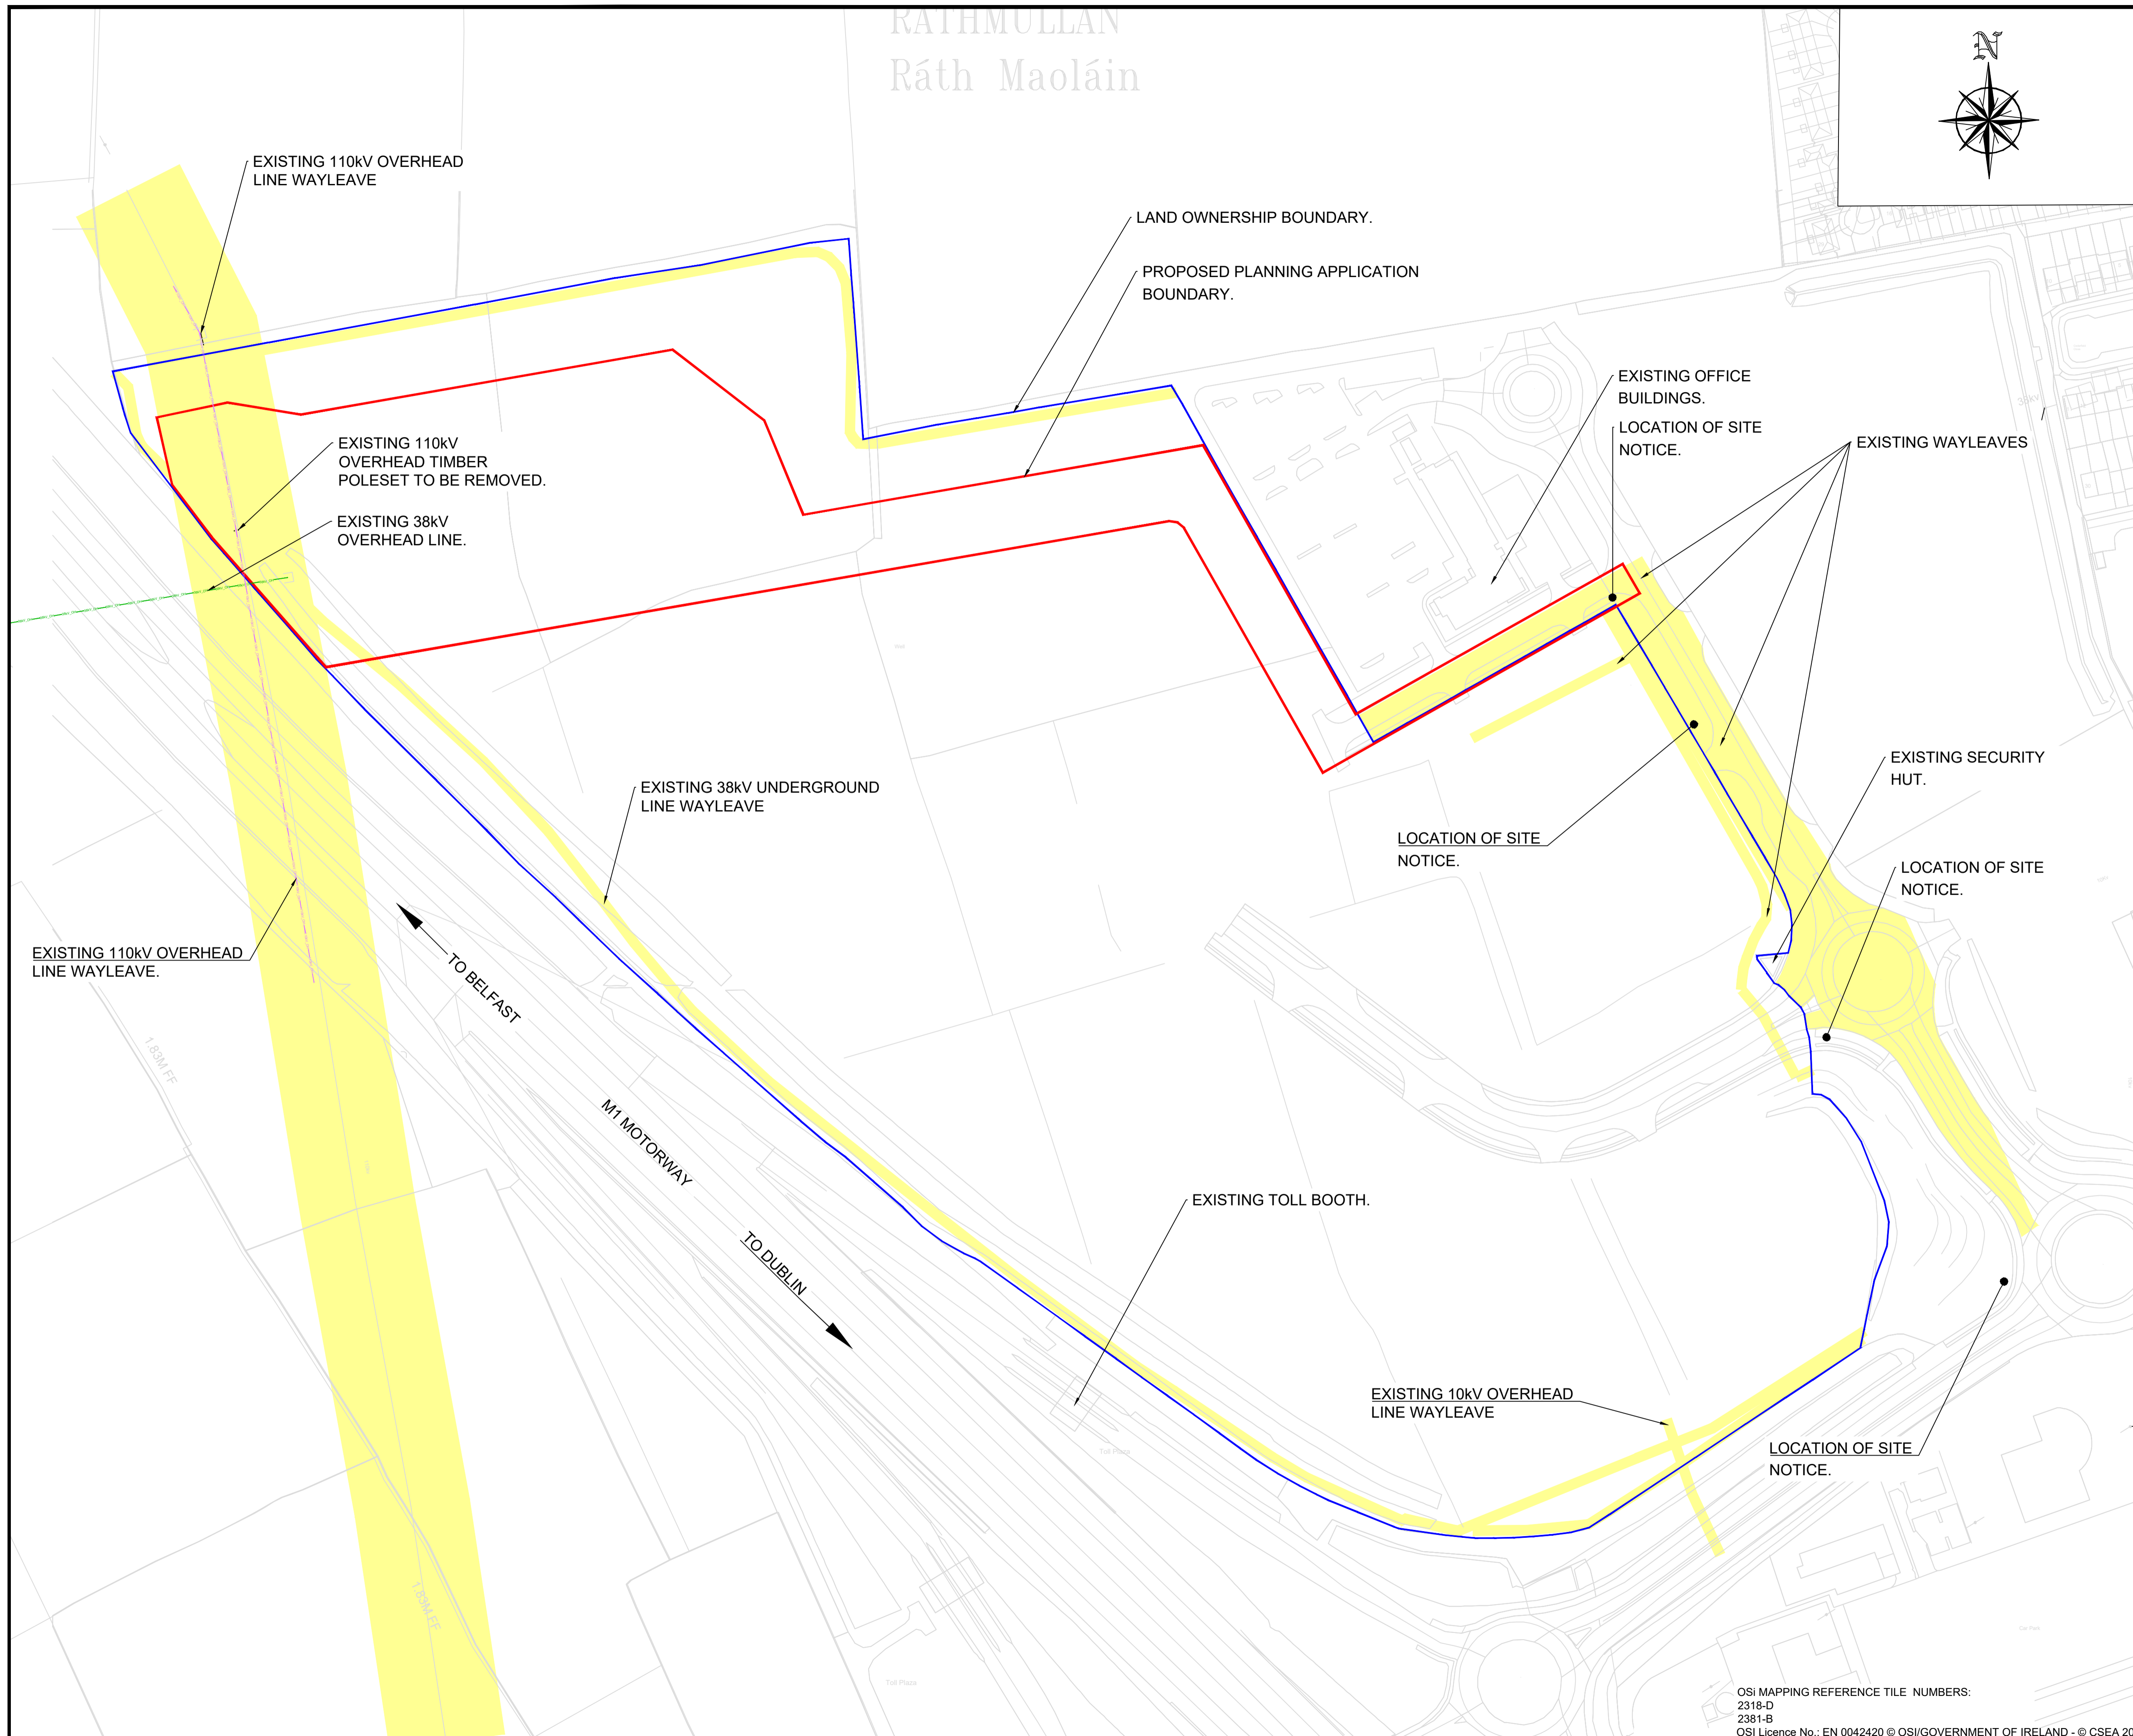

**Clifton Scannell Emerson Associates**  
Clifton Scannell Emerson Associates Limited  
Consulting Engineers,  
Seafor Lodge,  
Castledawson Avenue,  
Blackrock, Co. Dublin,  
Ireland, A94 P768  
T: +353 1 288 5006  
F: +353 1 283 3466  
E: info@csea.ie  
W: www.csea.ie

<b>Client</b>		CAP DEVELOPMENTS LLC	
<b>Project</b>		OLDBRIDGE 110KV SUBSTATION	
<b>Dwg. Title</b>		OSI MAPPING & EXISTING WAYLEAVES	
<b>Drawn By</b>	DM	<b>Date</b>	OCTOBER 2020
<b>Checked By</b>	PM	<b>Scale</b>	1:1250 @ A1
<b>Project Code</b>	Originator	<b>Zone/Phase</b>	Level
<b>Type</b>	Role	<b>Dwg. No.</b>	
<b>S2</b>		<b>SUITABLE FOR INFORMATION</b>	
<b>P05</b>	<b>PLANNING</b>		

OSI MAPPING REFERENCE TILE NUMBERS:  
2318-D  
2381-B  
OSI Licence No.: EN 0042420 © OSI/GOVERNMENT OF IRELAND - © CSEA 2020