


- LEGEND:**
- LANDS IN THE OWNERSHIP OF THE APPLICANT/ LANDOWNER.
 - PROPOSED SID APPLICATION SITE BOUNDARY
 - PROPOSED COMPOUND FENCE
 - PROPOSED ASPHALT ROAD
 - PROPOSED STONED AREA
 - PROPOSED CONCRETE FOOTPATH
 - PROPOSED CONCRETE SLAB
 - PROPOSED ASPHALT SURFACE
 - PROPOSED MAINTENANCE GRAVEL ROAD
 - PROPOSED LANDSCAPING
 - PROPOSED MASTS
 - - - PROPOSED TRANSMISSION LINE DUCT FROM MAST TO GIS BUILDING
 - - - PROPOSED FUTURE GRID CONNECTION
 - PROPOSED SAND PIT
 - PROPOSED HV CABLE INDICATING HORIZONTAL BEND
 - PROPOSED HV CABLE INDICATING VERTICAL BEND TO TRUNKING
 - PROPOSED HV DUCT FROM GIS TO TRANSFORMER
 - PROPOSED 2 No. 125mm COMMS DUCT
 - PROPOSED COMMS CHAMBER
 - PROPOSED COMMS CABLE WITH INDICATIVE VERTICAL BEND.
 - PERMITTED 2.4m PALISADE SECURITY FENCE
 - PERMITTED ASPHALT ROAD
 - PERMITTED CONCRETE FOOTPATH
 - PERMITTED EMBANKMENT AREA
 - EXISTING 110kv OVERHEAD LINE
 - EXISTING 38kv OVERHEAD LINE

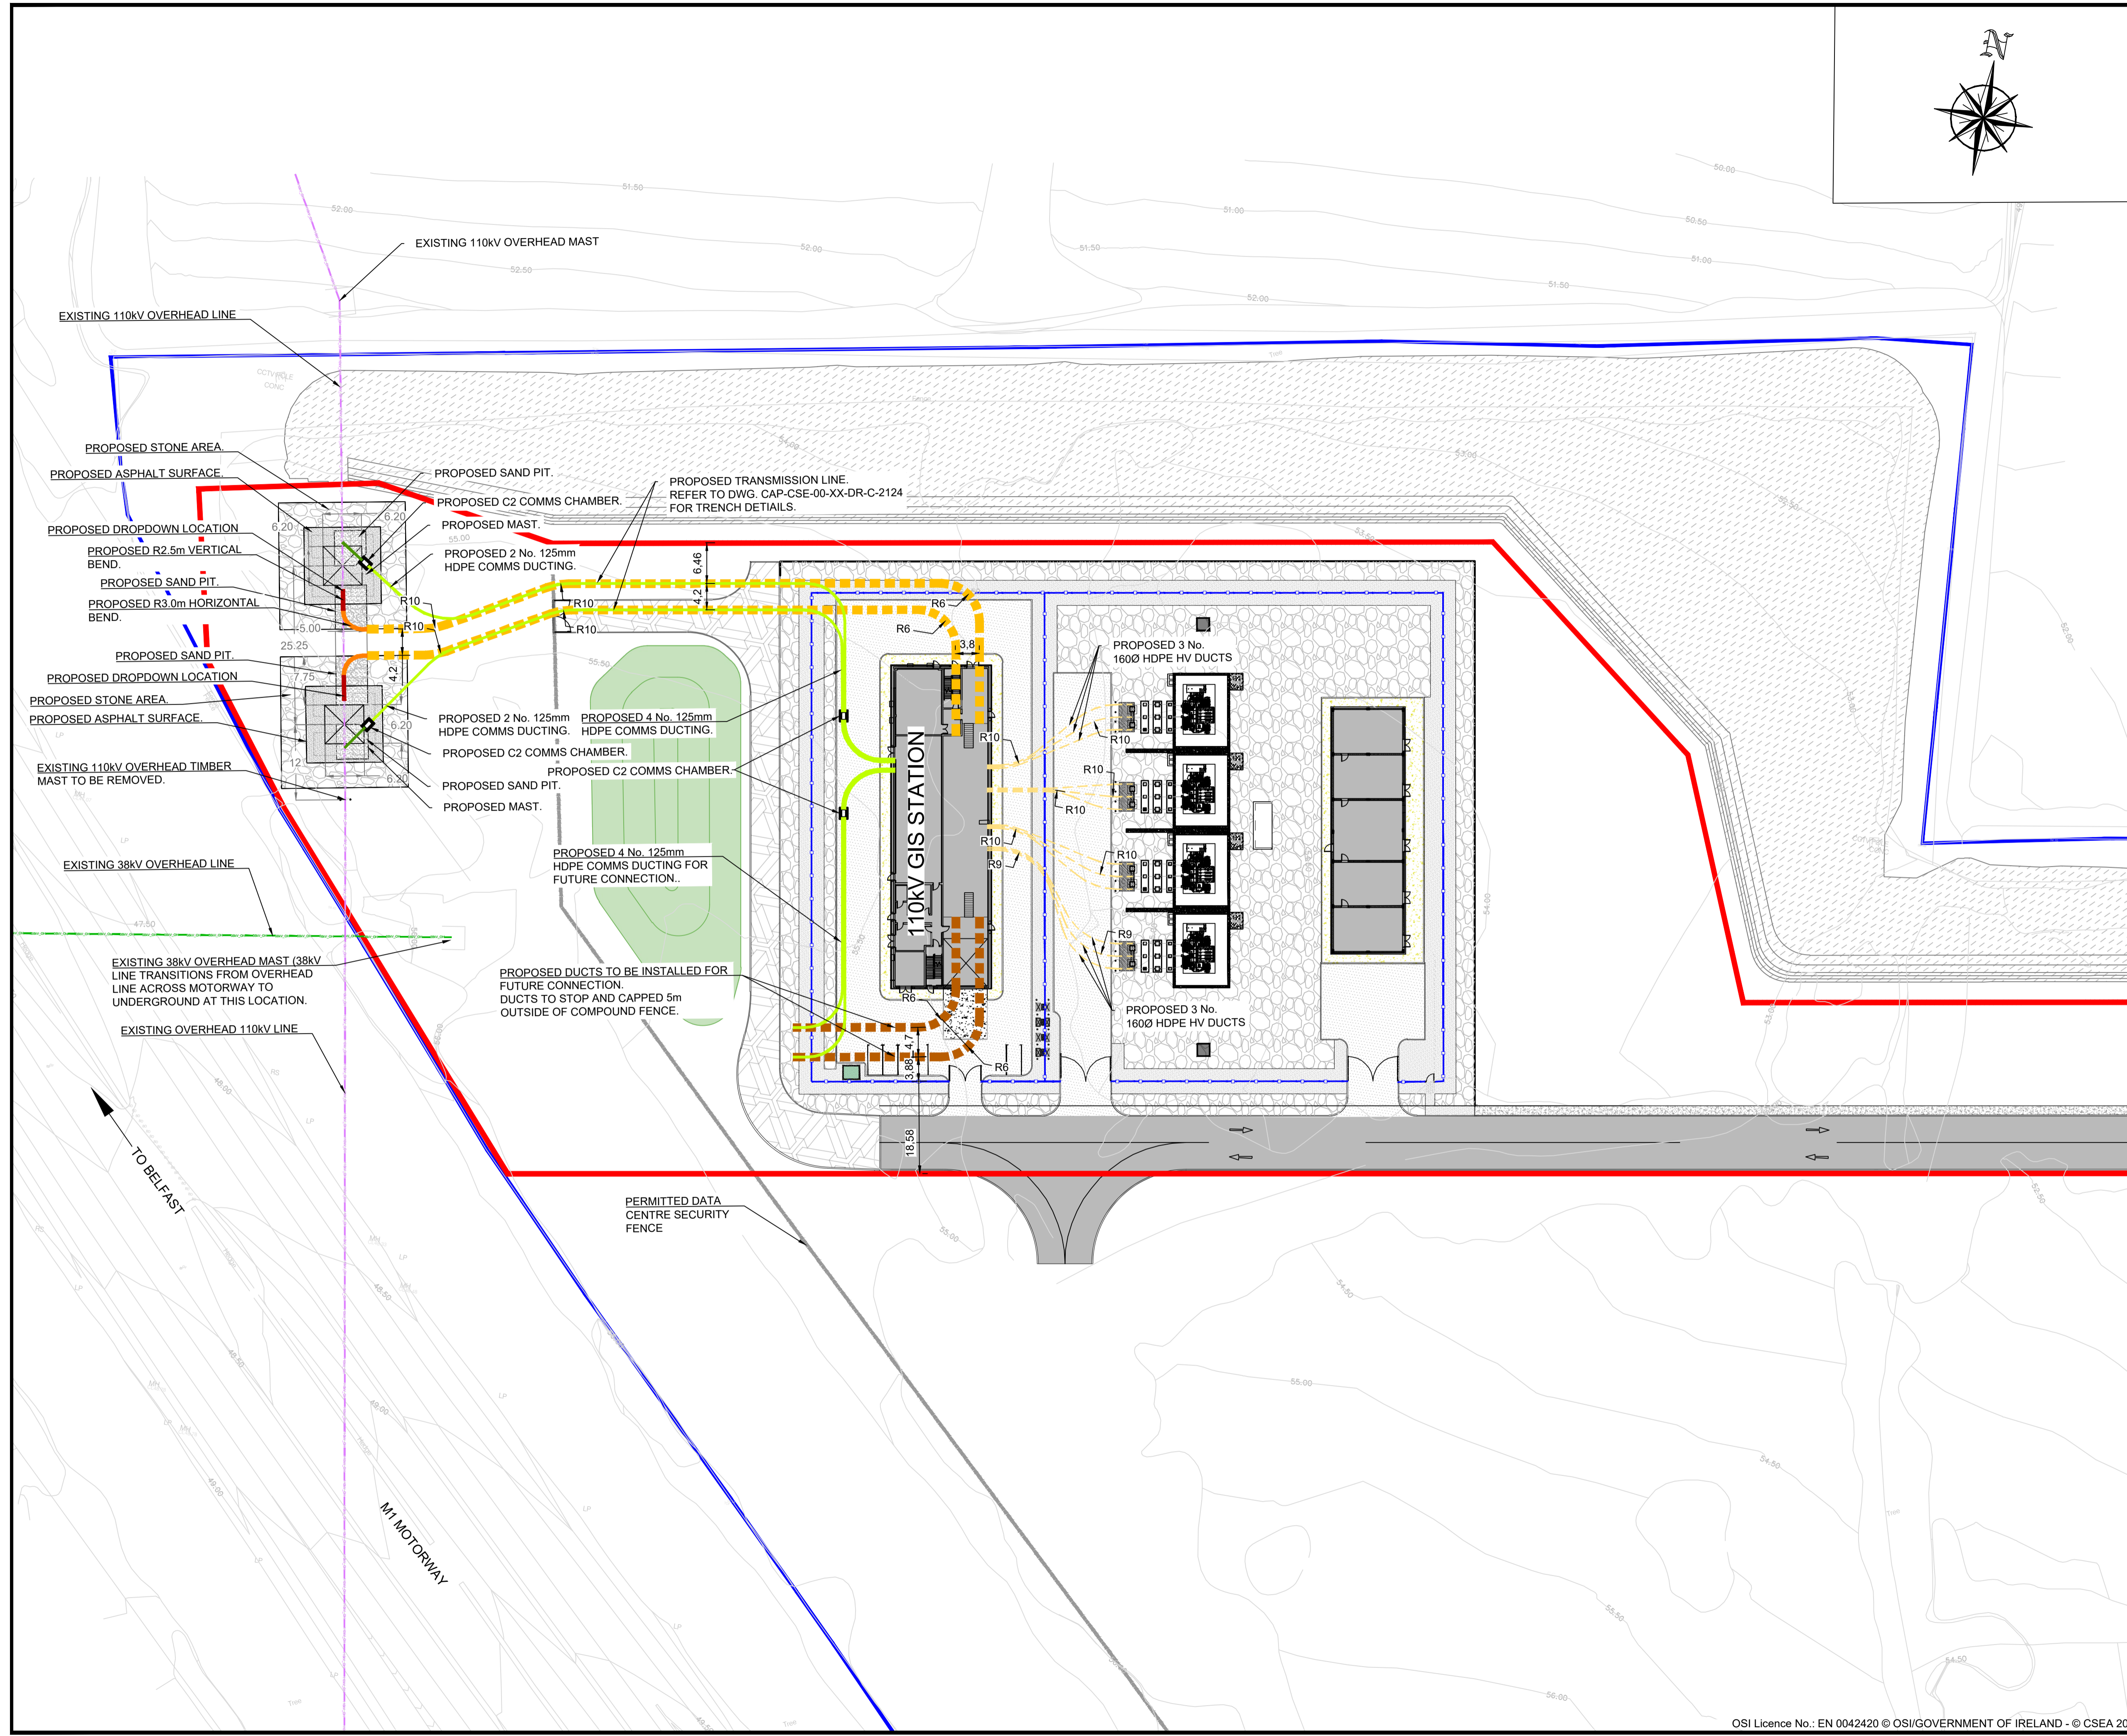

P07	SID ISSUE	DM	PM	05.11.2020
P06	SID ISSUE	DM	PM	03.11.2020
P05	EIRGRID REVIEW	DM	PM	13.10.2020
P04	EIRGRID REVIEW	DM	PM	08.10.2020
P03	FOR COMMENT	DM	PM	06.10.2020
P02	DP01 ISSUE	DM	PM	07.09.2020
P01	FOR DISCUSSION	DM	PM	28.08.2020
Rev	Description	Drawn	Checked	Date

Clifton Scannell Emerson Associates Limited
 Consulting Engineers,
 Saffron Lodge,
 Castledawson Avenue,
 Blackrock, Co. Dublin,
 Ireland, A94 P768
 T: +353 1 288 5006
 F: +353 1 283 3466
 E: info@csea.ie
 W: www.csea.ie

CAP DEVELOPMENTS LLC						
Client	OLDBRIDGE 110KV SUBSTATION					
Project	PROPOSED GRID CONNECTION CABLE ROUTE					
Dwg. Title						
Drawn By	DM					
Date	OCTOBER 2020					
Checked By	PM					
Scale	1:500 @ A1					
CSEA Job No.	20_057					
Project Code	Originator	Zone/Phase	Level	Type	Role	Dwg. No.
S2	SUITABLE FOR INFORMATION					
P07	PLANNING					