
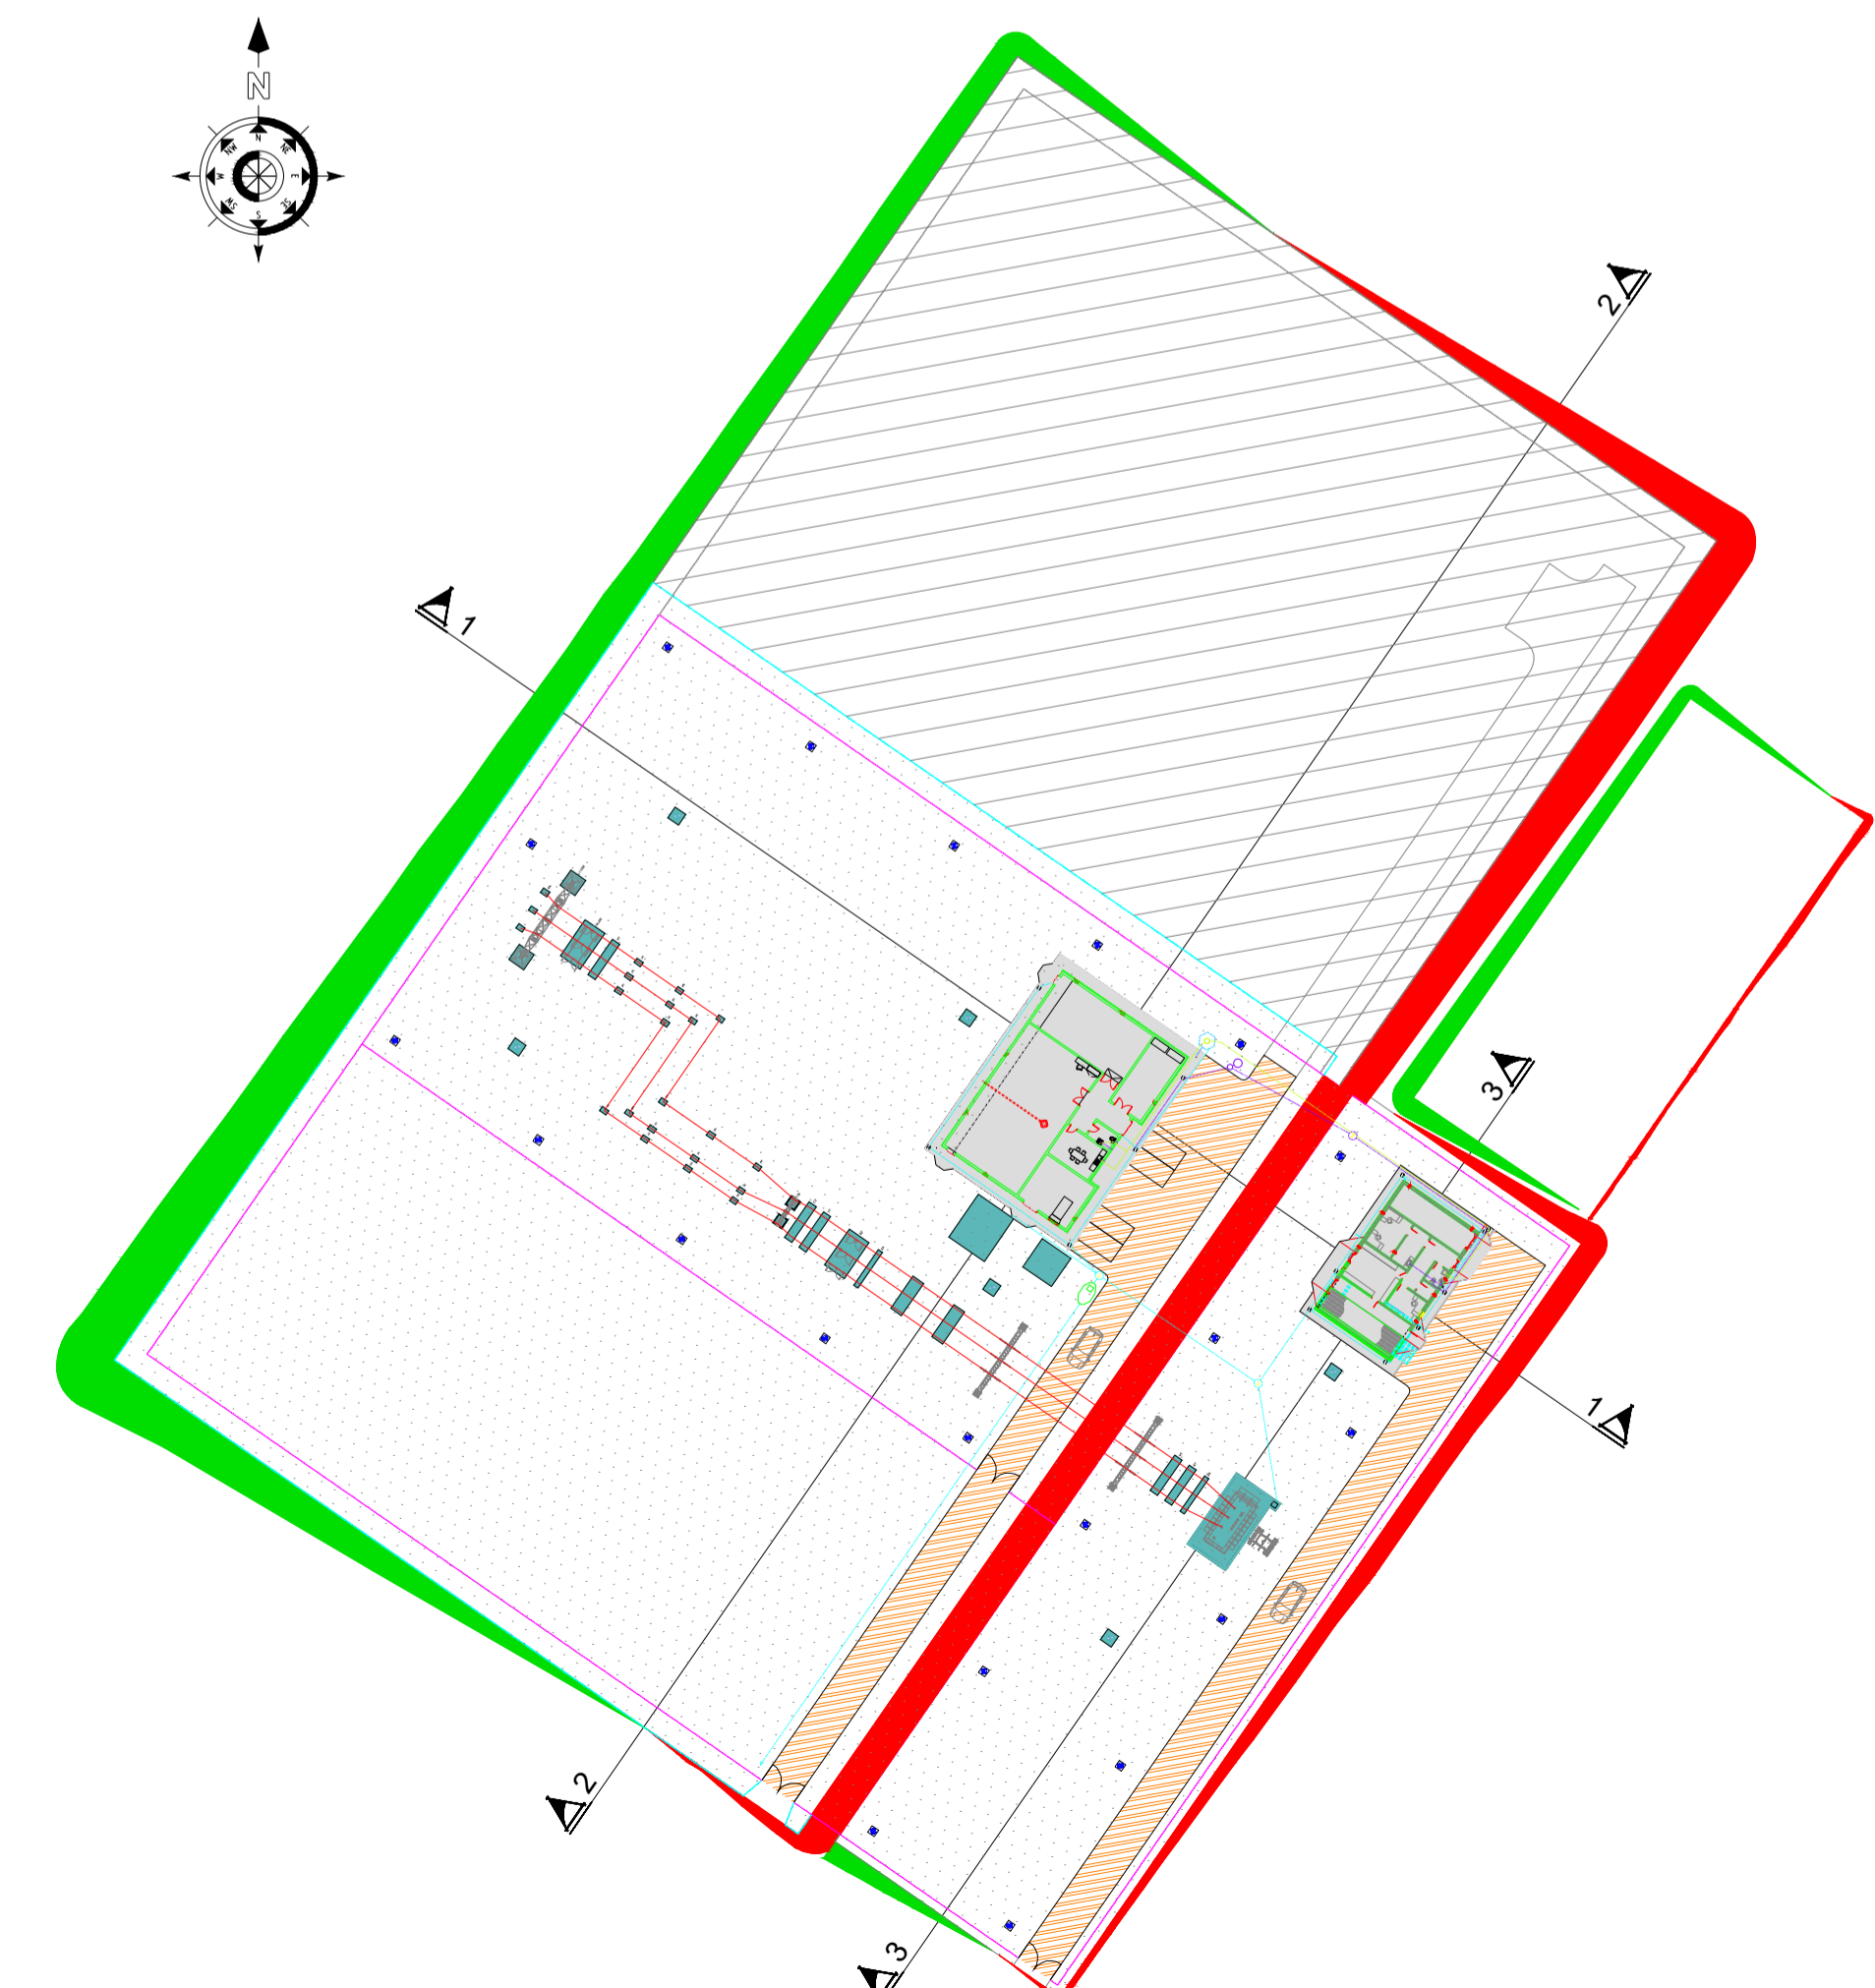
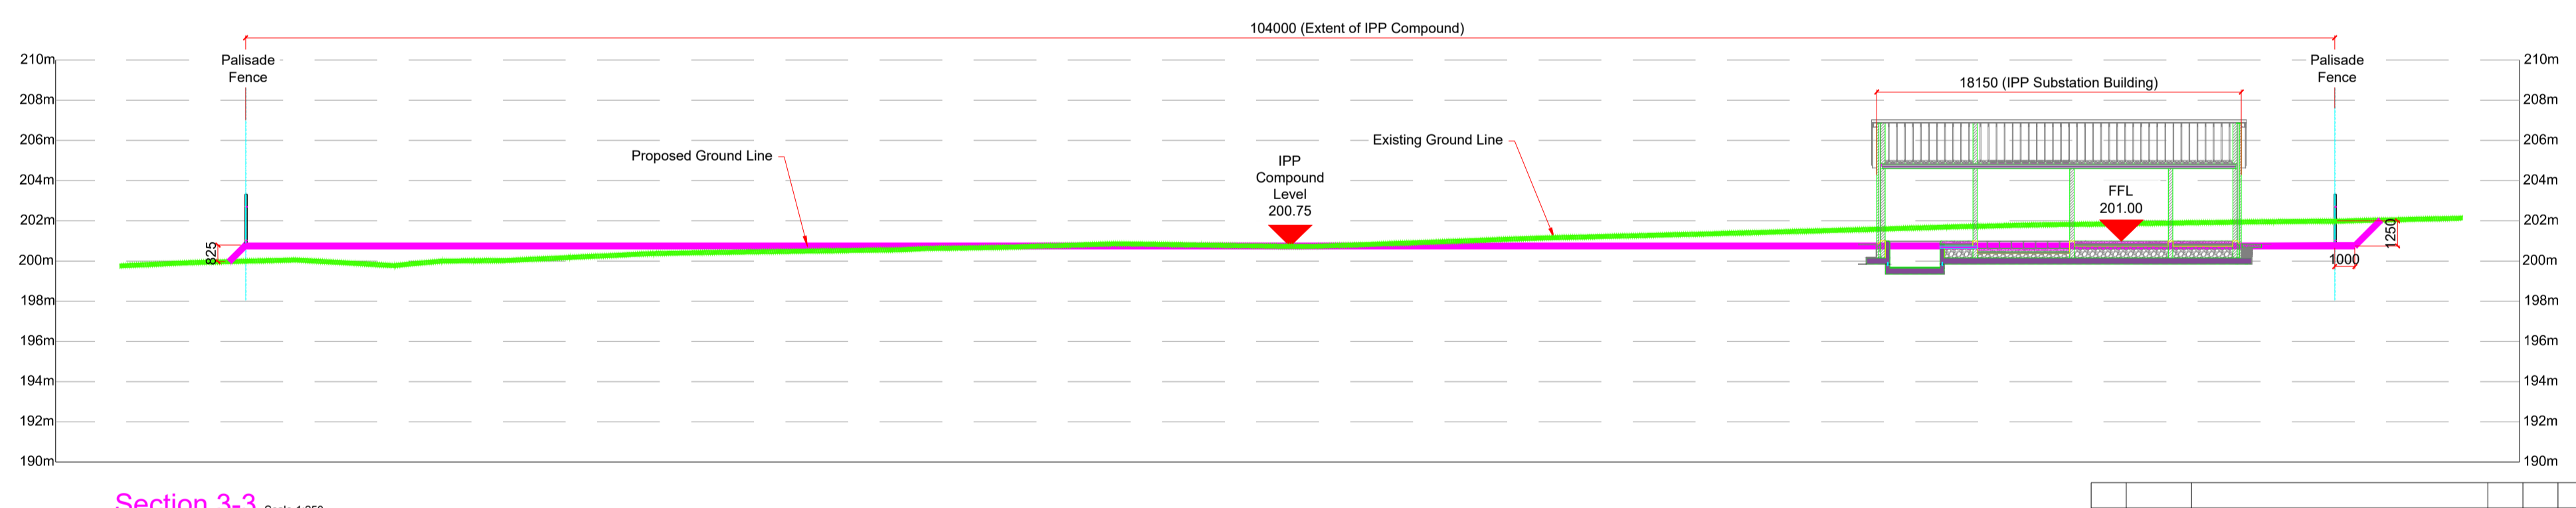
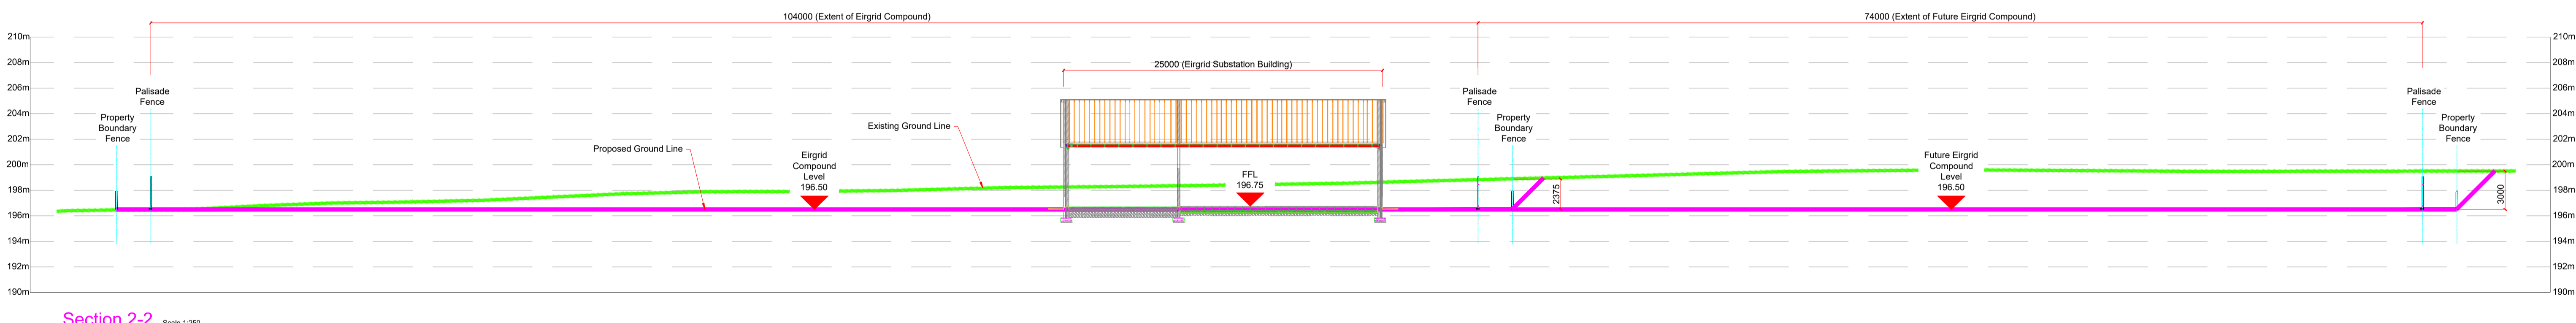


- Notes :**
- All drawings are to be read in conjunction with all relevant Specifications, Bills of Quantities, Architectural, Services and Engineering drawings.
 - Any discrepancies between these documents shall be brought to the attention of the Engineer.
 - All dimensions are in millimetres, unless noted otherwise.
 - All levels are in metres related to Ordnance Datum.
 - Drawings are not to be scaled.

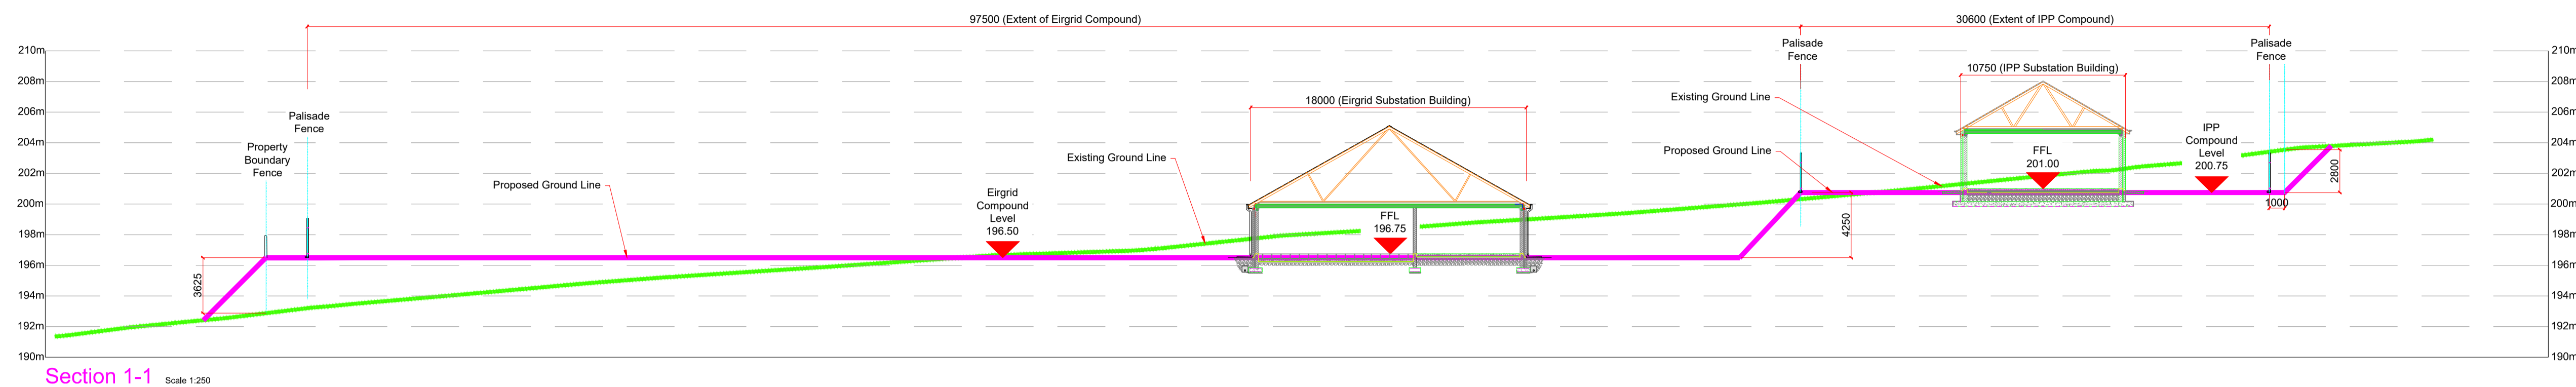

LEGEND:

	Substation Building
	4500mm wide Access Road
	Concrete Footpath
	Top layer of Permeable Compound Stone
	Future Eirgrid Compound
	Area of Fill
	Area of Cut
	Concrete Equipment Plinths
	2.6m High Palisade Fence
	1.2m High Concrete Post & Rail Property Fence
	Future 2.6m High Palisade Fence
	Future 1.2m High Concrete Post & Rail Property Fence
	Storm Water Pipe (Clean)
	Storm Water Pipe (Dirty)
	Foul Water Pipe
	Light Stand
	Lightning Mast
IPP Compound - Independent Power Producer Compound	

Rev.	Date	Description	JK	CM	HBR
A	03.07.2020	Issued For Planning			
Project: Carrowagowan Wind Farm					
Title: Substation Compound Site cross Sections					
Client:					
 Malachy Walsh and Partners Consulting Engineers Cork Tralee London Limerick					
Reen Point, Blennerville, Tralee, Co. Kerry Tel: +353 (0)66 7123494 Fax: +353 (0)66 7126586 E-mail: tralee@mwp.ie					
Scales (A1) 1:250		Drg. No. 19107-5050		Rev. A	
Drawn	NT	18.11.2019			
Ch'd (DO)	JK	18.11.2019			
Ch'd (Eng)	CM	18.11.2019			
Approved	JL	18.11.2019			