


PLEASE NOTE THAT THE COMPONENTS ILLUSTRATED ON THIS DRAWING ARE INDICATIVE ONLY. THE PRECISE SPECIFICATION AND DETAIL WILL BE DETERMINED BY THE ELECTRICAL EQUIPMENT SUPPLIER AND EIRGRID FUNCTIONAL SPECIFICATION

All dimensions are in millimeters unless otherwise stated.

NOTES:

- All dimensions must be checked on site and not scaled from this drawing.
- All dimensions in millimetres unless otherwise stated
- All levels are in metres to ordnance datum Malin Head

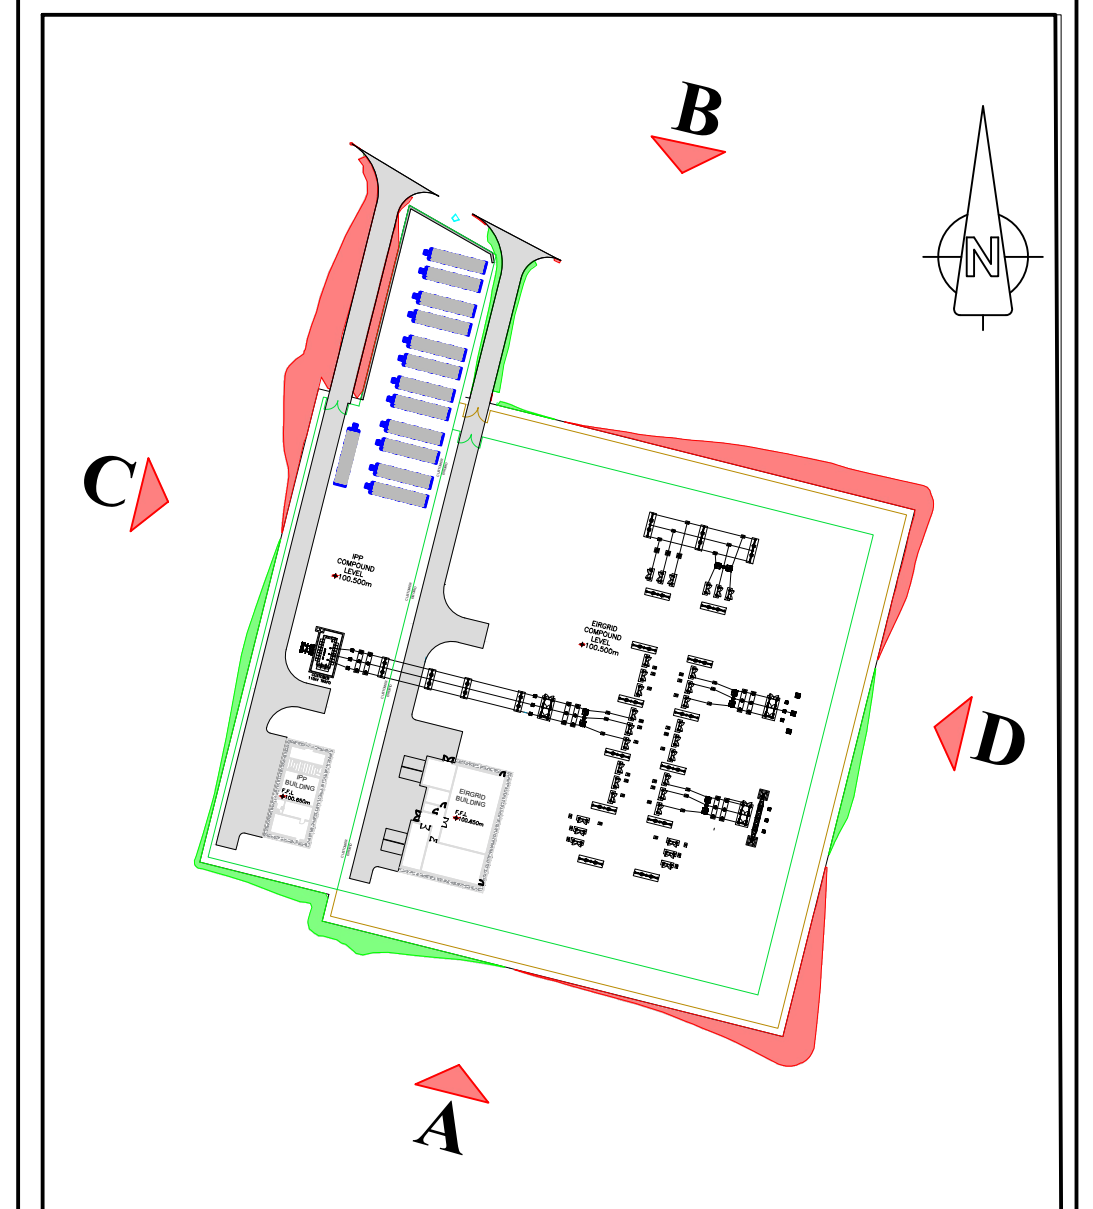

Date:	Rev:	Description:	Drawn By:

Prepared By:



Galetech Energy Services
Clondargan, Stradone
Co. Cavan, H12 NV06
info@galetechenergy.com
www.galetechenergy.com

Client: **Drumlins Park Ltd.**

Job Title: **Drumlins Park Wind Farm Substation & Grid Connection**

Drawing Title: **Figure 12: Typical Substation Compound Elevations**

Drawing No. DRU001SS_PAG_GA-0.01	Revision No. Rev 00
Scale: (A1) 1:250	Date: 03/12/2020
Drawn By: J.B.	Checked By: C.M.P.
	Confirmed By: S.C.