

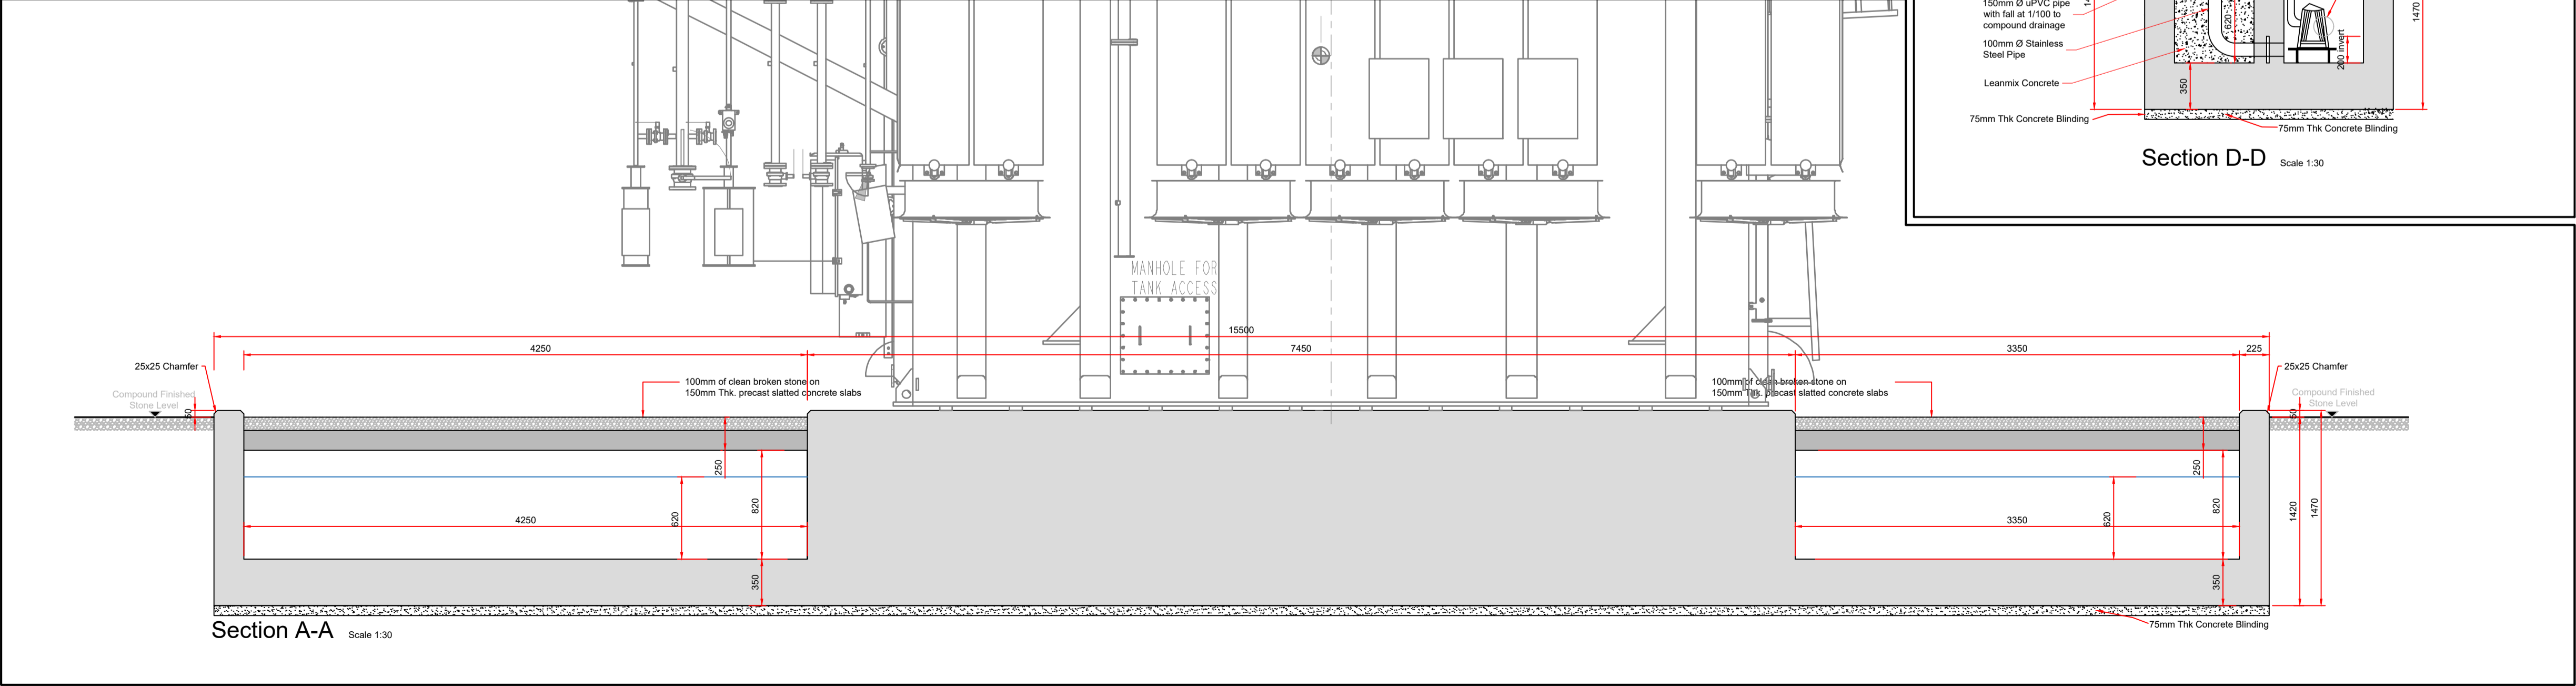
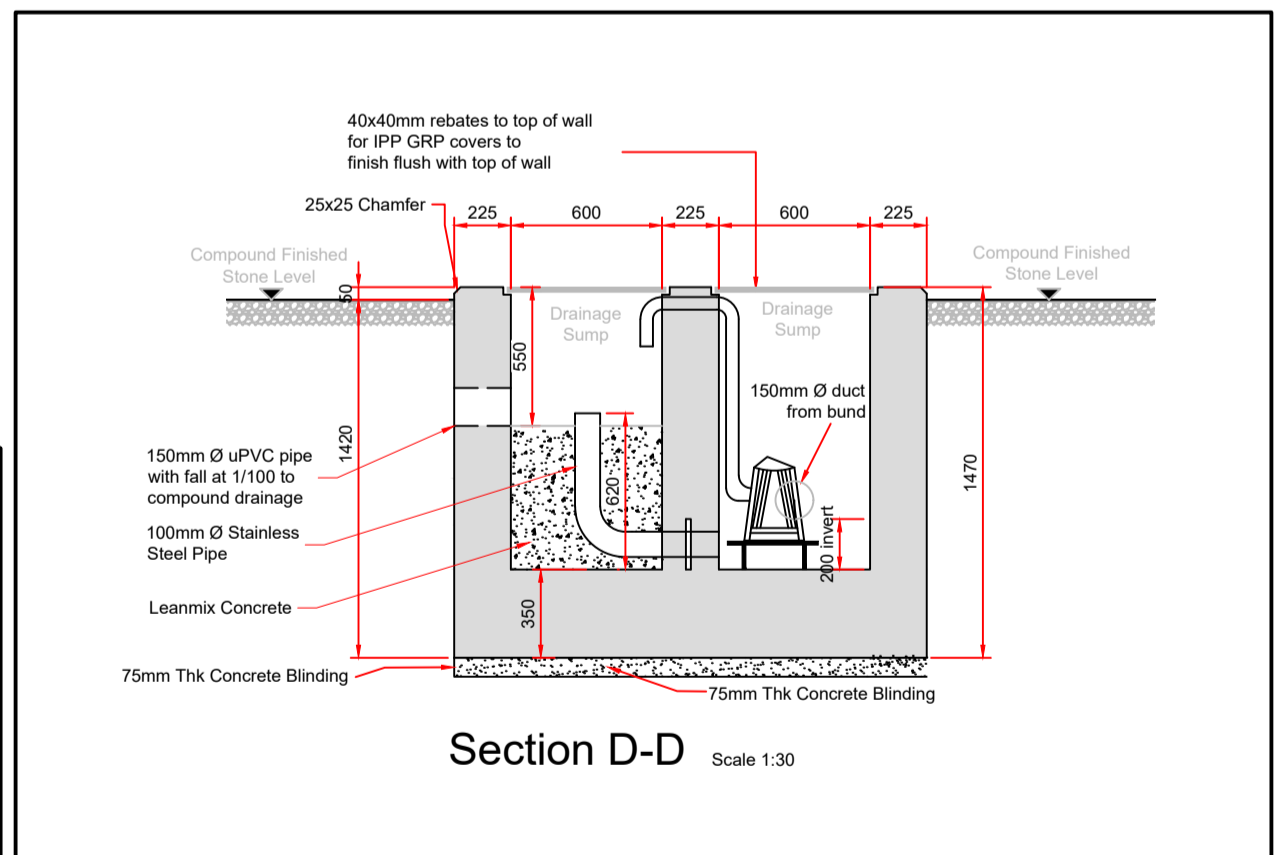
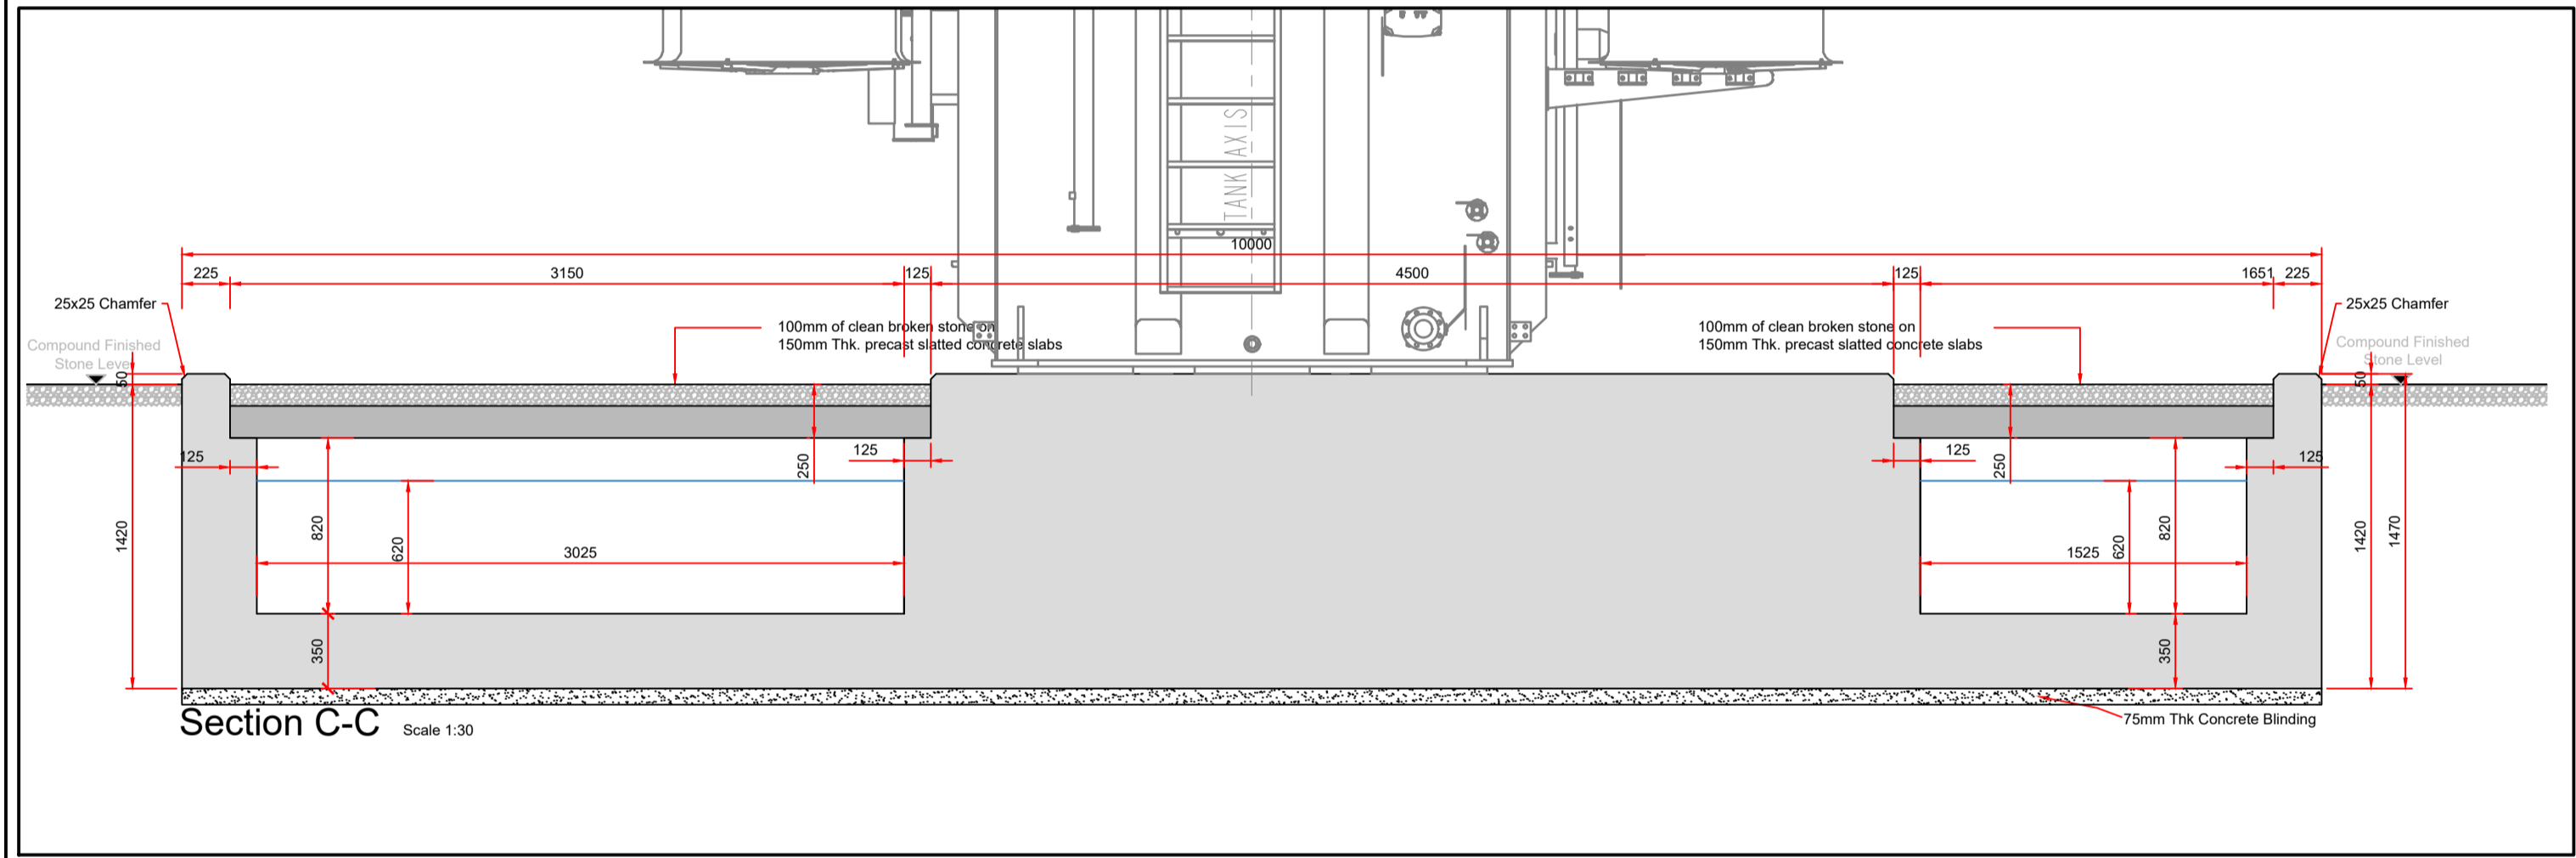


PLEASE NOTE THAT THE COMPONENTS ILLUSTRATED ON THIS DRAWING ARE INDICATIVE ONLY. THE PRECISE SPECIFICATION AND DETAIL WILL BE DETERMINED BY THE ELECTRICAL EQUIPMENT SUPPLIER AND EIRGRID FUNCTIONAL SPECIFICATION

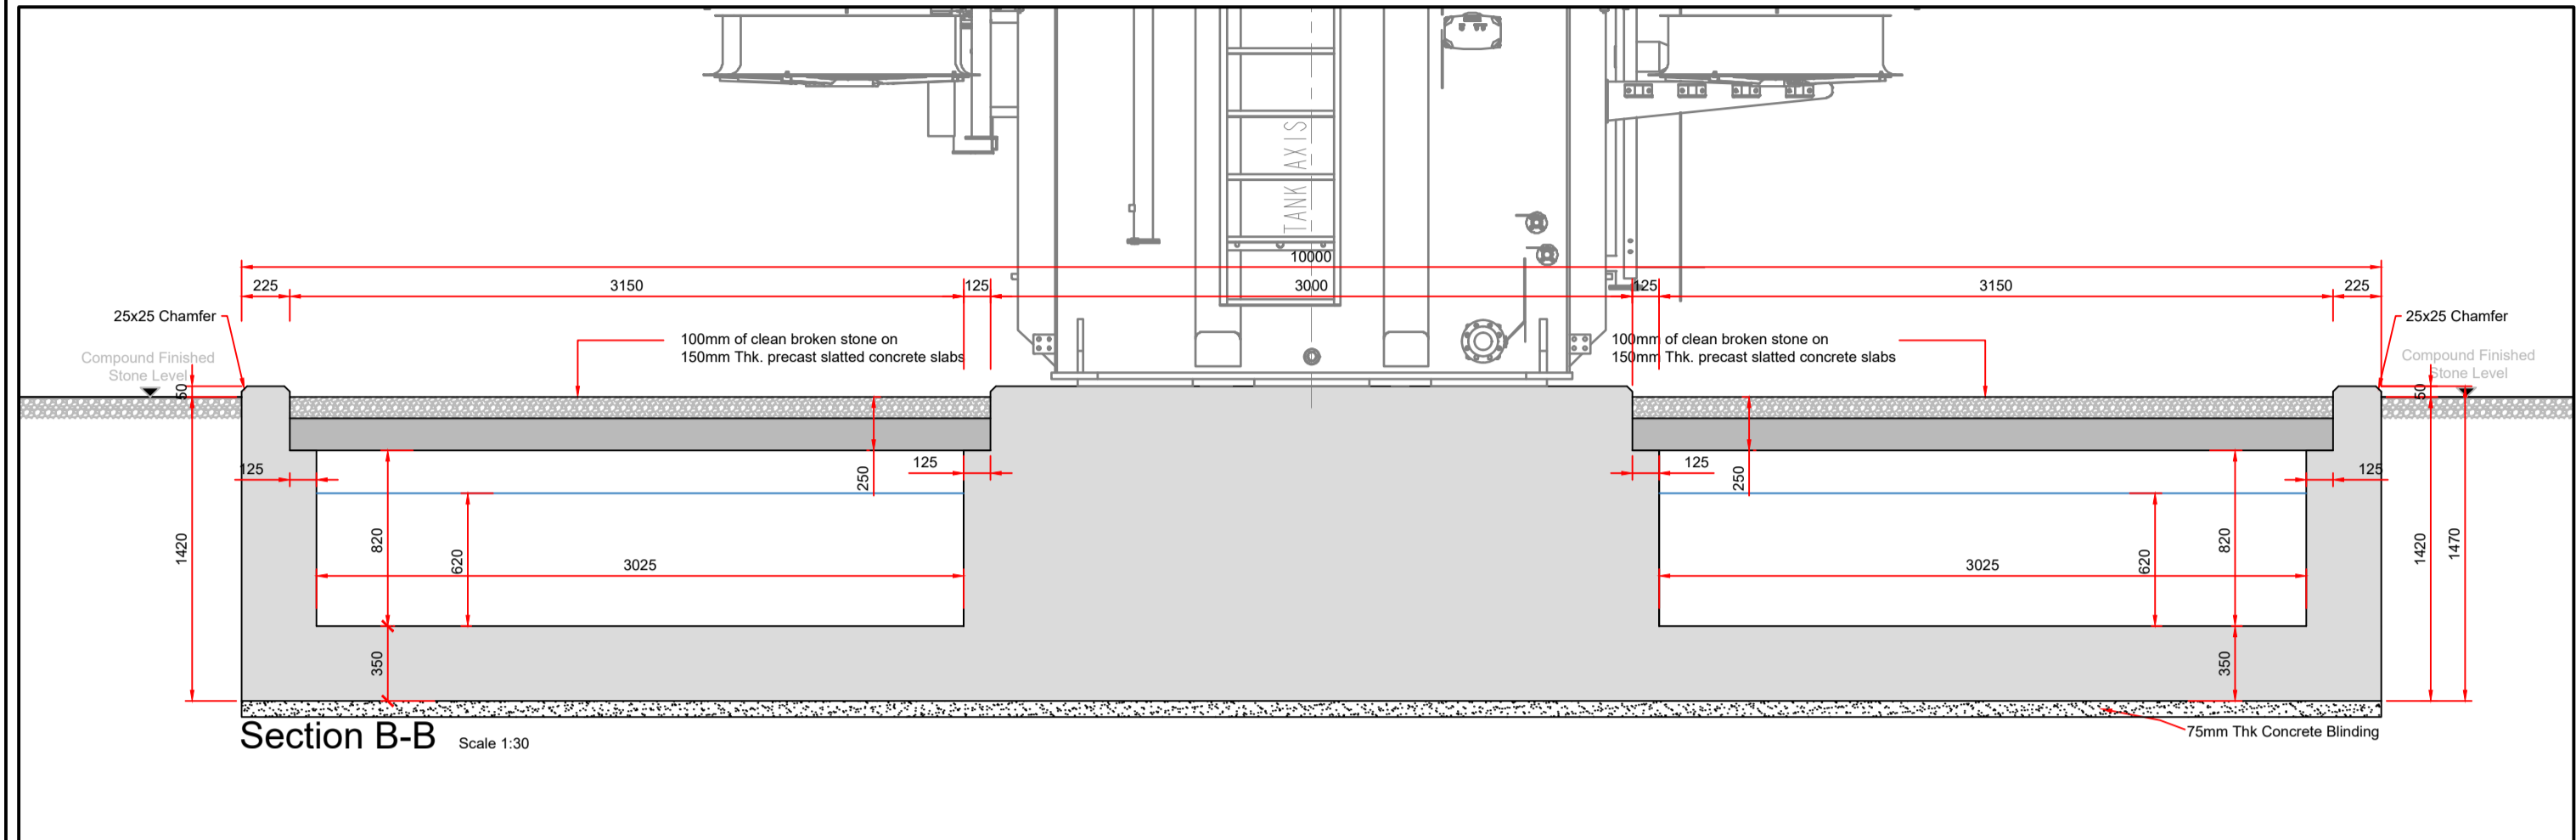

| Date: | Rev: | Description: | Drawn By: |
|-------|------|--------------|-----------|
|       |      |              |           |

Prepared By:

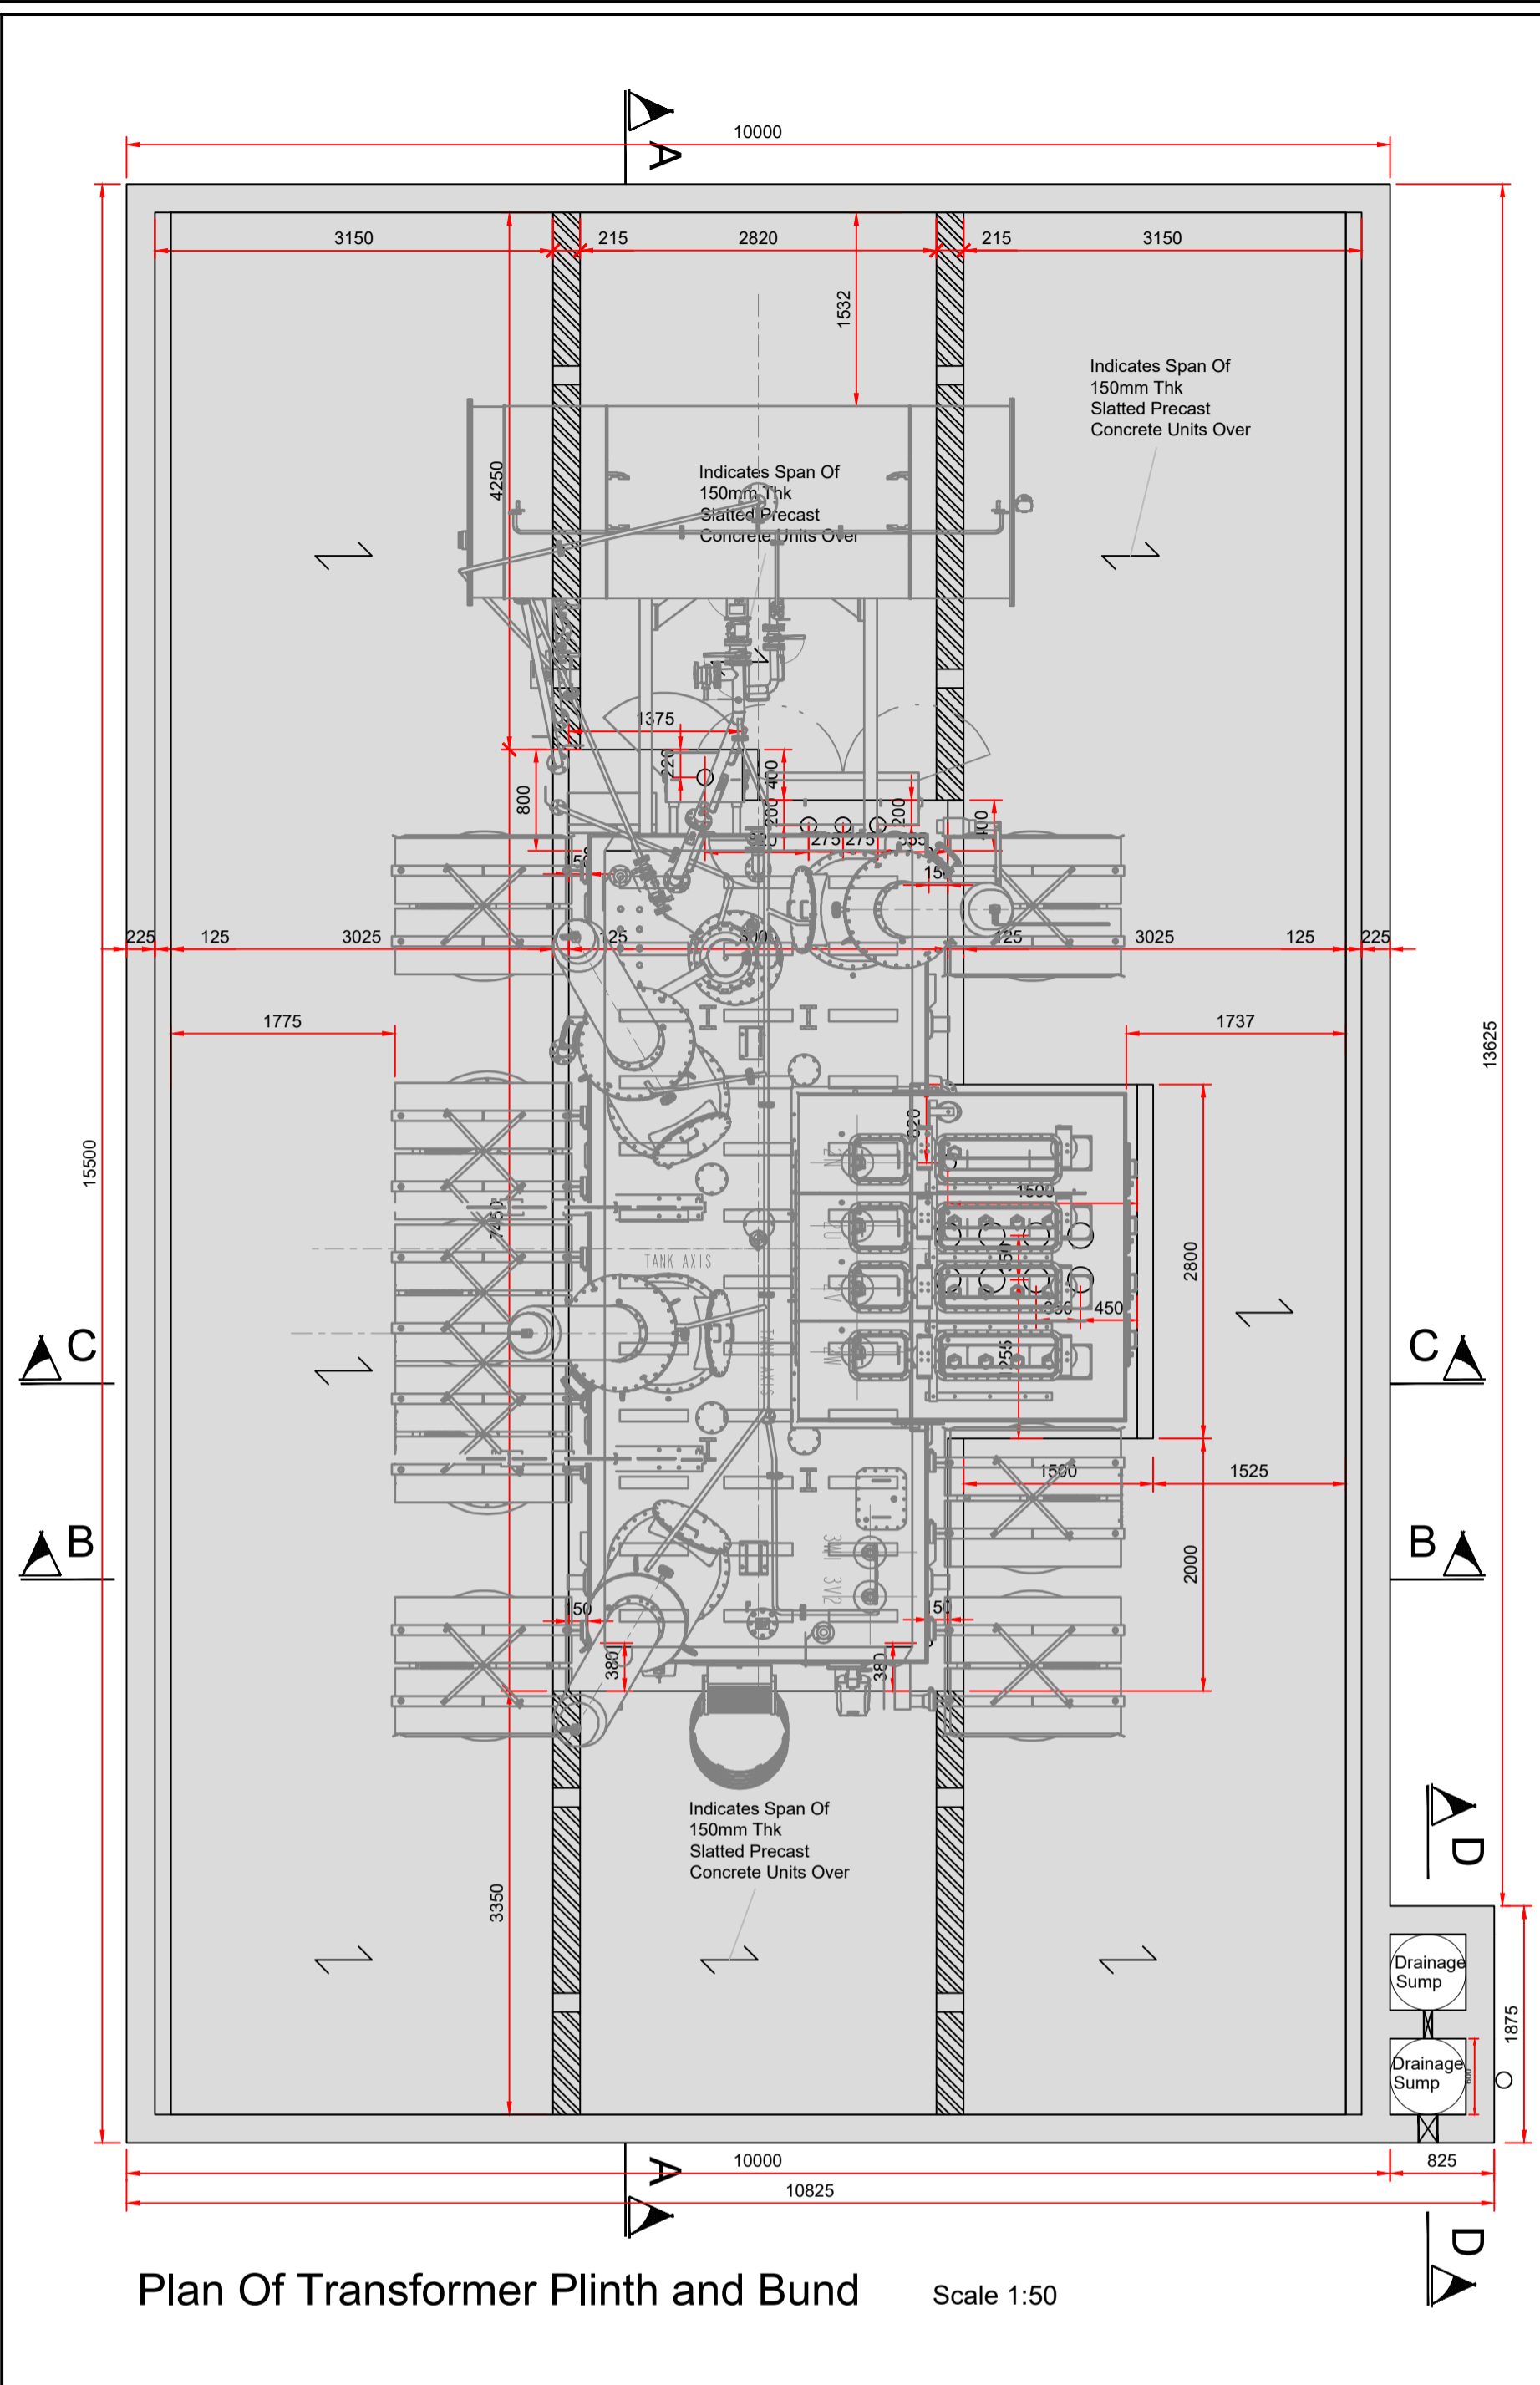

Galetech Energy Services  
Clondorgan, Stradone  
Co. Cavan, H12 NV06  
info@galetechenergy.com  
www.galetechenergy.com

Client: **Drumlins Park Ltd.**

Job Title: **Drumlins Park Wind Farm Substation & Grid Connection**

Drawing Title: **Figure 18: Typical Transformer Bund & Plinth Details**

|                                     |                        |
|-------------------------------------|------------------------|
| Drawing No.<br>DRU001SS_PAG_GA-0.07 | Revision No.<br>Rev 00 |
| Scale:<br>A1 - AS SHOWN             | Date:<br>03/12/2020    |
| Drawn By:<br>J.B.                   | Checked By:<br>C.M.P.  |
|                                     | Confirmed By:<br>S.C.  |