

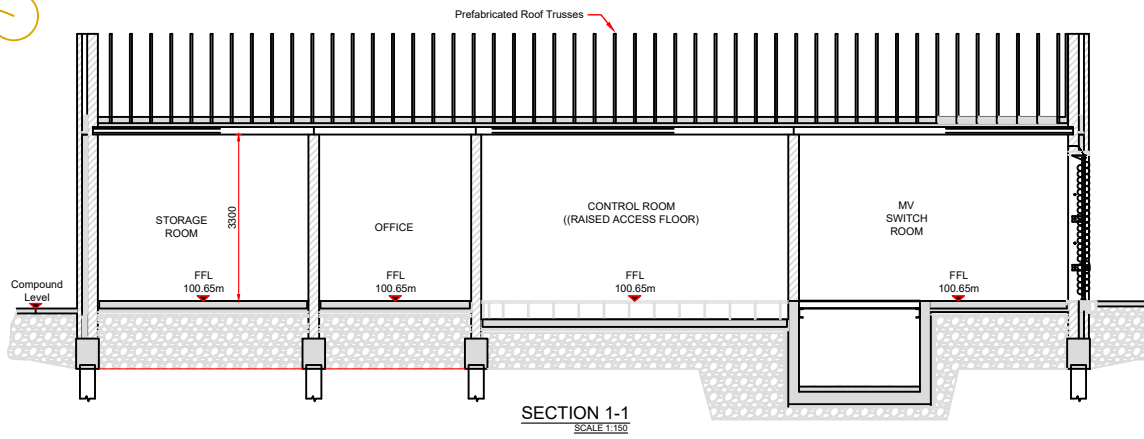
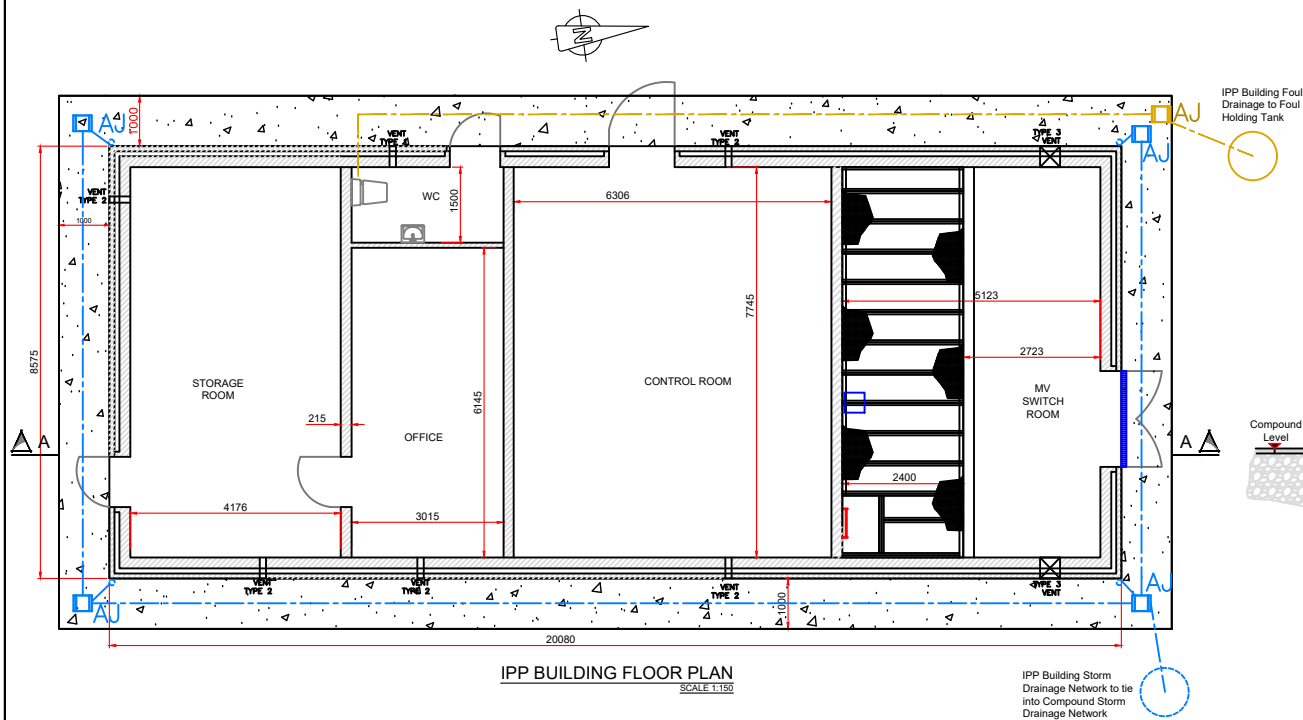
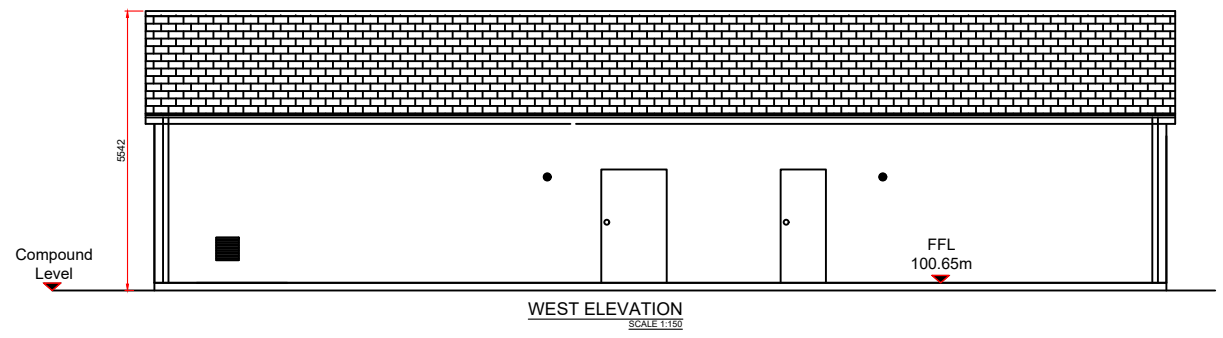
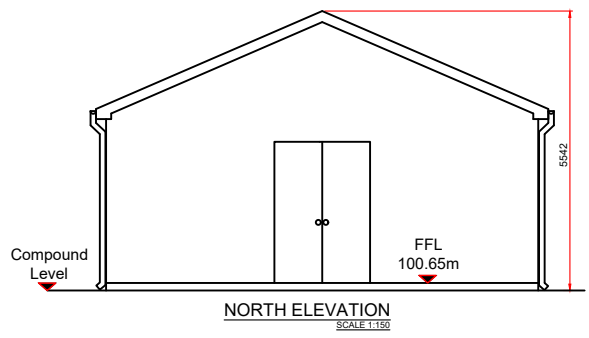


PLEASE NOTE THAT THE COMPONENTS ILLUSTRATED ON THIS DRAWING ARE INDICATIVE ONLY. THE PRECISE SPECIFICATION AND DETAIL WILL BE DETERMINED BY THE ELECTRICAL EQUIPMENT SUPPLIER AND EIRGRID FUNCTIONAL SPECIFICATION

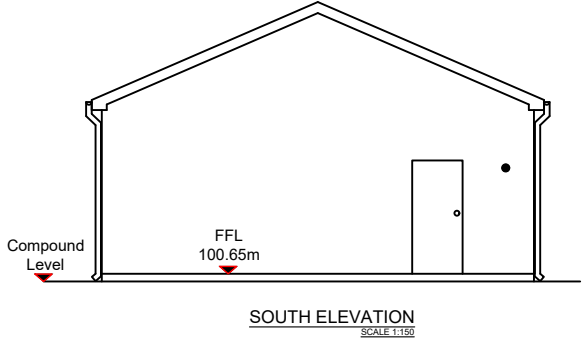

Legend:

Concrete Footpath	
100mm Ø uPVC Foul Water Pipe	
150mm Ø uPVC Storm Water Pipe	
Foul Water AJ	
Storm Water AJ	

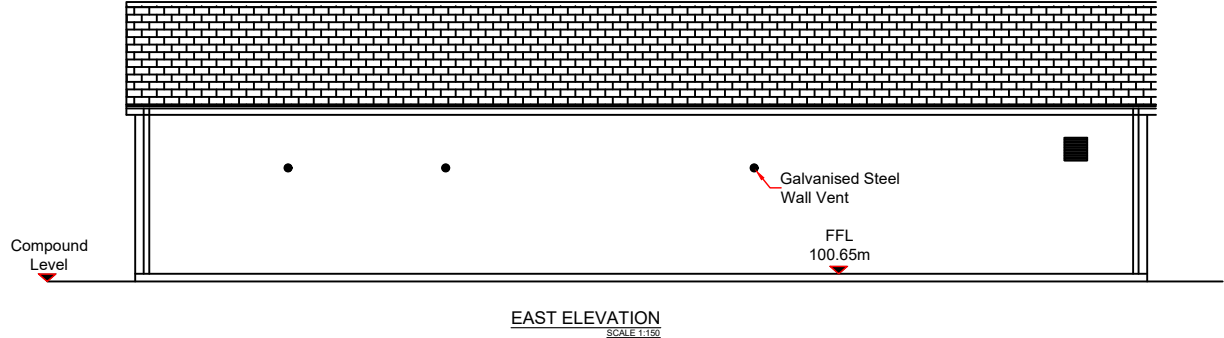

All dimensions are in millimeters unless otherwise stated.

Date:	Rev:	Description:	Drawn By:

Prepared By:



Galetech Energy Services
Clondargan, Stradone
Co. Cavan, H12 NV06
info@galetechenergy.com
www.galetechenergy.com

Client: **Drumlins Park Ltd.**

Job Title: **Drumlins Park Wind Farm Substation & Grid Connection**

Drawing Title: **Figure 14 - Typical IPP Building Plan and Elevations**

Drawing No.: DRU001SS_PAG_GA-0.03	Revision No.: Rev00
Scale: (A3) 1:150	Date: 03/12/2020
Drawn By: J.B.	Checked By: S.C.
	Confirmed By: S.C.