


**SECTION**


**PLAN**

**VENT STACK DETAIL**  
SCALE 1:75

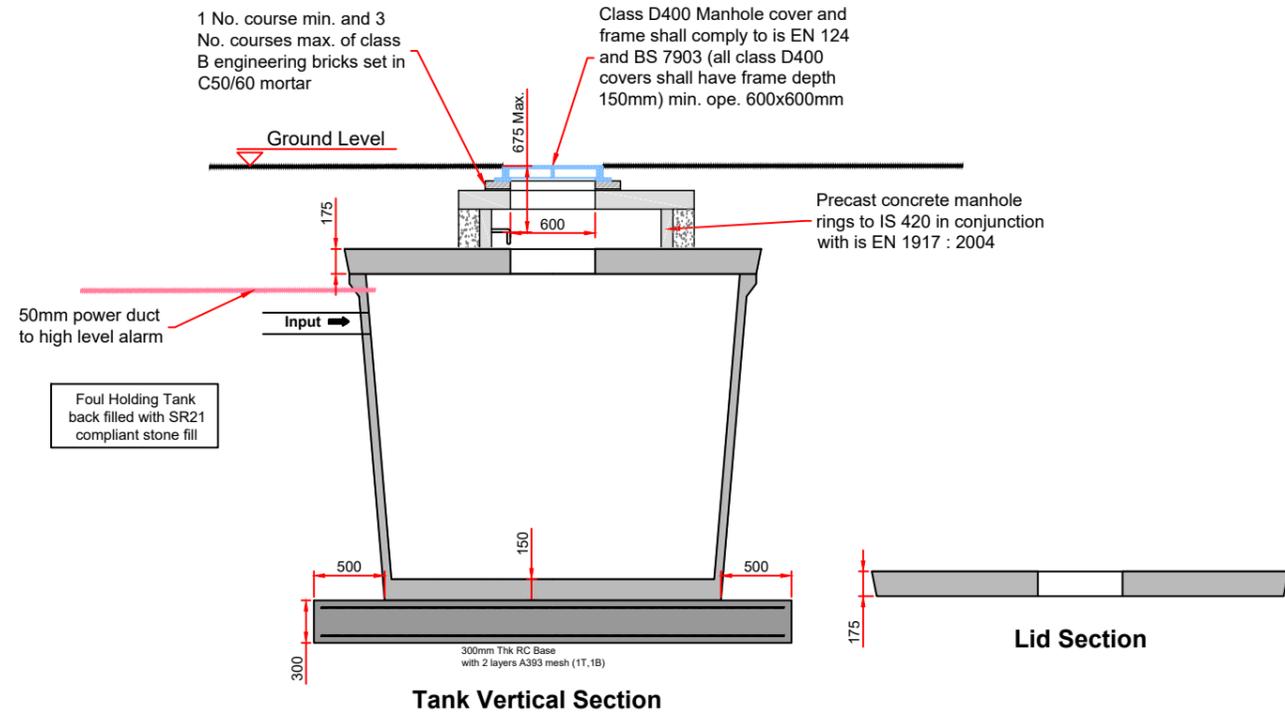


**Tank Vertical Section**

**Lid Section**

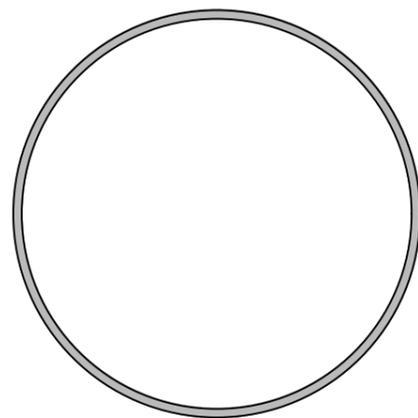

**Tank Top Plan**

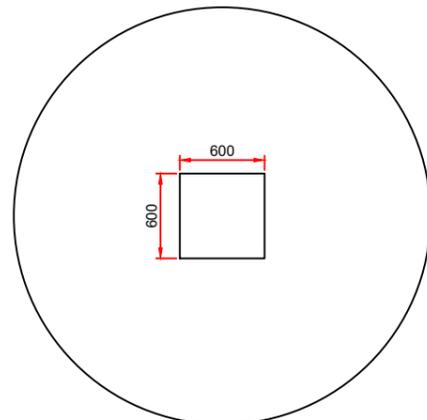

**Lid Top Plan**

**FOUL SEWER HOLDING TANK**  
**(Volume 5m<sup>3</sup>)**  
Scale 1:50



Date:	Rev:	Description:	Drawn By:
-------	------	--------------	-----------

Prepared By:

Galetech Energy Services  
Clondargan, Stradone  
Co. Cavan, H12 NV06  
info@galetechenergy.com  
www.galetechenergy.com

Client: **Drumlins Park Ltd.**

Job Title: **Drumlins Park Wind Farm Substation & Grid Connection**

Drawing Title: **Figure 19 - Typical Foul Holding Tank Details**

Drawing No.: DRU001SS_PAG_GA-0.08	Revision No.: Rev00
Scale: A3 - AS SHOWN	Date: 03/12/2020
Drawn By: J.B.	Checked By: S.C.
	Confirmed By: S.C.