

KEY PLAN

NOTES / LEGEND

GENERAL NOTES

- ROUTE SHOWN IS INDICATIVE ONLY AND IS SUBJECT TO FULL ELECTRICAL RATING/DERATING DESIGNS AND EIRGRID REVIEW AND APPROVAL
- UTILITY CAD INFORMATION PROVIDED FROM CLIENT TO KIRBY SHOWN ON THIS LAYOUT DRAWING.
- FURTHER REVIEW AND ACCEPTANCE REQUIRED FROM LANDOWNERS, EIRGRID AND ESB TO CONFIRM SUITABILITY OF ROUTE

READ IN CONJUNCTION WITH THE FOLLOWING DRAWING'S AND DOCUMENT'S

Doc.No.	Title

DRAWING STATUS

**ISSUED FOR PLANNING**

N	FOR DISCUSSION	25.11.2020	EOK	*
M	FOR DISCUSSION	18.11.2020	EOK	SK
L	FOR DISCUSSION	13.11.2020	EOK	SK
K	FOR DISCUSSION	11.11.2020	EOK	*
J	FOR DISCUSSION	04.11.2020	EOK	*
P	ISSUED FOR PLANNING	18.12.2020	EOK	SH
O	ISSUED FOR PLANNING	17.12.2020	EOK	SH
REV	DESCRIPTION	DATE	BY	CKD

PROJECT

CYRUS ONE / STRUCTURE TONE  
AUNGIERSTOWN 110KV GRID CONNECTION  
GRANGE CASTLE BUSINESS PARK SOUTH

TITLE

PROPOSED GRID CONNECTION ROUTE  
\*  
\*




London Office: PEOPLE WEST ROAD, GRANGE CASTLE, DUBLIN 15. TEL: +353 (0)1 45427910. FAX: +353 (0)1 45427911. Email: london@kirbygroup.ie

Limerick Office: RAHEEN BUSINESS PARK, LIMERICK. TEL: +353 (0)61 226060. FAX: +353 (0)61 226061. Email: limerick@kirbygroup.ie

Dublin Office: WHITE SWAN BUSINESS PARK, DUBLIN 15. TEL: +353 (0)1 45424111. FAX: +353 (0)1 45424112. Email: dublin@kirbygroup.ie

Galway Office: MOYVA ROAD, GALWAY. TEL: +353 (0)91 702800. FAX: +353 (0)91 702802. Email: galway@kirbygroup.ie

DRN: EOK	CKD: SH	JOB NO: P1278	DWG NO: KG-P1278-CD001
DATE: 18.12.2020	REV NO: P	SCALE: 1:500	A1

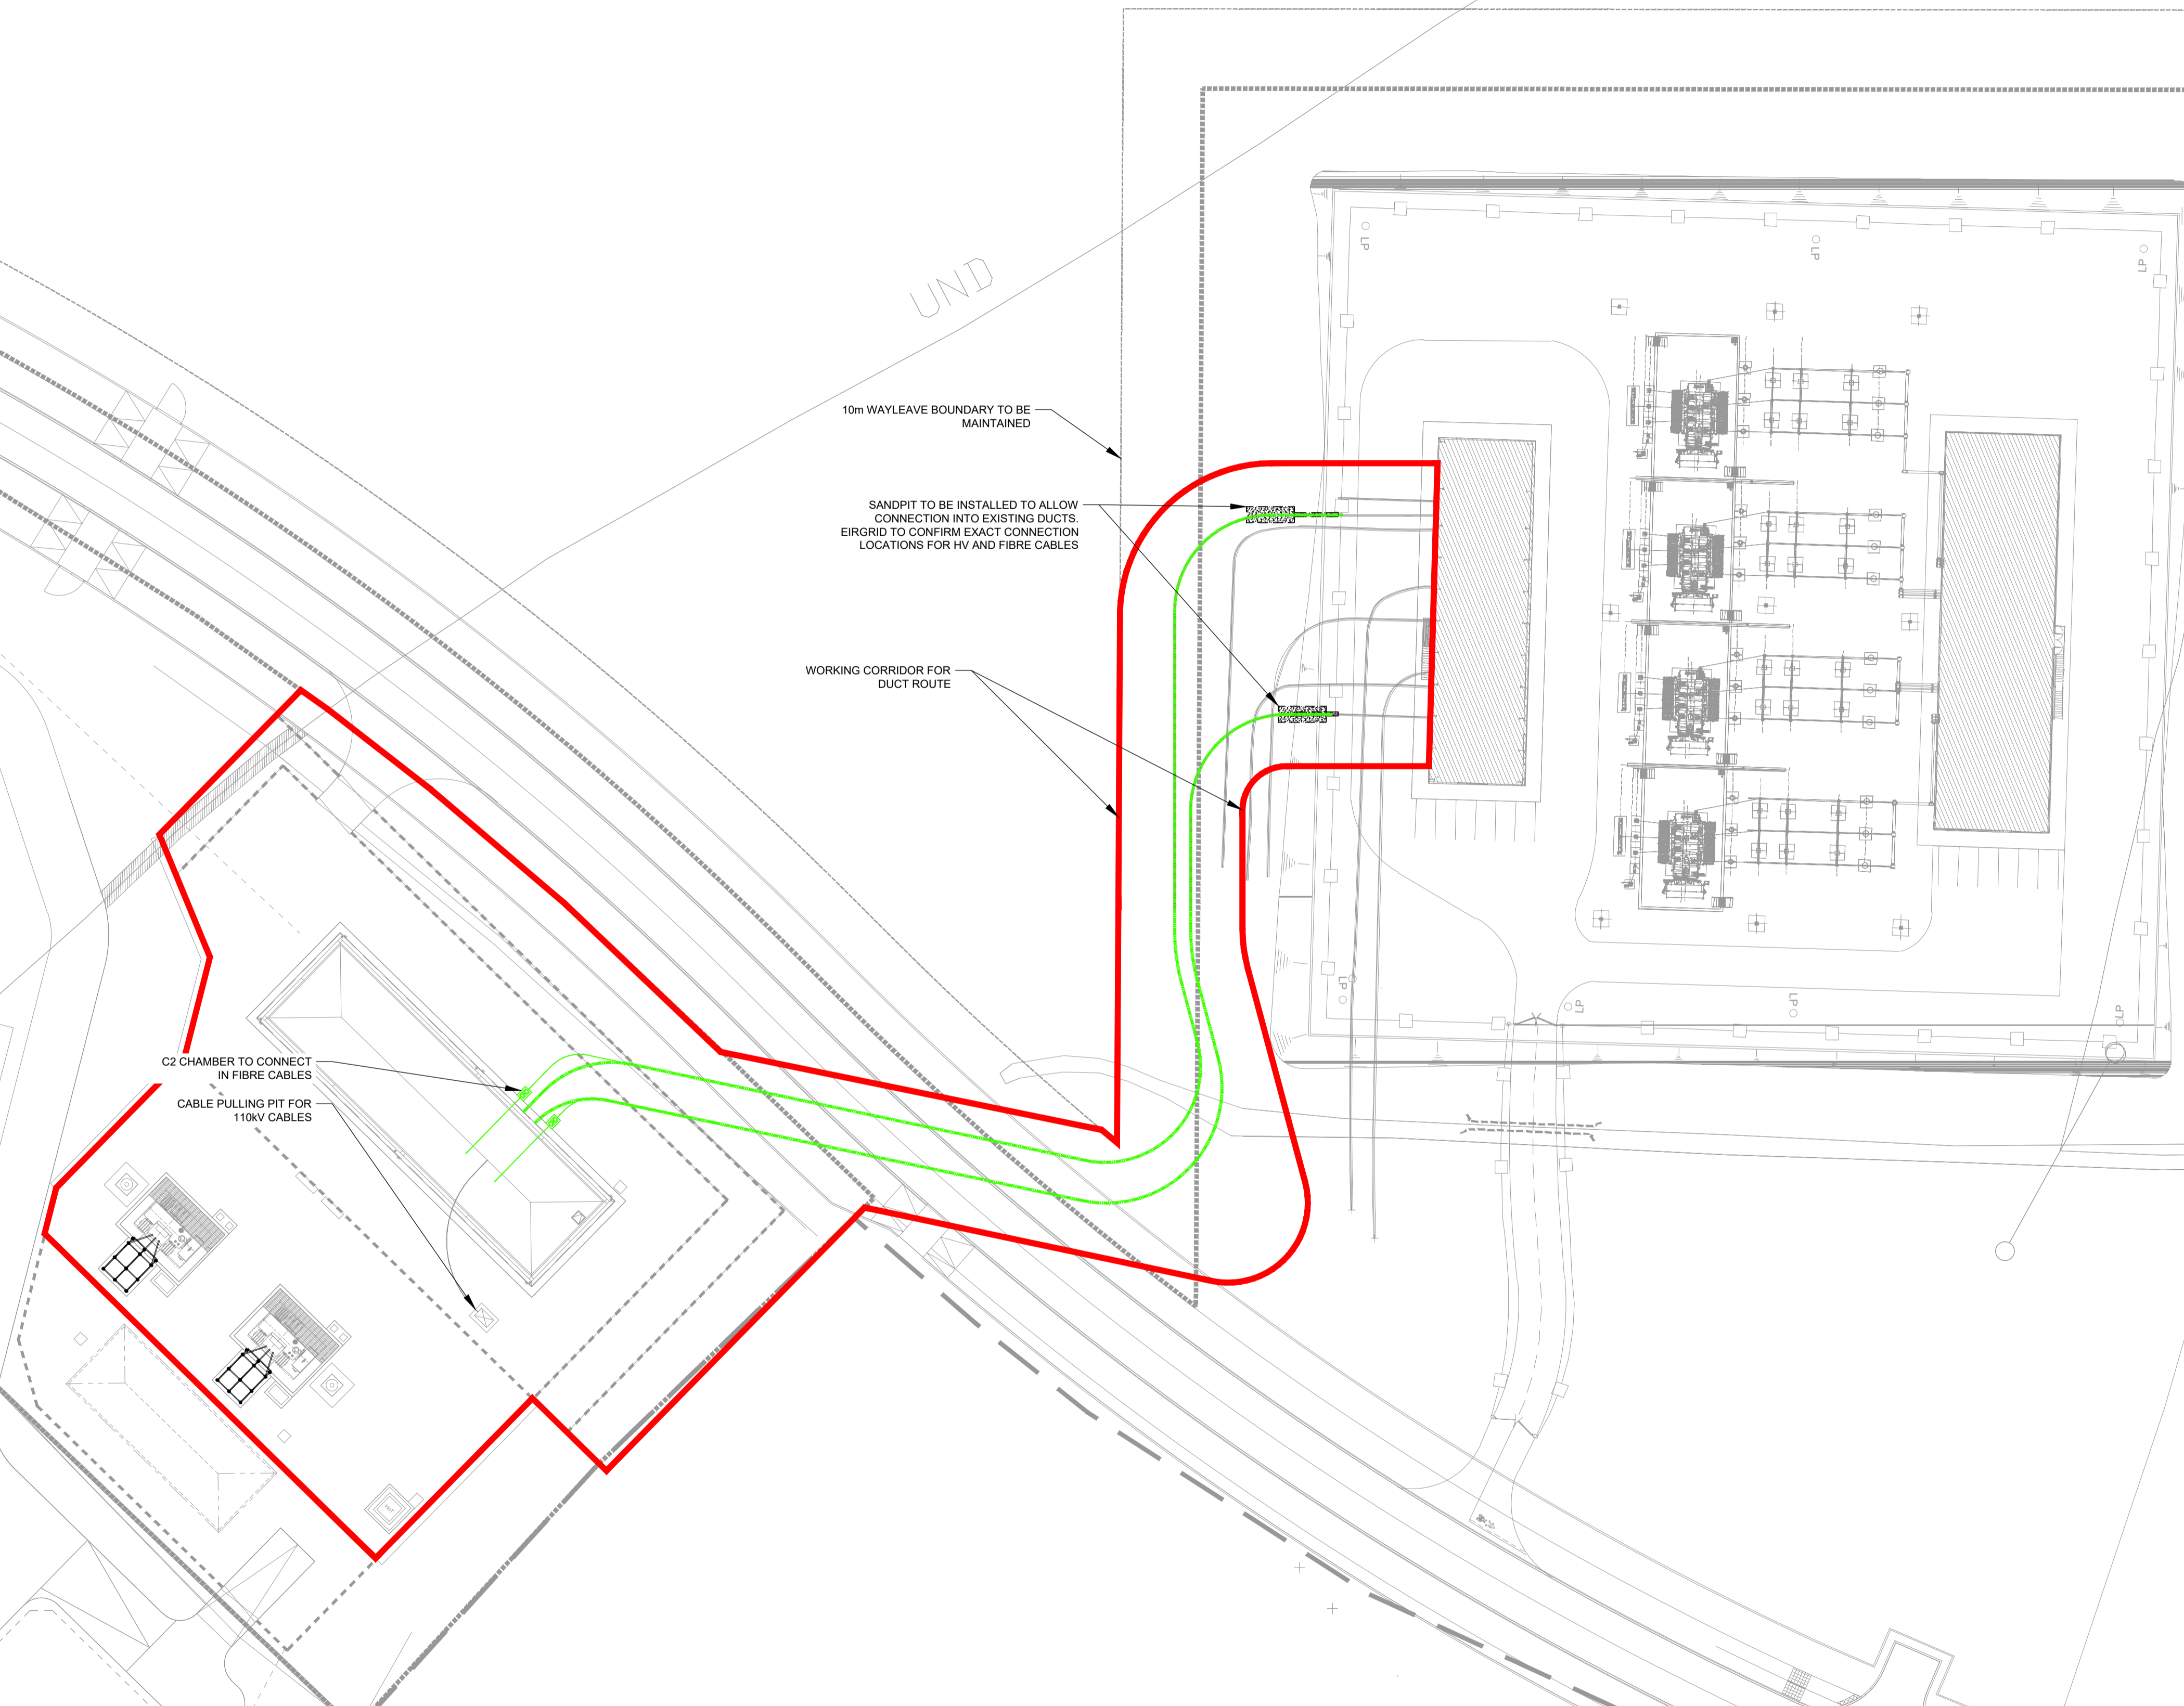

10m WAYLEAVE BOUNDARY TO BE MAINTAINED

SANDPIT TO BE INSTALLED TO ALLOW CONNECTION INTO EXISTING DUCTS. EIRGRID TO CONFIRM EXACT CONNECTION LOCATIONS FOR HV AND FIBRE CABLES

WORKING CORRIDOR FOR DUCT ROUTE

C2 CHAMBER TO CONNECT IN FIBRE CABLES

CABLE PULLING PIT FOR 110KV CABLES