



**South West Elevation**

SCALE 1:250

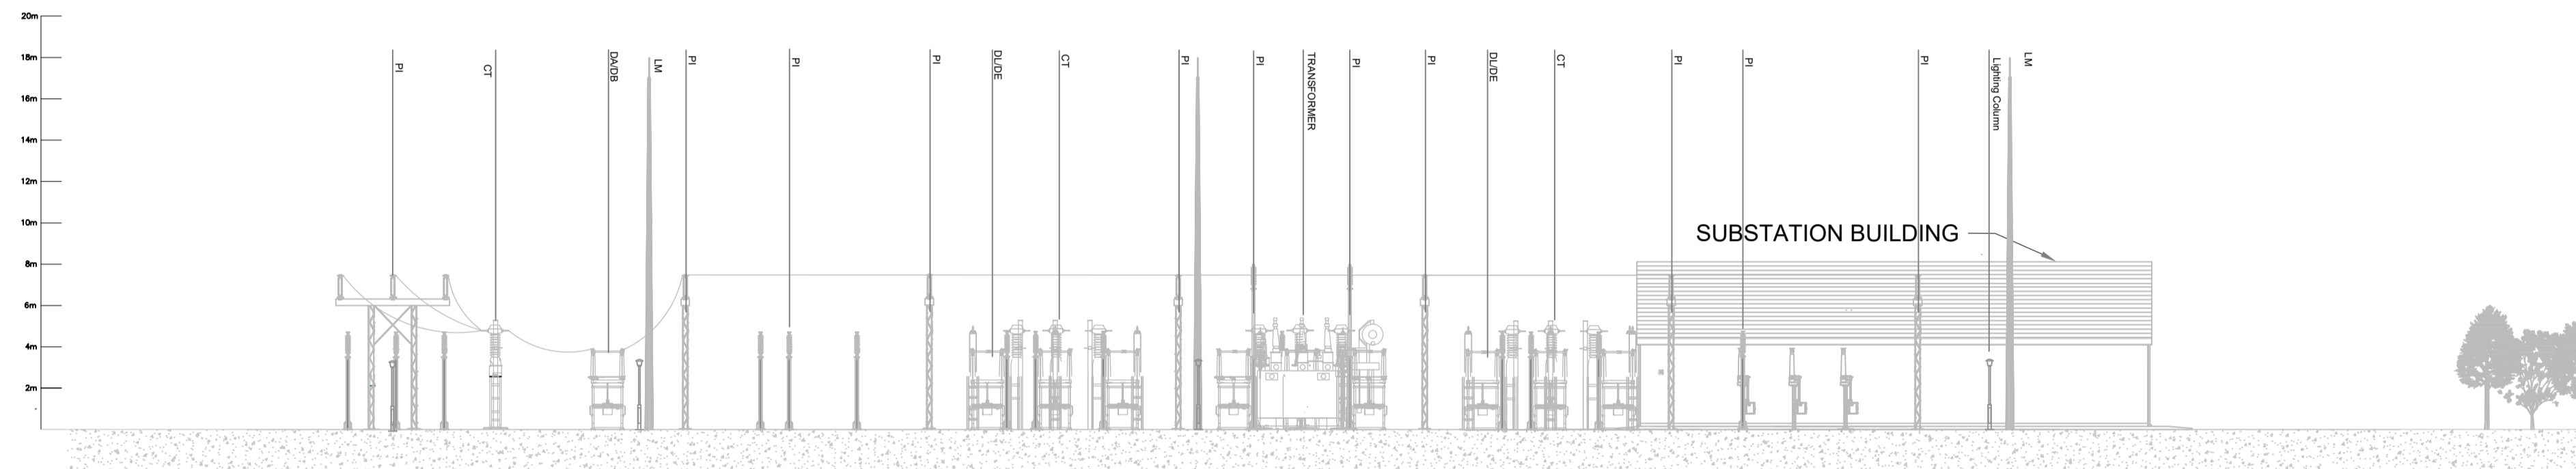


**North East Elevation**

SCALE 1:250

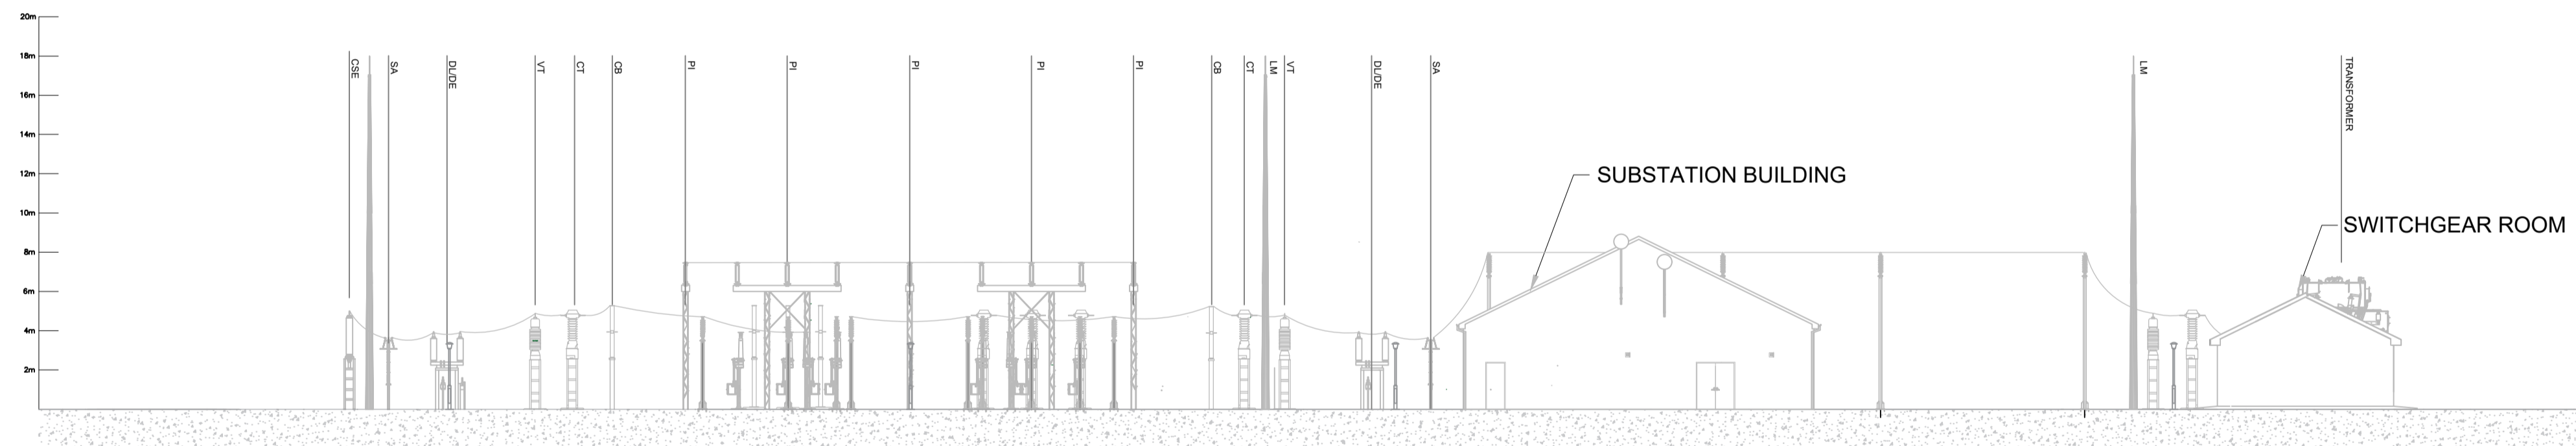

**North West Elevation**

SCALE 1:250

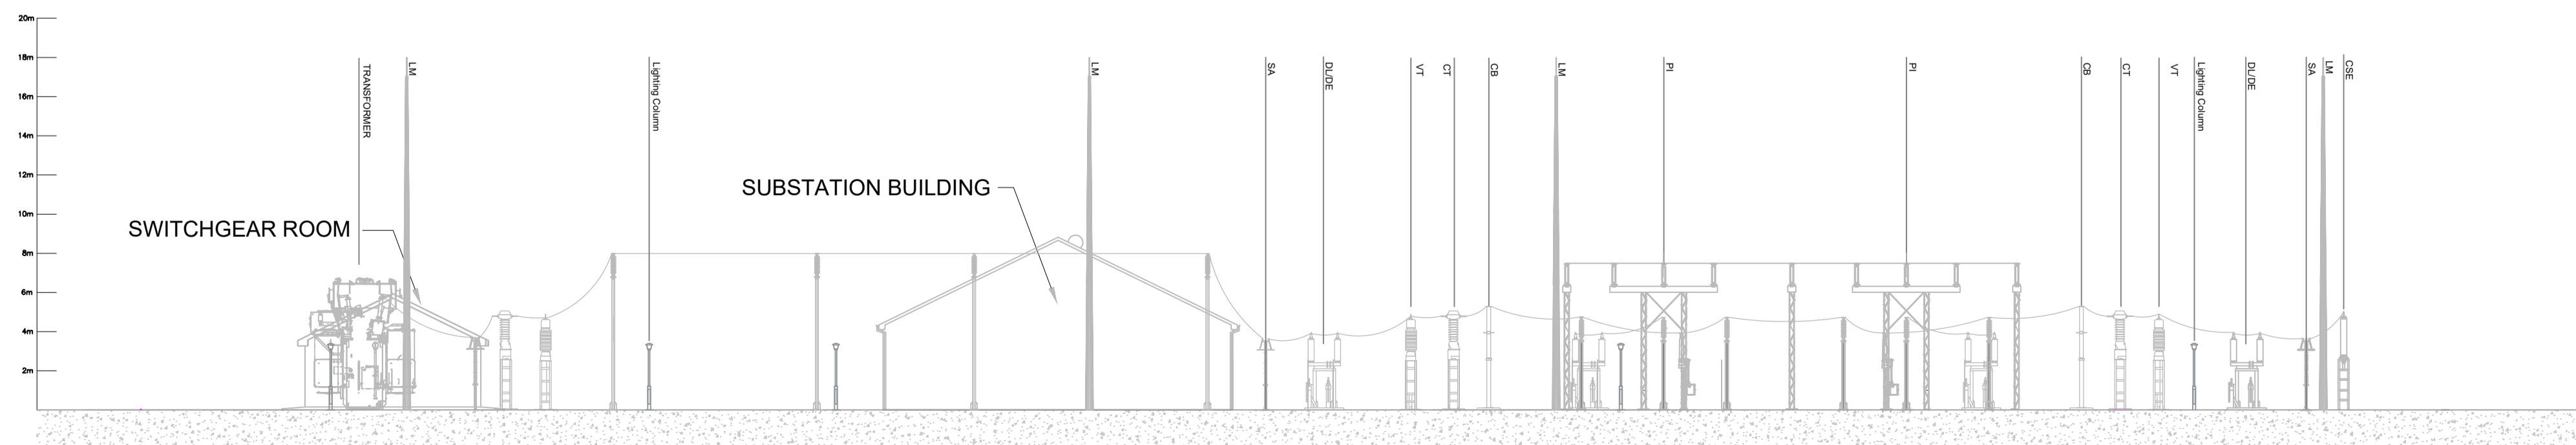


**South East Elevation**

SCALE 1:250

PROJECT

**Castlebanny Wind Farm  
 110kV Grid Connection**

CLIENT

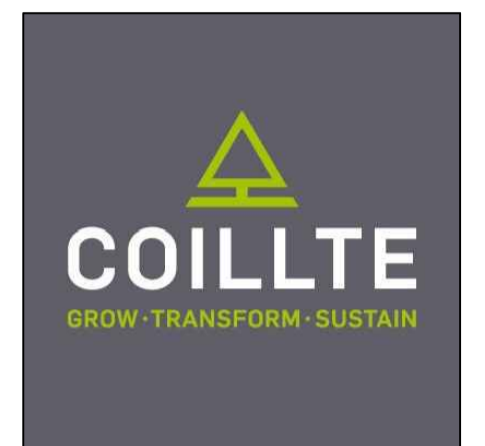

CONSULTANTS



NOTES: -

1. Layout and Arrangements of Substation Building and Electrical Equipment is shown indicatively and for illustration purposes only.
2. Dimensions shown are as per current EirGrid Specifications at the time of submission. Dimensions may vary at time of construction to reflect any revisions to EirGrid Specifications.
3. Final Specifications of Buildings and Electrical Equipment is to be as per EirGrid and ESB Specifications.
4. The Elevation of the Compound will be depicted by localized Topography such that Cut/Fill Earthworks associated with the construction of the Compound are balanced.

LEGEND: -

	Description
CSE	Cable Sealing End.
SA	Surge Arrester.
DL/DE	Line / Earth Disconnect.
DT/DEMI	Trafo / Earth Disconnect.
VT	Voltage Transformer.
CT	Current Transformer.
CB	Circuit Breaker.
DA	Busbar Disconnect.
PI	Post Insulator.
LM	Lightning Mast.
LC	Lighting Column

ISSUE/REVISION

NO	DATE	DESCRIPTION
P01	02.12.20	Issued for Planning
P00	04.09.20	Issued For Information
I/R	DATE	DESCRIPTION

PROJECT NUMBER

05-699

SHEET TITLE

Proposed 110kV AIS Loop Station Elevations

SHEET NUMBER

05699-DR-203