

**Lighting Design Report and Specifications for**

**Strategic Housing Development**  
**~ Lissywollen, Athlone,**  
**Co. Westmeath**

Client	Alanna Roadbridge Developments Ltd.
Project number	20043
Designed by	Patrick Redmond <i>HDip Bus, EngTech AMILP, AMSLL, Tech IEI</i>
Date submitted	15 <sup>th</sup> February 2021

## Contents

Accompanying Documents.....	ii
1 General Information.....	1
1.1 Client & Project.....	1
1.2 Our Design Role.....	1
2 Safety.....	1
2.1 Particular Risks.....	2
2.2 Other Risks.....	2
2.3 Construction and Risk Control.....	2
2.4 Electrical Safety Tests.....	2
2.4.1 Electrical Standard.....	2
2.5 Lighting Columns as a Hazard.....	2
2.6 BS 5489-1:2020.....	3
3 Lighting Design.....	3
3.1 Existing Lighting.....	3
3.2 Dimming.....	4
3.3 Constant Lumen Output.....	4
3.4 Switching.....	4
3.5 Lighting Impact.....	4
4 Lighting Performance.....	4
4.1 Maintenance Factor.....	5
4.2 S/P Ratio.....	5
4.3 Luminaire Selection.....	5
4.4 Luminaire Variation.....	5
4.5 Design Luminaire.....	5
5 Columns.....	5
5.1 Trees and Landscaping.....	5
6 Cable and Ducting.....	5
6.1 Midi Pillars.....	6

6.2	Circuits .....	6
7	Energy Consumption .....	6
Appendix A	Luminaire Quantities .....	7
Appendix B	Luminaire Specification .....	9
Appendix C	Column & Bracket Specification .....	11
Appendix D	Ducting & Cable Specification.....	13
Appendix E	Public Lighting Midi Pillar.....	14
Appendix F	Public Lighting Midi Pillar Fit Out.....	15
Appendix G	Public Lighting Midi Pillar Earthing.....	16

## Accompanying Documents

- 20043 Lighting class selection Brawny Road SHD ~ Lissywollen, Athlone.
- 20043 Product selection calculation SHD ~ Lissywollen, Athlone.
- 20043 Product selection calculation report SHD ~ Lissywollen, Athlone.
- 20043 Spacing calculation Brawny Road West SHD ~ Lissywollen, Athlone.
- 20043 Spacing calculation report Brawny Road West SHD ~ Lissywollen, Athlone.
- 20043 Lighting level calculation full output SHD ~ Lissywollen, Athlone.
- 20043 Lighting level calculation report full output SHD ~ Lissywollen, Athlone.
- 20043 Lighting level calculation dimmed U14 & U15 SHD ~ Lissywollen, Athlone.
- 20043 Lighting level calculation report dimmed U14 & U15 SHD ~ Lissywollen, Athlone.
- 20043 Lighting level calculation full output Brawny & Garrycastle roundabouts SHD ~ Lissywollen, Athlone.
- 20043 Lighting level calculation report full output Brawny & Garrycastle roundabouts SHD ~ Lissywollen, Athlone.
- 20043 Lighting level calculation dimmed U14 & U15 Brawny & Garrycastle roundabouts SHD ~ Lissywollen, Athlone.
- 20043 Lighting level calculation report dimmed U14 & U15 Brawny & Garrycastle roundabouts SHD ~ Lissywollen, Athlone.
- 20043 Cable calculations SHD ~ Lissywollen, Athlone.
- 20043 Energy consumption calculation SHD ~ Lissywollen, Athlone.
- 20043 Lighting layout drawing SHD ~ Lissywollen, Athlone.
- 20043 Lighting layout drawing SHD ~ Lissywollen, Athlone ~ PDF version.

## 1 General Information

The Safety, Health and Welfare at Work (Construction) Regulations 2013 clearly defines certain duties for Designers and for Project Supervisors, Design Stage. In order to meet these duties and to assist other designers and supervisors involved in this project to meet their duties we provide the following information. It must be noted that this information is based on our observations and there may be other risks that are beyond our knowledge on this project.

### 1.1 Client & Project

Project Name	Strategic Housing Development ~ Lissywollen, Athlone, Co. Westmeath
Project Location	Athlone, Co. Westmeath
Client	Alanna Roadbridge Developments Ltd.
Contact	Alan Fenton

### 1.2 Our Design Role

We have completed a lighting design for the above project to comply with relevant EU Norms, National Standards, and best guidance documents as appropriate.

European lighting standards	<i>I.S. EN 13201-2:2015</i> <i>I.S. EN 13201-5:2015</i> <i>I.S. EN 12464-2:2007</i>
Code of practise	<i>BS 5489-1: 2020</i>
Professional guidance documents	<i>ILP PLG03 (2012)</i> <i>Technical Report 12. ILP (2007)</i>
Electrical standard	<i>I.S. 10101:2020</i>
Lantern standard	<i>EN 60598</i>
Column standard	<i>EN 40</i>
Column calculation method	<i>BD94/07</i>
Steelwork protection	<i>EN 1461</i>

The design has been completed based on the drawings provided to us.

Our design covers the physical area defined by the calculation grids marked in the lighting design booklet accompanying this report.

It is not possible to incorporate the blocking and shadowing effect of trees, or other obstructions into the lighting level calculations.

## 2 Safety

We are committed to safe working practises and have done all in our power to identify and 'design out' hazards. If there is any detail within this design that requires clarification or if you need further information, please contact us and we will endeavour to co-operate fully.

## 2.1 Particular Risks

Using Schedule 1 *Non-exhaustive List of Work Involving Particular Risks to the Safety, Health and Welfare of Persons at Work* as a template, we have identified the following risks that affect the design process:

*None that we could identify.*

## 2.2 Other Risks

In addition to the risks described in **2 Particular Risks** above, we have identified the following risks that affect the design process:

*None that we could identify.*

## 2.3 Construction and Risk Control

It is the contractor's responsibility to ensure that their method of work meets their duty of care and requirements under the Safety, Health and Welfare at Work (Construction) Regulations 2013 and any other national or local requirements.

## 2.4 Electrical Safety Tests

It is the electrical contractor's duty to calculate the appropriate fuse size for the electrical infrastructure.

It is the contractor's duty to ensure that all his electrical work meets relevant national and local standards. The contractor must ensure that all electrical safety testing is completed by a competent member of staff and that all test results are recorded and signed, and a copy given to the client and to us.

### 2.4.1 Electrical Standard

The *ETCI National Rules for Electrical Installations Fourth Edition, ET 101:2008* is to be replaced with *IS 10101:2020*. This replacement is to happen over a time frame to allow a smooth transition as follows:

1. 1<sup>st</sup> April 2020: New electrical installations may be designed and certified to the new standard.
2. 31<sup>st</sup> January 2021: This is the last day new electrical installations may be designed to the old standard. Such installations must be certified by 31<sup>st</sup> July 2022.
3. 1<sup>st</sup> February 2021: New electrical installations must be designed to the new standard.
4. 31<sup>st</sup> July 2022: This is the last day an installation may be pre-connection certified to the old standard. Such installations must have been designed by 31<sup>st</sup> January 2021.
5. 1<sup>st</sup> August 2022: Electrical installations must be certified to the new standard.

We design electrical infrastructure to comply with *I.S. 10101 :2020*.

## 2.5 Lighting Columns as a Hazard

Public lighting columns are defined in *BS 5489-1:2020 6.13* as a potential hazard to road users and defines minimal setbacks to the column face from the edge of the carriageway. In general, the edge of the carriageway is defined by the raised kerb in residential developments.

In this project we have located the columns at the back of the footpath or set back by 800mm from the kerb edge to the column face, or 500mm set back from cycle lane edge to the column face.

## **2.6 BS 5489-1:2020**

In 2009, lighting designers in Ireland began reducing the design classification by one step when using white light. Effectively, to achieve *P2*, designing to *P3* with a source of colour rendering index (*Ra*) greater than 60.

This reduction of an entire step became discredited as it reduced the achieved lighting level excessively. In 2012, the *Institution of Lighting Professionals* published *PLG 03* which recommended the use of a weighting factor in line with the *Ra* of the light source, *S/P* ratios, when designing to *P* classifications. This guidance was included in *BS 5489-1 2013*, which was the code of practise that most Irish and UK based lighting designers adhered to.

On the 1<sup>st</sup> July 2020, *BS 5489-1:2020* was published, withdrawing the 2013 version. This revised document has stopped recommending the use of *S/P* ratios and instead has adjusted the lighting design selection process downwards by one whole step. Effectively going back to the 2009 method.

We believe that this will either lower lighting levels below that considered normal practise in Ireland or raise lighting levels, and at the same time increase energy consumption by as much as 40%.

We do not feel it is in our client's interest to follow the advice on selecting lighting classes given in *BS 5489-1:2020*, which is a code of practise rather than a standard. Therefore, we will continue to use the *S/P* ratio as detailed by *PLG 03*. Our lighting designs continue to meet or exceed the lighting levels recommended in *I.S. EN 13201-2:2015* and *S.R. CEN/TR 13201-1:2014*.

## **3 Lighting Design**

Using *S.R. CEN/TR 13201-1:2014 Table 4* we have determined that designing the lighting to comply with *I.S. EN 13201-2:2015 M4* is appropriate for Brawny Road. Given the nature of the spine road and the link to Garrycastle roundabout, an *M* classification is inappropriate. Therefore, we have designed those sections to comply with *I.S. EN 13201-2:2015 C4*, along with the small roundabout in the south west section.

We have designed the lighting on the three sections where the cycle lanes cross the carriageway to comply with *I.S. EN 13201-2:2015 C3*.

We have included a transition zone at the Garrycastle end of the new road, where the lighting is designed to comply with *I.S. EN 13201-2:2015 C2*.

We have designed the lighting in the residential sections to comply with *I.S. EN 13201-2:2015 P3*, in line with standard practise in County Westmeath.

### **3.1 Existing Lighting**

We believe that the lighting on Brawny roundabout may have been designed to an historical standard similar to *I.S. EN 13201-2:2015 C3*. However, the lanterns have been

changed over the years and there is now a mix of types installed. The new cycle lanes in the area will require that three of the existing columns be relocated.

We believe that the lighting on Garrycastle roundabout may have been designed to an historical standard similar to *I.S. EN 13201-2:2015 C1*. The proposed construction will require the retirement of one of these columns.

There are a small number of locations where existing residential lighting will need to be retired.

The lighting on the Brawny Road will not be appropriate for the intended usage and given the installation geometry, age, and condition, it is more appropriate to replace it with a new installation.

We believe that the current lighting on the roundabouts, and on Brawny Road may be connected directly to the DNO network, and it is therefore likely that it uses a concentric cable system.

All the existing lighting has been taken in charge by the local authority. Therefore, only local authority maintenance contractors may undertake any work on the lighting, and only with the written consent of the local authority.

All required changes are shown on the accompanying drawing.

### **3.2 Dimming**

We have designed the lighting to dim by 25% from 00:00 to 06:00 in line with dimming profile *U14* in the residential sections and on all *C* class sections. Lighting on the *M* class section will dim by 33% in line with dimming profile *U15*.

### **3.3 Constant Lumen Output**

The luminaires shall utilise constant lumen output.

### **3.4 Switching**

The luminaires will be operated by PECUs switching at 35/18<sub>lux</sub> levels.

### **3.5 Lighting Impact**

We select the luminaire that uses the lowest energy consumption for the specific application. We utilise the most appropriate lumen package (lumen output and distribution optics) to ensure efficient lighting of the target area and to minimise light spill outside of the area. Our energy consumption calculations are based on the requirements of *IS EN 13201-5:2015*.

We design using full cut off luminaires to ensure there is no direct upward light. We ensure that *threshold increment* is included in our calculations so that the luminaires are not a glare source.

We believe our lighting designs utilise the most energy efficient, sustainable luminaires currently available on the market and reflect practises laid out in relevant standards and in guidance notes from the professional bodies of which we are members, the Institution of Lighting Professionals and the Society of Light and Lighting.

## **4 Lighting Performance**

The lighting design has been carried out based on the performance of the selected luminaire. Any changes to the selected luminaire will make our design obsolete. This

includes variation of specification of the luminaire by any member of the supply chain, including the OEM. Once this design has been approved by the local authority, any changes to the design will also require approval.

#### **4.1 Maintenance Factor**

The luminaire manufacturer's stated *lumen depreciation factor* is 0.9 at 100,000 hours at 25° C for drive current selected. The *lamp survival factor* is 1. The mounting height, environmental zone and cleaning cycle derives a *luminaire maintenance factor* of 0.92 from *table C.1, BS 5489-1:2020*. This results in a *combined maintenance factor* of 0.83 which has been applied to the calculations.

#### **4.2 S/P Ratio**

Following guidance offered in *PLG 03*, a product specific S/P ratio has been applied to the calculation to factor visual efficacy under low level white light in the residential section only.

#### **4.3 Luminaire Selection**

We have selected a luminaire based on energy consumption, photometric performance, and general quality.

#### **4.4 Luminaire Variation**

While we endeavour to use the smallest number of luminaire variations on our projects, our primary aim is to comply with relevant European lighting standards while minimising energy consumption, minimising light pollution and light spill.

We achieve this by selecting an appropriate lumen package to suit the geometry of the area to be illuminated.

#### **4.5 Design Luminaire**

In this instance, we have selected a design based on the stated photometric performance and energy consumption of the Philips LumiStreet Gen2 range.

### **5 Columns**

We have used 8m columns on the traffic route through the development and 6m columns within the residential sections. We have used hinged columns in locations where future access by maintenance crews will be compromised.

We have used 6m columns throughout the development. The columns identified on the accompanying drawing as *PL 30* through *PL 32* will be hinged to facilitate future access for maintenance.

#### **5.1 Trees and Landscaping**

Trees and tall growth should be pruned back so that they do not cause shadowing. No trees or tall shrubs can be planted within a distance equal to the height of the column.

### **6 Cable and Ducting**

Ducting must be laid in accordance with the *National Rules for Electrical Installations I.S. 10101:2020*.

No cable joints are permitted. Cables can share ducts, but they must not be jointed in any manner.

No element of public lighting can stand on, or pass under, private property.

### **6.1 Midi Pillars**

The project will require 29 midi pillars. Midi pillars must not be placed within 2m of the customer service pillar.

### **6.2 Circuits**

No midi pillar will supply more than three circuits. No midi pillar loading exceeds 2kVa.

## **7 Energy Consumption**

The total energy consumption for this project is 29,555 kW/h per annum, including dimming.

## Appendix A Luminaire Quantities

Luminaire Quantities	
Quantity	Item
26	Philips BGP292 DX10 9.5klm in neutral white with 7 pin NEMA socket, DALI registered driver, and CLO. Programmed to dim by 25% from 00:00 to 06:00. Prewired to suit 8m mounting. Luminaire to comply with Appendix B attached. LumiStreet Gen2_Mini_BGP292_DX10_9500_40LED_5.2S_CLO_L90_740.ies PT U14
2	Philips BGP292 DX10 9.5klm in neutral white with 7 pin NEMA socket, DALI registered driver, and CLO. Programmed to dim by 25% from 00:00 to 06:00. Prewired to suit 8m mounting. Luminaire to comply with Appendix B attached. LumiStreet Gen2_Mini_BGP292_DX10_9500_40LED_5.2S_CLO_L90_740.ies SE U14
23	Philips BGP292 DW52 9.0klm in neutral white with 7 pin NEMA socket, DALI registered driver, and CLO. Programmed to dim by 25% from 00:00 to 06:00. Prewired to suit 8m mounting. Luminaire to comply with Appendix B attached. LumiStreet Gen2_Mini_BGP292_DW52_9000_40LED_5.2S_CLO_L90_740.ies PT U14
8	Philips BGP292 DW52 9.0klm in neutral white with 7 pin NEMA socket, DALI registered driver, and CLO. Programmed to dim by 25% from 00:00 to 06:00. Prewired to suit 8m mounting. Luminaire to comply with Appendix B attached. LumiStreet Gen2_Mini_BGP292_DW52_9000_40LED_5.2S_CLO_L90_740.ies SE U14
42	Philips BGP291 DM19 2.8klm in neutral white with 7 pin NEMA socket, DALI registered driver, and CLO. Programmed to dim by 25% from 00:00 to 06:00. Prewired to suit 6m mounting. Luminaire to comply with Appendix B attached. LumiStreet Gen2_Micro_BGP291_DM19_2800_10LED_5.2S_CLO_L90_740.ies PT U14
3	Philips BGP291 DM19 2.8klm in neutral white with 7 pin NEMA socket, DALI registered driver, and CLO. Programmed to dim by 25% from 00:00 to 06:00. Prewired to suit 6m mounting. Luminaire to comply with Appendix B attached. LumiStreet Gen2_Micro_BGP291_DM19_2800_10LED_5.2S_CLO_L90_740.ies SE U14
63	Philips BGP291 DX10 5.0klm in neutral white with 7 pin NEMA socket, DALI registered driver, and CLO. Programmed to dim by 25% from 00:00 to 06:00. Prewired to suit 6m mounting. Luminaire to comply with Appendix B attached. LumiStreet Gen2_Micro_BGP291_DX10_5000_20LED_5.2S_CLO_L90_740.ies PT U14
6	Philips BGP291 DX10 5.0klm in neutral white with 7 pin NEMA socket, DALI registered driver, and CLO. Programmed to dim by 25% from 00:00 to 06:00. Prewired to suit 6m mounting. Luminaire to comply with Appendix B attached. LumiStreet Gen2_Micro_BGP291_DX10_5000_20LED_5.2S_CLO_L90_740.ies SE U14
77	Philips BGP291 DN08 2.0klm in neutral white with 7 pin NEMA socket, DALI registered driver, and CLO. Programmed to dim by 25% from 00:00 to 06:00. Prewired to suit 6m mounting. Luminaire to comply with Appendix B attached. LumiStreet Gen2_Micro_BGP291_DN08_2000_10LED_5.2S_CLO_L90_740.ies PT U14
1	Philips BGP291 DN08 2.0klm in neutral white with 7 pin NEMA socket, DALI registered driver, and CLO. Programmed to dim by 25% from 00:00 to 06:00. Prewired to suit 6m mounting. Luminaire to comply with Appendix B attached. LumiStreet Gen2_Micro_BGP291_DN08_2000_10LED_5.2S_CLO_L90_740.ies SE U14
36	Philips BGP291 DN11 2.4klm in neutral white with 7 pin NEMA socket, DALI registered driver, and CLO. Programmed to dim by 25% from 00:00 to 06:00. Prewired to suit 6m mounting. Luminaire to comply with Appendix B attached. LumiStreet Gen2_Micro_BGP291_DN11_2400_10LED_5.2S_CLO_L90_740.ies PT U14
3	Philips BGP291 DN11 2.4klm in neutral white with 7 pin NEMA socket, DALI registered driver, and CLO. Programmed to dim by 25% from 00:00 to 06:00. Prewired to suit 6m mounting. Luminaire to comply with Appendix B attached. LumiStreet Gen2_Micro_BGP291_DN11_2400_10LED_5.2S_CLO_L90_740.ies SE U14

5	Philips BGP291 DN11 2.4klm in neutral white with 7 pin NEMA socket, DALI registered driver, and CLO. Programmed to dim by 25% from 00:00 to 06:00. Prewired to suit 8m mounting. Luminaire to comply with Appendix B attached. LumiStreet Gen2_Micro_BGP291_DN11_2400_10LED_5.2S_CLO_L90_740.ies SE U14
13	Philips BGP292 DX70 11.0klm in neutral white with 7 pin NEMA socket, DALI registered driver, and CLO. Programmed to dim by 33% from 00:00 to 06:00. Prewired to suit 8m mounting. Luminaire to comply with Appendix B attached. LumiStreet Gen2_Mini_BGP292_DX70_11000_40LED_5.2S_CLO_L90_740.ies SE U15
13	Philips BGP291 DM11 4.0klm in neutral white with 7 pin NEMA socket, DALI registered driver, and CLO. Programmed to dim by 33% from 00:00 to 06:00. Prewired to suit 8m mounting. Luminaire to comply with Appendix B attached. LumiStreet Gen2_Micro_BGP291_DM11_4000_20LED_5.2S_CLO_L90_740.ies SE U14
5	Philips BGP292 DX70 12.5klm in neutral white with 7 pin NEMA socket, DALI registered driver, and CLO. Programmed to dim by 33% from 00:00 to 06:00. Prewired to suit 8m mounting. Luminaire to comply with Appendix B attached. LumiStreet Gen2_Mini_BGP292_DX70_12500_40LED_5.2S_CLO_L90_740.ies PT U15
75	8m column to comply with Appendix C attached.
128	6m column to comply with Appendix C attached.
102	6m hinged column to comply with Appendix C attached.
20	Minimal outreach stub TEE bracket at zero degree inclination to suit 8m column and to comply with Appendix C attached.
1	Minimal outreach stub TEE bracket at zero degree inclination to suit 6m column and to comply with Appendix C attached.
10	0.5m outreach bracket at zero degree inclination to suit 6m column and to comply with Appendix C attached.
326	18/35 PECU.
284	Cut outs.
21	Twin cut outs
29	Midi Pillar
118	Cable access chamber
9900	Metres (approximately) 2 core 6mm <sup>2</sup> NYCY cable to link columns.
2000	Metres (approximately) 2 core 10mm <sup>2</sup> NYCY cable to link columns.
12400	Metres (approximately) Rigid duct to comply with Appendix D attached.
1000	Metres (approximately) Flexy duct.

## Appendix B Luminaire Specification

- 1 The luminaire shall be designed specifically to be used with LED light sources. It shall comply with all relevant EN standards and EC directives required by the CE *Community Marketing Directive*.  
  
Product quality and standard measurements will be based on *IEC/PAS 62717* and *IEC/PAS 62722*.  
  
Lantern shall comply with *EN 60598*.
- 2 The luminaire shall be supplied with surge protection of no less than 10kVa.
- 3 The light source shall be modular and replaceable on site. The module should be fixed in such a way as to maximise heat transfer from the LED chip and its respective board. The LED shall be a neutral white.  
  
The lens assembly shall be protected by an appropriate material. The optic assembly will be protected to IP 66 as defined by *BS EN 60529*.  
  
The lumen depreciation factor shall not exceed 10% at 100 000 hours at *ta* 25°C
- 4 The driver shall be housed in a dedicated, separate chamber within the luminaire, the enclosure will be protected to a minimum of IP 65 as defined by *BS EN 60529*.  
  
The driver shall be DALI registered and capable of communication and interaction with a CMS communication module should it be required in the future. Or shall be capable of being controlled by 1 to 10.  
  
The manufacturer shall ensure that the driver is compatible with the LED array being used, that the driver complies with all appropriate regulation, standards, quality criteria and directives.  
  
Drivers shall have over temperature protection and provide power factor correction of no less than 0.9.
- 5 The luminaire shall be constructed from die cast aluminium and powder coated in grey. All coloured components of the lantern shall be of the same colour code (RAL) and have the same visual appearance when viewed together.
- 6 The optic shall be protected to IP 66, the driver housing shall be protected to IP 66 as defined by *BS EN 60529*. The IP rating must be capable of being maintained throughout the design life of the luminaire.
- 7 The luminaire will be constructed in a robust manner and be suitable to use in the intended application and location. The luminaire shall have a minimum impact resistance of *IK08*.
- 8 A comprehensive written warranty covering lantern, driver and LED chip and module/array shall be provided. Warranty period shall be ten years as a minimum.  
Details of how the local authority can access the warranty claim procedure should be supplied by the manufacturer in writing and signed by a director.
- 9 A signed declaration of conformity, along with certificates for ENC compliance and EMC Directive compliance shall be provided. The equipment will be fully compliant with RoHS requirements.
- 10 The weight and projected side area should be stated for the luminaire with all equipment and angle of installation considered in order to calculate column load for this installation.
- 11 Covers or openings on the lantern or the gear box required to be opened during the installation or maintenance of the light point must be captive when open.
- 12 All screws or fixtures required to be opened during installation or maintenance of the product must be protected against corrosion and seizure for the design life of the lantern.

- 13 LED failure fraction shall not be greater than 5% of the LEDs installed in the lantern over the design life of the lantern.
- 14 Correlated colour temperature shall not exceed four thousand Kelvin.
- 15 The luminaire shall provide thermal protection for all its components to ensure the lantern and its components operate within the stated temperature parameters through the design life of the lantern.
- Ambient temperature related to lantern performance and tests will be in the range of -35°C to +55°C.
- 16 Electrical connection terminals shall be indelibly marked to indicate all wiring connections and use shrouded screws. Control equipment shall bear a clear circuit diagram in order to indicate all component connections in a concise manner.
- Operating voltages shall be clearly marked within the enclosure.
- 17 Electrical terminals shall be capable of terminating three core 2.5mm<sup>2</sup> flexible cable.
- 18 Any link cables, connector blocks and plug & socket arrangements must be of a suitable IP rating for their location and application and comply with all standards or directives.
- 19 The complete luminaire including all component parts shall be guaranteed by the manufacturer for a minimum of ten years. Full written details of the warranty must be provided with the bid.
- 20 The luminaire shall be individually switched via PECU set to 35/18 lux switching. This PECU will be selected by the lantern manufacturer and be included in the lantern warranty, unless a NEMA socket is selected.
- When a NEMA socket is used, it shall be a 7 pin unit and all communication cables shall be connected to the driver at the time of manufacturing.
- 21 The manufacturer shall provide the following information in accordance with the Lighting Industry Liaison Group's *A Guide to the Specification of LED Lighting Products*:
- i. Rated input power, identifying the amount of energy consumed by the lantern, including its power supply in Watts.
  - ii. Rated luminous flux in lumens in absolute photometric values. Absolute photometry results in a LOR=1
  - iii. Lantern efficacy in lumens per Watt.
  - iv. Luminous intensity distribution.
  - v. Correlated colour temperature in Kelvin.
  - vi. Rated colour rendering index (CRI).
  - vii. Rated chromaticity co-ordinate values. Initial and maintained.
  - viii. Maintained luminous flux.
  - ix. Rated life in hours of the LED module and the associated rated lumen maintenance.
  - x. Failure fracture corresponding to the rated life of the LED module within the lantern.
  - xi. Ambient temperature for the lantern.

## Appendix C Column & Bracket Specification

The column and bracket shall be designed to *EN 40* and in accordance with *BD 94/07*. They shall be of suitable size to bear the specified lantern and to achieve a nominal height to light source as called for by the lighting design.

The lighting column manufacturer shall be registered with and certified by either NSAI, British Standards Institute of Quality Assurance Services or Lloyds Register Quality Assurance Register for the design, manufacture, supply and verification of road lighting columns and brackets under their quality assessment schedule to ISO 9001.

The quality assurance certification shall relate to the specific lighting column material being proposed. The local authority reserves the right to request proof of certification from the proposed column manufacturer.

The column will comply with the following specifications:

- 1 The column shall be of functional design and suitable for the location and intended loading.
- 2 The column shall be protected against the ingress of moisture at the top and at the door entry.
- 3 Steel columns shall be galvanised to *BS EN 1461*.
- 4 Roots shall be protected with bitumen or other appropriate material. This protection should extend 100mm above ground level.
- 5 Doors shall be fitted in such a way as to minimise the risk of being pried off. Twin locks should be fitted. Column and door should have earth terminals of suitable mechanical type.
- 6 A suitable non-hygroscopic backboard will be fitted in line with the door and be large enough to take local authority approved termination units.
- 7 The space between the door and the backboard will be sufficient to enable the fitment of termination units as required by the County Council.
- 8 Each lantern shall be individually protected with a suitable fuse unit in the column base.
- 9 Neutral blocks, or looping-in blocks, shall be of an approved grooved bore 63A type, fully insulated and solidly mounted on the backboard.
- 10 Columns shall be wired with a minimum 2.5mm<sup>2</sup> PVC/PVC stranded copper cable.
- 11 All columns shall comply with *I.S. 10101:2020* regulations with regard to minimum door height.
- 12 Columns shall be installed so that their doors are aligned at 90° to the curb edge to enable maintenance personnel face towards oncoming traffic.
- 13 Close protection of street lighting lanterns to be provided by a 25A rated cut-out loaded with a 6A fuse incorporating a *cam lever* single pole disconnection. The cut-out will use a separate neutral and earth. The cut-out must provide ingress protection to *IP21* as defined by *EN 60529*. This fuse type is colloquially identified as conforming to *BS 88*.
- 14 The cut-out shall be constructed to conform to the requirements laid out in *BS 7654* For example: *MC040SLF 25A SLCO TYPE 1 (SNE)* by Lucy Zodion. Note that other cut-outs that meet this specification will be acceptable so long as they are an established and recognised, quality brand and do not have a negative impact on maintenance stock requirements of the local authority or their agents.
- 15 Where three phase supply is required, then separate link boxes will be installed in the column below the cut-out to allow for interconnecting. Link boxes must comply with the requirements laid out in *BS 7657:2010*. Link boxes will be supplied for live 1, live 2, live 3, neutral and finally earth. The link box must provide ingress protection to *IP21* as defined by *EN 60529*.
- 16 All terminals shall be formed from solid brass and be electroplated for temperature rise stability. Terminals shall have a serrated bore to ensure good contact with all types of

- conductors. The incoming terminals shall have additional protection, provided by a red safety shield to guard against accidental contact with live metal.
- 17 All components required will be firmly fixed to the back board of the column in a tidy professional manner. All conductors will be stripped to the appropriate length to allow for connection. No exposed conductors shall be allowed.
- 18 The column shall be earthed from the incoming cable via a 6mm<sup>2</sup> PVC cable which will be connected to the column by a crimped lug.

## Appendix D      Ducting & Cable Specification

- 1      All cabling shall be laid underground in 110mm PVC-U pipe coloured red of high density to *IS 135 class B* with a wall thickness in the range 2.3-2.8mm or other pipe coloured red having a high resistance to impact.  
  
Cable access chambers shall be provided at all road crossings with spare duct provided between chambers.
- 2      The minimum standard acceptable is *EN 50086-2-4* with a 750 Newton load rating for 5% deflection. A minimum cover of 600mm to the ducting shall be provided in grass margins and minimum cover of 750mm to the ducting shall be provided at road crossings.
- 3      The electrical cable should be at least:  
  
6mm<sup>2</sup> NYCY type to *BS 6346:1989*, with colours brown, blue, and green-yellow.
- 4      Cable joints are not permitted. Cables shall be looped from column to column on each circuit. If faults develop on cables prior to commissioning, the section of cable involved shall be replaced.
- 5      A duct should be provided between the ESB section pillar and the Public Lighting Customer Service Pillar.

## Appendix E      Public Lighting Midi Pillar

Public lighting midi pillars must not be located within two metres of an ESNB service pillar.

- 1            All columns shall be supplied from a Public Lighting Customer Service Pillar, located adjacent to the ESB section pillar. Not more than eight columns may be supplied from any one circuit and not more than four circuits may be taken from any one Customer Service Pillar.
- 2            The pillar shall consist of a rectangular box of approximate dimensions above ground of 150mm deep, 250mm width, and 600mm high. The root section shall be 320mm long and turned out at the bottom for a distance of 50mm. This root section will be protected by bitumen or other suitable material.
- 3            The pillar shall be fitted with a recessed, lift-out, door with a weather strip all round. The door shall be fixed with an M8 triangular headed locking screw at the top onto a suitably tapped fixing plate and secured at the bottom by a fixed catch onto the weather strip.
- 4            The door shall be equipped with a suitable unobtrusive finger grip to facilitate easy removal of the door.
- 5            The minimum opening size shall be 220mm wide by 510mm high.
- 6            The pillar shell, door and extension plates shall be of 3mm thick mild steel. The pillar, when fabricated, shall be suitable for free standing or recessing into a wall.
- 7            A suitable non-hygroscopic backboard shall be fitted in each pillar which shall be easily removable.
- 8            A main earth terminal shall also be provided with an insulated earth lead to the door.
- 9            After fabrication the pillar shall be hot dipped galvanized both inside and outside in accordance with *BS EN 1461*.
- 10          The pillar shall have a smooth exterior finish and be free of all sharp and rough edges, both outside and inside.

## Appendix F      Public Lighting Midi Pillar Fit Out

- 1            All electrical components shall be securely mounted on the baseboard.
- 2            All outgoing circuits shall be individually fused by means of a 20A HRC fuse unit, capable of accommodating cable sizes up to 25mm<sup>2</sup>. The fuse shall be rated 16kA minimum rupturing capacity and shall comply with *BS 1361*. The terminals of the fuse unit shall be of the grooved bore type. Unless appropriate calculations call for a different size fuse.  
  
RCDs must not be used.
- 3            Where there is more than one outgoing circuit, a main fuse shall also be provided. The main fuse shall be rated 25A and shall otherwise be identical with individual circuit fuses.
- 4            The electrical contractor shall consult with the local ESB Networks office on ESB interface requirements at the Customer Service Pillar.
- 5            The installed pillar shall be embedded in concrete, *Class E, Clause 1502*, Specification for Road-works, published by the Department of the Environment.
- 6            The front of all Public Lighting Customer Service Pillars shall display a permanent rigid danger warning sign (black lettering on a yellow background), 100mm wide by 120mm deep, securely fixed, as per the local authority specification.

## Appendix G      Public Lighting Midi Pillar Earthing

- 1      All public lighting midi pillars shall be earthed, using an earth electrode and the supply neutralised. The electrode shall consist of a bare copper, or hot dipped galvanised steel rod/pipe of at least 16mm diameter, driven vertically into the soil for a length of at least 1,200mm. If difficulties arise in driving the vertical rod, due to underground services, a horizontal earth electrode may be installed as follows:  
  
A straight length of at least 4.5m of either:
  - 16mm diameter bare copper.
  - 16mm diameter hot dipped galvanised steel rod.
  - 25mm<sup>2</sup> cross-section bare copper.
  - 25mm<sup>2</sup> cross-section hot dipped galvanised steel rod.  
This should be buried in the soil to a depth of at least 500mm. The earthing lead shall exit the pillar through the services cable entry opening.
- 2      The connection at the earth electrode shall be accessible for inspection and shall be protected against corrosion by a suitable waterproof tape. The connection shall be enclosed in a galvanised steel box, with an inspection cover. After inspection, the connection shall be buried underground.
- 3      A main earth terminal shall be mounted on the pillar baseboard, with the following connections:
  - 10mm<sup>2</sup> PVC cable from the earth terminal on the pillar, with a crimped lug connection to the pillar,
  - 10mm<sup>2</sup> PVC cable from the earth electrode,
  - 10mm<sup>2</sup> PVC cable from the neutral link.
- 4      A main earth terminal shall be mounted on the baseboard in each lighting column, with the following connections:
  - 6mm<sup>2</sup> PVC cable from the earth terminal to the column, with a crimped lug connection to the column,
  - 2.5mm<sup>2</sup> PVC cable from the lantern earth terminal.
- 5      The outer sheath of the incoming and/or outgoing service cable shall be connected to the main earth terminal, in the case of both the lighting column and the public lighting customer service pillar.
- 6      Earth continuity cables shall be coloured yellow/green, in accordance with *I.S. 10101:2020* wiring rules. In the case of NYC cables, appropriate yellow/green sleeving shall be used.

## M Classification Selection

Project Name SHD ~ Lissywoollen, Athlone, Co. Westmeath  
Project Number 20043

Parameter	Options	Description <sup>a</sup>		Weighting Value $V_w$ <sup>a</sup>	Designer Selection
<b>Design speed or speed limit</b>	Very high	$v \geq 100\text{km/h}$		2	
	High	$70 < v < 100\text{km/h}$		1	
	Moderate	$40 < v \leq 70\text{km/h}$		-1	-1
	Low	$v \leq 40\text{km/h}$		-2	
<b>Traffic volume</b>		Motorways, multilane routes	Two lane routes		
	High	> 65% of maximum capacity	> 45% of maximum capacity	1	1
	Moderate	35% - 65% of maximum capacity	15% - 45% of maximum capacity	0	
	Low	< 35% of maximum capacity	< 15% of maximum capacity	-1	
<b>Traffic composition</b>	Mixed with high percentage of non-motorised			2	
	Mixed			1	1
	Motorised only			0	
<b>Separation of carriageway</b>	No			1	1
	Yes			0	
<b>Junction density</b>		Intersection/km	Interchanges, distances between		
	High	> 3	< 3	1	
	Moderate	$\leq 3$	$\geq 3$	0	0
<b>Parked vehicles</b>	Present			1	
	Not present			0	0
<b>Ambient luminosity</b>	High	Shopping windows, advertisement expressions, sports fields, station areas, storage areas		1	
	Moderate	Normal situation		0	0
	Low			0	
<b>Navigational task</b>	Very difficult			2	
	Difficult			1	
	Easy			0	0

<sup>a</sup> The values stated in the column are an example. Any adaption of the method or more appropriate weighting values can be used instead, on the national level.

**Number of lighting classes** 6  
**Weighting Value  $V_w$**  2  
**M Lighting class selected** 4

**DATE:** 10 February 2021  
**DESIGNER:** Patrick Redmond  
**PROJECT No:** 20043  
**PROJECT NAME:** SHD ~ Lissywollen, Athlone



Lighting on Brawny Road designed to comply with I.S. EN 13201-2:2015 M4 ~ Spacing calculation attached. Lighting on spine road & small r'bout to I.S. EN 13201-2:2015 C4. Cycle & pedestrian cross points (main road) to I.S. EN 13201-2:2015 C3. Residential section to I.S. EN 13201-2:2015 P3. Energy consumption assessed in accordance with I.S. EN 13201-5:2015.

A product specific S/P ratio has been applied to the calculation to factor visual efficacy under low level white light, in line with guidance offered by PLG 03 (ILP '12), residential section only.

LMF 0.92 x LDF 0.9 x LSF 1 = MF 0.83 at 100,000 hours with 25 degree ambient. Photometry measured at minimum 15 degree ambient.

Luminaire A = 53W. B = 50W. C = 17W. D = 29W. E = 12W.  
F = 14W. G = 63W. H = 23W. I = 74W.  
Connected load, averaged for CLO.

## **Lighting Level ~ Full Output**

**PREPARED BY:** Patrick Redmond Hdip BUS, EngTech AMILP, AMSLL, Tech IEI  
Redmond Analytical Management Services Ltd.  
M~ 086 2356356  
O~ 053 9383696  
patrick@redmondams.ie  
Rosewood House, Mount Seaton, Camolin,  
Enniscorthy, Co. Wexford. Y21 K8P3  
www.redmondams.ie  
Document control: TD 01 Version: 1.0

## Layout Report

### General Data

Dimensions in Metres Angles in Degrees

### Calculation Grids

ID	Grid Name	X	Y	X' Length	Y' Length	X' Spacing	Y' Spacing
1	Spine Road 1	1257.64	440.92	326.11	189.59	1.50	1.49
2	Spine Road 2	1549.37	293.68	326.11	113.40	1.50	1.49
3	Spine Road 3	1886.75	287.61	326.11	88.49	1.50	1.50
4	Spine Road 4	2202.16	75.26	126.45	179.78	1.49	1.50
5	Sector 1A1	1733.59	339.21	259.00	100.32	1.50	1.50
6	Sector 1A2	1984.27	272.68	73.61	78.82	1.47	1.49
7	Sector 1A3	1715.73	276.66	128.91	65.08	1.50	1.48
8	Sector 1A4	1749.74	252.74	73.08	15.68	1.49	1.43
9	Sector 1B1	1840.09	242.70	246.01	72.91	1.49	1.49
10	Sector 1B2	1844.33	125.35	234.91	112.59	1.50	1.48
11	Sector 1B3	2001.91	232.16	53.65	37.62	1.49	1.45
12	Sector 2A1	1643.89	188.28	84.46	106.20	1.48	1.50
13	Sector 2A2	1722.84	160.90	126.74	94.92	1.49	1.48
14	Sector 2A3	1803.97	224.96	29.59	51.61	1.48	1.47
15	Sector 2B1	1662.74	306.22	59.77	148.81	1.49	1.49
16	Sector 2B2	1556.67	212.29	90.77	118.47	1.49	1.50
17	Sector 3A	1301.63	427.83	167.49	186.35	1.50	1.49
18	Sector 3B	1247.12	296.41	321.87	140.59	1.50	1.50
19	Sector 3 Roundabout	1301.41	413.71	47.76	55.15	1.49	1.49
20	Crossing Assessment	1257.24	627.97	10.23	17.76	1.46	1.48

### Luminaires



#### Luminaire A Data

Supplier	Philips
Type	BGP292 DX10
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	9.50
File Name	LumiStreet Gen2 Mini_BGP292_DX10_9500_40LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	513.2, 85.3, 0.0
Lamp S/P Ratio	1.61
No. in Project	28



#### Luminaire B Data

Supplier	Philips
Type	BGP292 DW52
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	9.00
File Name	LumiStreet Gen2 Mini_BGP292_DW52_9000_40LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	639.6, 45.2, 0.0
Lamp S/P Ratio	1.61
No. in Project	31

## Luminaires



### Luminaire C Data

Supplier	Philips
Type	BGP291 DM10
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	2.80
File Name	LumiStreet Gen2 Micro_BGP291_DM10_280_0_10LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	534.0, 55.4, 0.0
Lamp S/P Ratio	1.61
No. in Project	45



### Luminaire D Data

Supplier	Philips
Type	BGP291 DX10
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	5.00
File Name	LumiStreet Gen2 Micro_BGP291_DX10_5000_20LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	513.2, 85.3, 0.0
Lamp S/P Ratio	1.61
No. in Project	69



### Luminaire E Data

Supplier	Philips
Type	BGP291 DN08
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	2.00
File Name	LumiStreet Gen2 Micro_BGP291_DN08_2000_10LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	753.5, 151.2, 0.0
Lamp S/P Ratio	1.61
No. in Project	78



### Luminaire F Data

Supplier	Philips
Type	BGP291 DN11
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	2.40
File Name	LumiStreet Gen2 Micro_BGP291_DN11_2400_10LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	595.8, 72.9, 0.0
Lamp S/P Ratio	1.61
No. in Project	44



### Luminaire G Data

Supplier	Philips
Type	BGP292 DX70
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	11.00
File Name	LumiStreet Gen2 Mini_BGP292_DX70_11000_40LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	325.1, 353.8, 0.0
Lamp S/P Ratio	1.61
No. in Project	13



### Luminaire H Data

Supplier	Philips
Type	BGP291 DM11
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	4.00
File Name	LumiStreet Gen2 Micro_BGP291_DM11_400_0_20LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	555.3, 96.2, 0.0
Lamp S/P Ratio	1.61
No. in Project	13



### Luminaire I Data


Supplier	Philips
Type	BGP292 DX70
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	12.50
File Name	LumiStreet Gen2 Mini_BGP292_DX70_12500_40LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	325.1, 353.8, 0.0
Lamp S/P Ratio	1.61
No. in Project	5



### Luminaire J Data

Supplier	_Historic Lanterns
Type	ZX3/Clear_P/1289/103/-39/922301
Lamp(s)	150W-SONT+
Lamp Flux (klm)	18.00
File Name	ZX3_Clear Poly_1289_SON-T+_150_103#-3_9_922301TX.ltd
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	545.9, 77.6, 38.8
Lamp S/P Ratio	0.00
No. in Project	11

## Luminaires



### Luminaire K Data

Supplier	_Historic Lanterns
Type	ZX3/FG/1289/115/-45/892242
Lamp(s)	250W-SONT+
Lamp Flux (klm)	33.20
File Name	ZX3_Flat Glass_1289_SON-T+_250_115#-45_892242TY.lgt
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	389.0, 25.0, 0.0
Lamp S/P Ratio	0.00
No. in Project	11

**Layout**

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Target X	Target Y	Target Z
1	A	1473.27	460.05	8.00	163.00	0.00	0.00	0.50			
2	B	1439.08	387.77	8.00	344.00	0.00	0.00	0.50			
3	B	1447.24	416.64	8.00	344.00	0.00	0.00	0.50			
4	B	1454.23	440.88	8.00	341.00	0.00	0.00	0.50			
5	B	1375.22	525.32	8.00	197.00	0.00	0.00	0.50			
6	A	1440.54	459.29	8.00	78.00	0.00	0.00	0.50			
7	A	1414.13	466.83	8.00	73.00	0.00	0.00	0.50			
8	A	1388.41	479.24	8.00	47.00	0.00	0.00	0.50			
9	B	1374.41	503.35	8.00	31.00	0.00	0.00	0.50			
10	B	1365.71	552.73	8.00	352.00	0.00	0.00	0.50			
11	B	1356.20	576.26	8.00	25.00	0.00	0.00	0.50			
12	B	1351.95	600.54	8.00	236.00	0.00	0.00	0.50			
13	B	1325.29	613.12	8.00	246.00	0.00	0.00	0.50			
14	A	1502.41	378.26	8.00	262.00	0.00	0.00	0.50			
15	A	1478.02	383.65	8.00	258.00	0.00	0.00	0.50			
16	A	1526.80	372.65	8.00	258.00	0.00	0.00	0.50			
17	A	1551.17	367.71	8.00	258.00	0.00	0.00	0.50			
18	A	1575.27	363.04	8.00	260.00	0.00	0.00	0.50			
19	B	1353.89	521.03	8.00	308.00	0.00	0.00	0.50			
20	B	1457.60	384.72	8.00	247.00	0.00	0.00	0.50			
21	F	1462.19	402.91	6.00	162.00	0.00	0.00	0.40			
22	F	1351.48	534.17	6.00	333.00	0.00	0.00	0.40			
23	F	1325.48	613.49	8.00	67.00	0.00	0.00	0.40			
24	F	1371.78	496.62	6.00	26.00	0.00	0.00	0.40			
25	F	1365.33	552.77	8.00	177.00	0.00	0.00	0.40			
26	F	1352.09	600.76	8.00	47.00	0.00	0.00	0.40			
27	F	1341.43	515.74	6.00	333.00	0.00	0.00	0.40			
28	F	1462.99	389.50	6.00	216.00	0.00	0.00	0.50			
29	F	1362.17	508.15	6.00	40.00	0.00	0.00	0.40			
30	A	1603.78	347.30	8.00	218.00	0.00	0.00	0.50			
31	A	1621.66	323.67	8.00	213.00	0.00	0.00	0.50			
32	A	1659.46	307.34	8.00	251.00	0.00	0.00	0.50			
33	A	1684.62	299.76	8.00	258.00	0.00	0.00	0.50			
34	A	1629.83	301.56	8.00	76.00	0.00	0.00	0.50			
35	A	1710.12	293.01	8.00	253.00	0.00	0.00	0.50			
36	A	1735.83	292.28	8.00	202.00	0.00	0.00	0.50			

**Layout Continued**

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Target X	Target Y	Target Z
37	B	1734.54	267.83	8.00	31.00	0.00	0.00	0.50			
38	B	1756.36	256.59	8.00	208.00	0.00	0.00	0.50			
39	A	1771.19	232.52	8.00	77.00	0.00	0.00	0.50			
40	A	1800.55	224.43	8.00	80.00	0.00	0.00	0.50			
41	B	1816.29	242.17	8.00	297.00	0.00	0.00	0.50			
42	B	1843.50	241.65	8.00	135.00	0.00	0.00	0.50			
43	B	1838.13	261.77	8.00	337.00	0.00	0.00	0.50			
44	B	1853.33	306.44	8.00	346.00	0.00	0.00	0.50			
45	B	1844.64	284.62	8.00	347.00	0.00	0.00	0.50			
46	A	1880.30	293.47	8.00	76.00	0.00	0.00	0.50			
47	B	1909.61	287.16	8.00	74.00	0.00	0.00	0.50			
48	D	1599.96	364.22	6.00	155.00	0.00	0.00	0.40			
49	C	1727.14	313.85	6.00	346.00	0.00	0.00	0.90			
50	D	1858.58	333.99	6.00	342.00	0.00	0.00	0.40			
51	A	1937.77	276.94	8.00	76.00	0.00	0.00	0.50			
52	A	1966.76	268.87	8.00	76.00	0.00	0.00	0.50			
53	A	1997.74	269.29	8.00	112.00	0.00	0.00	0.50			
54	A	2018.93	290.91	8.00	290.00	0.00	0.00	0.50			
55	A	2050.15	297.52	8.00	277.00	0.00	0.00	0.50			
56	A	2082.65	300.89	8.00	273.00	0.00	0.00	0.50			
57	A	2114.68	301.89	8.00	273.00	0.00	0.00	0.50			
58	B	2147.92	300.33	8.00	262.00	0.00	0.00	0.50			
59	B	2177.26	285.94	8.00	222.00	0.00	0.00	0.50			
60	B	2185.25	256.49	8.00	43.00	0.00	0.00	0.50			
61	B	2218.93	247.03	8.00	238.00	0.00	0.00	0.50			
62	F	2035.55	300.79	8.00	291.00	0.00	0.00	0.40			
63	B	2242.38	228.95	8.00	221.00	0.00	0.00	0.50			
64	B	2255.25	201.82	8.00	191.00	0.00	0.00	0.50			
65	B	2247.59	169.12	8.00	10.00	0.00	0.00	0.50			
66	B	2253.15	134.91	8.00	8.00	0.00	0.00	0.50			
67	A	2269.30	103.98	8.00	35.00	0.00	0.00	0.50			
68	A	2290.83	87.40	8.00	68.00	0.00	0.00	0.50			
69	B	2312.21	82.55	8.00	84.00	0.00	0.00	0.50			
70	D	1736.68	348.27	6.00	344.00	0.00	0.00	0.90			
71	D	1745.63	379.37	6.00	346.00	0.00	0.00	0.90			
72	D	1754.49	410.18	6.00	348.00	0.00	0.00	0.90			

**Layout Continued**

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Target X	Target Y	Target Z
73	C	1819.75	408.62	6.00	253.00	0.00	0.00	0.40			
74	C	1786.91	417.99	6.00	253.00	0.00	0.00	0.40			
75	C	1852.71	399.32	6.00	254.00	0.00	0.00	0.40			
76	C	1880.78	391.26	6.00	255.00	0.00	0.00	0.40			
77	C	1914.28	381.79	6.00	253.00	0.00	0.00	0.40			
78	C	1946.19	372.98	6.00	256.00	0.00	0.00	0.40			
79	D	1969.67	357.14	6.00	75.00	0.00	0.00	0.90			
80	C	2002.08	356.51	6.00	252.00	0.00	0.00	0.40			
81	D	1809.19	383.69	6.00	346.00	0.00	0.00	0.40			
82	D	1800.32	351.27	6.00	346.00	0.00	0.00	0.40			
83	D	1867.92	367.61	6.00	344.00	0.00	0.00	0.40			
84	D	1943.46	353.66	6.00	168.00	0.00	0.00	0.90			
85	C	1935.89	327.24	6.00	166.00	0.00	0.00	0.40			
86	D	2002.41	333.39	6.00	161.00	0.00	0.00	0.40			
87	D	1994.03	300.82	6.00	161.00	0.00	0.00	0.40			
88	D	1763.76	342.57	6.00	254.00	0.00	0.00	0.40			
89	D	1796.01	333.42	6.00	257.00	0.00	0.00	0.40			
90	E	1820.11	324.57	6.00	257.00	0.00	0.00	0.40			
91	E	1827.23	314.48	6.00	287.00	0.00	0.00	0.40			
92	D	1931.23	310.62	6.00	163.00	0.00	0.00	0.40			
93	D	2024.47	333.03	6.00	21.00	0.00	0.00	0.40			
94	D	2031.43	310.12	6.00	12.00	0.00	0.00	0.40			
95	E	2008.13	322.56	6.00	197.00	0.00	0.00	0.40			
96	E	2020.63	318.53	6.00	105.00	0.00	0.00	0.40			
97	E	2009.03	307.04	6.00	108.00	0.00	0.00	0.40			
98	E	2016.82	333.50	6.00	105.00	0.00	0.00	0.40			
99	E	2002.46	295.05	6.00	27.00	0.00	0.00	0.40			
100	E	2018.86	299.41	6.00	197.00	0.00	0.00	0.40			
101	C	2023.93	349.53	6.00	227.00	0.00	0.00	0.40			
102	D	1761.81	290.40	6.00	251.00	0.00	0.00	0.40			
103	D	1771.06	269.48	6.00	122.00	0.00	0.00	0.40			
104	F	1794.99	288.99	6.00	295.00	0.00	0.00	0.40			
105	F	1819.61	292.61	6.00	122.00	0.00	0.00	0.40			
106	E	1836.13	302.23	6.00	286.00	0.00	0.00	0.40			
107	F	1804.81	307.06	6.00	344.00	0.00	0.00	0.40			
108	E	1762.68	304.70	6.00	346.00	0.00	0.00	0.40			

**Layout Continued**

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Target X	Target Y	Target Z
109	E	1779.50	314.29	6.00	165.00	0.00	0.00	0.40			
110	E	1758.19	320.17	6.00	346.00	0.00	0.00	0.40			
111	E	1760.79	312.85	6.00	255.00	0.00	0.00	0.40			
112	E	1801.18	270.20	6.00	24.00	0.00	0.00	0.40			
113	E	1811.27	252.21	6.00	23.00	0.00	0.00	0.40			
114	E	1785.00	262.57	6.00	301.00	0.00	0.00	0.40			
115	E	1795.93	251.93	6.00	37.00	0.00	0.00	0.40			
116	F	1793.27	318.75	6.00	78.00	0.00	0.00	0.40			
117	C	1906.27	271.65	6.00	342.00	0.00	0.00	0.40			
118	C	1900.36	250.48	6.00	343.00	0.00	0.00	0.40			
119	C	1978.06	251.43	6.00	345.00	0.00	0.00	0.40			
120	C	1969.42	220.78	6.00	345.00	0.00	0.00	0.40			
121	C	1994.34	247.03	6.00	162.00	0.00	0.00	0.40			
122	C	1985.83	217.41	6.00	160.00	0.00	0.00	0.40			
123	D	1888.22	241.80	6.00	254.00	0.00	0.00	0.40			
124	C	1920.72	232.27	6.00	251.00	0.00	0.00	0.40			
125	D	1952.79	223.21	6.00	256.00	0.00	0.00	0.40			
126	F	1983.26	208.08	6.00	260.00	0.00	0.00	0.90			
127	F	2037.92	192.04	6.00	256.00	0.00	0.00	0.40			
128	F	2061.68	178.54	6.00	79.00	0.00	0.00	0.90			
129	F	1854.91	238.95	6.00	74.00	0.00	0.00	0.40			
130	E	2002.20	229.74	6.00	76.00	0.00	0.00	0.40			
131	E	2007.83	246.73	6.00	251.00	0.00	0.00	0.40			
132	F	2013.92	218.04	6.00	80.00	0.00	0.00	0.40			
133	E	2027.24	231.01	6.00	132.00	0.00	0.00	0.40			
134	E	2023.63	244.39	6.00	284.00	0.00	0.00	0.40			
135	E	2013.62	253.02	6.00	1.00	0.00	0.00	0.40			
136	E	2036.33	256.34	6.00	166.00	0.00	0.00	0.40			
137	E	2023.94	260.01	6.00	304.00	0.00	0.00	0.40			
138	D	1931.44	204.92	6.00	346.00	0.00	0.00	0.40			
139	E	1899.93	215.81	6.00	161.00	0.00	0.00	0.40			
140	D	1996.36	180.14	6.00	346.00	0.00	0.00	0.40			
141	F	2013.98	192.22	6.00	78.00	0.00	0.00	0.90			
142	D	1885.59	219.60	6.00	162.00	0.00	0.00	0.40			
143	D	1869.16	200.28	6.00	334.00	0.00	0.00	0.40			
144	D	1860.30	169.29	6.00	346.00	0.00	0.00	0.40			

**Layout Continued**

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Target X	Target Y	Target Z
145	D	1864.17	143.19	6.00	162.00	0.00	0.00	0.40			
146	F	1855.89	127.66	6.00	74.00	0.00	0.00	0.40			
147	C	1923.01	176.12	6.00	344.00	0.00	0.00	0.40			
148	C	1913.90	143.14	6.00	342.00	0.00	0.00	0.40			
149	F	1910.67	119.43	6.00	74.00	0.00	0.00	0.40			
150	E	1894.64	197.21	6.00	165.00	0.00	0.00	0.40			
151	C	1895.92	180.82	6.00	254.00	0.00	0.00	0.40			
152	E	1921.12	185.12	6.00	342.00	0.00	0.00	0.40			
153	F	1886.86	162.35	6.00	164.00	0.00	0.00	0.40			
154	F	1877.88	136.12	6.00	171.00	0.00	0.00	0.40			
155	E	1904.37	166.82	6.00	80.00	0.00	0.00	0.40			
156	E	1894.39	137.05	6.00	70.00	0.00	0.00	0.40			
157	E	1889.89	130.93	6.00	252.00	0.00	0.00	0.40			
158	E	1931.61	119.90	6.00	258.00	0.00	0.00	0.40			
159	E	1961.88	111.39	6.00	252.00	0.00	0.00	0.40			
160	C	1980.43	123.41	6.00	344.00	0.00	0.00	0.40			
161	C	1988.26	151.32	6.00	346.00	0.00	0.00	0.40			
162	F	2070.42	104.65	6.00	101.00	0.00	0.00	0.40			
163	F	2034.70	104.00	6.00	82.00	0.00	0.00	0.40			
164	F	1998.94	112.69	6.00	76.00	0.00	0.00	0.40			
165	D	2071.48	166.48	6.00	185.00	0.00	0.00	0.40			
166	F	2072.70	146.52	6.00	188.00	0.00	0.00	0.40			
167	F	2074.10	126.59	6.00	185.00	0.00	0.00	0.40			
168	E	1895.92	181.51	6.00	75.00	0.00	0.00	0.40			
169	E	1915.07	151.67	6.00	167.00	0.00	0.00	0.40			
170	F	1981.19	108.48	6.00	75.00	0.00	0.00	0.40			
171	E	2011.86	264.95	6.00	25.00	0.00	0.00	0.40			
172	E	2026.07	269.94	6.00	24.00	0.00	0.00	0.40			
173	E	2036.05	274.82	6.00	14.00	0.00	0.00	0.40			
174	D	1685.53	272.73	6.00	164.00	0.00	0.00	0.40			
175	D	1689.85	259.80	6.00	249.00	0.00	0.00	0.40			
176	D	1718.65	251.63	6.00	254.00	0.00	0.00	0.40			
177	D	1737.21	249.05	6.00	305.00	0.00	0.00	0.40			
178	C	1675.03	237.13	6.00	162.00	0.00	0.00	0.40			
179	D	1653.36	202.83	6.00	343.00	0.00	0.00	0.40			
180	E	1633.30	199.15	6.00	253.00	0.00	0.00	0.40			

**Layout Continued**

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Target X	Target Y	Target Z
181	C	1727.87	225.77	6.00	346.00	0.00	0.00	0.40			
182	D	1724.79	184.90	6.00	160.00	0.00	0.00	0.40			
183	C	1741.19	203.90	6.00	257.00	0.00	0.00	0.40			
184	E	1675.53	187.14	6.00	255.00	0.00	0.00	0.40			
185	E	1697.41	180.93	6.00	254.00	0.00	0.00	0.40			
186	E	1726.49	175.66	6.00	167.00	0.00	0.00	0.40			
187	E	1704.14	266.07	6.00	257.00	0.00	0.00	0.40			
188	C	1668.08	212.80	6.00	166.00	0.00	0.00	0.40			
189	E	1744.47	188.43	6.00	82.00	0.00	0.00	0.40			
190	C	1772.02	195.22	6.00	251.00	0.00	0.00	0.40			
191	D	1800.59	187.25	6.00	254.00	0.00	0.00	0.40			
192	C	1805.97	194.46	6.00	346.00	0.00	0.00	0.40			
193	C	1812.12	216.69	6.00	346.00	0.00	0.00	0.40			
194	F	1798.09	166.47	6.00	346.00	0.00	0.00	0.40			
195	E	1766.26	176.68	6.00	47.00	0.00	0.00	0.40			
196	E	1779.76	165.02	6.00	48.00	0.00	0.00	0.40			
197	F	1792.08	154.00	6.00	255.00	0.00	0.00	0.40			
198	E	1818.00	149.30	6.00	251.00	0.00	0.00	0.40			
199	E	1838.81	143.54	6.00	252.00	0.00	0.00	0.40			
200	E	1840.03	224.79	6.00	77.00	0.00	0.00	0.40			
201	E	1852.45	232.51	6.00	162.00	0.00	0.00	0.40			
202	E	1842.33	230.72	6.00	27.00	0.00	0.00	0.40			
203	D	1737.64	419.39	6.00	256.00	0.00	0.00	0.40			
204	D	1709.89	422.94	6.00	276.00	0.00	0.00	0.40			
205	D	1722.59	351.45	6.00	273.00	0.00	0.00	0.40			
206	D	1695.82	342.16	6.00	86.00	0.00	0.00	0.40			
207	D	1707.20	327.69	6.00	163.00	0.00	0.00	0.40			
208	E	1697.67	317.78	6.00	251.00	0.00	0.00	0.40			
209	E	1679.64	336.76	6.00	154.00	0.00	0.00	0.40			
210	E	1707.29	315.42	6.00	78.00	0.00	0.00	0.40			
211	D	1626.32	290.28	6.00	162.00	0.00	0.00	0.90			
212	C	1605.42	281.14	6.00	346.00	0.00	0.00	0.40			
213	C	1593.90	240.49	6.00	346.00	0.00	0.00	0.40			
214	D	1590.89	221.24	6.00	342.00	0.00	0.00	0.40			
215	E	1569.28	237.38	6.00	254.00	0.00	0.00	0.40			
216	F	1589.37	208.46	6.00	74.00	0.00	0.00	0.40			

**Layout Continued**

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Target X	Target Y	Target Z
217	E	1614.33	204.45	6.00	252.00	0.00	0.00	0.40			
218	E	1592.98	317.47	6.00	62.00	0.00	0.00	0.40			
219	E	1588.31	232.15	6.00	250.00	0.00	0.00	0.40			
220	C	1599.54	260.01	6.00	346.00	0.00	0.00	0.40			
221	D	1384.95	573.18	6.00	66.00	0.00	0.00	0.40			
222	D	1411.12	563.28	6.00	71.00	0.00	0.00	0.40			
223	D	1451.64	527.80	6.00	45.00	0.00	0.00	0.40			
224	C	1445.69	535.90	6.00	159.00	0.00	0.00	0.40			
225	D	1442.64	551.10	6.00	71.00	0.00	0.00	0.40			
226	E	1399.31	540.37	6.00	64.00	0.00	0.00	0.40			
227	E	1419.73	534.02	6.00	245.00	0.00	0.00	0.40			
228	F	1397.76	528.97	6.00	29.00	0.00	0.00	0.40			
229	F	1423.82	501.70	6.00	83.00	0.00	0.00	0.40			
230	E	1442.72	492.66	6.00	340.00	0.00	0.00	0.40			
231	E	1435.66	519.17	6.00	248.00	0.00	0.00	0.40			
232	F	1453.25	518.68	6.00	298.00	0.00	0.00	0.40			
233	F	1413.75	524.89	6.00	140.00	0.00	0.00	0.40			
234	C	1431.30	415.17	6.00	258.00	0.00	0.00	0.40			
235	C	1426.84	398.22	6.00	76.00	0.00	0.00	0.40			
236	D	1379.74	429.71	6.00	256.00	0.00	0.00	0.40			
237	C	1401.99	423.51	6.00	250.00	0.00	0.00	0.40			
238	C	1395.59	407.01	6.00	74.00	0.00	0.00	0.40			
239	C	1366.51	414.11	6.00	78.00	0.00	0.00	0.40			
240	D	1338.58	422.06	6.00	79.00	0.00	0.00	0.40			
241	D	1345.34	440.68	6.00	248.00	0.00	0.00	0.40			
242	D	1416.35	435.56	6.00	346.00	0.00	0.00	0.40			
243	F	1410.26	449.35	6.00	79.00	0.00	0.00	0.40			
244	E	1398.75	436.88	6.00	346.00	0.00	0.00	0.40			
245	F	1366.05	468.22	6.00	249.00	0.00	0.00	0.40			
246	E	1379.44	455.30	6.00	165.00	0.00	0.00	0.40			
247	E	1367.71	440.00	6.00	249.00	0.00	0.00	0.40			
248	E	1363.60	492.29	6.00	71.00	0.00	0.00	0.40			
249	D	1349.12	483.97	6.00	163.00	0.00	0.00	0.40			
250	D	1340.54	456.72	6.00	157.00	0.00	0.00	0.40			
251	E	1331.19	487.52	6.00	346.00	0.00	0.00	0.40			
252	E	1321.06	459.29	6.00	346.00	0.00	0.00	0.40			

**Layout Continued**

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Target X	Target Y	Target Z
253	E	1313.92	440.64	6.00	333.00	0.00	0.00	0.40			
254	E	1302.85	412.71	6.00	336.00	0.00	0.00	0.40			
255	D	1477.32	495.38	6.00	310.00	0.00	0.00	0.40			
256	D	1366.76	403.75	6.00	346.00	0.00	0.00	0.40			
257	F	1418.97	519.04	6.00	275.00	0.00	0.00	0.40			
258	E	1383.30	540.56	6.00	124.00	0.00	0.00	0.40			
259	C	1465.09	482.28	6.00	346.00	0.00	0.00	0.40			
260	D	1312.19	395.94	6.00	156.00	0.00	0.00	0.40			
261	D	1302.82	373.20	6.00	155.00	0.00	0.00	0.40			
262	D	1291.11	343.89	6.00	155.00	0.00	0.00	0.40			
263	D	1284.24	326.72	6.00	70.00	0.00	0.00	0.40			
264	D	1312.30	317.87	6.00	77.00	0.00	0.00	0.40			
265	D	1339.33	310.42	6.00	75.00	0.00	0.00	0.40			
266	D	1357.40	370.55	6.00	345.00	0.00	0.00	0.40			
267	D	1349.07	341.59	6.00	339.00	0.00	0.00	0.40			
268	C	1341.32	300.07	6.00	344.00	0.00	0.00	0.40			
269	C	1338.62	283.24	6.00	75.00	0.00	0.00	0.40			
270	F	1359.23	277.36	6.00	74.00	0.00	0.00	0.40			
271	C	1345.34	376.05	6.00	72.00	0.00	0.00	0.40			
272	C	1350.59	394.66	6.00	259.00	0.00	0.00	0.40			
273	E	1328.35	400.89	6.00	258.00	0.00	0.00	0.40			
274	E	1329.92	366.99	6.00	348.00	0.00	0.00	0.40			
275	E	1333.46	348.02	6.00	78.00	0.00	0.00	0.40			
276	C	1308.46	356.63	6.00	259.00	0.00	0.00	0.40			
277	E	1262.99	313.37	6.00	338.00	0.00	0.00	0.40			
278	E	1273.85	341.27	6.00	344.00	0.00	0.00	0.40			
279	F	1423.83	356.82	6.00	337.00	0.00	0.00	0.40			
280	E	1442.30	354.06	6.00	113.00	0.00	0.00	0.40			
281	D	1474.21	362.42	6.00	258.00	0.00	0.00	0.40			
282	D	1500.11	346.27	6.00	164.00	0.00	0.00	0.40			
283	D	1575.19	329.69	6.00	77.00	0.00	0.00	0.40			
284	D	1560.90	325.13	6.00	165.00	0.00	0.00	0.40			
285	C	1537.36	341.11	6.00	76.00	0.00	0.00	0.40			
286	E	1513.18	347.78	6.00	78.00	0.00	0.00	0.40			
287	D	1319.56	414.42	6.00	159.00	0.00	0.00	0.40			
288	D	1323.36	444.43	6.00	335.00	0.00	0.00	0.40			

**Layout Continued**


ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Target X	Target Y	Target Z
289	D	1316.45	429.79	6.00	337.00	0.00	0.00	0.40			
290	E	1775.70	308.82	6.00	256.00	0.00	0.00	0.40			
291	I	1266.22	624.73	8.00	71.00	5.00	0.00	0.90			
292	I	1265.57	643.36	8.00	248.00	5.00	0.00	0.90			
293	G	1289.09	626.97	8.00	245.00	0.00	0.00	0.50			
294	G	1236.69	651.45	8.00	245.00	0.00	0.00	0.50			
295	G	1199.97	666.98	8.00	245.00	0.00	0.00	0.50			
296	G	1163.12	682.93	8.00	245.00	0.00	0.00	0.50			
297	G	1132.84	699.12	8.00	236.00	0.00	0.00	0.50			
298	G	1096.83	716.49	8.00	245.00	0.00	0.00	0.50			
299	G	1059.30	730.65	8.00	249.00	0.00	0.00	0.50			
300	G	1023.83	742.56	8.00	257.00	0.00	0.00	0.50			
301	G	985.31	753.63	8.00	256.00	0.00	0.00	0.50			
302	G	957.31	761.78	8.00	256.00	0.00	0.00	0.50			
303	G	927.45	769.49	8.00	258.00	0.00	0.00	0.50			
304	G	888.45	778.48	8.00	257.00	0.00	0.00	0.50			
305	G	849.19	786.40	8.00	261.00	0.00	0.00	0.50			
306	H	1289.19	627.18	8.00	72.00	0.00	0.00	0.40			
307	H	1236.75	651.63	8.00	72.00	0.00	0.00	0.40			
308	H	1200.04	667.08	8.00	72.00	0.00	0.00	0.40			
309	H	1163.21	683.06	8.00	69.00	0.00	0.00	0.40			
310	H	1132.90	699.31	8.00	60.00	0.00	0.00	0.40			
311	H	1096.90	716.65	8.00	72.00	0.00	0.00	0.40			
312	H	1059.45	730.92	8.00	72.00	0.00	0.00	0.40			
313	H	1023.87	742.76	8.00	77.00	0.00	0.00	0.40			
314	H	985.35	753.75	8.00	79.00	0.00	0.00	0.40			
315	H	957.35	761.91	8.00	79.00	0.00	0.00	0.40			
316	H	927.53	769.76	8.00	78.00	0.00	0.00	0.40			
317	H	888.53	778.76	8.00	84.00	0.00	0.00	0.40			
318	H	849.22	786.61	8.00	79.00	0.00	0.00	0.40			
319	B	2343.16	80.99	8.00	270.00	0.00	0.00	0.50			
320	B	2343.20	81.17	8.00	88.00	0.00	0.00	0.50			
321	B	2312.18	82.27	8.00	263.00	0.00	0.00	0.50			
322	F	2268.88	103.74	8.00	215.00	0.00	0.00	0.40			
323	F	2290.73	87.20	8.00	243.00	0.00	0.00	0.40			
324	I	2173.19	271.19	8.00	37.00	0.00	0.00	0.50			

**Layout Continued**

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Target X	Target Y	Target Z
Existing 325	J	811.06	861.93	10.00	128.00	5.00	0.00	2.50			
Existing 326	J	772.75	859.25	10.00	292.00	5.00	0.00	2.50			
Existing 327	J	738.43	849.00	10.00	277.00	5.00	0.00	2.50			
Existing 328	J	700.15	849.64	10.00	43.00	5.00	0.00	2.50			
Relocate 329	J	709.41	822.58	10.00	354.00	5.00	0.00	2.50			
Existing 330	J	691.18	787.66	10.00	106.00	5.00	0.00	2.50			
Existing 331	J	715.71	793.23	10.00	96.00	5.00	0.00	2.50			
Existing 332	J	745.93	793.57	10.00	101.00	5.00	0.00	2.50			
Relocate 333	J	767.47	788.15	10.00	62.00	5.00	0.00	2.50			
Relocate 334	J	811.57	777.67	10.00	91.00	5.00	0.00	2.50			
Existing 335	J	767.24	823.06	10.00	180.00	5.00	0.00	2.50			
Existing 336	K	2428.88	138.81	10.00	204.00	5.00	0.00	1.30			
Existing 337	K	2444.48	104.06	10.00	197.00	5.00	0.00	1.30			
Existing 338	K	2451.84	89.63	10.00	226.00	5.00	0.00	1.30			
Existing 339	K	2467.36	59.56	10.00	97.00	5.00	0.00	1.30			
Existing 340	K	2450.29	53.13	10.00	142.00	5.00	0.00	1.30			
Existing 341	K	2454.27	11.42	10.00	204.00	5.00	0.00	1.30			
Existing 342	K	2427.42	37.14	10.00	10.00	5.00	0.00	1.30			
Existing 343	K	2418.39	57.91	10.00	40.00	5.00	0.00	1.30			
Existing 344	K	2360.73	92.61	10.00	272.00	5.00	0.00	1.30			
Existing 345	K	2402.79	89.91	10.00	267.00	5.00	0.00	1.30			
Existing 346	K	2418.17	94.43	10.00	320.00	5.00	0.00	1.30			
347	I	826.78	794.30	8.00	259.00	0.00	0.00	0.50			
348	I	824.30	777.34	8.00	76.00	0.00	0.00	0.50			

# Horizontal Illuminance (lux)

Spine Road 1

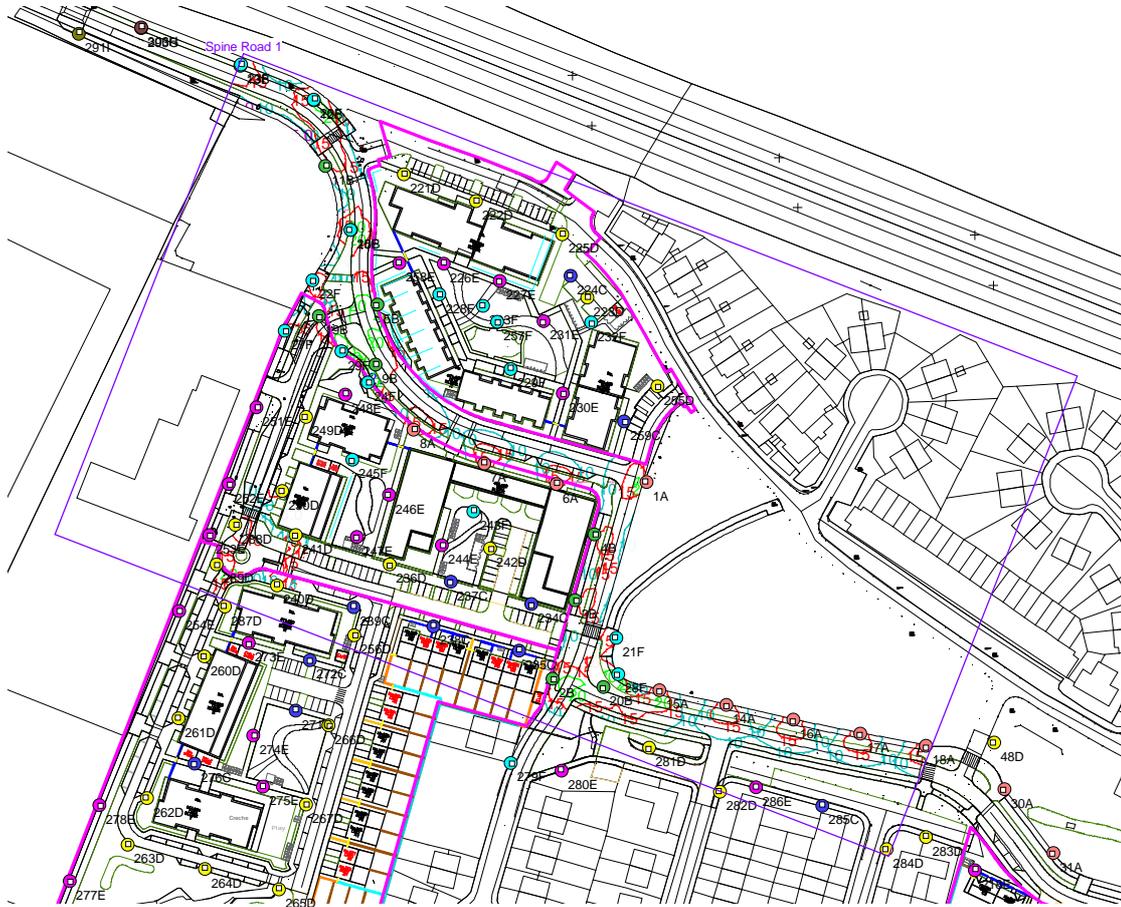


## Results

Eav	13.17
Emin	5.38
Emax	25.66
Emin/Emax	0.21
Emin/Eav	0.41



# Horizontal Illuminance (lux)

Spine Road 3

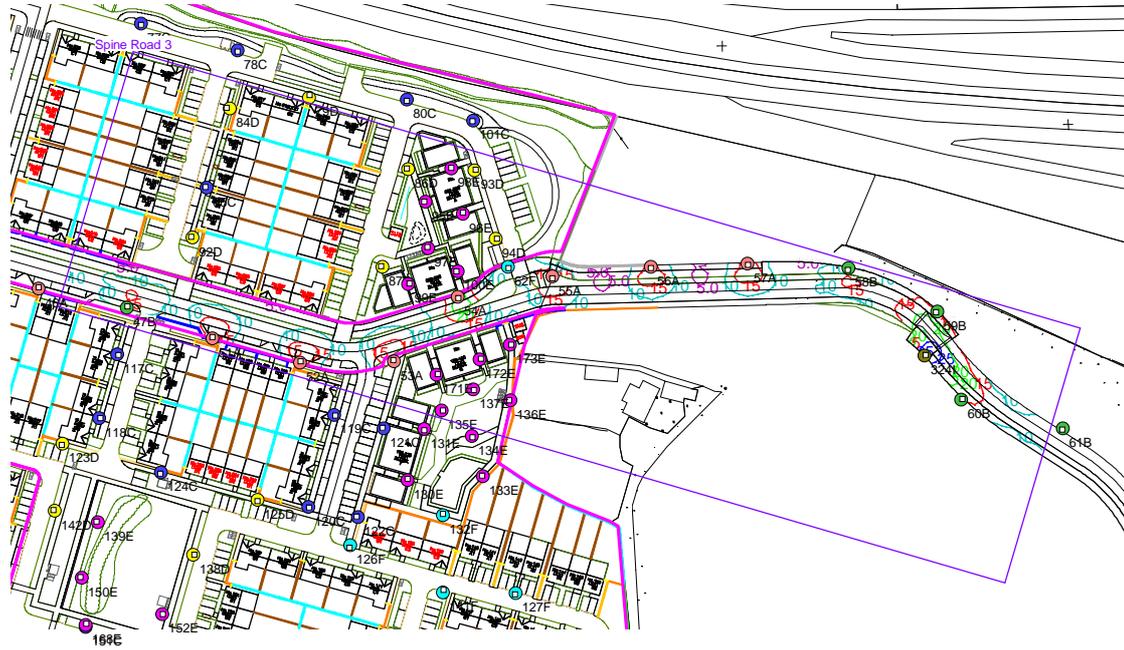


## Results

Eav	11.20
Emin	4.46
E <sub>max</sub>	28.53
E <sub>min</sub> /E <sub>max</sub>	0.16
E <sub>min</sub> /E <sub>av</sub>	0.40

# Horizontal Illuminance (lux)

Spine Road 4

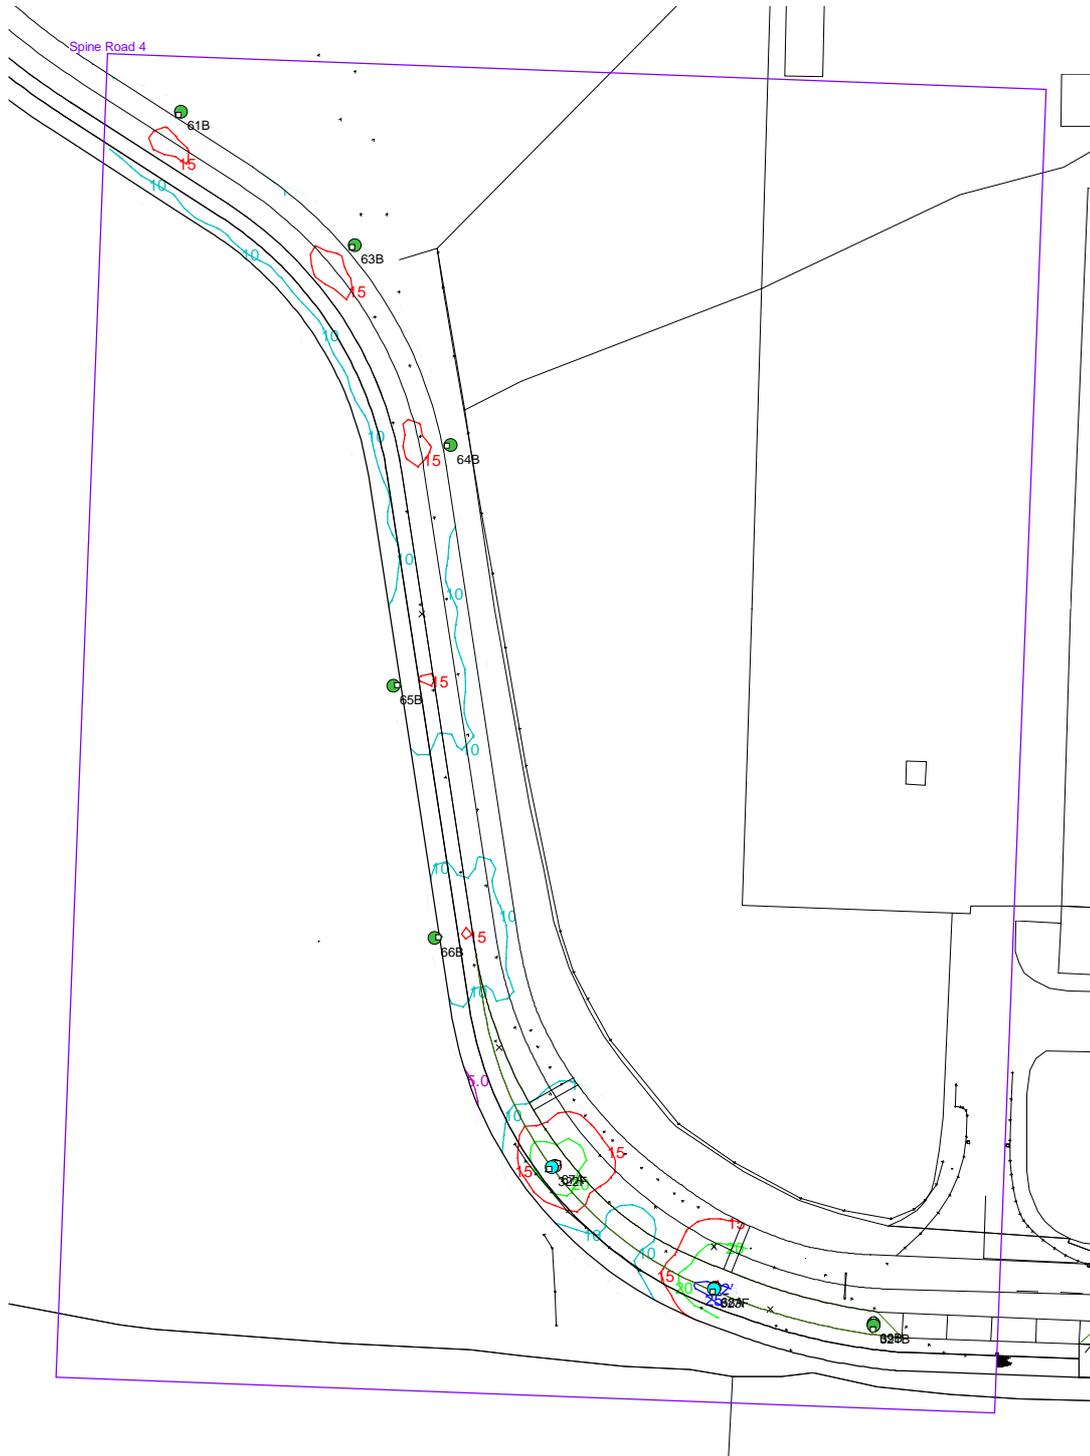


## Results

Eav	12.15
Emin	5.02
Emax	26.27
Emin/Emax	0.19
Emin/Eav	0.41

# Horizontal Illuminance (lux)

Sector 1A1

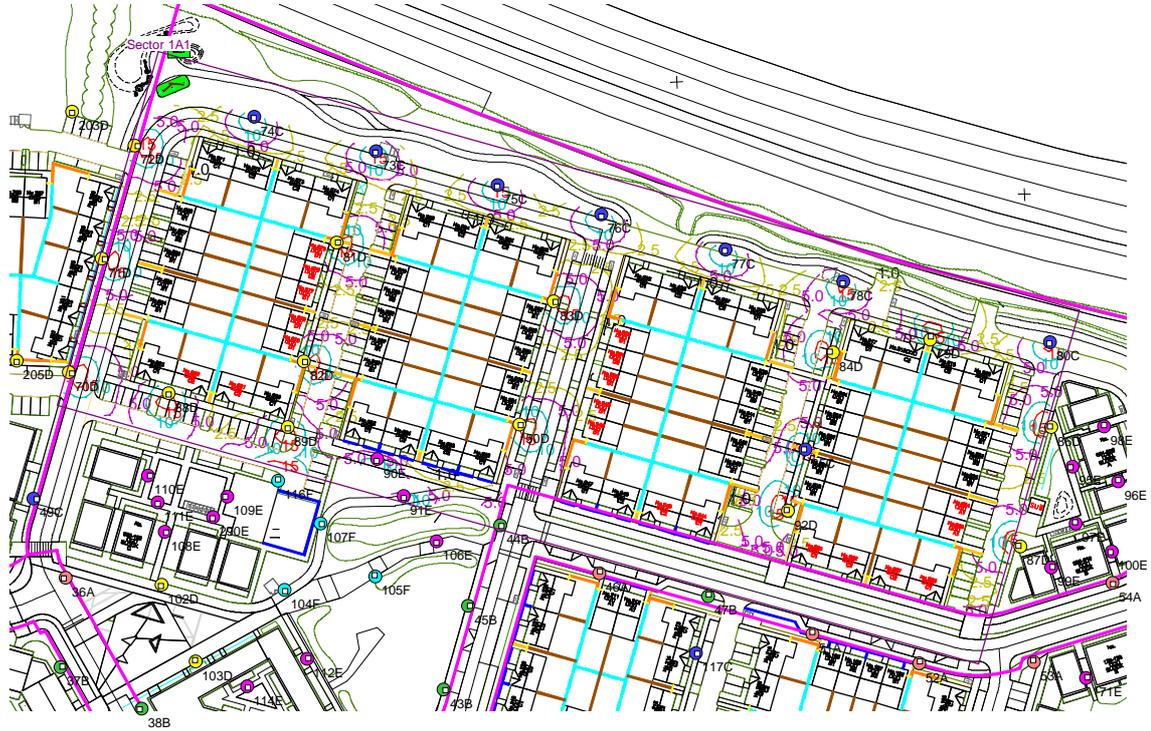


## Results

Eav	6.14
Emin	1.30
Emax	19.93
Emin/Emax	0.07
Emin/Eav	0.21

# Horizontal Illuminance (lux)

Sector 1A2

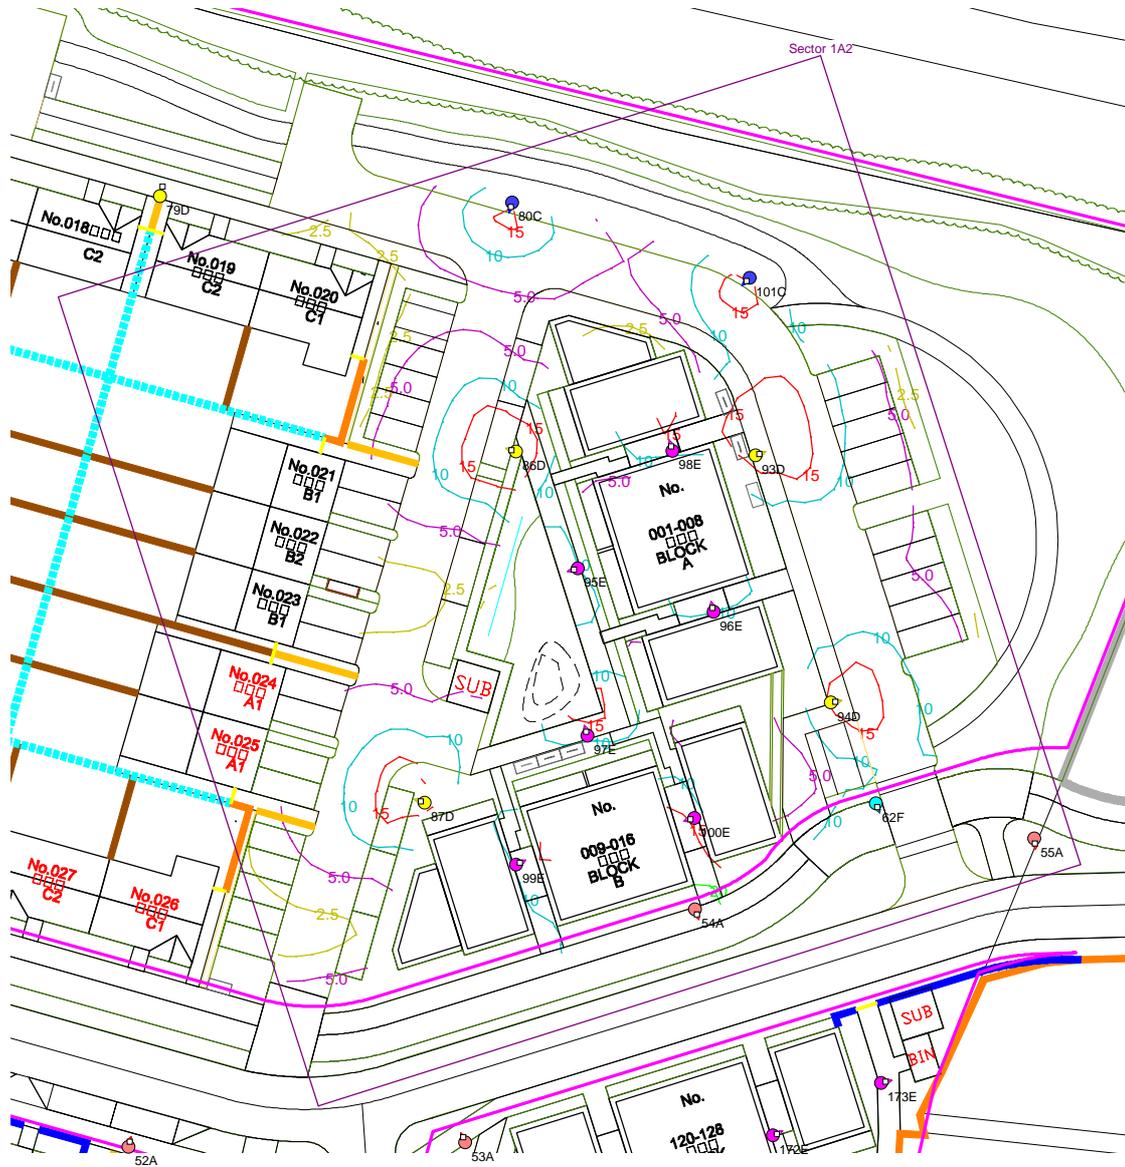


## Results

Eav	8.26
Emin	1.81
Emax	20.50
Emin/Emax	0.09
Emin/Eav	0.22

# Horizontal Illuminance (lux)

Sector 1A3

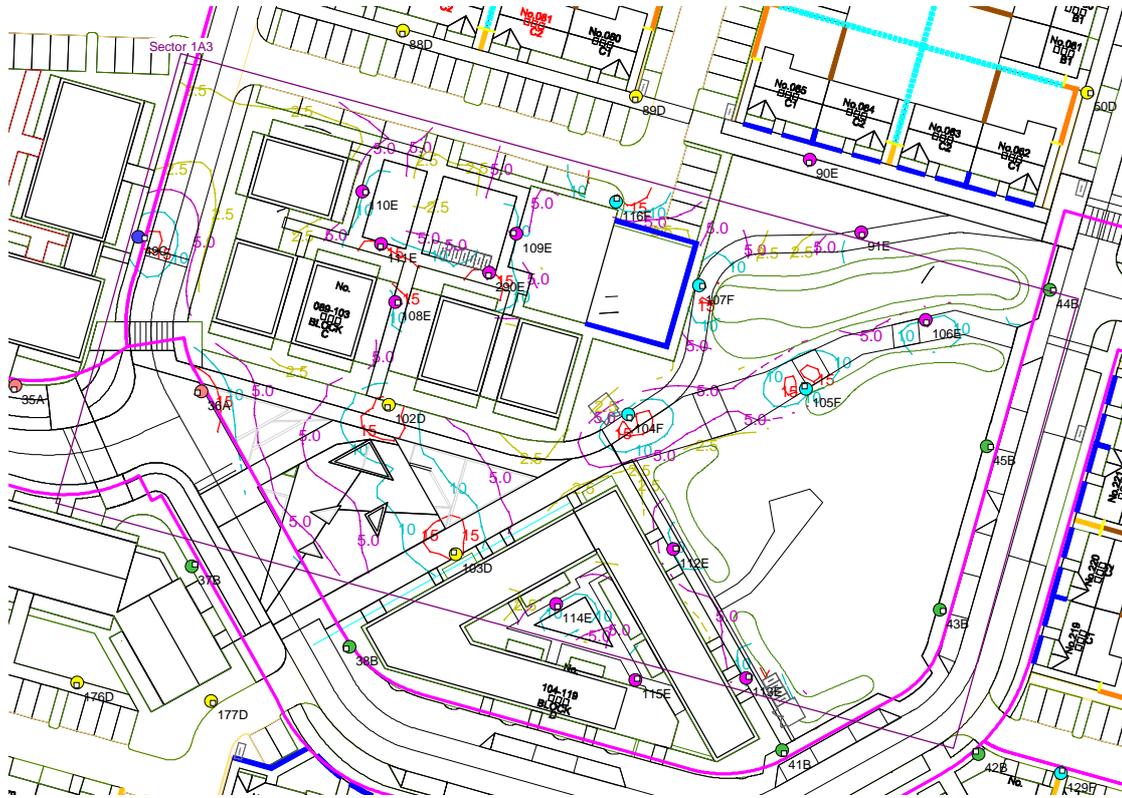


## Results

Eav	7.38
Emin	1.44
Emax	19.79
Emin/Emax	0.07
Emin/Eav	0.20

## Horizontal Illuminance (lux)

Sector 1A4

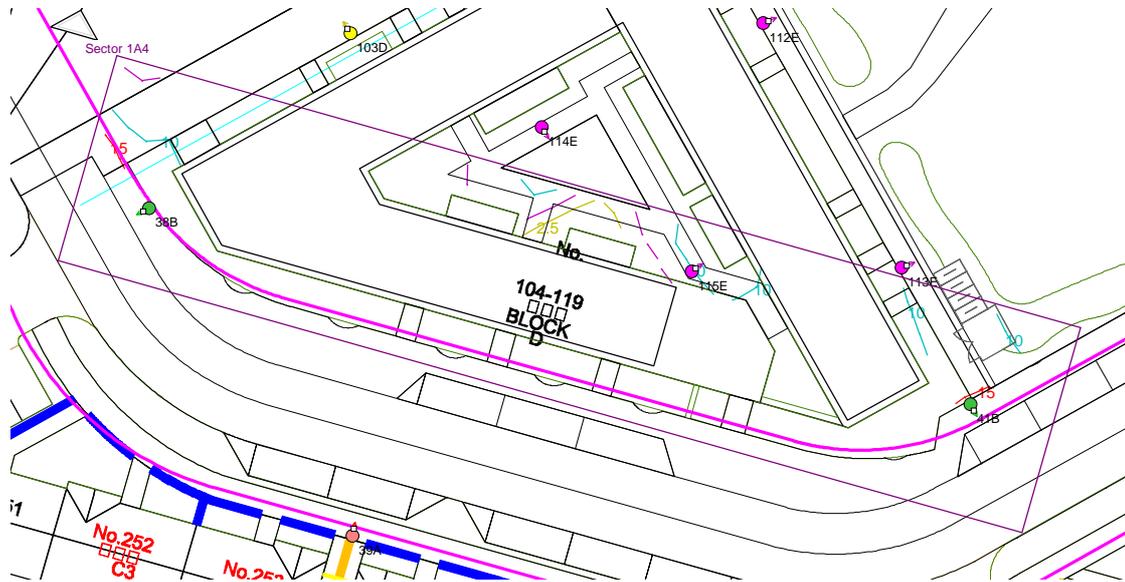


### Results

Eav	8.97
Emin	1.70
E <sub>max</sub>	13.81
E <sub>min</sub> /E <sub>max</sub>	0.12
E <sub>min</sub> /E <sub>av</sub>	0.19

# Horizontal Illuminance (lux)

Sector 1B1

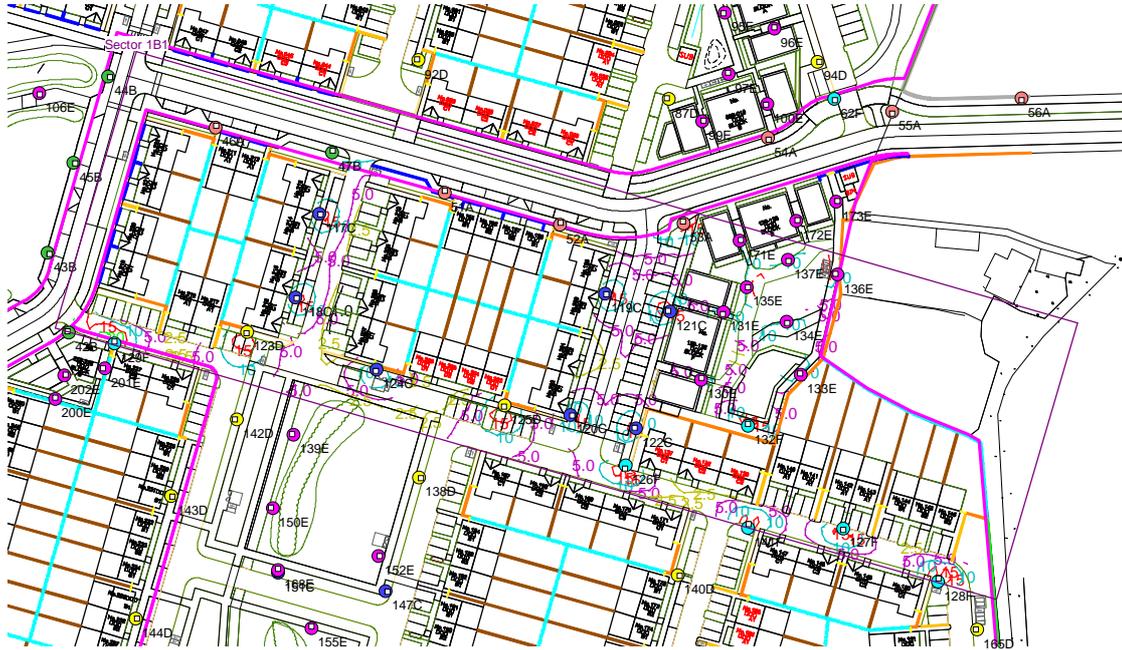


## Results

Eav	7.35
Emin	1.46
Emax	21.55
Emin/Emax	0.07
Emin/Eav	0.20

# Horizontal Illuminance (lux)

Sector 1B2

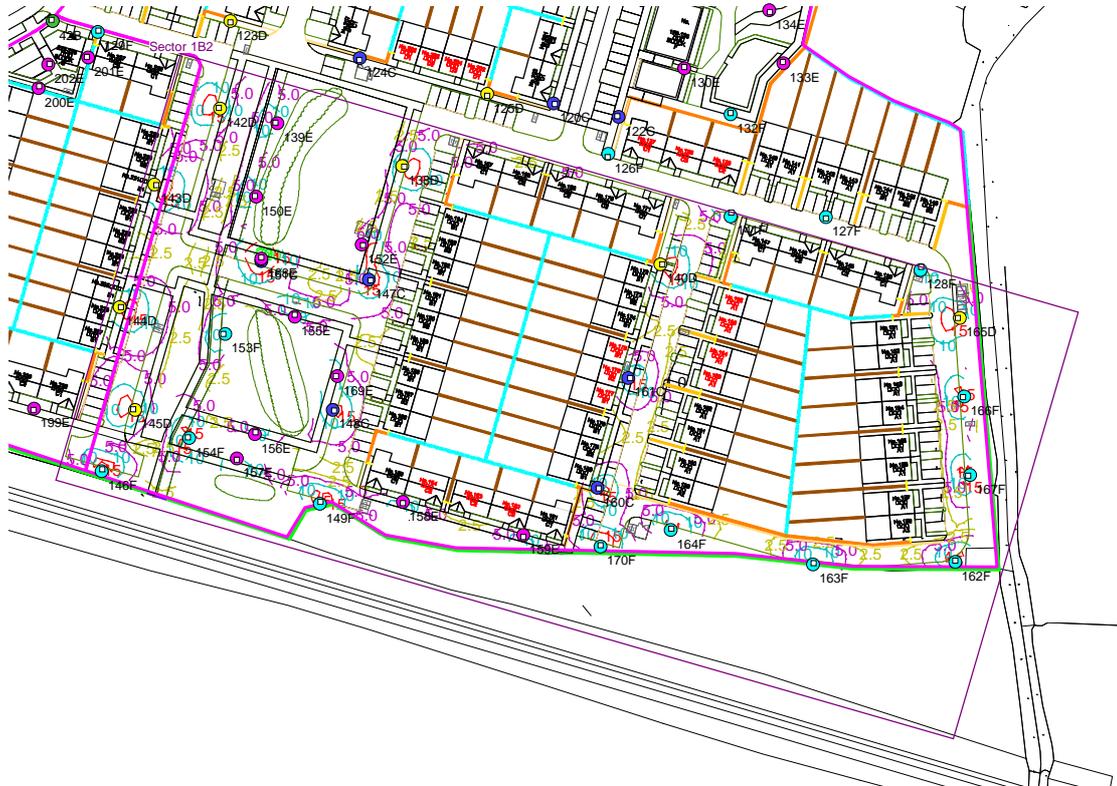


## Results

Eav	7.02
Emin	1.43
Emax	21.20
Emin/Emax	0.07
Emin/Eav	0.20

## Horizontal Illuminance (lux)

Sector 1B3

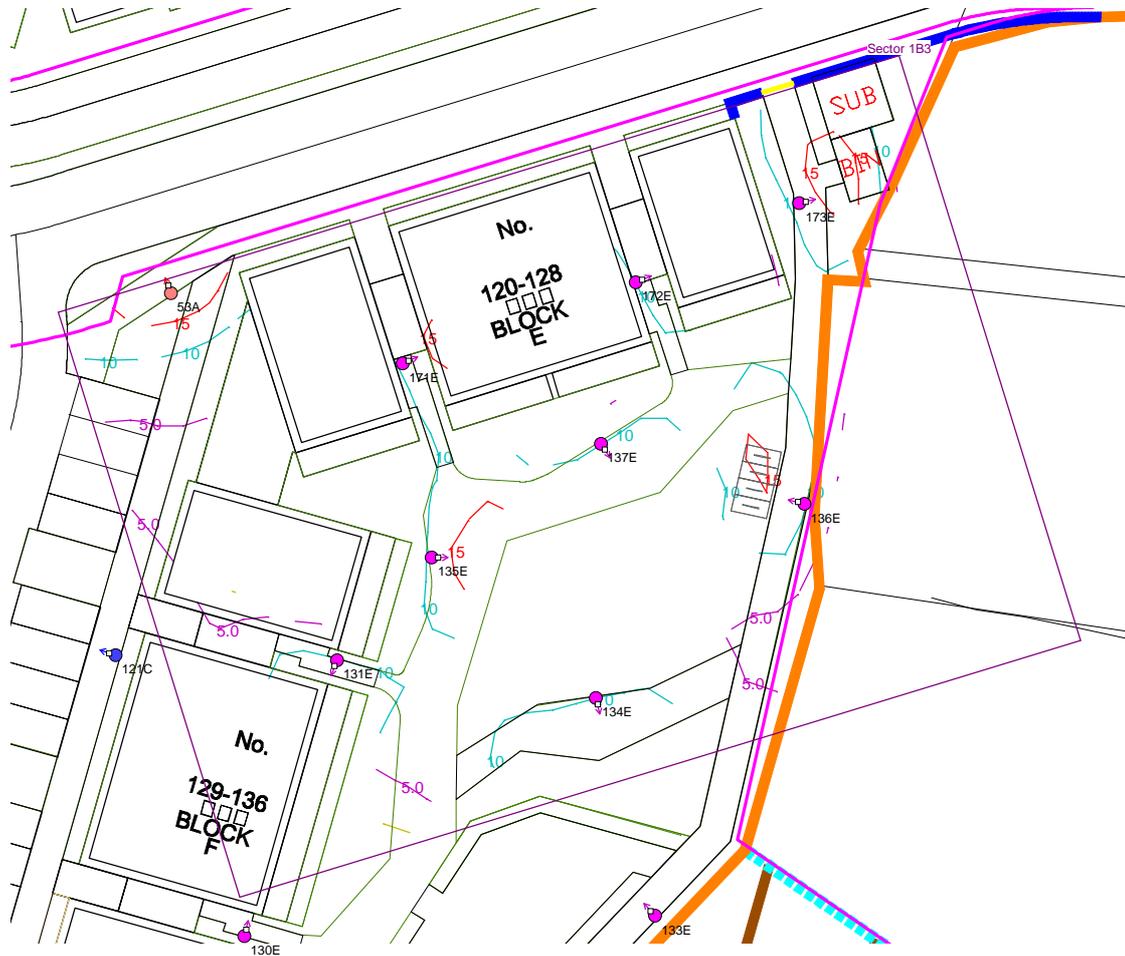


### Results

Eav	9.81
Emin	3.30
E <sub>max</sub>	17.05
E <sub>min</sub> /E <sub>max</sub>	0.19
E <sub>min</sub> /E <sub>av</sub>	0.34

# Horizontal Illuminance (lux)

Sector 2A1

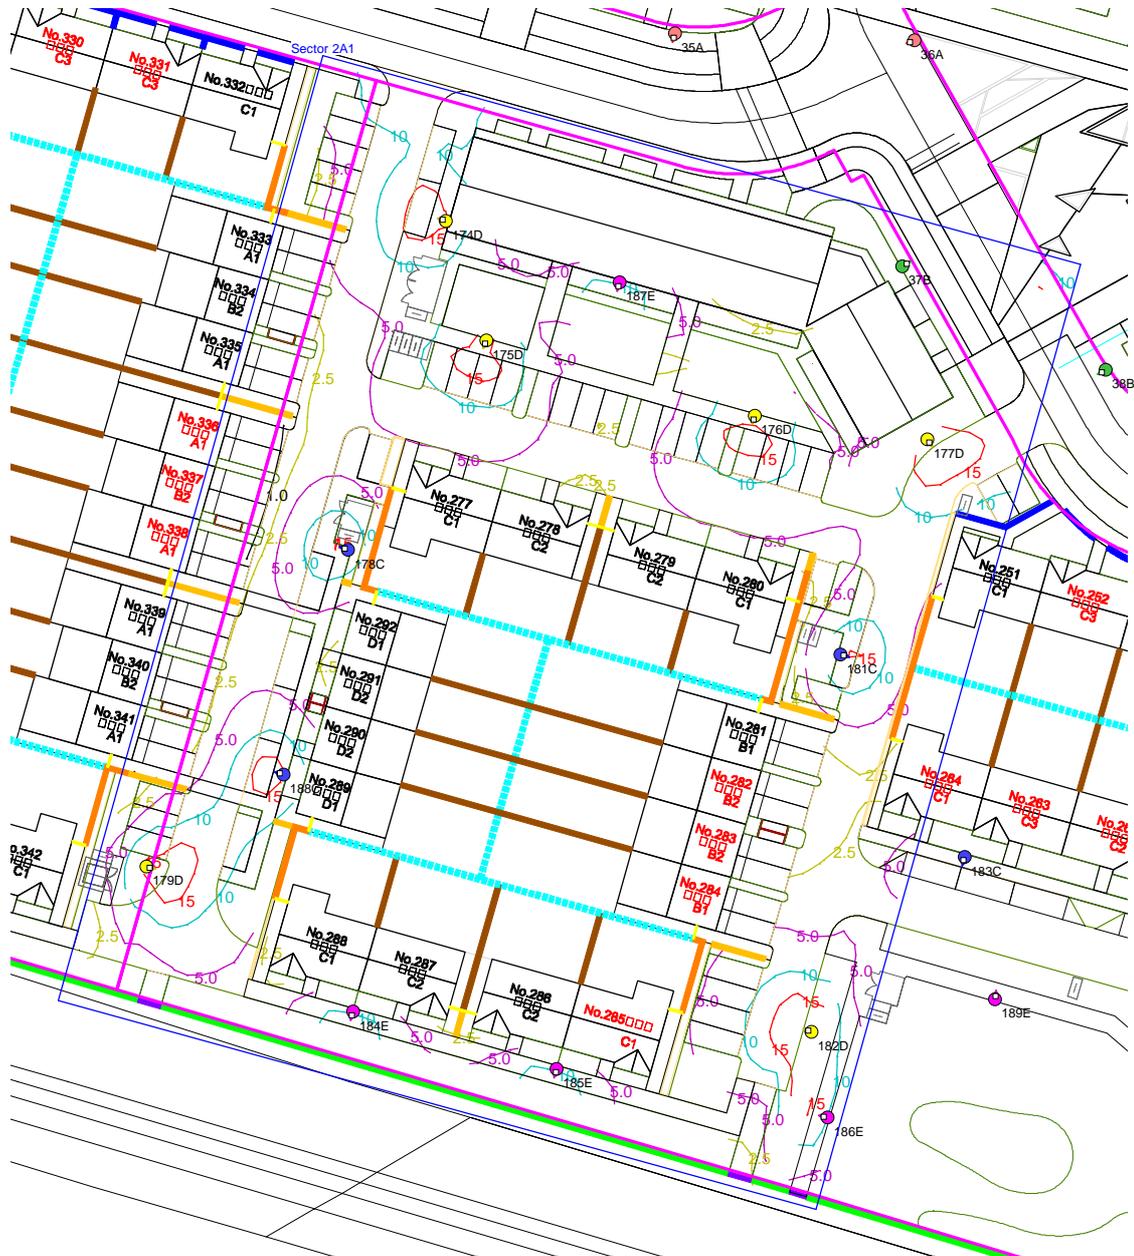


## Results

Eav	7.33
Emin	1.67
Emax	18.45
Emin/Emax	0.09
Emin/Eav	0.23

# Horizontal Illuminance (lux)

Sector 2A2

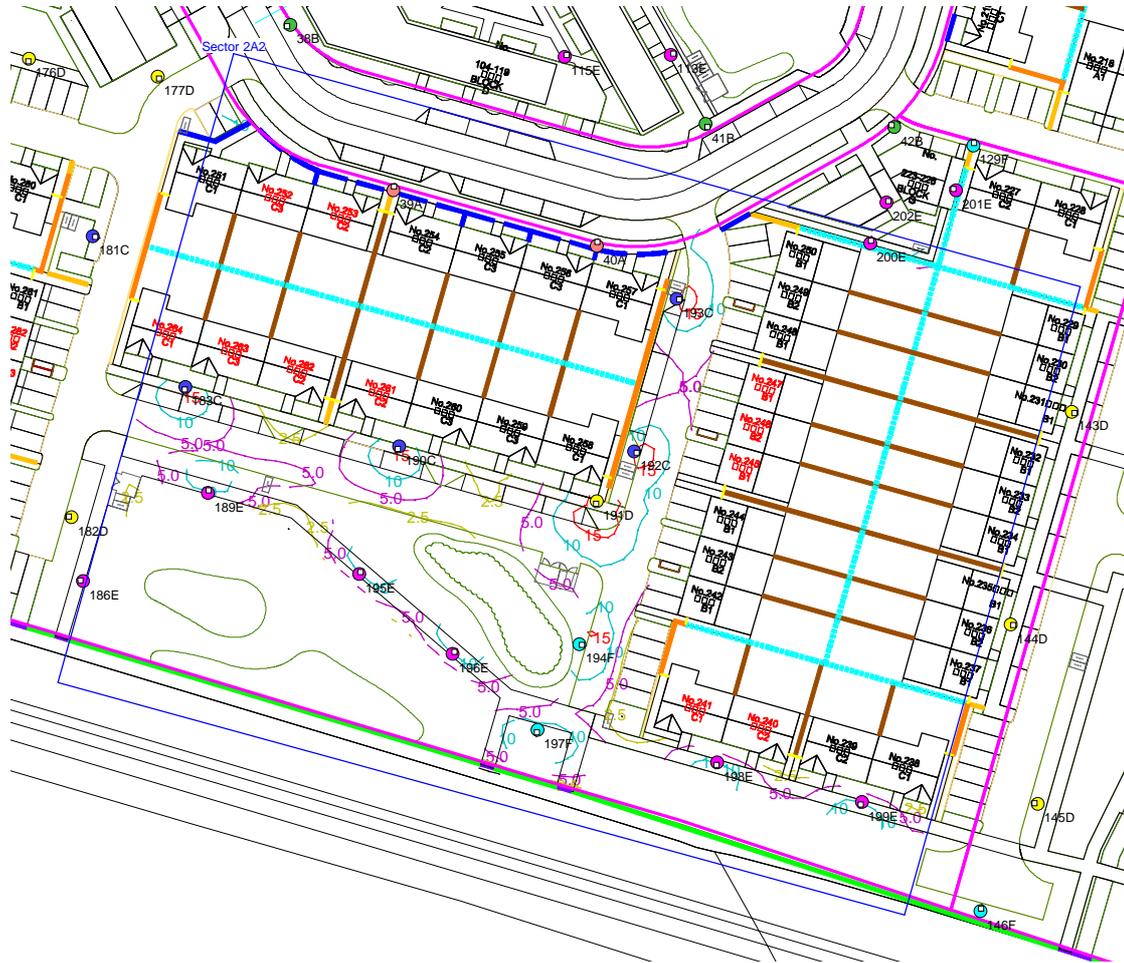


## Results

Eav	7.36
Emin	1.86
E <sub>max</sub>	18.47
E <sub>min</sub> /E <sub>max</sub>	0.10
E <sub>min</sub> /E <sub>av</sub>	0.25

## Horizontal Illuminance (lux)

Sector 2A3

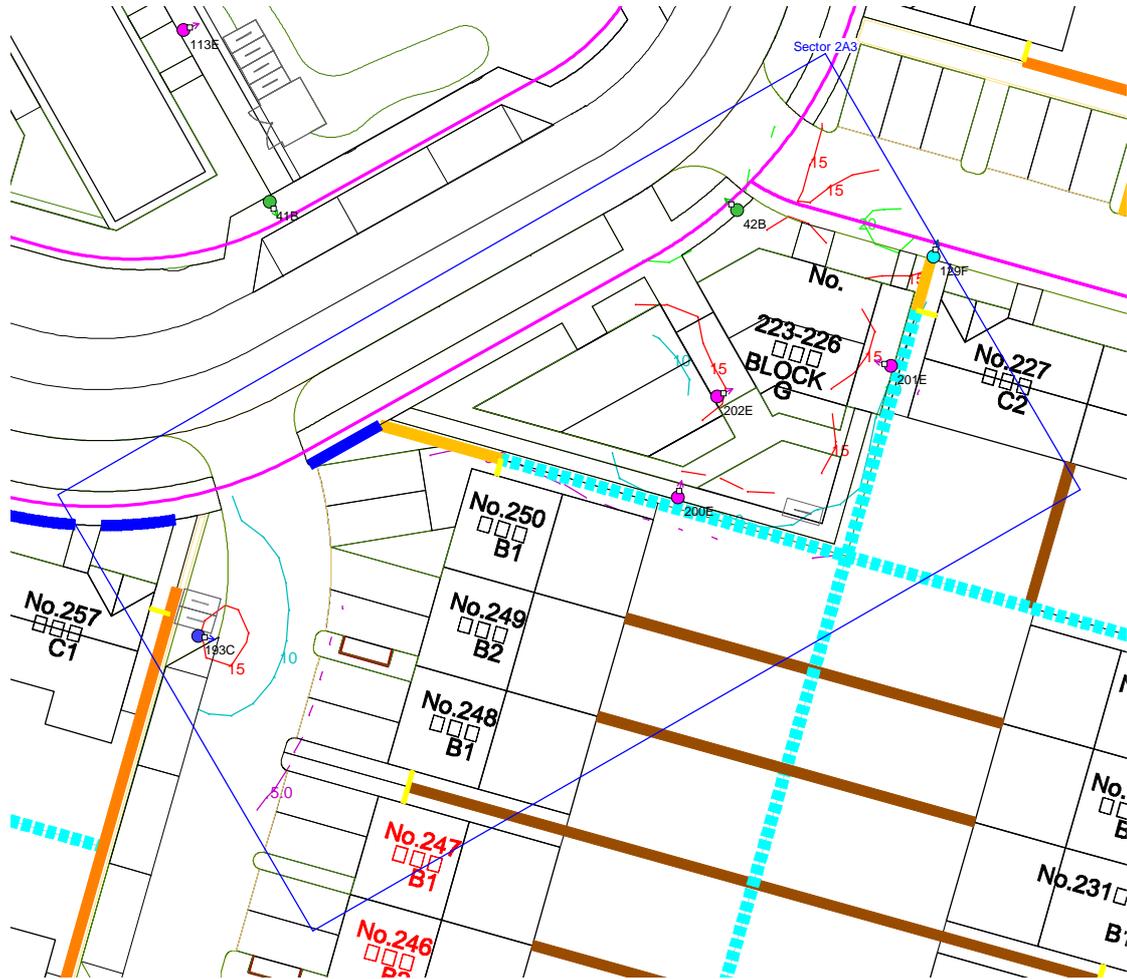


### Results

Eav	12.29
Emin	5.14
Emax	21.54
Emin/Emax	0.24
Emin/Eav	0.42

# Horizontal Illuminance (lux)

Sector 2B1

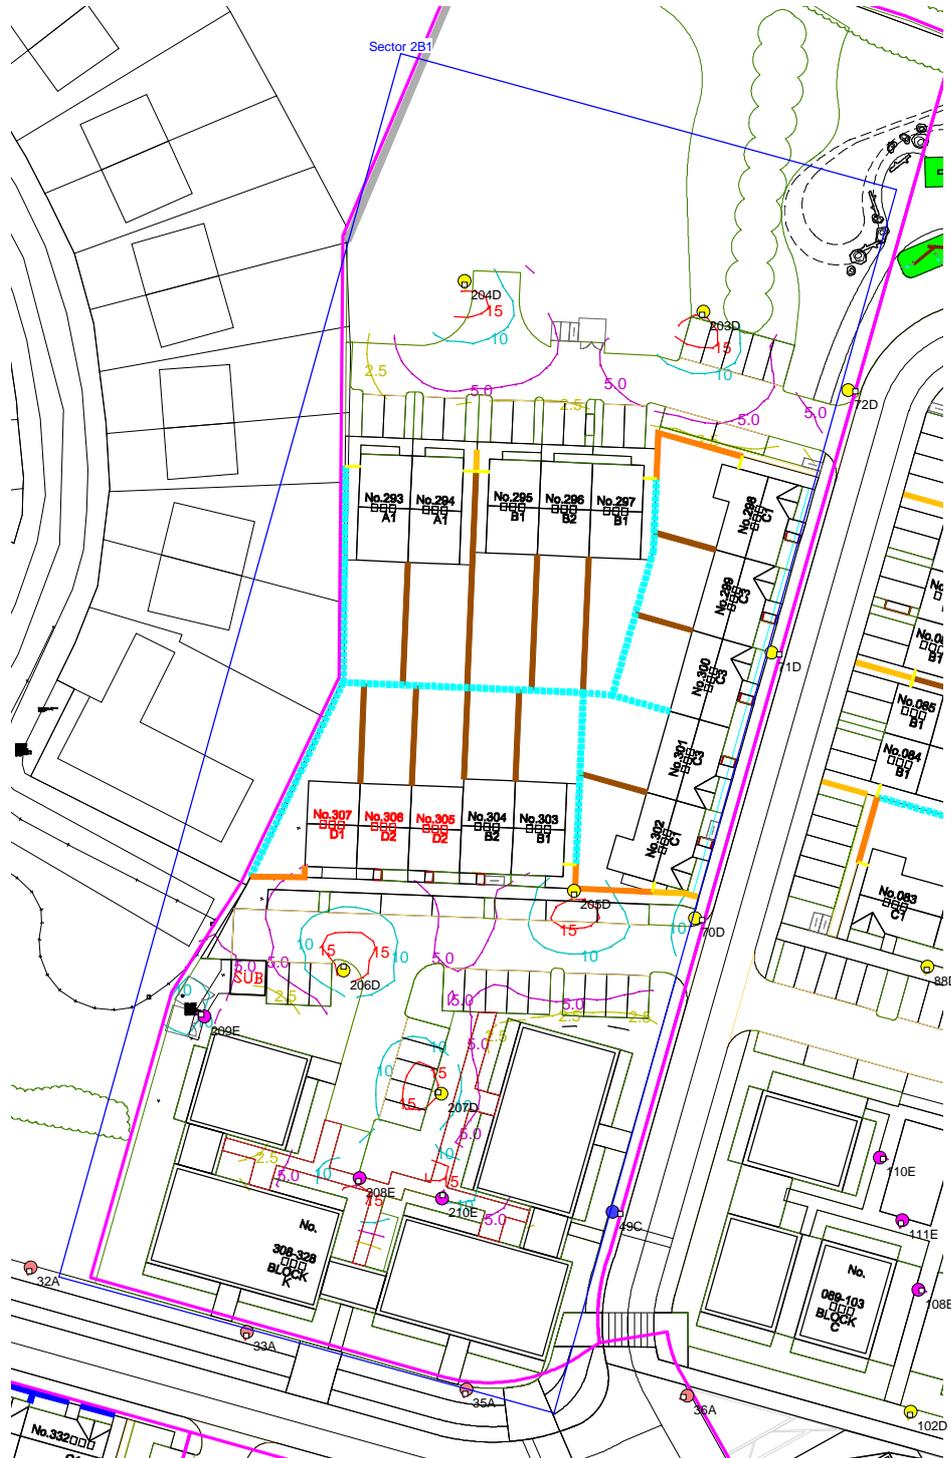

## Results

Eav	7.74
Emin	1.69
Emax	17.66
Emin/Emax	0.10
Emin/Eav	0.22

# Horizontal Illuminance (lux)

Sector 2B2



## Results

Eav	9.16
Emin	1.96
Emax	18.96
Emin/Emax	0.10
Emin/Eav	0.21

# Horizontal Illuminance (lux)

Sector 3A




## Results

Eav	7.34
Emin	1.44
E <sub>max</sub>	18.93
E <sub>min</sub> /E <sub>max</sub>	0.08
E <sub>min</sub> /E <sub>av</sub>	0.20

## Horizontal Illuminance (lux)

Sector 3B

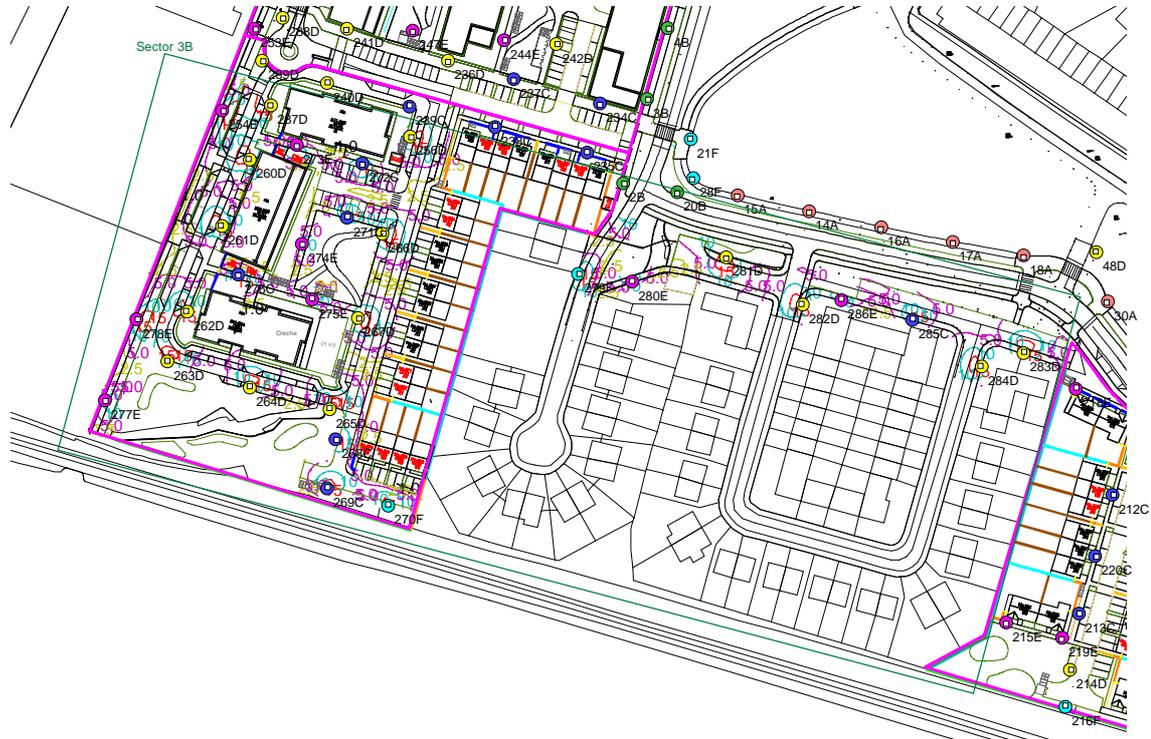


### Results

Eav	7.35
Emin	1.52
Emax	19.76
Emin/Emax	0.08
Emin/Eav	0.21



# Horizontal Illuminance (lux)

## Crossing Assessment

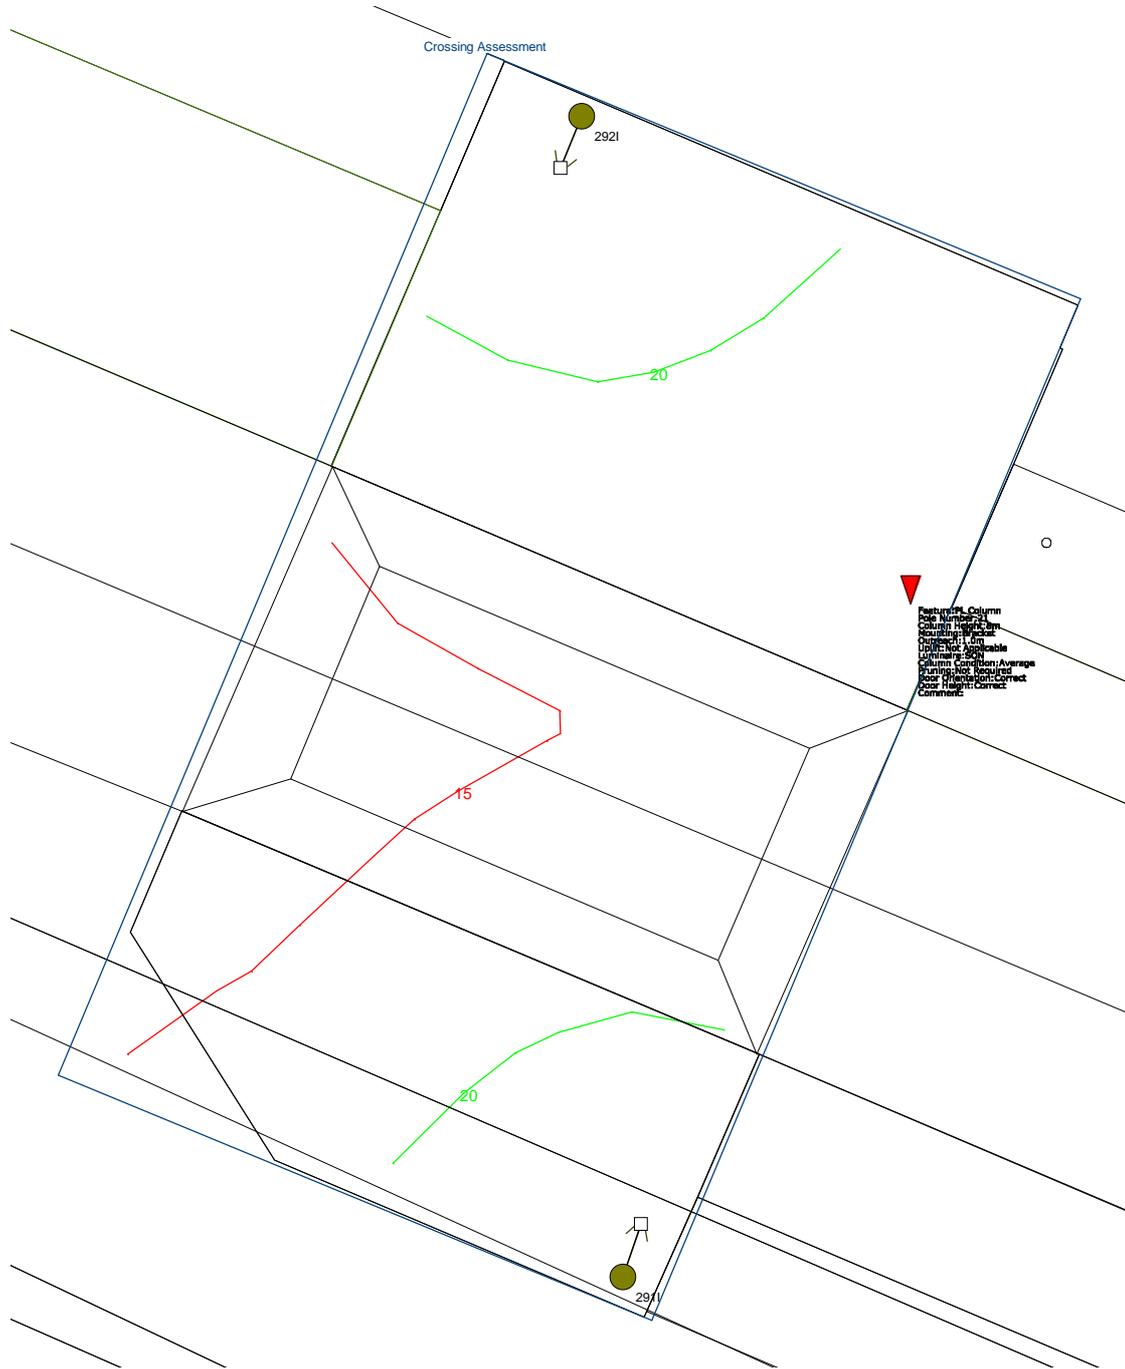

### Results

Eav	17.78
Emin	13.66
Emax	24.29
Emin/Emax	0.56
Emin/Eav	0.77

**DATE:** 9 February 2021  
**DESIGNER:** Patrick Redmond  
**PROJECT No:** 20043  
**PROJECT NAME:** Brawny & Garrycastle roundabouts



We have made certain assumptions regarding the photometric performance of the existing lighting on both roundabouts. Brawny roundabout appears to have been designed in line with historical equivalents of C3, and Garrycastle roundabout with C2.

Lighting on the crossing points and the Garrycastle approach has been designed to comply with I.S. EN 13201-2:2015 C2 Energy consumption assessed in accordance with I.S. EN 13201-5:2015.

$LMF 0.92 \times LDF 0.9 \times LSF 1 = MF 0.83$  at 100,000 hours with 25 degree ambient. Photometry measured at minimum 15 degree ambient.

See associated documentation for information on energy consumption.

## Lighting Level ~ Full Output

**PREPARED BY:** Patrick Redmond Hdip BUS, EngTech AMILP, AMSLL, Tech IEI  
Redmond Analytical Management Services Ltd.  
M~ 086 2356356  
O~ 053 9383696  
patrick@redmondams.ie  
Rosewood House, Mount Seaton, Camolin,  
Enniscorthy, Co. Wexford. Y21 K8P3  
www.redmondams.ie  
Document control: TD 01 Version: 1.0

## Layout Report

### General Data

Dimensions in Metres Angles in Degrees

### Calculation Grids

ID	Grid Name	X	Y	X' Length	Y' Length	X' Spacing	Y' Spacing
1	Brawny Roundabout	663.12	772.04	162.23	119.17	1.49	1.49
2	Garrycastle Roundabout	2360.49	3.52	110.32	135.62	1.49	1.49
3	Garrycastle Approach	2285.75	71.52	76.06	37.14	1.49	1.49
4	Crossing Assessment 1	820.79	777.51	6.20	17.86	1.24	1.49
5	Crossing Assessment 2	2164.87	279.38	13.02	14.90	1.45	1.49

### Luminaires

#### Luminaire A Data



Supplier	Philips
Type	BGP292 DX10
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	9.50
File Name	LumiStreet Gen2 Mini_BGP292_DX10_9500_40LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	513.2, 85.3, 0.0
No. in Project	1

#### Luminaire B Data



Supplier	Philips
Type	BGP292 DW52
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	9.00
File Name	LumiStreet Gen2 Mini_BGP292_DW52_9000_40LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	639.6, 45.2, 0.0
No. in Project	7

#### Luminaire F Data



Supplier	Philips
Type	BGP291 DN11
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	2.40
File Name	LumiStreet Gen2 Micro_BGP291_DN11_2400_10LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	595.8, 72.9, 0.0
No. in Project	1

#### Luminaire G Data



Supplier	Philips
Type	BGP292 DX70
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	11.00
File Name	LumiStreet Gen2 Mini_BGP292_DX70_11000_40LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	325.1, 353.8, 0.0
No. in Project	1

#### Luminaire H Data



Supplier	Philips
Type	BGP291 DM11
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	4.00
File Name	LumiStreet Gen2 Micro_BGP291_DM11_4000_20LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	555.3, 96.2, 0.0
No. in Project	1

#### Luminaire I Data



Supplier	Philips
Type	BGP292 DX70
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	12.50
File Name	LumiStreet Gen2 Mini_BGP292_DX70_12500_40LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	325.1, 353.8, 0.0
No. in Project	3

## Luminaires



### Luminaire J Data

Supplier	_Historic Lanterns
Type	ZX3/Clear_P/1289/103/-39/922301
Lamp(s)	150W-SONT+
Lamp Flux (klm)	18.00
File Name	ZX3_Clear Poly_1289_SON-T+_150_103#-39_922301TX.ltd
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	545.9, 77.6, 38.8
No. in Project	11



### Luminaire K Data


Supplier	_Historic Lanterns
Type	ZX3/FG/1289/115/-45/892242
Lamp(s)	250W-SONT+
Lamp Flux (klm)	33.20
File Name	ZX3_Flat Glass_1289_SON-T+_250_115#-45_892242TY.ltd
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	389.0, 25.0, 0.0
No. in Project	11

**Layout**

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Target X	Target Y	Target Z
1	G	849.19	786.40	8.00	261.00	0.00	0.00	0.50			
2	H	849.22	786.61	8.00	79.00	0.00	0.00	0.40			
3	A	2290.83	87.40	8.00	68.00	0.00	0.00	0.50			
4	B	2343.15	81.21	8.00	90.00	0.00	0.00	0.50			
5	K	2428.88	138.81	10.00	204.00	5.00	0.00	1.30			
6	K	2444.48	104.06	10.00	197.00	5.00	0.00	1.30			
7	K	2451.84	89.63	10.00	226.00	5.00	0.00	1.30			
8	K	2467.36	59.56	10.00	97.00	5.00	0.00	1.30			
9	K	2450.29	53.13	10.00	142.00	5.00	0.00	1.30			
10	K	2454.27	11.42	10.00	204.00	5.00	0.00	1.30			
11	K	2427.42	37.14	10.00	10.00	5.00	0.00	1.30			
12	K	2418.39	57.91	10.00	40.00	5.00	0.00	1.30			
13	K	2418.17	94.43	10.00	320.00	5.00	0.00	1.30			
14	K	2402.79	89.91	10.00	267.00	5.00	0.00	1.30			
15	K	2360.73	92.61	10.00	272.00	5.00	0.00	1.30			
16	B	2343.16	80.99	8.00	270.00	0.00	0.00	0.50			
17	B	2312.21	82.55	8.00	84.00	0.00	0.00	0.50			
18	B	2312.21	82.32	8.00	265.00	0.00	0.00	0.50			
19	J	772.75	859.25	10.00	292.00	5.00	0.00	2.50			
20	J	738.43	849.00	10.00	277.00	5.00	0.00	2.50			
21	J	700.15	849.64	10.00	43.00	5.00	0.00	2.50			
22	J	811.06	861.93	10.00	128.00	5.00	0.00	2.50			
23	J	767.24	823.06	10.00	180.00	5.00	0.00	2.50			
24	J	691.18	787.80	10.00	106.00	5.00	0.00	2.50			
25	J	715.71	793.23	10.00	96.00	5.00	0.00	2.50			
26	J	745.93	793.57	10.00	101.00	5.00	0.00	2.50			
Relocate 27	J	767.47	788.15	10.00	62.00	5.00	0.00	2.50			
Relocate 28	J	811.57	777.67	10.00	91.00	5.00	0.00	2.50			
Relocate 29	J	709.41	822.58	10.00	354.00	5.00	0.00	2.50			
30	I	826.78	794.30	8.00	259.00	0.00	0.00	0.50			
31	B	2177.26	285.94	8.00	222.00	0.00	0.00	0.50			
32	B	2185.98	257.38	8.00	43.00	0.00	0.00	0.50			
33	B	2147.92	300.33	8.00	262.00	0.00	0.00	0.50			
34	I	2173.19	271.19	8.00	37.00	0.00	0.00	0.50			
35	F	2290.70	87.19	8.00	241.00	0.00	0.00	0.50			
36	I	824.30	777.34	8.00	76.00	0.00	0.00	0.50			

## Horizontal Illuminance (lux)

### Brawny Roundabout

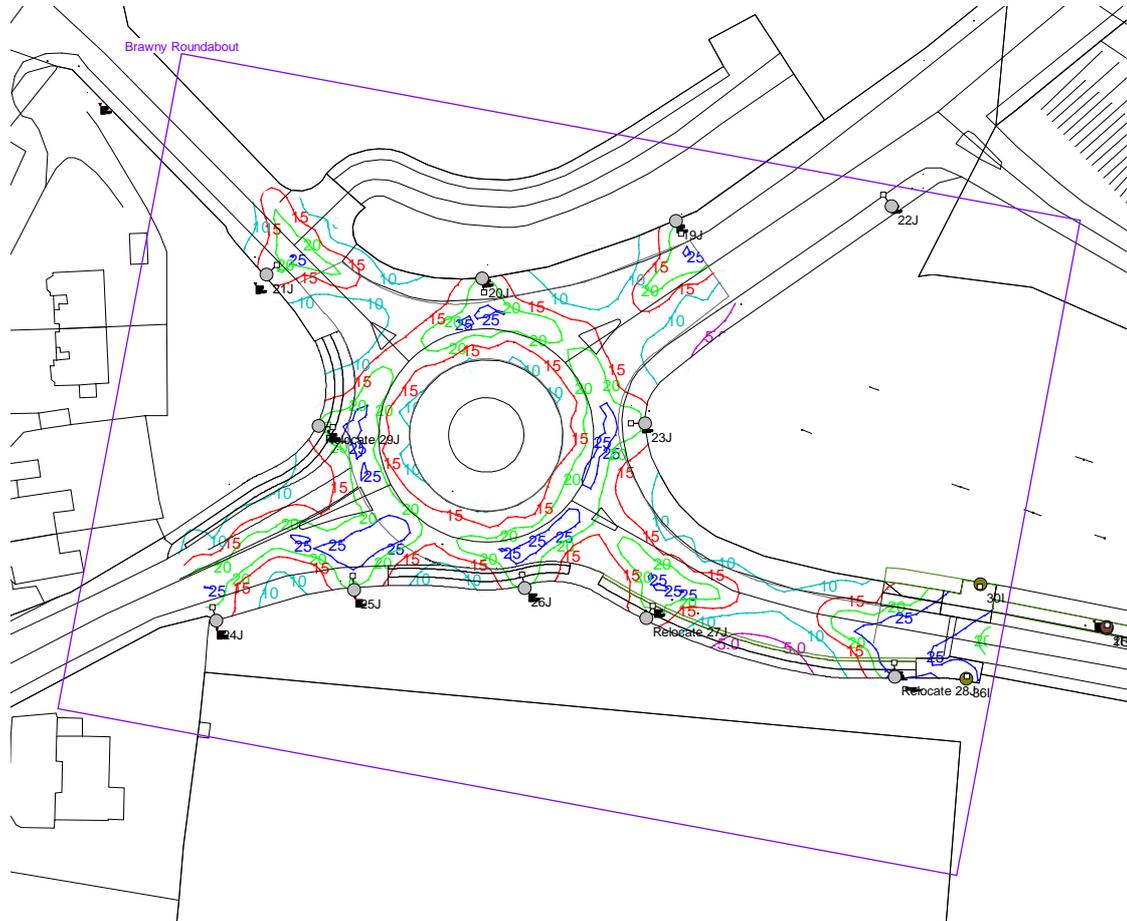


### Results

Eav	15.79
Emin	3.20
E <sub>max</sub>	34.23
E <sub>min</sub> /E <sub>max</sub>	0.09
E <sub>min</sub> /E <sub>av</sub>	0.20

# Horizontal Illuminance (lux)

## Garrycastle Roundabout

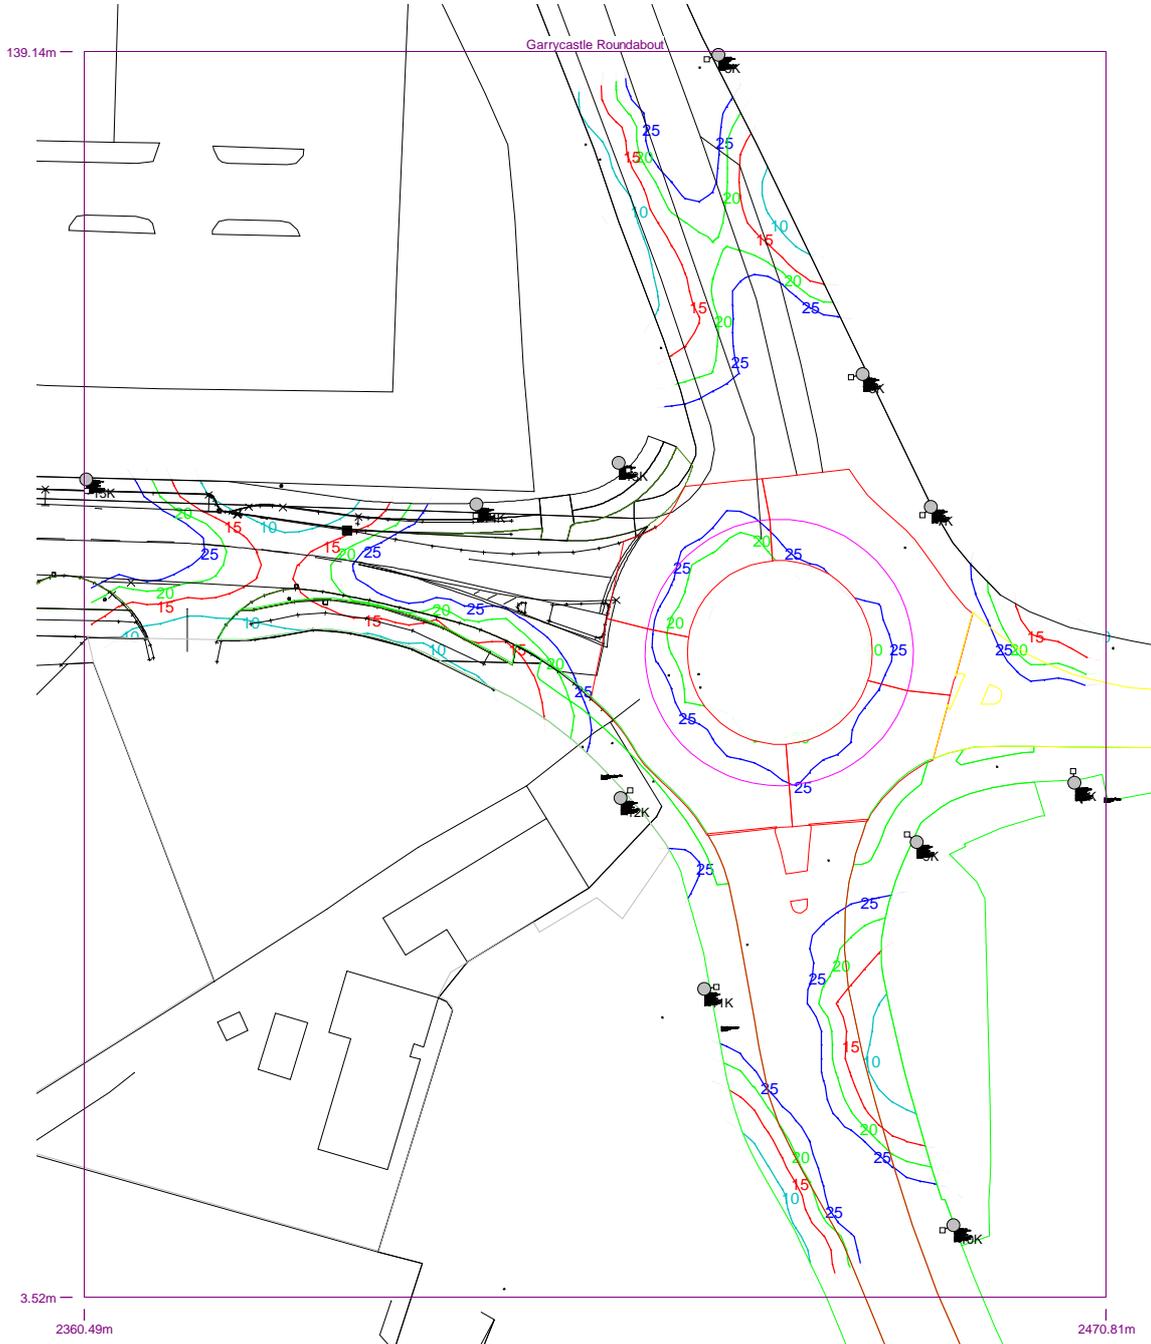


### Results

Eav	31.39
Emin	5.93
Emax	66.78
Emin/Emax	0.09
Emin/Eav	0.19

## Horizontal Illuminance (lux)

Garrycastle Approach

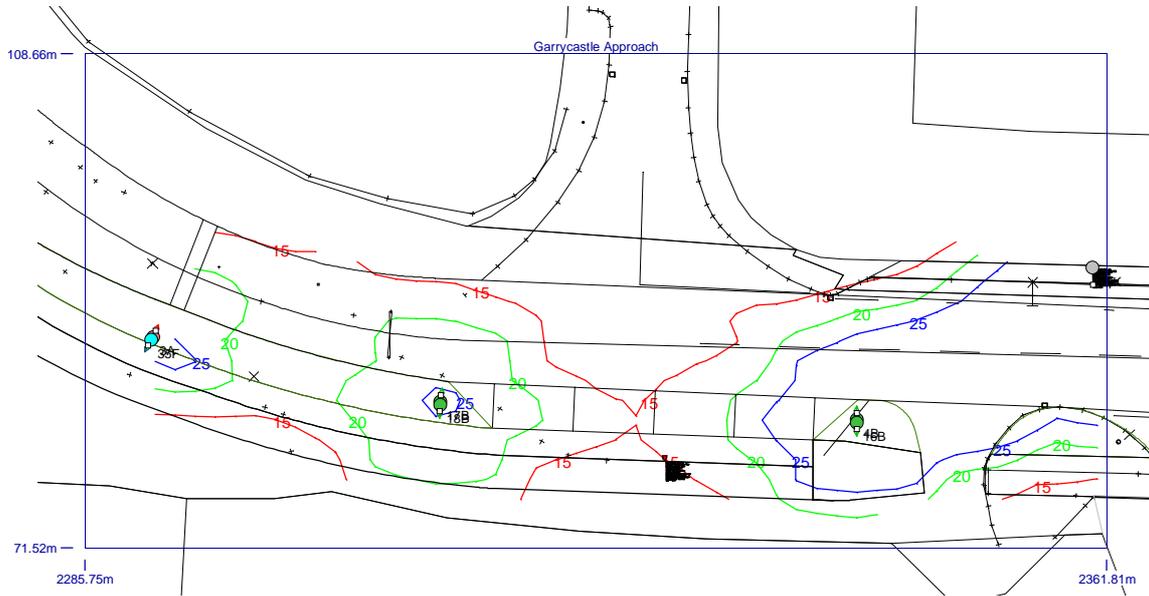


### Results

Eav	22.39
Emin	11.51
E <sub>max</sub>	58.79
E <sub>min</sub> /E <sub>max</sub>	0.20
E <sub>min</sub> /E <sub>av</sub>	0.51

# Horizontal Illuminance (lux)

## Crossing Assessment 1

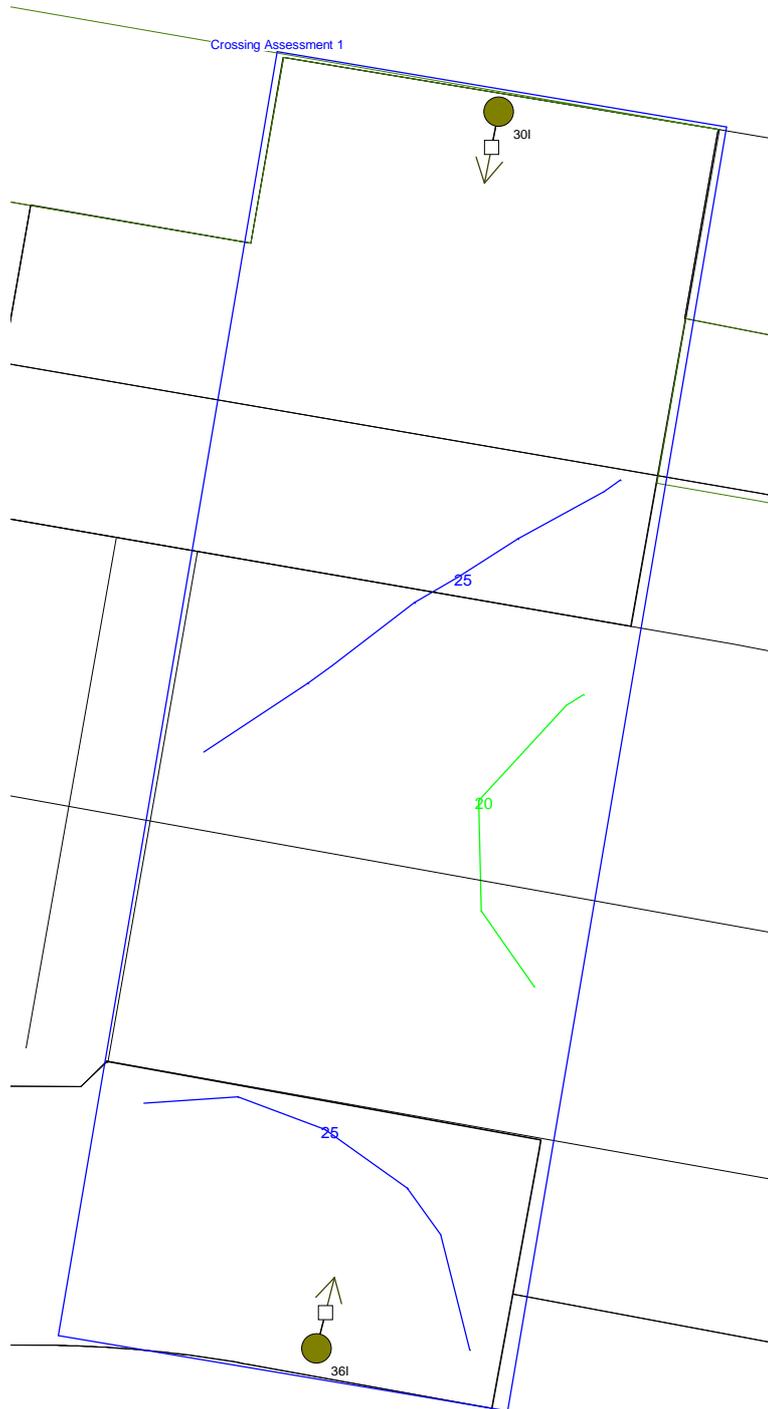


### Results

Eav	25.24
Emin	18.68
Emax	29.54
Emin/Emax	0.63
Emin/Eav	0.74

## Horizontal Illuminance (lux)

### Crossing Assessment 2

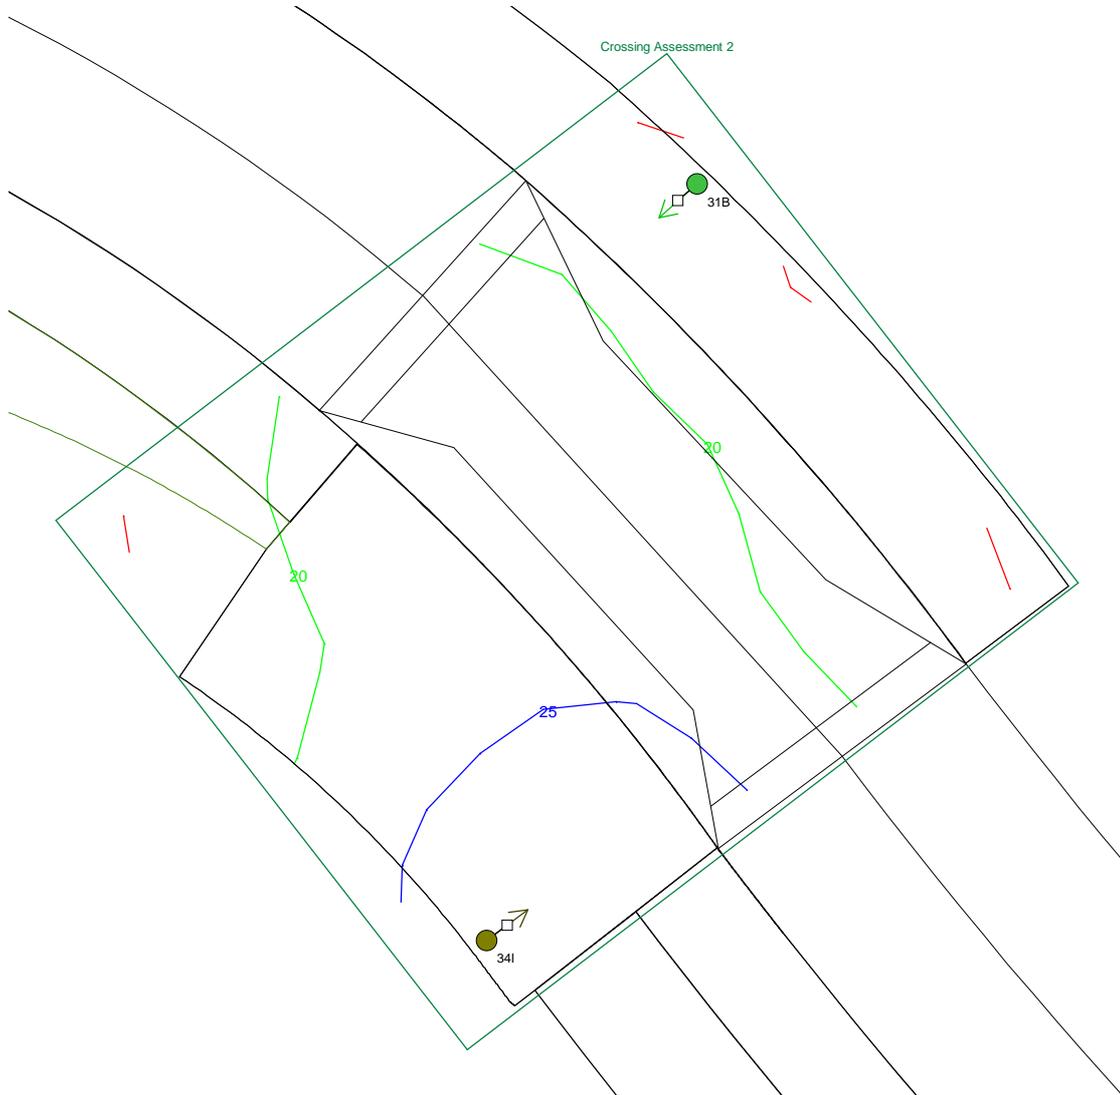

### Results

Eav	20.86
Emin	14.26
Emax	28.43
Emin/Emax	0.50
Emin/Eav	0.68

**DATE:** 10 February 2021  
**DESIGNER:** Patrick Redmond  
**PROJECT No:** 20043  
**PROJECT NAME:** SHD ~ Lissywollen, Athlone



Lighting on Brawny Road designed to comply with I.S. EN 13201-2:2015 M5 ~ Spacing calculation attached. Lighting on spine road & small r'bout to I.S. EN 13201-2:2015 C5. Cycle & pedestrian cross points (main road) to I.S. EN 13201-2:2015 C4. Residential section to I.S. EN 13201-2:2015 P4. Energy consumption assessed in accordance with I.S. EN 13201-5:2015.

A product specific S/P ratio has been applied to the calculation to factor visual efficacy under low level white light, in line with guidance offered by PLG 03 (ILP '12), residential section only.

LMF 0.92 x LDF 0.9 x LSF 1 = MF 0.83 at 100,000 hours with 25 degree ambient. Photometry measured at minimum 15 degree ambient.

Luminaire A = 40W. B = 38W. C = 13W. D = 22W. E = 9W.  
F = 11W. G = 42W. H = 15W. I = 56W.  
Connected load, averaged for CLO.

## Lighting Level ~ Dimmed U14 & U15

**PREPARED BY:** Patrick Redmond Hdip BUS, EngTech AMILP, AMSLL, Tech IEI  
Redmond Analytical Management Services Ltd.  
M~ 086 2356356  
O~ 053 9383696  
patrick@redmondams.ie  
Rosewood House, Mount Seaton, Camolin,  
Enniscorthy, Co. Wexford. Y21 K8P3  
www.redmondams.ie  
Document control: TD 01 Version: 1.0

## Layout Report

### General Data

Dimensions in Metres Angles in Degrees

### Calculation Grids

ID	Grid Name	X	Y	X' Length	Y' Length	X' Spacing	Y' Spacing
1	Spine Road 1	1257.64	440.92	326.11	189.59	1.50	1.49
2	Spine Road 2	1549.37	293.68	326.11	113.40	1.50	1.49
3	Spine Road 3	1886.75	287.61	326.11	88.49	1.50	1.50
4	Spine Road 4	2202.16	75.26	126.45	179.78	1.49	1.50
5	Sector 1A1	1733.59	339.21	259.00	100.32	1.50	1.50
6	Sector 1A2	1984.27	272.68	73.61	78.82	1.47	1.49
7	Sector 1A3	1715.73	276.66	128.91	65.08	1.50	1.48
8	Sector 1A4	1749.74	252.74	73.08	15.68	1.49	1.43
9	Sector 1B1	1840.09	242.70	246.01	72.91	1.49	1.49
10	Sector 1B2	1844.33	125.35	234.91	112.59	1.50	1.48
11	Sector 1B3	2001.91	232.16	53.65	37.62	1.49	1.45
12	Sector 2A1	1643.89	188.28	84.46	106.20	1.48	1.50
13	Sector 2A2	1722.84	160.90	126.74	94.92	1.49	1.48
14	Sector 2A3	1803.97	224.96	29.59	51.61	1.48	1.47
15	Sector 2B1	1662.74	306.22	59.77	148.81	1.49	1.49
16	Sector 2B2	1556.67	212.29	90.77	118.47	1.49	1.50
17	Sector 3A	1301.63	427.83	167.49	186.35	1.50	1.49
18	Sector 3B	1247.12	296.41	321.87	140.59	1.50	1.50
19	Sector 3 Roundabout	1301.41	413.71	47.76	55.15	1.49	1.49
20	Crossing Assessment	1257.24	627.97	10.23	17.76	1.46	1.48

### Luminaires



#### Luminaire A Data

Supplier	Philips
Type	BGP292 DX10
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	9.50
File Name	LumiStreet Gen2 Mini_BGP292_DX10_9500_40LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	513.2, 85.3, 0.0
Lamp S/P Ratio	1.61
No. in Project	28



#### Luminaire B Data

Supplier	Philips
Type	BGP292 DW52
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	9.00
File Name	LumiStreet Gen2 Mini_BGP292_DW52_9000_40LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	639.6, 45.2, 0.0
Lamp S/P Ratio	1.61
No. in Project	31

## Luminaires



### Luminaire C Data

Supplier	Philips
Type	BGP291 DM10
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	2.80
File Name	LumiStreet Gen2 Micro_BGP291_DM10_2800_10LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	534.0, 55.4, 0.0
Lamp S/P Ratio	1.61
No. in Project	45



### Luminaire D Data

Supplier	Philips
Type	BGP291 DX10
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	5.00
File Name	LumiStreet Gen2 Micro_BGP291_DX10_5000_20LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	513.2, 85.3, 0.0
Lamp S/P Ratio	1.61
No. in Project	69



### Luminaire E Data

Supplier	Philips
Type	BGP291 DN08
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	2.00
File Name	LumiStreet Gen2 Micro_BGP291_DN08_2000_10LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	753.5, 151.2, 0.0
Lamp S/P Ratio	1.61
No. in Project	78



### Luminaire F Data

Supplier	Philips
Type	BGP291 DN11
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	2.40
File Name	LumiStreet Gen2 Micro_BGP291_DN11_2400_10LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	595.8, 72.9, 0.0
Lamp S/P Ratio	1.61
No. in Project	44



### Luminaire G Data

Supplier	Philips
Type	BGP292 DX70
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	11.00
File Name	LumiStreet Gen2 Mini_BGP292_DX70_11000_40LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	325.1, 353.8, 0.0
Lamp S/P Ratio	1.61
No. in Project	13



### Luminaire H Data

Supplier	Philips
Type	BGP291 DM11
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	4.00
File Name	LumiStreet Gen2 Micro_BGP291_DM11_4000_20LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	555.3, 96.2, 0.0
Lamp S/P Ratio	1.61
No. in Project	13



### Luminaire I Data


Supplier	Philips
Type	BGP292 DX70
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	12.50
File Name	LumiStreet Gen2 Mini_BGP292_DX70_12500_40LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	325.1, 353.8, 0.0
Lamp S/P Ratio	1.61
No. in Project	5



### Luminaire J Data

Supplier	_Historic Lanterns
Type	ZX3/Clear_P/1289/103/-39/922301
Lamp(s)	150W-SONT+
Lamp Flux (klm)	18.00
File Name	ZX3_Clear Poly_1289_SON-T+_150_103#-3_9_922301TX.ltd
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	545.9, 77.6, 38.8
Lamp S/P Ratio	0.00
No. in Project	11

## Luminaires



### Luminaire K Data

Supplier	_Historic Lanterns
Type	ZX3/FG/1289/115/-45/892242
Lamp(s)	250W-SONT+
Lamp Flux (klm)	33.20
File Name	ZX3_Flat Glass_1289_SON-T+_250_115#-45_892242TY.lgt
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	389.0, 25.0, 0.0
Lamp S/P Ratio	0.00
No. in Project	11

**Layout**

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Dimmed to	Target X	Target Y	Target Z
1	A	1473.27	460.05	8.00	163.00	0.00	0.00	0.50	75%			
2	B	1439.08	387.77	8.00	344.00	0.00	0.00	0.50	75%			
3	B	1447.24	416.64	8.00	344.00	0.00	0.00	0.50	75%			
4	B	1454.23	440.88	8.00	341.00	0.00	0.00	0.50	75%			
5	B	1375.22	525.32	8.00	197.00	0.00	0.00	0.50	75%			
6	A	1440.54	459.29	8.00	78.00	0.00	0.00	0.50	75%			
7	A	1414.13	466.83	8.00	73.00	0.00	0.00	0.50	75%			
8	A	1388.41	479.24	8.00	47.00	0.00	0.00	0.50	75%			
9	B	1374.41	503.35	8.00	31.00	0.00	0.00	0.50	75%			
10	B	1365.71	552.73	8.00	352.00	0.00	0.00	0.50	75%			
11	B	1356.20	576.26	8.00	25.00	0.00	0.00	0.50	75%			
12	B	1351.95	600.54	8.00	236.00	0.00	0.00	0.50	75%			
13	B	1325.29	613.12	8.00	246.00	0.00	0.00	0.50	75%			
14	A	1502.41	378.26	8.00	262.00	0.00	0.00	0.50	75%			
15	A	1478.02	383.65	8.00	258.00	0.00	0.00	0.50	75%			
16	A	1526.80	372.65	8.00	258.00	0.00	0.00	0.50	75%			
17	A	1551.17	367.71	8.00	258.00	0.00	0.00	0.50	75%			
18	A	1575.27	363.04	8.00	260.00	0.00	0.00	0.50	75%			
19	B	1353.89	521.03	8.00	308.00	0.00	0.00	0.50	75%			
20	B	1457.60	384.72	8.00	247.00	0.00	0.00	0.50	75%			
21	F	1462.19	402.91	6.00	162.00	0.00	0.00	0.40	75%			
22	F	1351.48	534.17	6.00	333.00	0.00	0.00	0.40	75%			
23	F	1325.48	613.49	8.00	67.00	0.00	0.00	0.40	75%			
24	F	1371.78	496.62	6.00	26.00	0.00	0.00	0.40	75%			
25	F	1365.33	552.77	8.00	177.00	0.00	0.00	0.40	75%			
26	F	1352.09	600.76	8.00	47.00	0.00	0.00	0.40	75%			
27	F	1341.43	515.74	6.00	333.00	0.00	0.00	0.40	75%			
28	F	1462.99	389.50	6.00	216.00	0.00	0.00	0.50	75%			
29	F	1362.17	508.15	6.00	40.00	0.00	0.00	0.40	75%			
30	A	1603.78	347.30	8.00	218.00	0.00	0.00	0.50	75%			
31	A	1621.66	323.67	8.00	213.00	0.00	0.00	0.50	75%			
32	A	1659.46	307.34	8.00	251.00	0.00	0.00	0.50	75%			
33	A	1684.62	299.76	8.00	258.00	0.00	0.00	0.50	75%			
34	A	1629.83	301.56	8.00	76.00	0.00	0.00	0.50	75%			
35	A	1710.12	293.01	8.00	253.00	0.00	0.00	0.50	75%			
36	A	1735.83	292.28	8.00	202.00	0.00	0.00	0.50	75%			

**Layout Continued**

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Dimmed to	Target X	Target Y	Target Z
37	B	1734.54	267.83	8.00	31.00	0.00	0.00	0.50	75%			
38	B	1756.36	256.59	8.00	208.00	0.00	0.00	0.50	75%			
39	A	1771.19	232.52	8.00	77.00	0.00	0.00	0.50	75%			
40	A	1800.55	224.43	8.00	80.00	0.00	0.00	0.50	75%			
41	B	1816.29	242.17	8.00	297.00	0.00	0.00	0.50	75%			
42	B	1843.50	241.65	8.00	135.00	0.00	0.00	0.50	75%			
43	B	1838.13	261.77	8.00	337.00	0.00	0.00	0.50	75%			
44	B	1853.33	306.44	8.00	346.00	0.00	0.00	0.50	75%			
45	B	1844.64	284.62	8.00	347.00	0.00	0.00	0.50	75%			
46	A	1880.30	293.47	8.00	76.00	0.00	0.00	0.50	75%			
47	B	1909.61	287.16	8.00	74.00	0.00	0.00	0.50	75%			
48	D	1599.96	364.22	6.00	155.00	0.00	0.00	0.40	75%			
49	C	1727.14	313.85	6.00	346.00	0.00	0.00	0.90	75%			
50	D	1858.58	333.99	6.00	342.00	0.00	0.00	0.40	75%			
51	A	1937.77	276.94	8.00	76.00	0.00	0.00	0.50	75%			
52	A	1966.76	268.87	8.00	76.00	0.00	0.00	0.50	75%			
53	A	1997.74	269.29	8.00	112.00	0.00	0.00	0.50	75%			
54	A	2018.93	290.91	8.00	290.00	0.00	0.00	0.50	75%			
55	A	2050.15	297.52	8.00	277.00	0.00	0.00	0.50	75%			
56	A	2082.65	300.89	8.00	273.00	0.00	0.00	0.50	75%			
57	A	2114.68	301.89	8.00	273.00	0.00	0.00	0.50	75%			
58	B	2147.92	300.33	8.00	262.00	0.00	0.00	0.50	75%			
59	B	2177.26	285.94	8.00	222.00	0.00	0.00	0.50	75%			
60	B	2185.25	256.49	8.00	43.00	0.00	0.00	0.50	75%			
61	B	2218.93	247.03	8.00	238.00	0.00	0.00	0.50	75%			
62	F	2035.55	300.79	8.00	291.00	0.00	0.00	0.40	75%			
63	B	2242.38	228.95	8.00	221.00	0.00	0.00	0.50	75%			
64	B	2255.25	201.82	8.00	191.00	0.00	0.00	0.50	75%			
65	B	2247.59	169.12	8.00	10.00	0.00	0.00	0.50	75%			
66	B	2253.15	134.91	8.00	8.00	0.00	0.00	0.50	75%			
67	A	2269.30	103.98	8.00	35.00	0.00	0.00	0.50	75%			
68	A	2290.83	87.40	8.00	68.00	0.00	0.00	0.50	75%			
69	B	2312.21	82.55	8.00	84.00	0.00	0.00	0.50	75%			
70	D	1736.68	348.27	6.00	344.00	0.00	0.00	0.90	75%			
71	D	1745.63	379.37	6.00	346.00	0.00	0.00	0.90	75%			
72	D	1754.49	410.18	6.00	348.00	0.00	0.00	0.90	75%			

**Layout Continued**

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Dimmed to	Target X	Target Y	Target Z
73	C	1819.75	408.62	6.00	253.00	0.00	0.00	0.40	75%			
74	C	1786.91	417.99	6.00	253.00	0.00	0.00	0.40	75%			
75	C	1852.71	399.32	6.00	254.00	0.00	0.00	0.40	75%			
76	C	1880.78	391.26	6.00	255.00	0.00	0.00	0.40	75%			
77	C	1914.28	381.79	6.00	253.00	0.00	0.00	0.40	75%			
78	C	1946.19	372.98	6.00	256.00	0.00	0.00	0.40	75%			
79	D	1969.67	357.14	6.00	75.00	0.00	0.00	0.90	75%			
80	C	2002.08	356.51	6.00	252.00	0.00	0.00	0.40	75%			
81	D	1809.19	383.69	6.00	346.00	0.00	0.00	0.40	75%			
82	D	1800.32	351.27	6.00	346.00	0.00	0.00	0.40	75%			
83	D	1867.92	367.61	6.00	344.00	0.00	0.00	0.40	75%			
84	D	1943.46	353.66	6.00	168.00	0.00	0.00	0.90	75%			
85	C	1935.89	327.24	6.00	166.00	0.00	0.00	0.40	75%			
86	D	2002.41	333.39	6.00	161.00	0.00	0.00	0.40	75%			
87	D	1994.03	300.82	6.00	161.00	0.00	0.00	0.40	75%			
88	D	1763.76	342.57	6.00	254.00	0.00	0.00	0.40	75%			
89	D	1796.01	333.42	6.00	257.00	0.00	0.00	0.40	75%			
90	E	1820.11	324.57	6.00	257.00	0.00	0.00	0.40	75%			
91	E	1827.23	314.48	6.00	287.00	0.00	0.00	0.40	75%			
92	D	1931.23	310.62	6.00	163.00	0.00	0.00	0.40	75%			
93	D	2024.47	333.03	6.00	21.00	0.00	0.00	0.40	75%			
94	D	2031.43	310.12	6.00	12.00	0.00	0.00	0.40	75%			
95	E	2008.13	322.56	6.00	197.00	0.00	0.00	0.40	75%			
96	E	2020.63	318.53	6.00	105.00	0.00	0.00	0.40	75%			
97	E	2009.03	307.04	6.00	108.00	0.00	0.00	0.40	75%			
98	E	2016.82	333.50	6.00	105.00	0.00	0.00	0.40	75%			
99	E	2002.46	295.05	6.00	27.00	0.00	0.00	0.40	75%			
100	E	2018.86	299.41	6.00	197.00	0.00	0.00	0.40	75%			
101	C	2023.93	349.53	6.00	227.00	0.00	0.00	0.40	75%			
102	D	1761.81	290.40	6.00	251.00	0.00	0.00	0.40	75%			
103	D	1771.06	269.48	6.00	122.00	0.00	0.00	0.40	75%			
104	F	1794.99	288.99	6.00	295.00	0.00	0.00	0.40	75%			
105	F	1819.61	292.61	6.00	122.00	0.00	0.00	0.40	75%			
106	E	1836.13	302.23	6.00	286.00	0.00	0.00	0.40	75%			
107	F	1804.81	307.06	6.00	344.00	0.00	0.00	0.40	75%			
108	E	1762.68	304.70	6.00	346.00	0.00	0.00	0.40	75%			

**Layout Continued**

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Dimmed to	Target X	Target Y	Target Z
109	E	1779.50	314.29	6.00	165.00	0.00	0.00	0.40	75%			
110	E	1758.19	320.17	6.00	346.00	0.00	0.00	0.40	75%			
111	E	1760.79	312.85	6.00	255.00	0.00	0.00	0.40	75%			
112	E	1801.18	270.20	6.00	24.00	0.00	0.00	0.40	75%			
113	E	1811.27	252.21	6.00	23.00	0.00	0.00	0.40	75%			
114	E	1785.00	262.57	6.00	301.00	0.00	0.00	0.40	75%			
115	E	1795.93	251.93	6.00	37.00	0.00	0.00	0.40	75%			
116	F	1793.27	318.75	6.00	78.00	0.00	0.00	0.40	75%			
117	C	1906.27	271.65	6.00	342.00	0.00	0.00	0.40	75%			
118	C	1900.36	250.48	6.00	343.00	0.00	0.00	0.40	75%			
119	C	1978.06	251.43	6.00	345.00	0.00	0.00	0.40	75%			
120	C	1969.42	220.78	6.00	345.00	0.00	0.00	0.40	75%			
121	C	1994.34	247.03	6.00	162.00	0.00	0.00	0.40	75%			
122	C	1985.83	217.41	6.00	160.00	0.00	0.00	0.40	75%			
123	D	1888.22	241.80	6.00	254.00	0.00	0.00	0.40	75%			
124	C	1920.72	232.27	6.00	251.00	0.00	0.00	0.40	75%			
125	D	1952.79	223.21	6.00	256.00	0.00	0.00	0.40	75%			
126	F	1983.26	208.08	6.00	260.00	0.00	0.00	0.90	75%			
127	F	2037.92	192.04	6.00	256.00	0.00	0.00	0.40	75%			
128	F	2061.68	178.54	6.00	79.00	0.00	0.00	0.90	75%			
129	F	1854.91	238.95	6.00	74.00	0.00	0.00	0.40	75%			
130	E	2002.20	229.74	6.00	76.00	0.00	0.00	0.40	75%			
131	E	2007.83	246.73	6.00	251.00	0.00	0.00	0.40	75%			
132	F	2013.92	218.04	6.00	80.00	0.00	0.00	0.40	75%			
133	E	2027.24	231.01	6.00	132.00	0.00	0.00	0.40	75%			
134	E	2023.63	244.39	6.00	284.00	0.00	0.00	0.40	75%			
135	E	2013.62	253.02	6.00	1.00	0.00	0.00	0.40	75%			
136	E	2036.33	256.34	6.00	166.00	0.00	0.00	0.40	75%			
137	E	2023.94	260.01	6.00	304.00	0.00	0.00	0.40	75%			
138	D	1931.44	204.92	6.00	346.00	0.00	0.00	0.40	75%			
139	E	1899.93	215.81	6.00	161.00	0.00	0.00	0.40	75%			
140	D	1996.36	180.14	6.00	346.00	0.00	0.00	0.40	75%			
141	F	2013.98	192.22	6.00	78.00	0.00	0.00	0.90	75%			
142	D	1885.59	219.60	6.00	162.00	0.00	0.00	0.40	75%			
143	D	1869.16	200.28	6.00	334.00	0.00	0.00	0.40	75%			
144	D	1860.30	169.29	6.00	346.00	0.00	0.00	0.40	75%			

**Layout Continued**

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Dimmed to	Target X	Target Y	Target Z
145	D	1864.17	143.19	6.00	162.00	0.00	0.00	0.40	75%			
146	F	1855.89	127.66	6.00	74.00	0.00	0.00	0.40	75%			
147	C	1923.01	176.12	6.00	344.00	0.00	0.00	0.40	75%			
148	C	1913.90	143.14	6.00	342.00	0.00	0.00	0.40	75%			
149	F	1910.67	119.43	6.00	74.00	0.00	0.00	0.40	75%			
150	E	1894.64	197.21	6.00	165.00	0.00	0.00	0.40	75%			
151	C	1895.92	180.82	6.00	254.00	0.00	0.00	0.40	75%			
152	E	1921.12	185.12	6.00	342.00	0.00	0.00	0.40	75%			
153	F	1886.86	162.35	6.00	164.00	0.00	0.00	0.40	75%			
154	F	1877.88	136.12	6.00	171.00	0.00	0.00	0.40	75%			
155	E	1904.37	166.82	6.00	80.00	0.00	0.00	0.40	75%			
156	E	1894.39	137.05	6.00	70.00	0.00	0.00	0.40	75%			
157	E	1889.89	130.93	6.00	252.00	0.00	0.00	0.40	75%			
158	E	1931.61	119.90	6.00	258.00	0.00	0.00	0.40	75%			
159	E	1961.88	111.39	6.00	252.00	0.00	0.00	0.40	75%			
160	C	1980.43	123.41	6.00	344.00	0.00	0.00	0.40	75%			
161	C	1988.26	151.32	6.00	346.00	0.00	0.00	0.40	75%			
162	F	2070.42	104.65	6.00	101.00	0.00	0.00	0.40	75%			
163	F	2034.70	104.00	6.00	82.00	0.00	0.00	0.40	75%			
164	F	1998.94	112.69	6.00	76.00	0.00	0.00	0.40	75%			
165	D	2071.48	166.48	6.00	185.00	0.00	0.00	0.40	75%			
166	F	2072.70	146.52	6.00	188.00	0.00	0.00	0.40	75%			
167	F	2074.10	126.59	6.00	185.00	0.00	0.00	0.40	75%			
168	E	1895.92	181.51	6.00	75.00	0.00	0.00	0.40	75%			
169	E	1915.07	151.67	6.00	167.00	0.00	0.00	0.40	75%			
170	F	1981.19	108.48	6.00	75.00	0.00	0.00	0.40	75%			
171	E	2011.86	264.95	6.00	25.00	0.00	0.00	0.40	75%			
172	E	2026.07	269.94	6.00	24.00	0.00	0.00	0.40	75%			
173	E	2036.05	274.82	6.00	14.00	0.00	0.00	0.40	75%			
174	D	1685.53	272.73	6.00	164.00	0.00	0.00	0.40	75%			
175	D	1689.85	259.80	6.00	249.00	0.00	0.00	0.40	75%			
176	D	1718.65	251.63	6.00	254.00	0.00	0.00	0.40	75%			
177	D	1737.21	249.05	6.00	305.00	0.00	0.00	0.40	75%			
178	C	1675.03	237.13	6.00	162.00	0.00	0.00	0.40	75%			
179	D	1653.36	202.83	6.00	343.00	0.00	0.00	0.40	75%			
180	E	1633.30	199.15	6.00	253.00	0.00	0.00	0.40	75%			

**Layout Continued**

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Dimmed to	Target X	Target Y	Target Z
181	C	1727.87	225.77	6.00	346.00	0.00	0.00	0.40	75%			
182	D	1724.79	184.90	6.00	160.00	0.00	0.00	0.40	75%			
183	C	1741.19	203.90	6.00	257.00	0.00	0.00	0.40	75%			
184	E	1675.53	187.14	6.00	255.00	0.00	0.00	0.40	75%			
185	E	1697.41	180.93	6.00	254.00	0.00	0.00	0.40	75%			
186	E	1726.49	175.66	6.00	167.00	0.00	0.00	0.40	75%			
187	E	1704.14	266.07	6.00	257.00	0.00	0.00	0.40	75%			
188	C	1668.08	212.80	6.00	166.00	0.00	0.00	0.40	75%			
189	E	1744.47	188.43	6.00	82.00	0.00	0.00	0.40	75%			
190	C	1772.02	195.22	6.00	251.00	0.00	0.00	0.40	75%			
191	D	1800.59	187.25	6.00	254.00	0.00	0.00	0.40	75%			
192	C	1805.97	194.46	6.00	346.00	0.00	0.00	0.40	75%			
193	C	1812.12	216.69	6.00	346.00	0.00	0.00	0.40	75%			
194	F	1798.09	166.47	6.00	346.00	0.00	0.00	0.40	75%			
195	E	1766.26	176.68	6.00	47.00	0.00	0.00	0.40	75%			
196	E	1779.76	165.02	6.00	48.00	0.00	0.00	0.40	75%			
197	F	1792.08	154.00	6.00	255.00	0.00	0.00	0.40	75%			
198	E	1818.00	149.30	6.00	251.00	0.00	0.00	0.40	75%			
199	E	1838.81	143.54	6.00	252.00	0.00	0.00	0.40	75%			
200	E	1840.03	224.79	6.00	77.00	0.00	0.00	0.40	75%			
201	E	1852.45	232.51	6.00	162.00	0.00	0.00	0.40	75%			
202	E	1842.33	230.72	6.00	27.00	0.00	0.00	0.40	75%			
203	D	1737.64	419.39	6.00	256.00	0.00	0.00	0.40	75%			
204	D	1709.89	422.94	6.00	276.00	0.00	0.00	0.40	75%			
205	D	1722.59	351.45	6.00	273.00	0.00	0.00	0.40	75%			
206	D	1695.82	342.16	6.00	86.00	0.00	0.00	0.40	75%			
207	D	1707.20	327.69	6.00	163.00	0.00	0.00	0.40	75%			
208	E	1697.67	317.78	6.00	251.00	0.00	0.00	0.40	75%			
209	E	1679.64	336.76	6.00	154.00	0.00	0.00	0.40	75%			
210	E	1707.29	315.42	6.00	78.00	0.00	0.00	0.40	75%			
211	D	1626.32	290.28	6.00	162.00	0.00	0.00	0.90	75%			
212	C	1605.42	281.14	6.00	346.00	0.00	0.00	0.40	75%			
213	C	1593.90	240.49	6.00	346.00	0.00	0.00	0.40	75%			
214	D	1590.89	221.24	6.00	342.00	0.00	0.00	0.40	75%			
215	E	1569.28	237.38	6.00	254.00	0.00	0.00	0.40	75%			
216	F	1589.37	208.46	6.00	74.00	0.00	0.00	0.40	75%			

**Layout Continued**

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Dimmed to	Target X	Target Y	Target Z
217	E	1614.33	204.45	6.00	252.00	0.00	0.00	0.40	75%			
218	E	1592.98	317.47	6.00	62.00	0.00	0.00	0.40	75%			
219	E	1588.31	232.15	6.00	250.00	0.00	0.00	0.40	75%			
220	C	1599.54	260.01	6.00	346.00	0.00	0.00	0.40	75%			
221	D	1384.95	573.18	6.00	66.00	0.00	0.00	0.40	75%			
222	D	1411.12	563.28	6.00	71.00	0.00	0.00	0.40	75%			
223	D	1451.64	527.80	6.00	45.00	0.00	0.00	0.40	75%			
224	C	1445.69	535.90	6.00	159.00	0.00	0.00	0.40	75%			
225	D	1442.64	551.10	6.00	71.00	0.00	0.00	0.40	75%			
226	E	1399.31	540.37	6.00	64.00	0.00	0.00	0.40	75%			
227	E	1419.73	534.02	6.00	245.00	0.00	0.00	0.40	75%			
228	F	1397.76	528.97	6.00	29.00	0.00	0.00	0.40	75%			
229	F	1423.82	501.70	6.00	83.00	0.00	0.00	0.40	75%			
230	E	1442.72	492.66	6.00	340.00	0.00	0.00	0.40	75%			
231	E	1435.66	519.17	6.00	248.00	0.00	0.00	0.40	75%			
232	F	1453.25	518.68	6.00	298.00	0.00	0.00	0.40	75%			
233	F	1413.75	524.89	6.00	140.00	0.00	0.00	0.40	75%			
234	C	1431.30	415.17	6.00	258.00	0.00	0.00	0.40	75%			
235	C	1426.84	398.22	6.00	76.00	0.00	0.00	0.40	75%			
236	D	1379.74	429.71	6.00	256.00	0.00	0.00	0.40	75%			
237	C	1401.99	423.51	6.00	250.00	0.00	0.00	0.40	75%			
238	C	1395.59	407.01	6.00	74.00	0.00	0.00	0.40	75%			
239	C	1366.51	414.11	6.00	78.00	0.00	0.00	0.40	75%			
240	D	1338.58	422.06	6.00	79.00	0.00	0.00	0.40	75%			
241	D	1345.34	440.68	6.00	248.00	0.00	0.00	0.40	75%			
242	D	1416.35	435.56	6.00	346.00	0.00	0.00	0.40	75%			
243	F	1410.26	449.35	6.00	79.00	0.00	0.00	0.40	75%			
244	E	1398.75	436.88	6.00	346.00	0.00	0.00	0.40	75%			
245	F	1366.05	468.22	6.00	249.00	0.00	0.00	0.40	75%			
246	E	1379.44	455.30	6.00	165.00	0.00	0.00	0.40	75%			
247	E	1367.71	440.00	6.00	249.00	0.00	0.00	0.40	75%			
248	E	1363.60	492.29	6.00	71.00	0.00	0.00	0.40	75%			
249	D	1349.12	483.97	6.00	163.00	0.00	0.00	0.40	75%			
250	D	1340.54	456.72	6.00	157.00	0.00	0.00	0.40	75%			
251	E	1331.19	487.52	6.00	346.00	0.00	0.00	0.40	75%			
252	E	1321.06	459.29	6.00	346.00	0.00	0.00	0.40	75%			

**Layout Continued**

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Dimmed to	Target X	Target Y	Target Z
253	E	1313.92	440.64	6.00	333.00	0.00	0.00	0.40	75%			
254	E	1302.85	412.71	6.00	336.00	0.00	0.00	0.40	75%			
255	D	1477.32	495.38	6.00	310.00	0.00	0.00	0.40	75%			
256	D	1366.76	403.75	6.00	346.00	0.00	0.00	0.40	75%			
257	F	1418.97	519.04	6.00	275.00	0.00	0.00	0.40	75%			
258	E	1383.30	540.56	6.00	124.00	0.00	0.00	0.40	75%			
259	C	1465.09	482.28	6.00	346.00	0.00	0.00	0.40	75%			
260	D	1312.19	395.94	6.00	156.00	0.00	0.00	0.40	75%			
261	D	1302.82	373.20	6.00	155.00	0.00	0.00	0.40	75%			
262	D	1291.11	343.89	6.00	155.00	0.00	0.00	0.40	75%			
263	D	1284.24	326.72	6.00	70.00	0.00	0.00	0.40	75%			
264	D	1312.30	317.87	6.00	77.00	0.00	0.00	0.40	75%			
265	D	1339.33	310.42	6.00	75.00	0.00	0.00	0.40	75%			
266	D	1357.40	370.55	6.00	345.00	0.00	0.00	0.40	75%			
267	D	1349.07	341.59	6.00	339.00	0.00	0.00	0.40	75%			
268	C	1341.32	300.07	6.00	344.00	0.00	0.00	0.40	75%			
269	C	1338.62	283.24	6.00	75.00	0.00	0.00	0.40	75%			
270	F	1359.23	277.36	6.00	74.00	0.00	0.00	0.40	75%			
271	C	1345.34	376.05	6.00	72.00	0.00	0.00	0.40	75%			
272	C	1350.59	394.66	6.00	259.00	0.00	0.00	0.40	75%			
273	E	1328.35	400.89	6.00	258.00	0.00	0.00	0.40	75%			
274	E	1329.92	366.99	6.00	348.00	0.00	0.00	0.40	75%			
275	E	1333.46	348.02	6.00	78.00	0.00	0.00	0.40	75%			
276	C	1308.46	356.63	6.00	259.00	0.00	0.00	0.40	75%			
277	E	1262.99	313.37	6.00	338.00	0.00	0.00	0.40	75%			
278	E	1273.85	341.27	6.00	344.00	0.00	0.00	0.40	75%			
279	F	1423.83	356.82	6.00	337.00	0.00	0.00	0.40	75%			
280	E	1442.30	354.06	6.00	113.00	0.00	0.00	0.40	75%			
281	D	1474.21	362.42	6.00	258.00	0.00	0.00	0.40	75%			
282	D	1500.11	346.27	6.00	164.00	0.00	0.00	0.40	75%			
283	D	1575.19	329.69	6.00	77.00	0.00	0.00	0.40	75%			
284	D	1560.90	325.13	6.00	165.00	0.00	0.00	0.40	75%			
285	C	1537.36	341.11	6.00	76.00	0.00	0.00	0.40	75%			
286	E	1513.18	347.78	6.00	78.00	0.00	0.00	0.40	75%			
287	D	1319.56	414.42	6.00	159.00	0.00	0.00	0.40	75%			
288	D	1323.36	444.43	6.00	335.00	0.00	0.00	0.40	75%			

**Layout Continued**


ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Dimmed to	Target X	Target Y	Target Z
289	D	1316.45	429.79	6.00	337.00	0.00	0.00	0.40	75%			
290	E	1775.70	308.82	6.00	256.00	0.00	0.00	0.40	75%			
291	I	1266.22	624.73	8.00	71.00	5.00	0.00	0.90	75%			
292	I	1265.57	643.36	8.00	248.00	5.00	0.00	0.90	75%			
293	G	1289.09	626.97	8.00	245.00	0.00	0.00	0.50	66%			
294	G	1236.69	651.45	8.00	245.00	0.00	0.00	0.50	66%			
295	G	1199.97	666.98	8.00	245.00	0.00	0.00	0.50	66%			
296	G	1163.12	682.93	8.00	245.00	0.00	0.00	0.50	66%			
297	G	1132.84	699.12	8.00	236.00	0.00	0.00	0.50	66%			
298	G	1096.83	716.49	8.00	245.00	0.00	0.00	0.50	66%			
299	G	1059.30	730.65	8.00	249.00	0.00	0.00	0.50	66%			
300	G	1023.83	742.56	8.00	257.00	0.00	0.00	0.50	66%			
301	G	985.31	753.63	8.00	256.00	0.00	0.00	0.50	66%			
302	G	957.31	761.78	8.00	256.00	0.00	0.00	0.50	66%			
303	G	927.45	769.49	8.00	258.00	0.00	0.00	0.50	66%			
304	G	888.45	778.48	8.00	257.00	0.00	0.00	0.50	66%			
305	G	849.19	786.40	8.00	261.00	0.00	0.00	0.50	66%			
306	H	1289.19	627.18	8.00	72.00	0.00	0.00	0.40	66%			
307	H	1236.75	651.63	8.00	72.00	0.00	0.00	0.40	66%			
308	H	1200.04	667.08	8.00	72.00	0.00	0.00	0.40	66%			
309	H	1163.21	683.06	8.00	69.00	0.00	0.00	0.40	66%			
310	H	1132.90	699.31	8.00	60.00	0.00	0.00	0.40	66%			
311	H	1096.90	716.65	8.00	72.00	0.00	0.00	0.40	66%			
312	H	1059.45	730.92	8.00	72.00	0.00	0.00	0.40	66%			
313	H	1023.87	742.76	8.00	77.00	0.00	0.00	0.40	66%			
314	H	985.35	753.75	8.00	79.00	0.00	0.00	0.40	66%			
315	H	957.35	761.91	8.00	79.00	0.00	0.00	0.40	66%			
316	H	927.53	769.76	8.00	78.00	0.00	0.00	0.40	66%			
317	H	888.53	778.76	8.00	84.00	0.00	0.00	0.40	66%			
318	H	849.22	786.61	8.00	79.00	0.00	0.00	0.40	66%			
319	B	2343.16	80.99	8.00	270.00	0.00	0.00	0.50	75%			
320	B	2343.20	81.17	8.00	88.00	0.00	0.00	0.50	75%			
321	B	2312.18	82.27	8.00	263.00	0.00	0.00	0.50	75%			
322	F	2268.88	103.74	8.00	215.00	0.00	0.00	0.40	75%			
323	F	2290.73	87.20	8.00	243.00	0.00	0.00	0.40	75%			
324	I	2173.19	271.19	8.00	37.00	0.00	0.00	0.50	75%			

**Layout Continued**

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Dimmed to	Target X	Target Y	Target Z
Existing 325	J	811.06	861.93	10.00	128.00	5.00	0.00	2.50	100%			
Existing 326	J	772.75	859.25	10.00	292.00	5.00	0.00	2.50	100%			
Existing 327	J	738.43	849.00	10.00	277.00	5.00	0.00	2.50	100%			
Existing 328	J	700.15	849.64	10.00	43.00	5.00	0.00	2.50	100%			
Relocate 329	J	709.41	822.58	10.00	354.00	5.00	0.00	2.50	100%			
Existing 330	J	691.18	787.66	10.00	106.00	5.00	0.00	2.50	100%			
Existing 331	J	715.71	793.23	10.00	96.00	5.00	0.00	2.50	100%			
Existing 332	J	745.93	793.57	10.00	101.00	5.00	0.00	2.50	100%			
Relocate 333	J	767.47	788.15	10.00	62.00	5.00	0.00	2.50	100%			
Relocate 334	J	811.57	777.67	10.00	91.00	5.00	0.00	2.50	100%			
Existing 335	J	767.24	823.06	10.00	180.00	5.00	0.00	2.50	100%			
Existing 336	K	2428.88	138.81	10.00	204.00	5.00	0.00	1.30	100%			
Existing 337	K	2444.48	104.06	10.00	197.00	5.00	0.00	1.30	100%			
Existing 338	K	2451.84	89.63	10.00	226.00	5.00	0.00	1.30	100%			
Existing 339	K	2467.36	59.56	10.00	97.00	5.00	0.00	1.30	100%			
Existing 340	K	2450.29	53.13	10.00	142.00	5.00	0.00	1.30	100%			
Existing 341	K	2454.27	11.42	10.00	204.00	5.00	0.00	1.30	100%			
Existing 342	K	2427.42	37.14	10.00	10.00	5.00	0.00	1.30	100%			
Existing 343	K	2418.39	57.91	10.00	40.00	5.00	0.00	1.30	100%			
Existing 344	K	2360.73	92.61	10.00	272.00	5.00	0.00	1.30	100%			
Existing 345	K	2402.79	89.91	10.00	267.00	5.00	0.00	1.30	100%			
Existing 346	K	2418.17	94.43	10.00	320.00	5.00	0.00	1.30	100%			
347	I	826.78	794.30	8.00	259.00	0.00	0.00	0.50	75%			
348	I	824.30	777.34	8.00	76.00	0.00	0.00	0.50	75%			

# Horizontal Illuminance (lux)

Spine Road 1

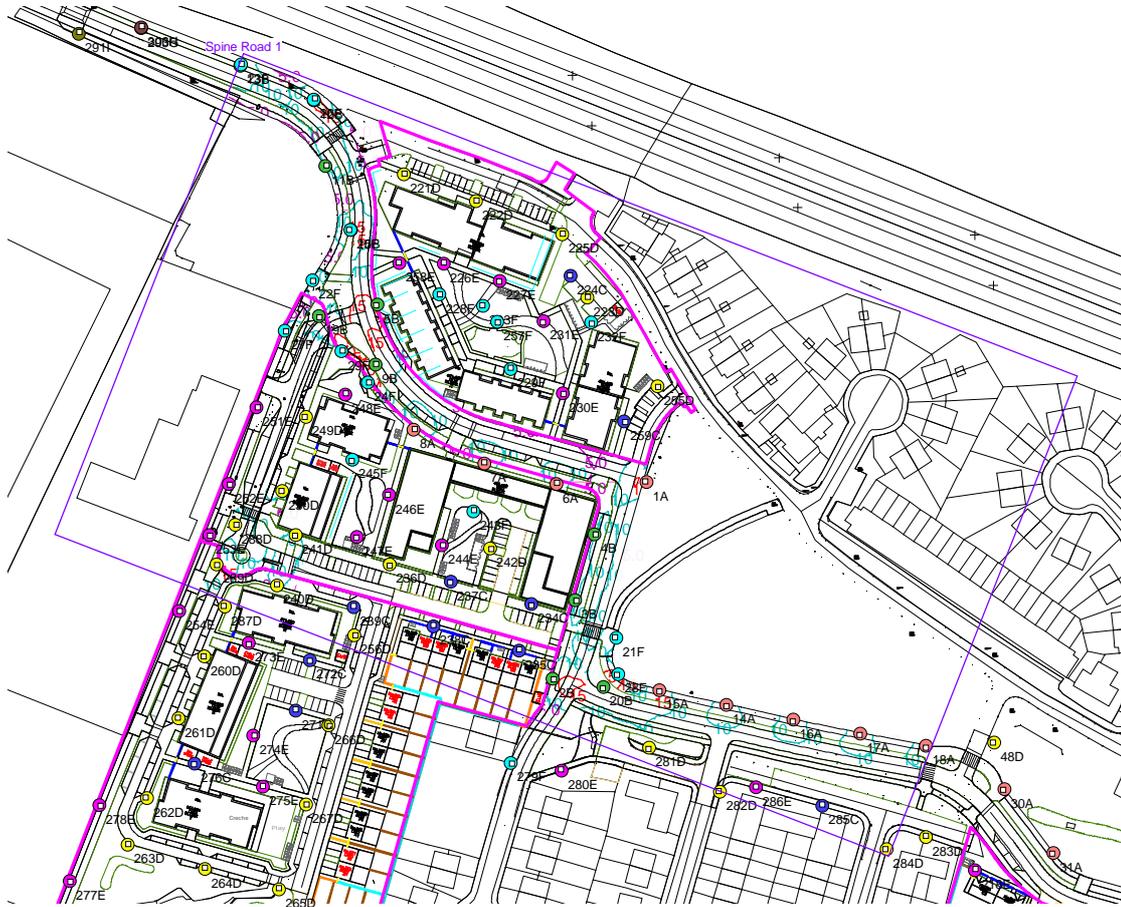


## Results

Eav	9.87
Emin	4.03
Emax	19.25
Emin/Emax	0.21
Emin/Eav	0.41



# Horizontal Illuminance (lux)

Spine Road 3

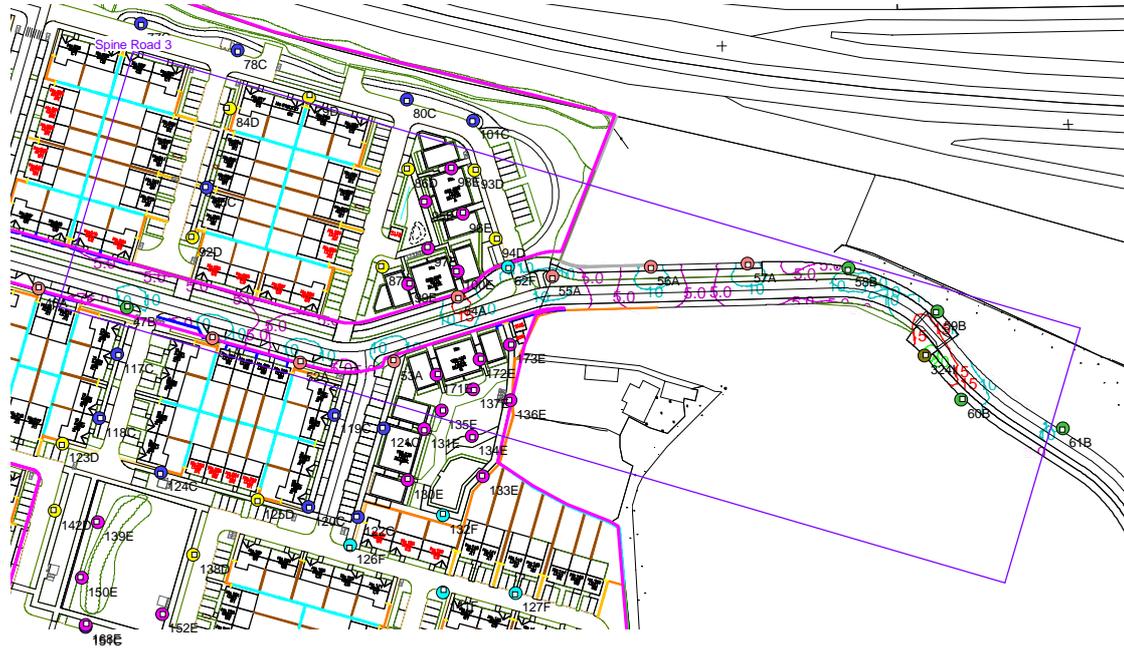


## Results

Eav	8.40
Emin	3.35
E <sub>max</sub>	21.40
E <sub>min</sub> /E <sub>max</sub>	0.16
E <sub>min</sub> /E <sub>av</sub>	0.40

# Horizontal Illuminance (lux)

Spine Road 4

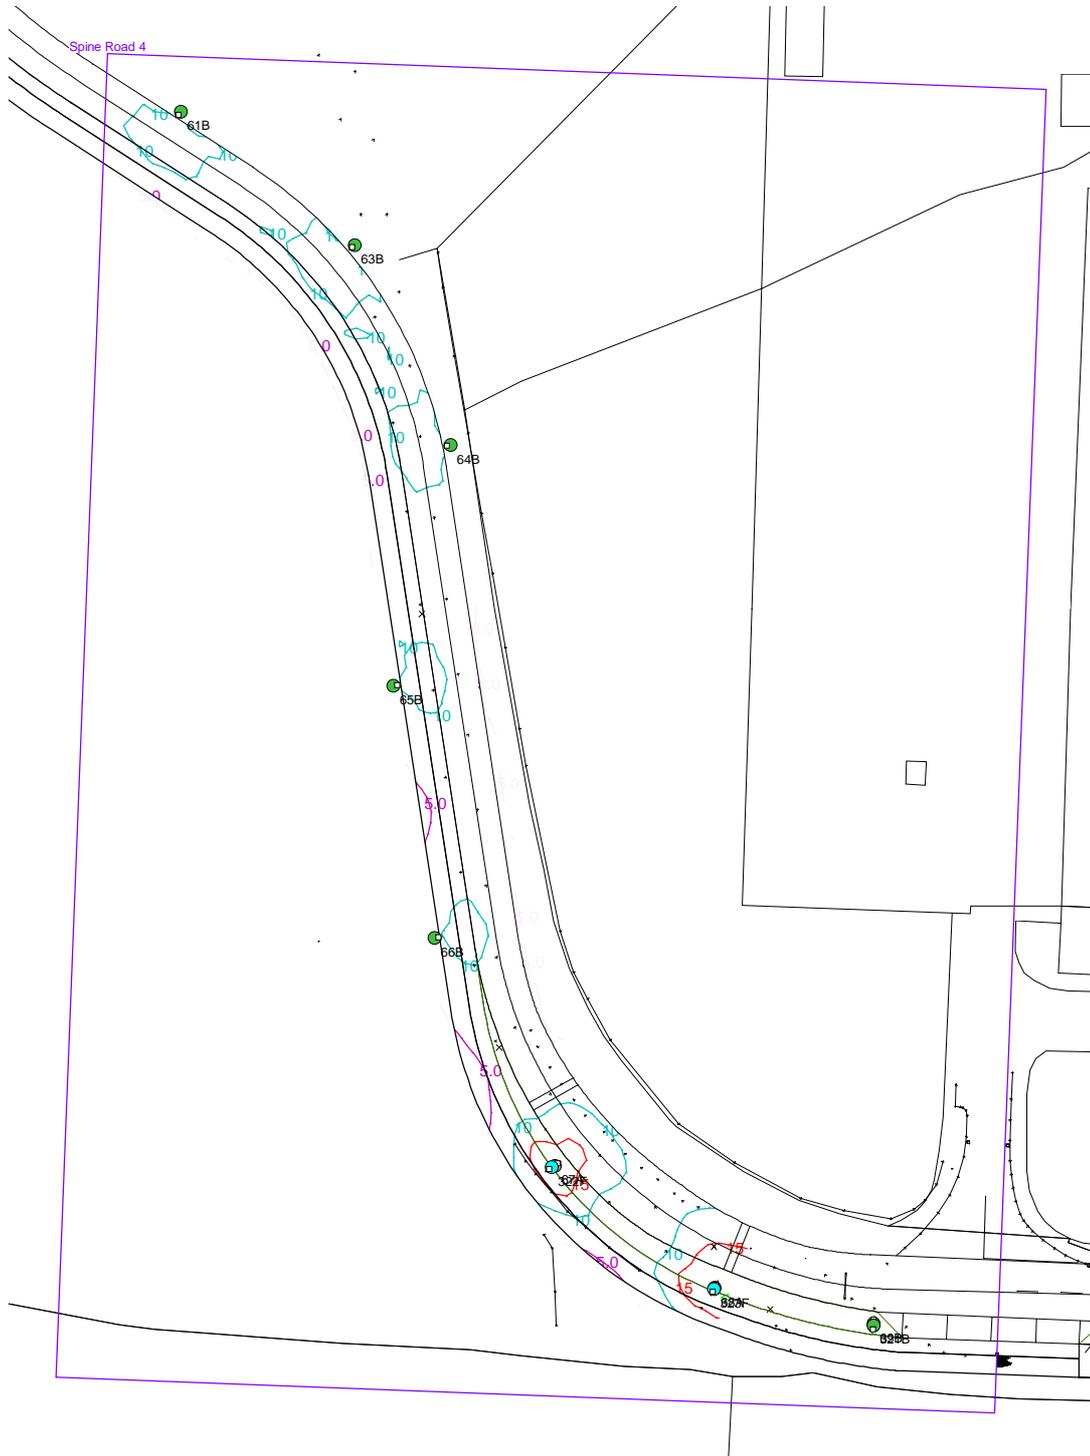


## Results

Eav	9.11
Emin	3.77
Emax	19.70
Emin/Emax	0.19
Emin/Eav	0.41

# Horizontal Illuminance (lux)

Sector 1A1

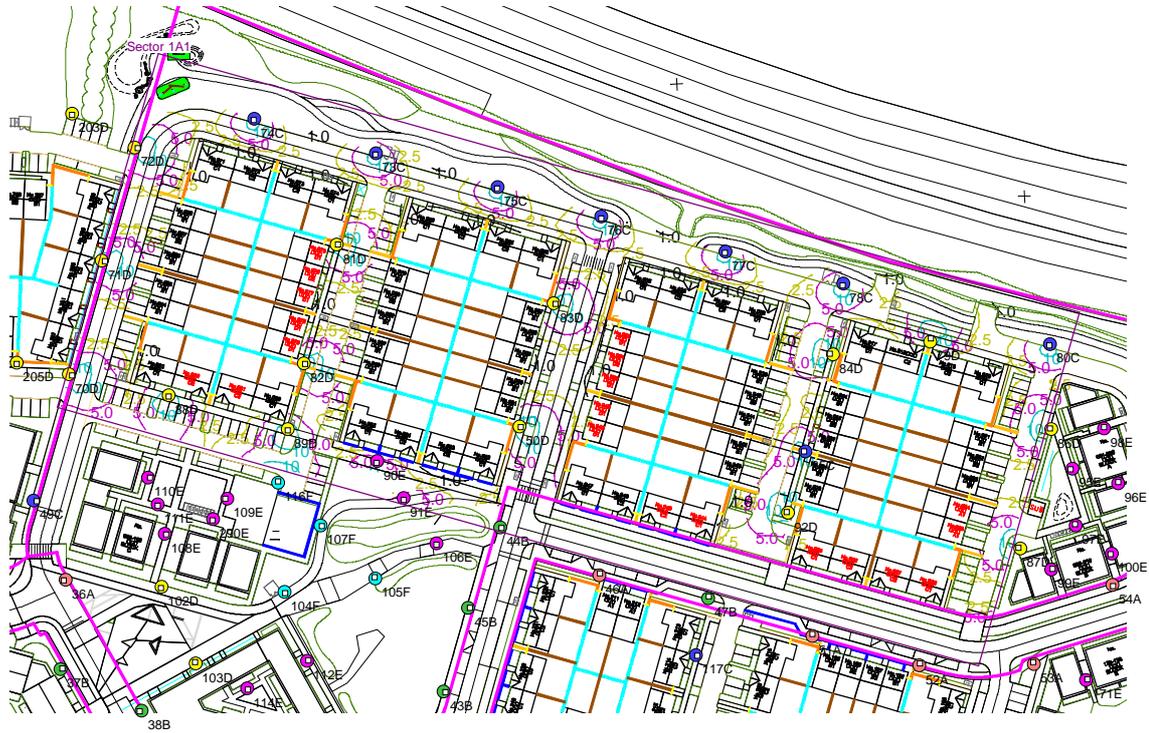


## Results

Eav	4.60
Emin	0.98
Emax	14.95
Emin/Emax	0.07
Emin/Eav	0.21

# Horizontal Illuminance (lux)

Sector 1A2

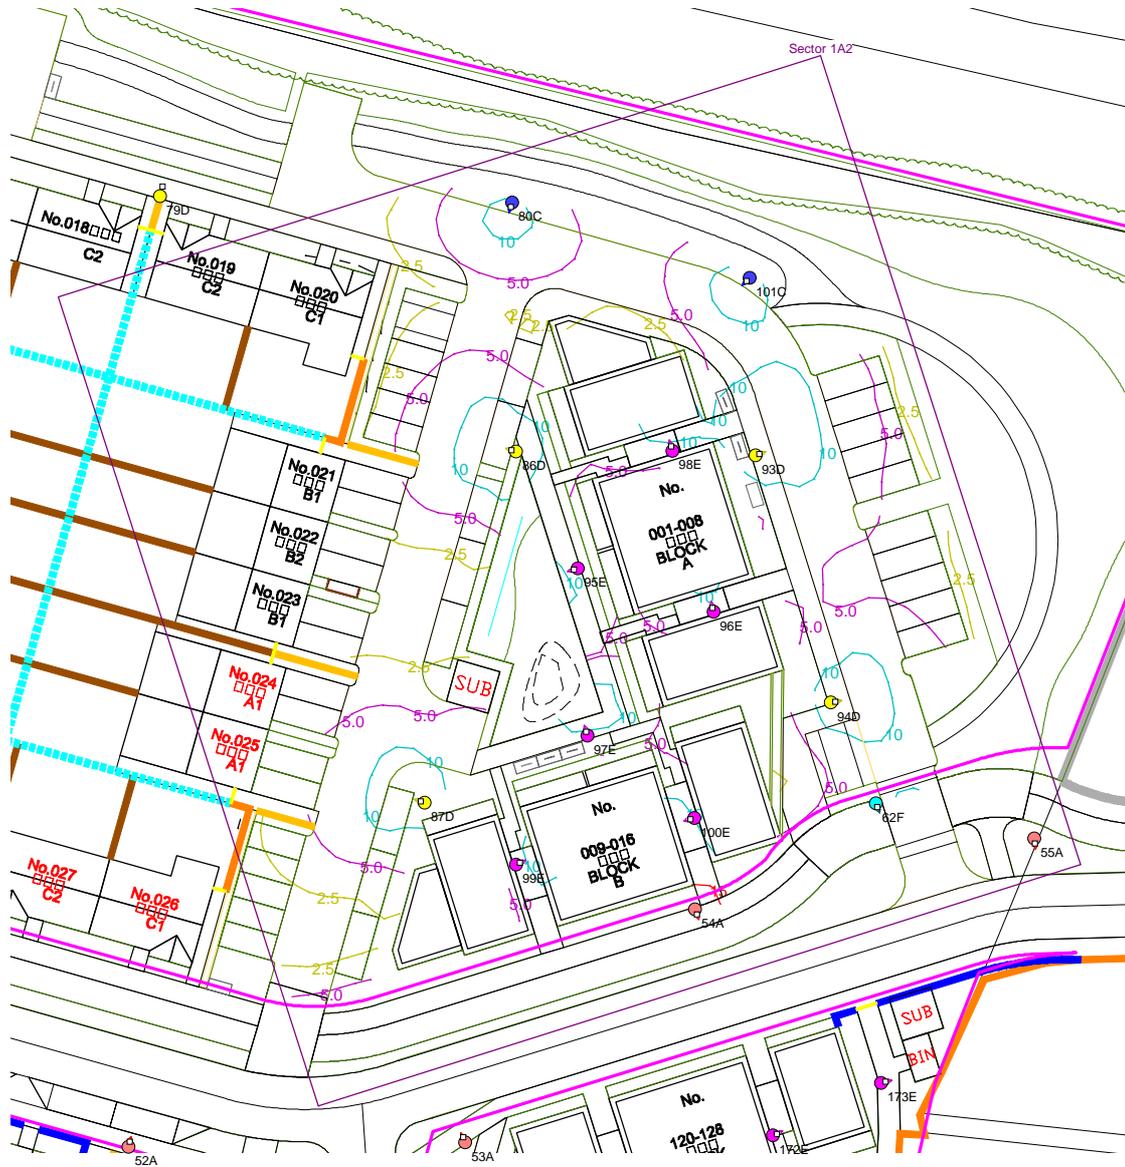


## Results

Eav	6.20
Emin	1.36
Emax	15.37
Emin/Emax	0.09
Emin/Eav	0.22

# Horizontal Illuminance (lux)

Sector 1A3

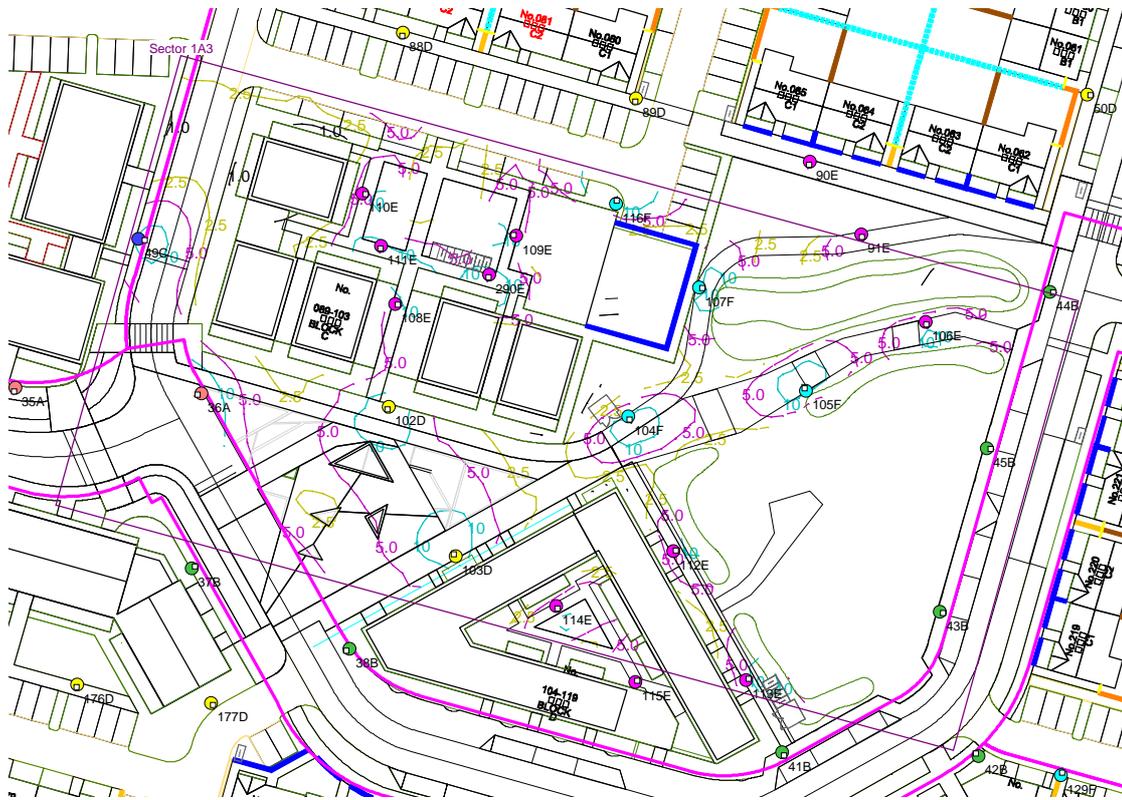


## Results

Eav	5.53
Emin	1.08
Emax	14.84
Emin/Emax	0.07
Emin/Eav	0.20

## Horizontal Illuminance (lux)

Sector 1A4

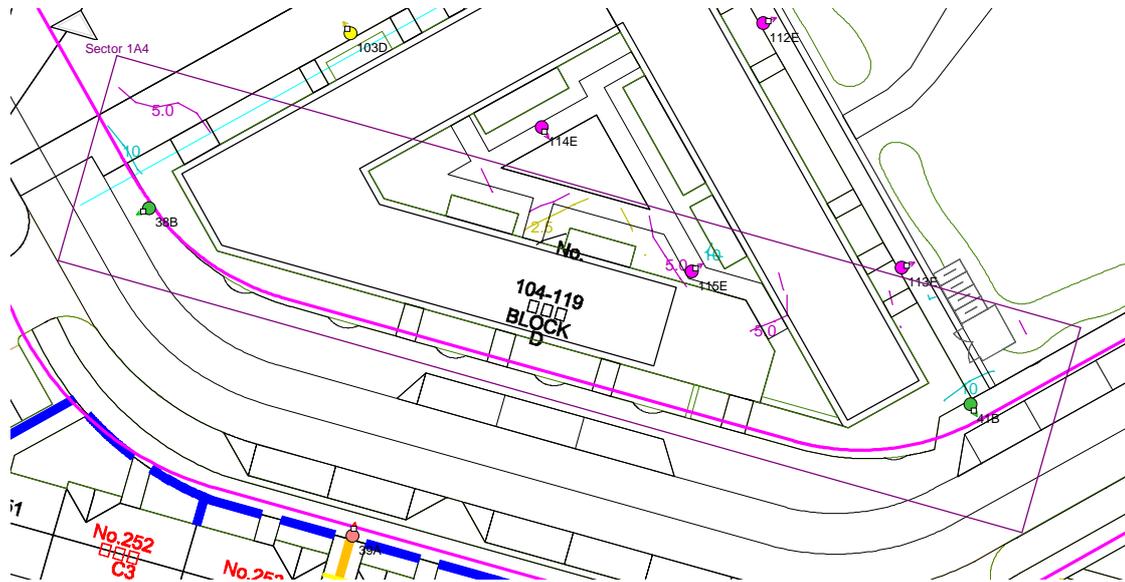


### Results

Eav	6.73
Emin	1.27
Emax	10.36
Emin/Emax	0.12
Emin/Eav	0.19

# Horizontal Illuminance (lux)

Sector 1B1

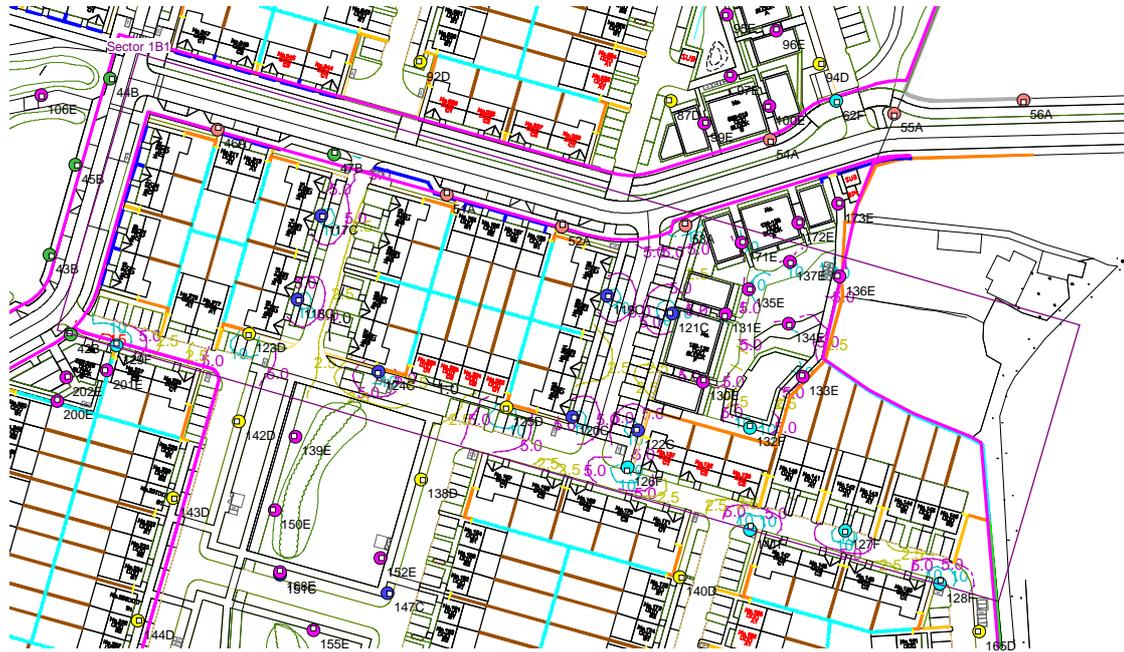


## Results

Eav	5.52
Emin	1.10
Emax	16.16
Emin/Emax	0.07
Emin/Eav	0.20

# Horizontal Illuminance (lux)

Sector 1B2

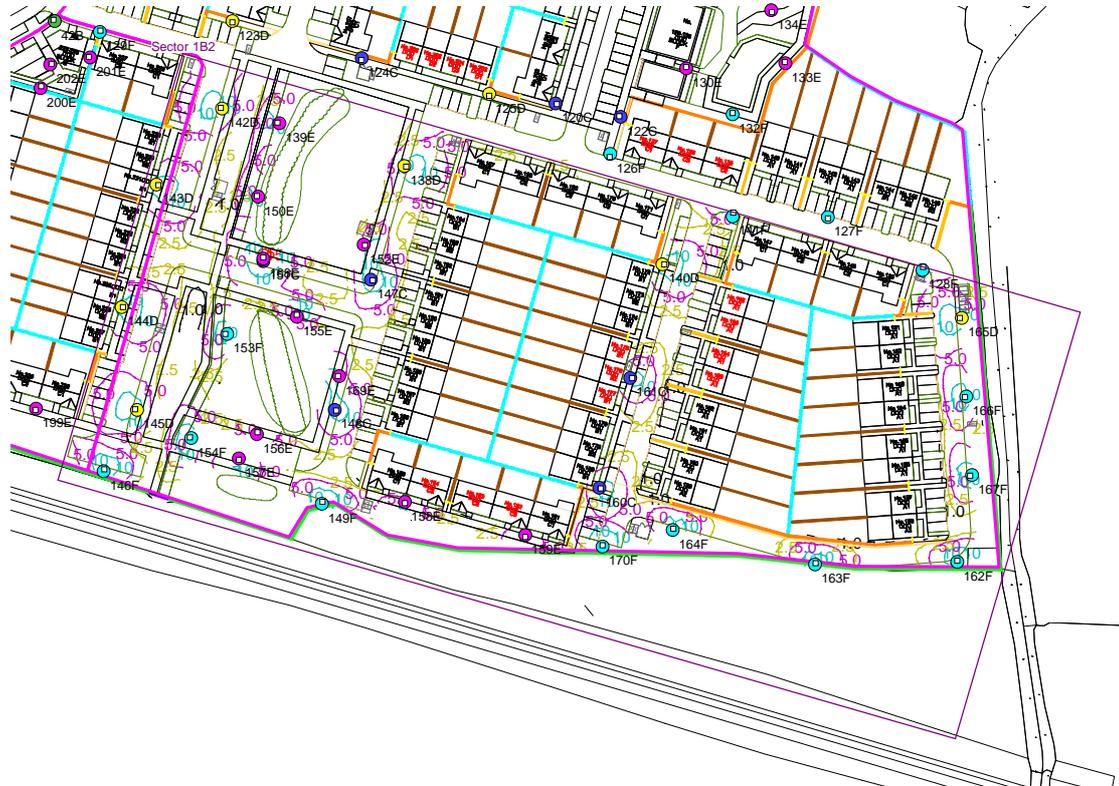


## Results

Eav	5.26
Emin	1.07
Emax	15.90
Emin/Emax	0.07
Emin/Eav	0.20

## Horizontal Illuminance (lux)

Sector 1B3

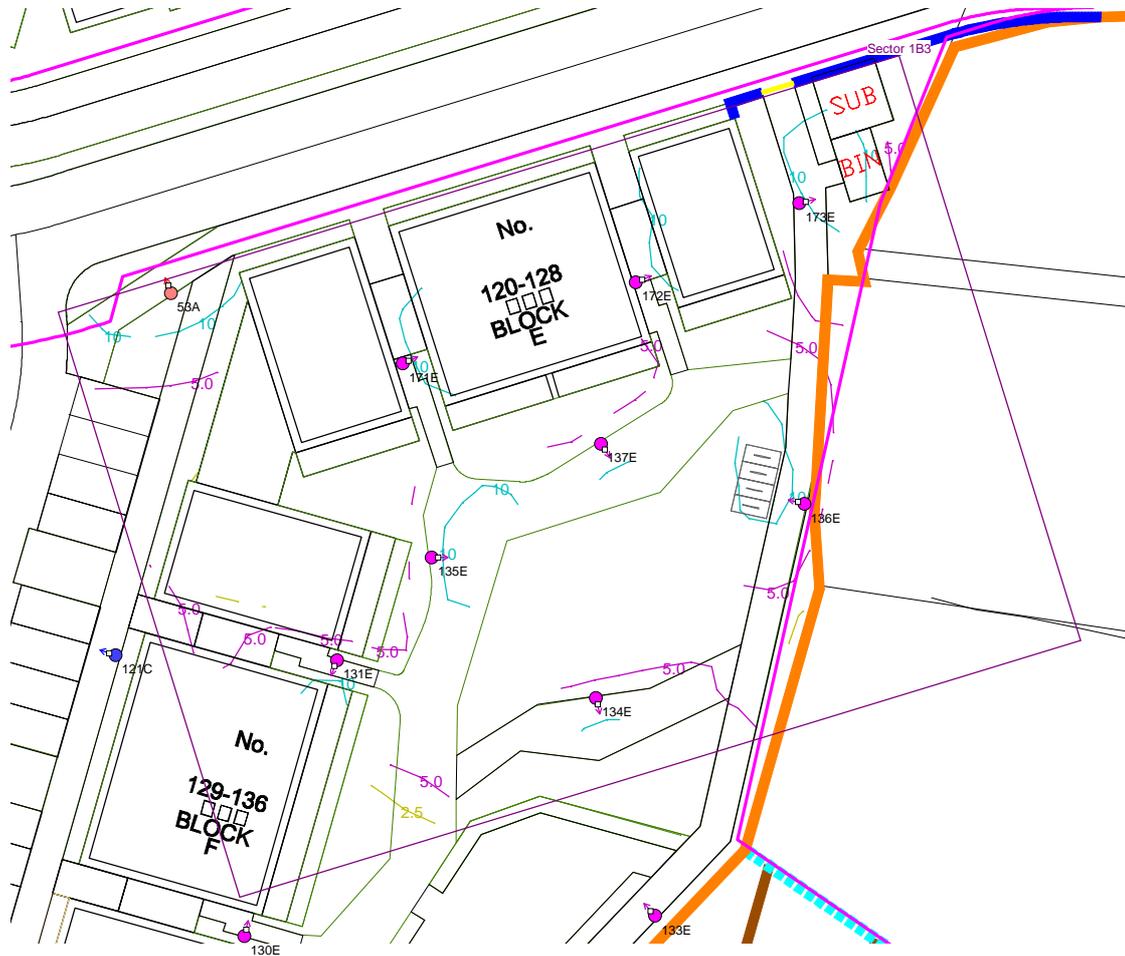


### Results

Eav	7.36
Emin	2.48
Emax	12.79
Emin/Emax	0.19
Emin/Eav	0.34

# Horizontal Illuminance (lux)

Sector 2A1

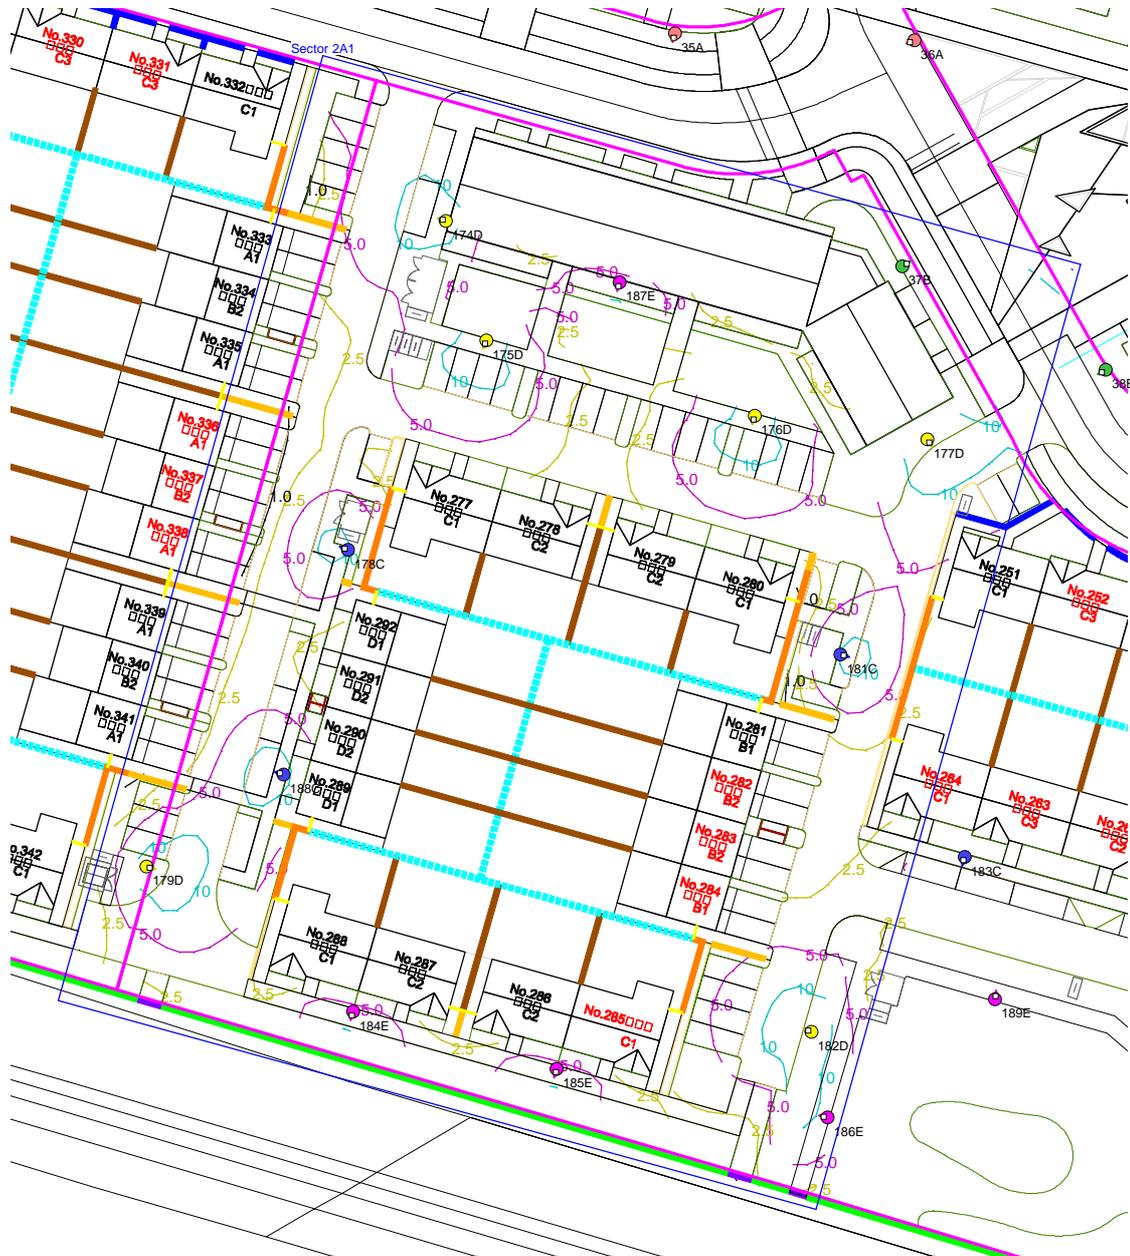


## Results

Eav	5.50
Emin	1.26
Emax	13.84
Emin/Emax	0.09
Emin/Eav	0.23

# Horizontal Illuminance (lux)

Sector 2A2

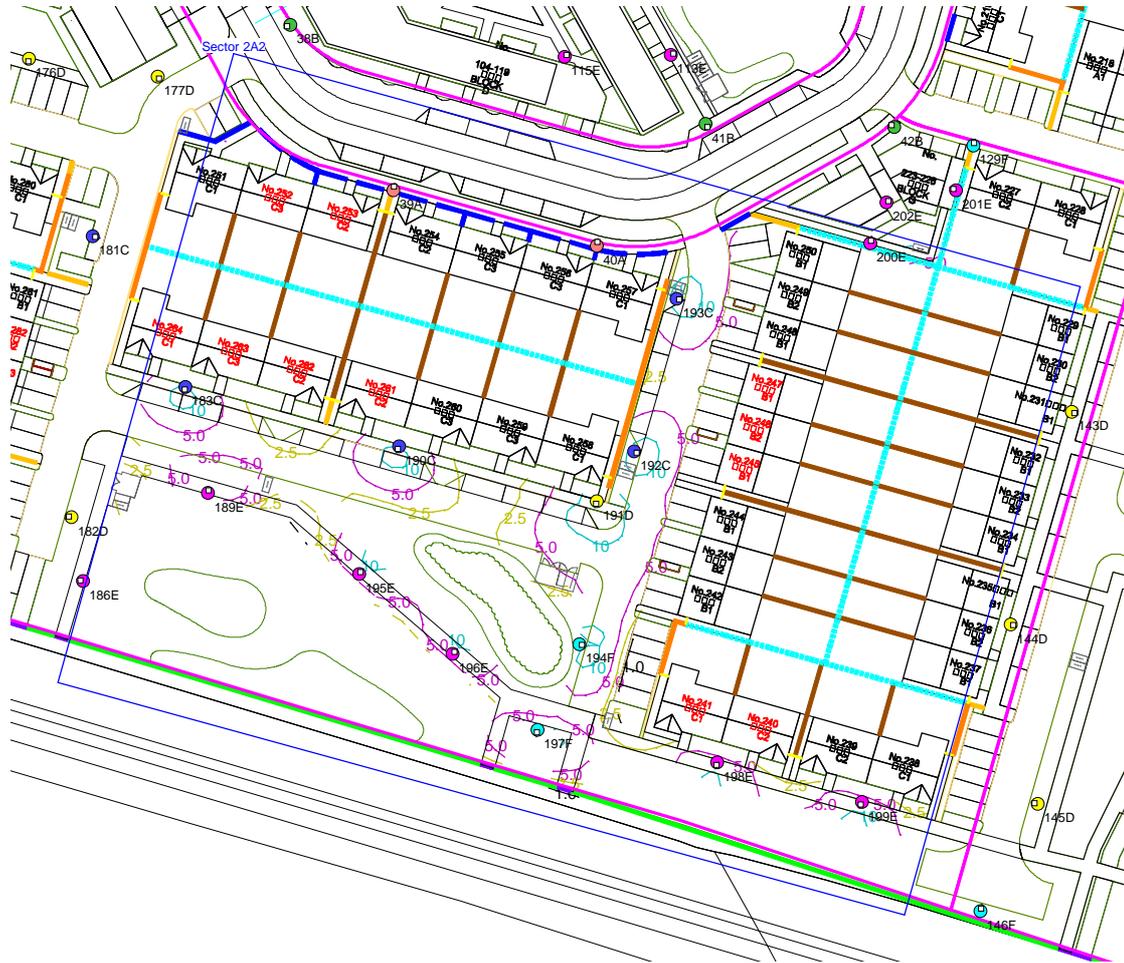


## Results

Eav	5.52
Emin	1.39
Emax	13.85
Emin/Emax	0.10
Emin/Eav	0.25

# Horizontal Illuminance (lux)

Sector 2A3

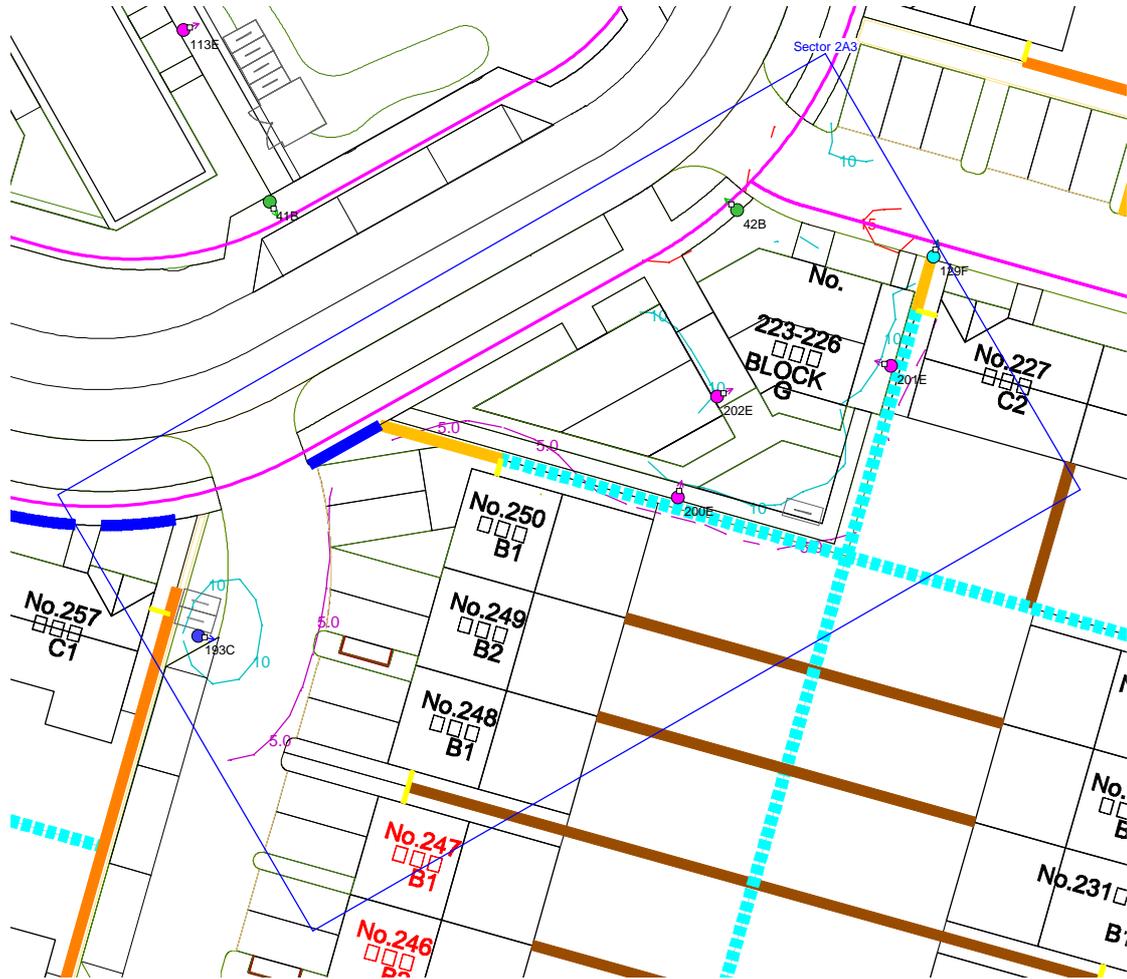


## Results

Eav	9.22
Emin	3.85
E <sub>max</sub>	16.15
E <sub>min</sub> /E <sub>max</sub>	0.24
E <sub>min</sub> /E <sub>av</sub>	0.42

# Horizontal Illuminance (lux)

Sector 2B1

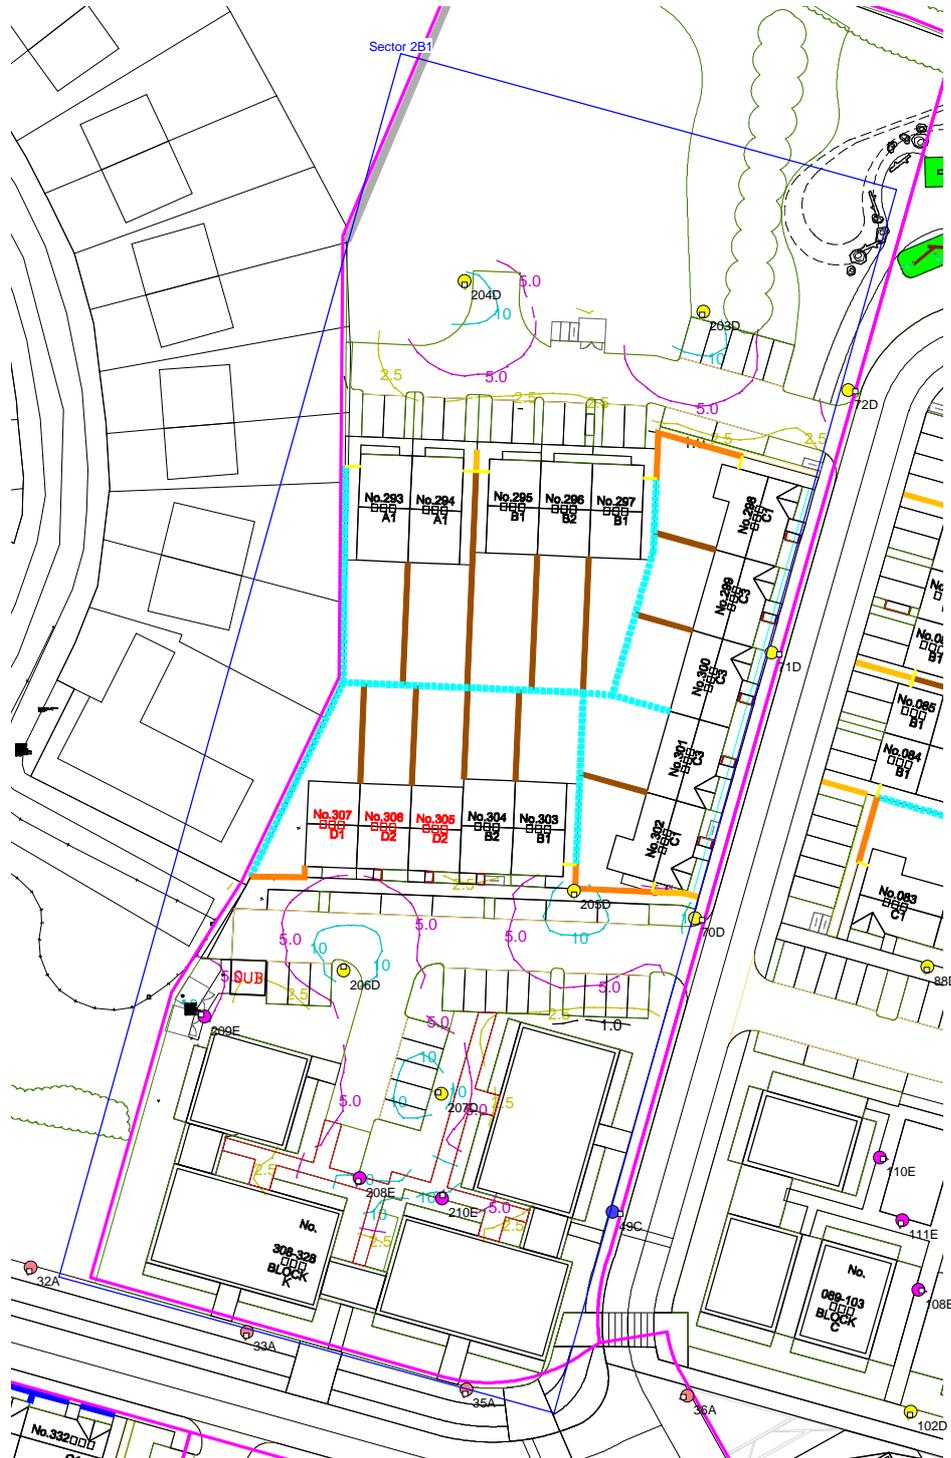

## Results

Eav	5.81
Emin	1.27
Emax	13.24
Emin/Emax	0.10
Emin/Eav	0.22

# Horizontal Illuminance (lux)

Sector 2B2




## Results

Eav	6.87
Emin	1.47
Emax	14.22
Emin/Emax	0.10
Emin/Eav	0.21



# Horizontal Illuminance (lux)

Sector 3B

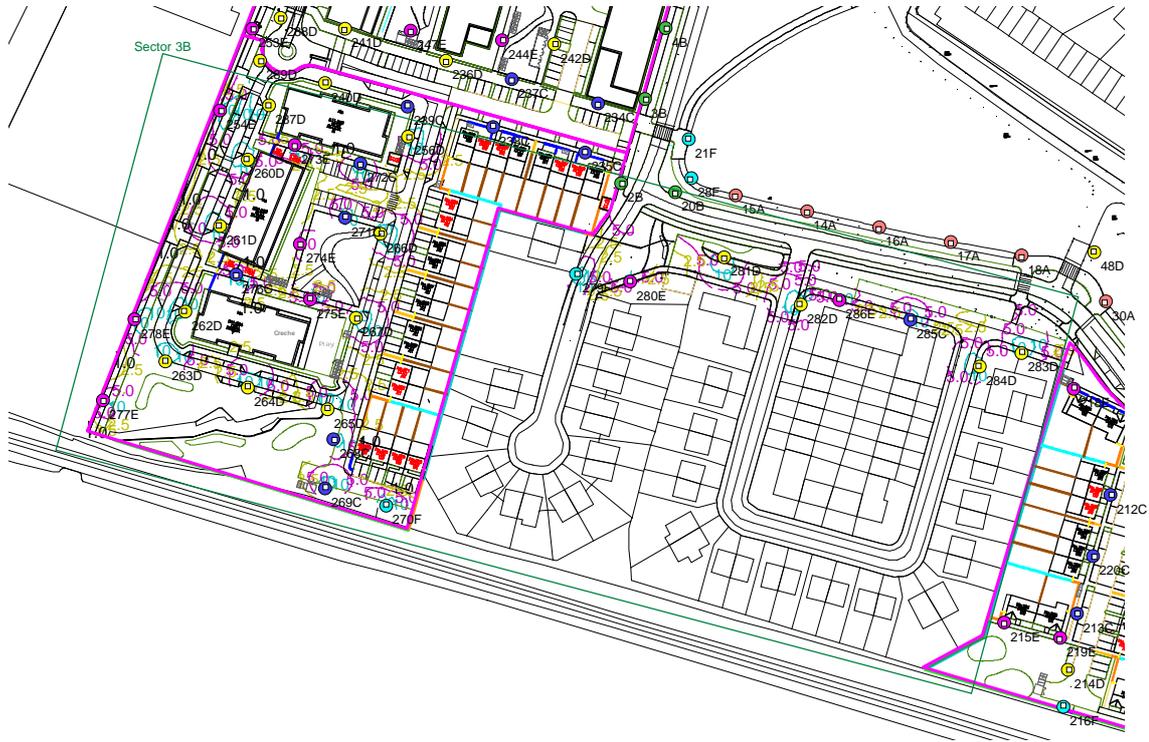


## Results

Eav	5.51
Emin	1.14
Emax	14.82
Emin/Emax	0.08
Emin/Eav	0.21

## Horizontal Illuminance (lux)

### Sector 3 Roundabout

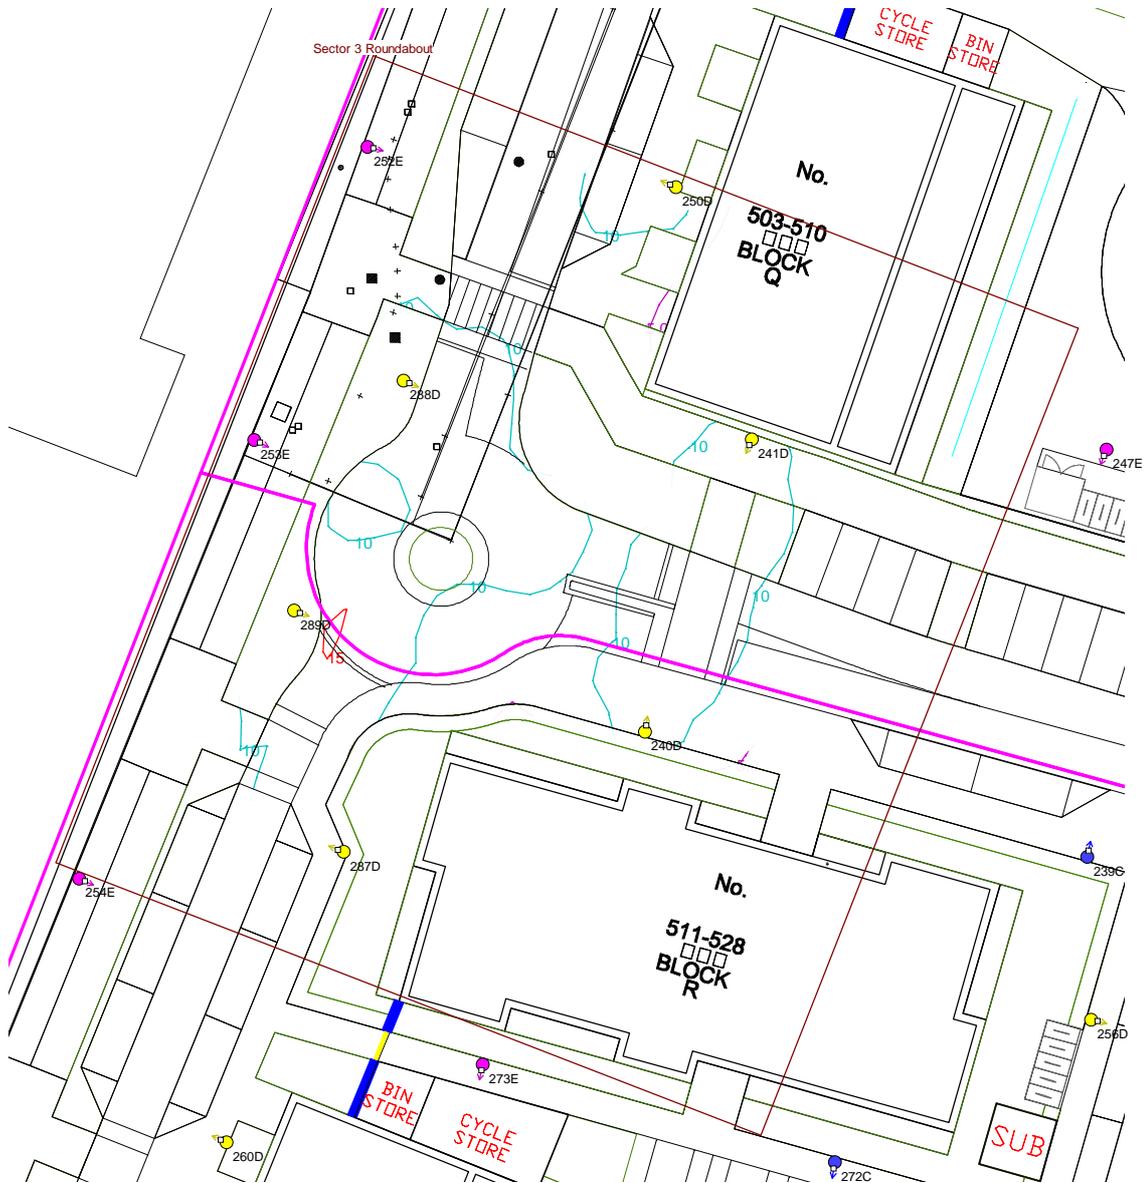


### Results

Eav	9.89
Emin	4.34
E <sub>max</sub>	15.31
E <sub>min</sub> /E <sub>max</sub>	0.28
E <sub>min</sub> /E <sub>av</sub>	0.44

# Horizontal Illuminance (lux)

## Crossing Assessment

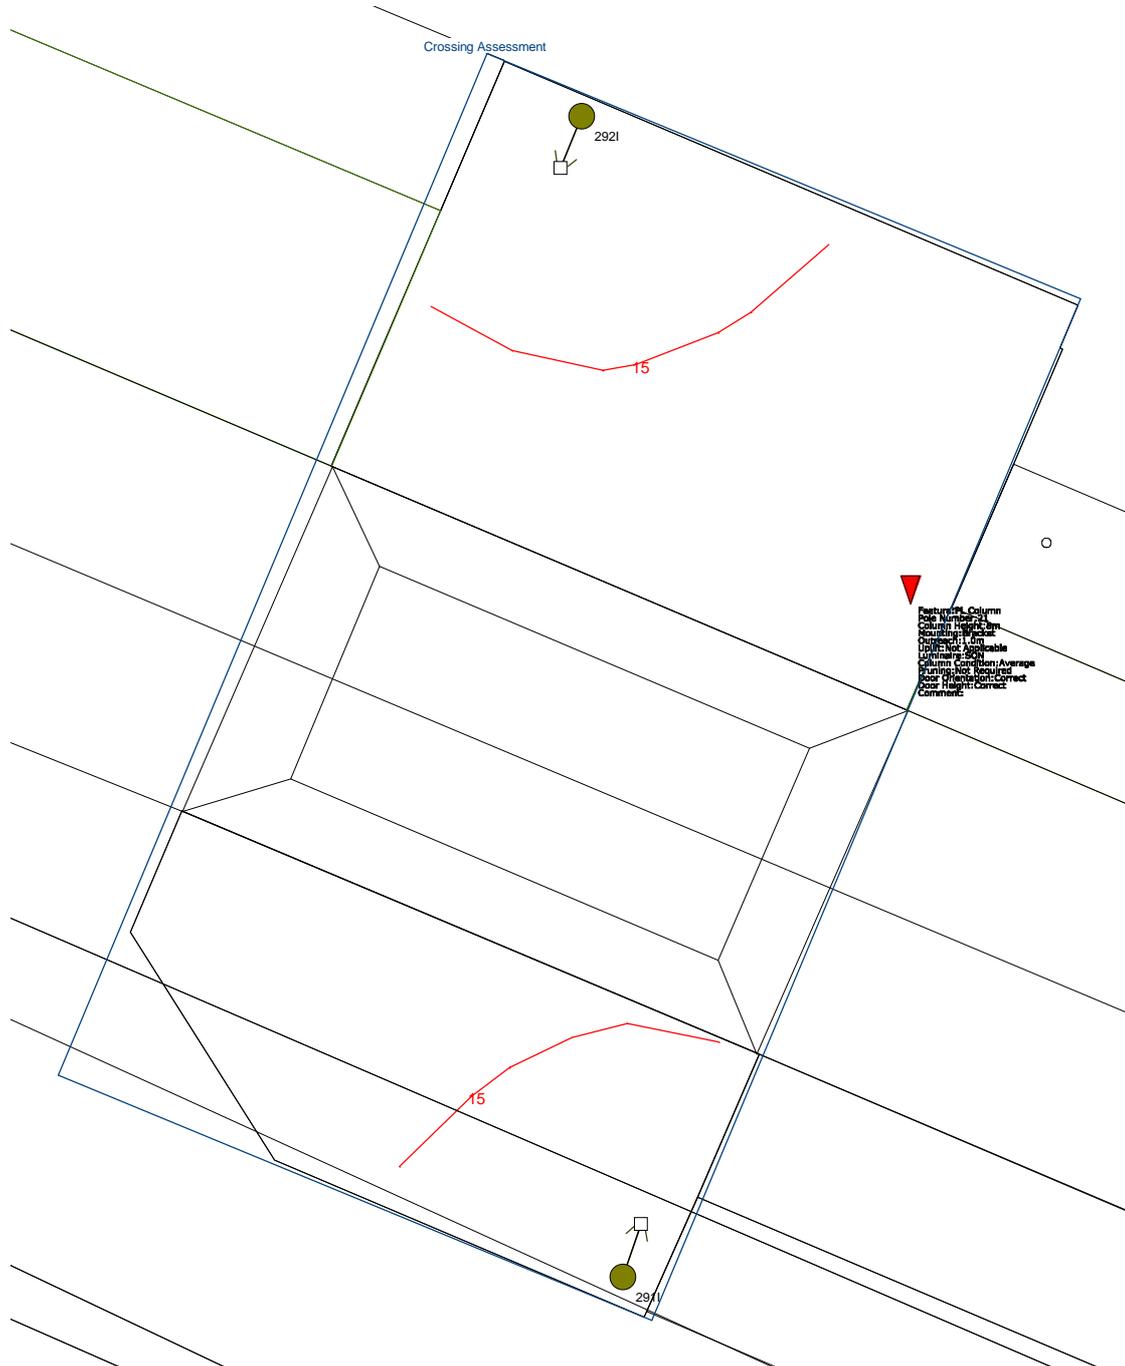

Pole No: 2921  
 Pole Height: 12m  
 Pole Diameter: 0.15m  
 Pole Orientation: 0  
 Pole Height: Correct  
 Pole Orientation: Correct  
 Comment:

### Results

Eav	13.12
Emin	10.06
Emax	18.03
Emin/Emax	0.56
Emin/Eav	0.77

**DATE:** 9 February 2021  
**DESIGNER:** Patrick Redmond  
**PROJECT No:** 20043  
**PROJECT NAME:** Brawny & Garrycastle roundabouts



We have made certain assumptions regarding the photometric performance of the existing lighting on both roundabouts. Brawny roundabout appears to have been designed in line with historical equivalents of C3, and Garrycastle roundabout with C2.

Lighting on the crossing points and the Garrycastle approach has been designed to comply with I.S. EN 13201-2:2015 C3 after dimming.

Energy consumption assessed in accordance with I.S. EN 13201-5:2015.

LMF 0.92 x LDF 0.9 x LSF 1 = MF 0.83 at 100,000 hours with 25 degree ambient. Photometry measured at minimum 15 degree ambient.

See associated documentation for information on energy

## Lighting Level ~ Dimmed U14 & U15

**PREPARED BY:** Patrick Redmond Hdip BUS, EngTech AMILP, AMSLL, Tech IEI  
Redmond Analytical Management Services Ltd.  
M~ 086 2356356  
O~ 053 9383696  
patrick@redmondams.ie  
Rosewood House, Mount Seaton, Camolin,  
Enniscorthy, Co. Wexford. Y21 K8P3  
www.redmondams.ie  
Document control: TD 01 Version: 1.0

## Layout Report

### General Data

Dimensions in Metres Angles in Degrees

### Calculation Grids

ID	Grid Name	X	Y	X' Length	Y' Length	X' Spacing	Y' Spacing
1	Brawny Roundabout	663.12	772.04	162.23	119.17	1.49	1.49
2	Garrycastle Roundabout	2360.49	3.52	110.32	135.62	1.49	1.49
3	Garrycastle Approach	2285.75	71.52	76.06	37.14	1.49	1.49
4	Crossing Assessment 1	820.79	777.51	6.20	17.86	1.24	1.49
5	Crossing Assessment 2	2164.87	279.38	13.02	14.90	1.45	1.49

### Luminaires

#### Luminaire A Data



Supplier	Philips
Type	BGP292 DX10
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	9.50
File Name	LumiStreet Gen2 Mini_BGP292_DX10_9500_40LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	513.2, 85.3, 0.0
No. in Project	1

#### Luminaire B Data



Supplier	Philips
Type	BGP292 DW52
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	9.00
File Name	LumiStreet Gen2 Mini_BGP292_DW52_9000_40LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	639.6, 45.2, 0.0
No. in Project	7

#### Luminaire F Data



Supplier	Philips
Type	BGP291 DN11
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	2.40
File Name	LumiStreet Gen2 Micro_BGP291_DN11_2400_10LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	595.8, 72.9, 0.0
No. in Project	1

#### Luminaire G Data



Supplier	Philips
Type	BGP292 DX70
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	11.00
File Name	LumiStreet Gen2 Mini_BGP292_DX70_11000_40LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	325.1, 353.8, 0.0
No. in Project	1

#### Luminaire H Data



Supplier	Philips
Type	BGP291 DM11
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	4.00
File Name	LumiStreet Gen2 Micro_BGP291_DM11_4000_20LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	555.3, 96.2, 0.0
No. in Project	1

#### Luminaire I Data



Supplier	Philips
Type	BGP292 DX70
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	12.50
File Name	LumiStreet Gen2 Mini_BGP292_DX70_12500_40LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	325.1, 353.8, 0.0
No. in Project	3

## Luminaires



### Luminaire J Data

Supplier	_Historic Lanterns
Type	ZX3/Clear_P/1289/103/-39/922301
Lamp(s)	150W-SONT+
Lamp Flux (klm)	18.00
File Name	ZX3_Clear Poly_1289_SON-T+_150_103#-39_922301TX.ltd
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	545.9, 77.6, 38.8
No. in Project	11



### Luminaire K Data


Supplier	_Historic Lanterns
Type	ZX3/FG/1289/115/-45/892242
Lamp(s)	250W-SONT+
Lamp Flux (klm)	33.20
File Name	ZX3_Flat Glass_1289_SON-T+_250_115#-45_892242TY.ltd
Maintenance Factor	0.83
Imax70,80,90(cd/klm)	389.0, 25.0, 0.0
No. in Project	11

**Layout**

ID	Type	X	Y	Height	Angle	Tilt	Cant	Out-reach	Dimmed to	Target X	Target Y	Target Z
1	G	849.19	786.40	8.00	261.00	0.00	0.00	0.50	66%			
2	H	849.22	786.61	8.00	79.00	0.00	0.00	0.40	66%			
3	A	2290.83	87.40	8.00	68.00	0.00	0.00	0.50	75%			
4	B	2343.15	81.21	8.00	90.00	0.00	0.00	0.50	75%			
5	K	2428.88	138.81	10.00	204.00	5.00	0.00	1.30	100%			
6	K	2444.48	104.06	10.00	197.00	5.00	0.00	1.30	100%			
7	K	2451.84	89.63	10.00	226.00	5.00	0.00	1.30	100%			
8	K	2467.36	59.56	10.00	97.00	5.00	0.00	1.30	100%			
9	K	2450.29	53.13	10.00	142.00	5.00	0.00	1.30	100%			
10	K	2454.27	11.42	10.00	204.00	5.00	0.00	1.30	100%			
11	K	2427.42	37.14	10.00	10.00	5.00	0.00	1.30	100%			
12	K	2418.39	57.91	10.00	40.00	5.00	0.00	1.30	100%			
13	K	2418.17	94.43	10.00	320.00	5.00	0.00	1.30	100%			
14	K	2402.79	89.91	10.00	267.00	5.00	0.00	1.30	100%			
15	K	2360.73	92.61	10.00	272.00	5.00	0.00	1.30	100%			
16	B	2343.16	80.99	8.00	270.00	0.00	0.00	0.50	75%			
17	B	2312.21	82.55	8.00	84.00	0.00	0.00	0.50	75%			
18	B	2312.21	82.32	8.00	265.00	0.00	0.00	0.50	75%			
19	J	772.75	859.25	10.00	292.00	5.00	0.00	2.50	100%			
20	J	738.43	849.00	10.00	277.00	5.00	0.00	2.50	100%			
21	J	700.15	849.64	10.00	43.00	5.00	0.00	2.50	100%			
22	J	811.06	861.93	10.00	128.00	5.00	0.00	2.50	100%			
23	J	767.24	823.06	10.00	180.00	5.00	0.00	2.50	100%			
24	J	691.18	787.80	10.00	106.00	5.00	0.00	2.50	100%			
25	J	715.71	793.23	10.00	96.00	5.00	0.00	2.50	100%			
26	J	745.93	793.57	10.00	101.00	5.00	0.00	2.50	100%			
Relocate 27	J	767.47	788.15	10.00	62.00	5.00	0.00	2.50	100%			
Relocate 28	J	811.57	777.67	10.00	91.00	5.00	0.00	2.50	100%			
Relocate 29	J	709.41	822.58	10.00	354.00	5.00	0.00	2.50	100%			
30	I	826.78	794.30	8.00	259.00	0.00	0.00	0.50	75%			
31	B	2177.26	285.94	8.00	222.00	0.00	0.00	0.50	75%			
32	B	2185.98	257.38	8.00	43.00	0.00	0.00	0.50	75%			
33	B	2147.92	300.33	8.00	262.00	0.00	0.00	0.50	75%			
34	I	2173.19	271.19	8.00	37.00	0.00	0.00	0.50	75%			
35	F	2290.70	87.19	8.00	241.00	0.00	0.00	0.50	75%			
36	I	824.30	777.34	8.00	76.00	0.00	0.00	0.50	75%			

# Horizontal Illuminance (lux)

## Brawny Roundabout

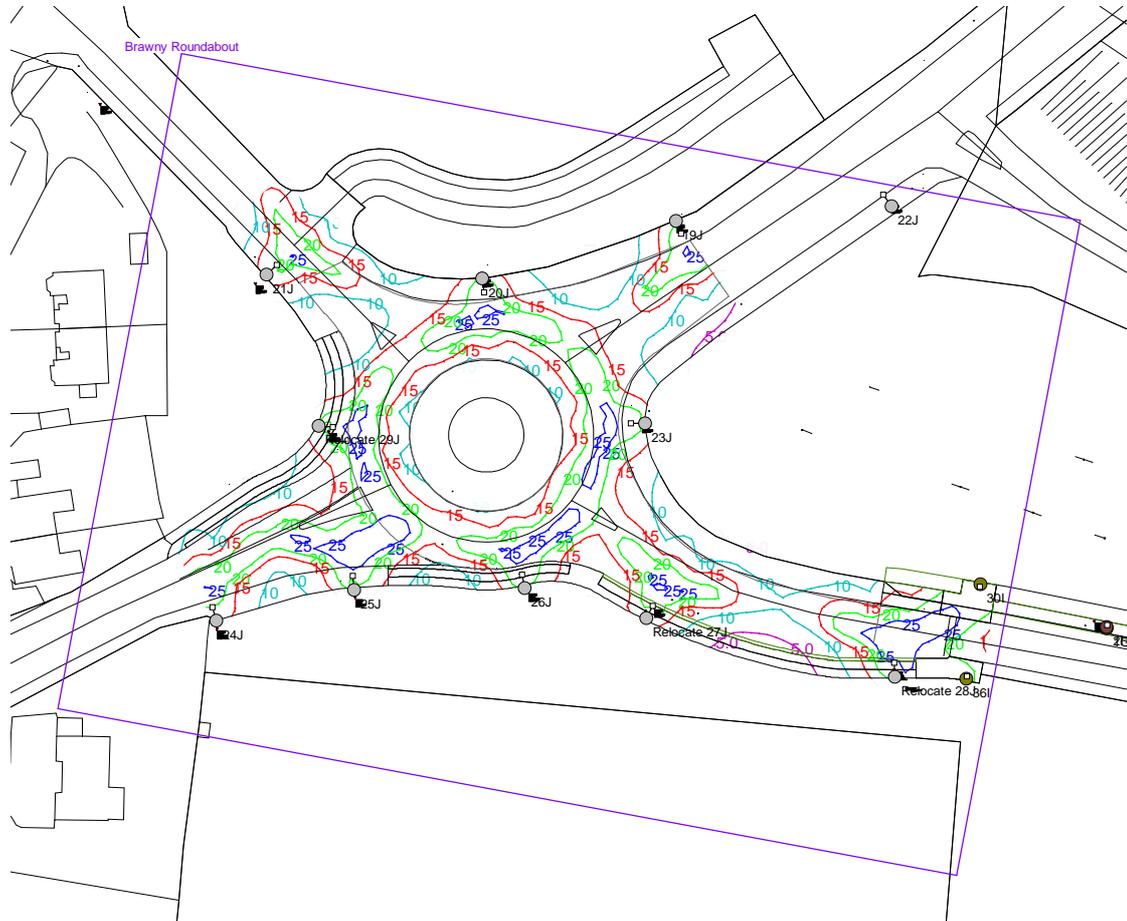


### Results

Eav	15.52
Emin	3.04
E <sub>max</sub>	31.58
E <sub>min</sub> /E <sub>max</sub>	0.10
E <sub>min</sub> /E <sub>av</sub>	0.20

# Horizontal Illuminance (lux)

## Garrycastle Roundabout

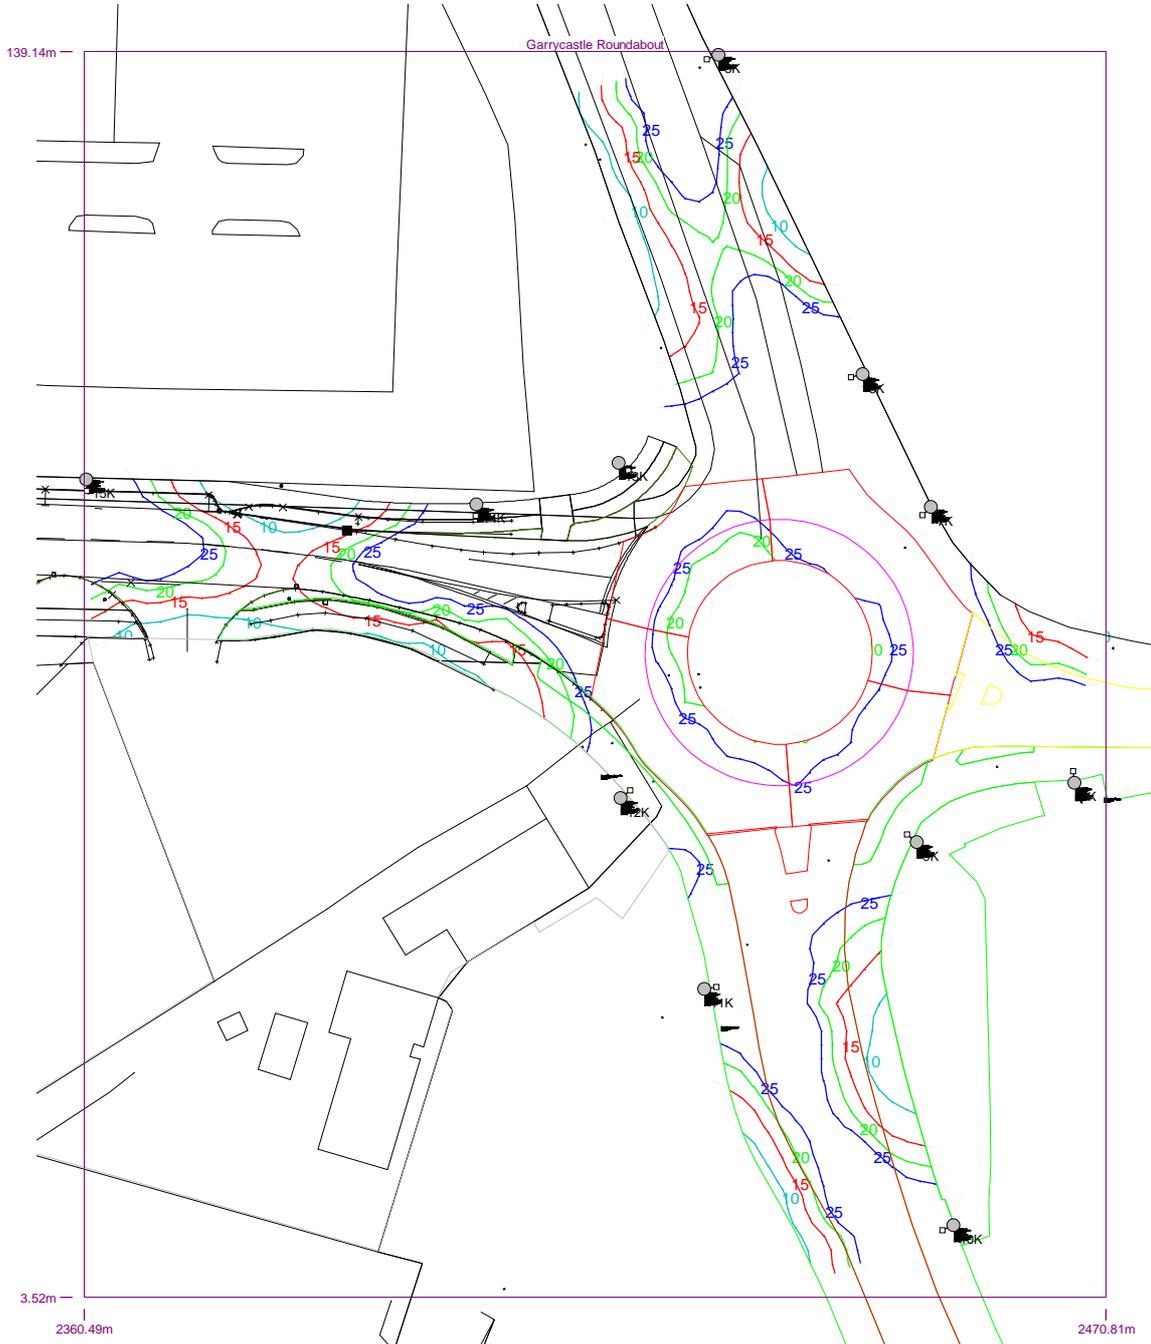


### Results

Eav	31.35
Emin	5.91
Emax	66.78
Emin/Emax	0.09
Emin/Eav	0.19

# Horizontal Illuminance (lux)

## Garrycastle Approach

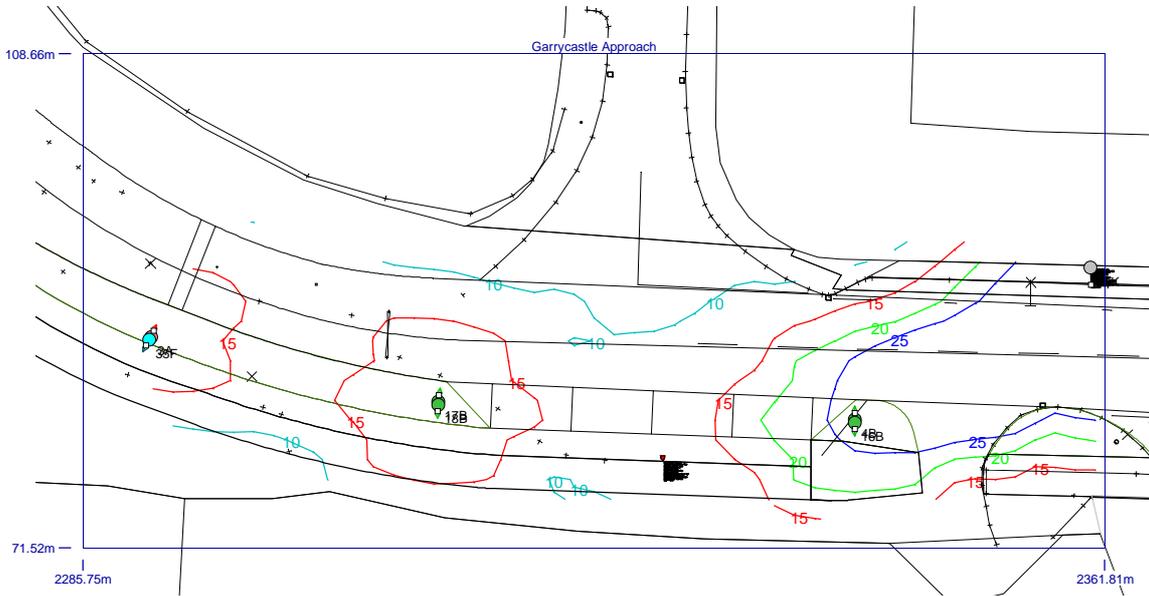


### Results

Eav	18.38
Emin	8.73
E <sub>max</sub>	57.14
E <sub>min</sub> /E <sub>max</sub>	0.15
E <sub>min</sub> /E <sub>av</sub>	0.47

# Horizontal Illuminance (lux)

## Crossing Assessment 1

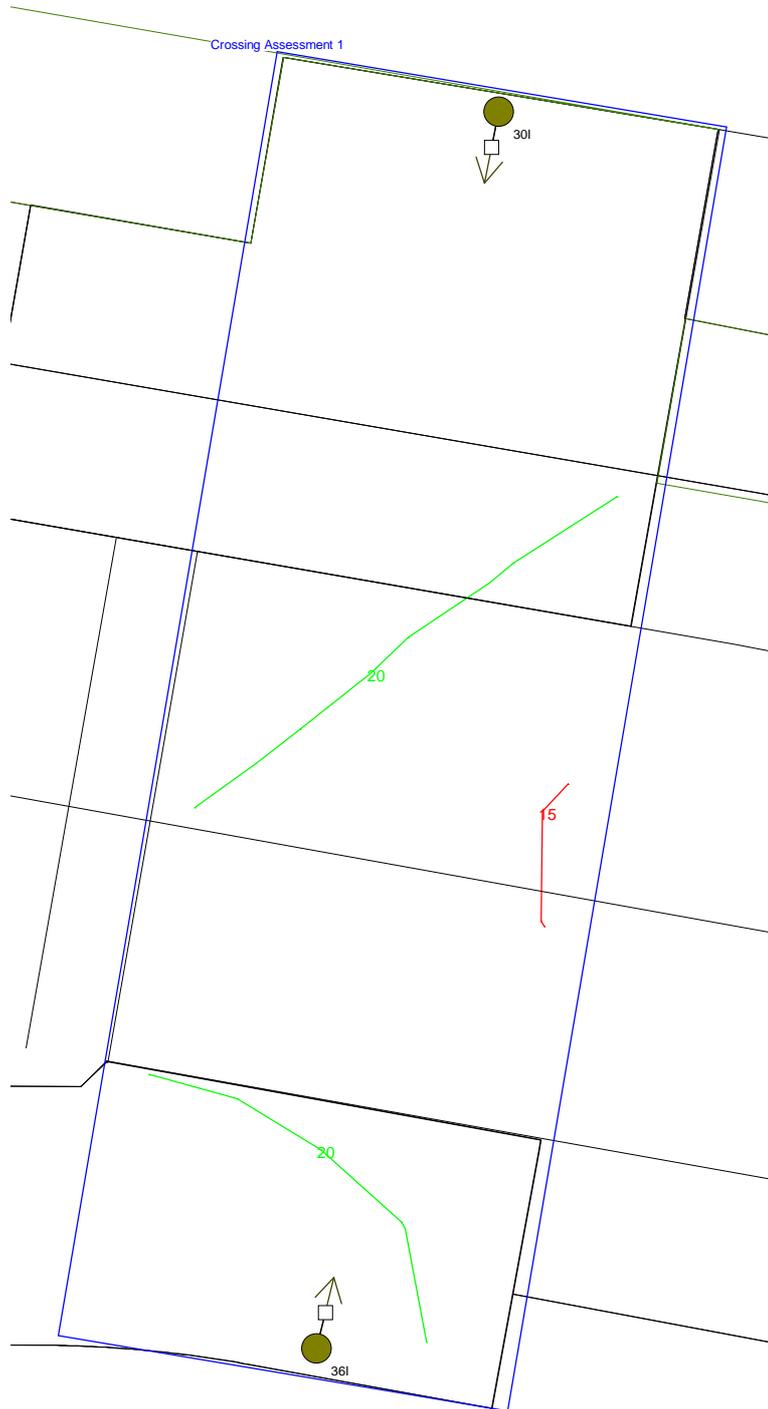


### Results

Eav	20.39
Emin	14.71
E <sub>max</sub>	24.85
E <sub>min</sub> /E <sub>max</sub>	0.59
E <sub>min</sub> /E <sub>av</sub>	0.72

# Horizontal Illuminance (lux)

## Crossing Assessment 2

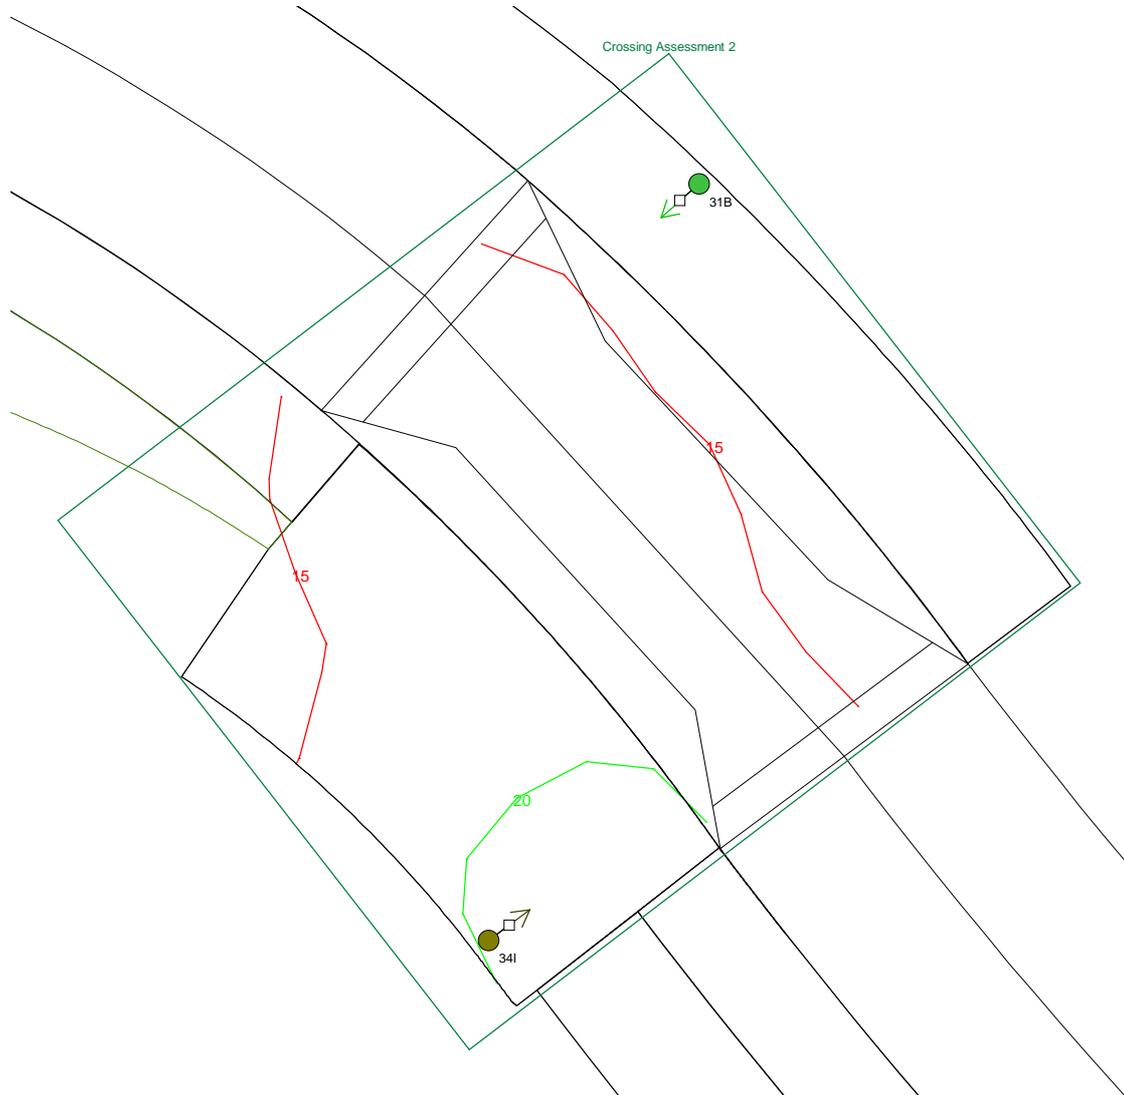

### Results

Eav	15.65
Emin	10.69
Emax	21.32
Emin/Emax	0.50
Emin/Eav	0.68

**DATE:** 7 December 2020  
**DESIGNER:** Patrick Redmond  
**PROJECT No:** 20043  
**PROJECT NAME:** SHD ~ Lissywollen, Athlone



Product selected based on lowest energy consumption whilst achieving compliance with I.S. EN 13201-2:2015 C4 on the main spine road. Energy consumption assessed in accordance with I.S. EN 13201-5:2015.

LMF 0.92 x LDF 0.9 x LSF 1 = MF 0.83 at 100,000 hours with 25 degree ambient. Photometry measured at minimum 15 degree ambient.


Of the comparable products assessed, the Philips luminaire offers the lowest energy consumption. Product specification may vary with detailed design.

## **Product Selection**

**PREPARED BY:** Patrick Redmond Hdip BUS, EngTech AMILP, AMSLL, Tech IEI  
Redmond Analytical Management Services Ltd.  
M~ 086 2356356  
O~ 053 9383696  
patrick@redmondams.ie  
Rosewood House, Mount Seaton, Camolin,  
Enniscorthy, Co. Wexford. Y21 K8P3  
www.redmondams.ie  
Document control: TD 01 Version: 1.0

## Roadway Report Summary

### Layout

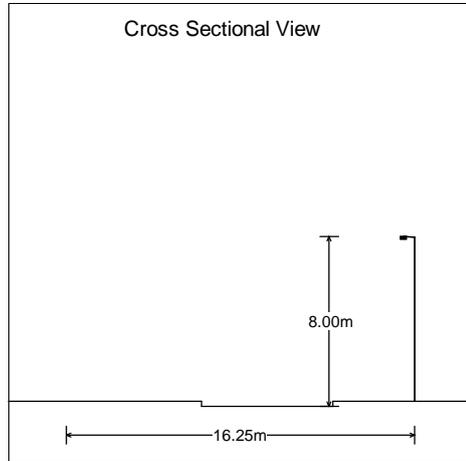

### Road Data

Calculation Grid	2015:EN13201 Illuminance
Width (m)	16.25
No. of Lanes	2
Road Surface	C2
Q0	0.07
Left Footpath(m)	6.30
Right Footpath(m)	3.80

### Main Lighting



### Column Data

Configuration	Single Sided Right
Spacing (m)	34.00
Height (m)	8.00
Tilt (deg)	5.00
Setback (m)	3.80
Outreach (m)	0.50
Overhang (m)	-3.30

### Luminaire Data


Supplier	Philips
Type	BGP292 DM33
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	9.50
File Name	LumiStreet Gen2 Mini_BGP292_DM33_9500_40LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Lum. Int. Class	G3

### Results


#### Main

Complies with C4

Eav	10.02
Emin	4.10
Emax	27.19
Emin/Emax	0.15
Emin/Eav	0.41
TI(%)	10.30

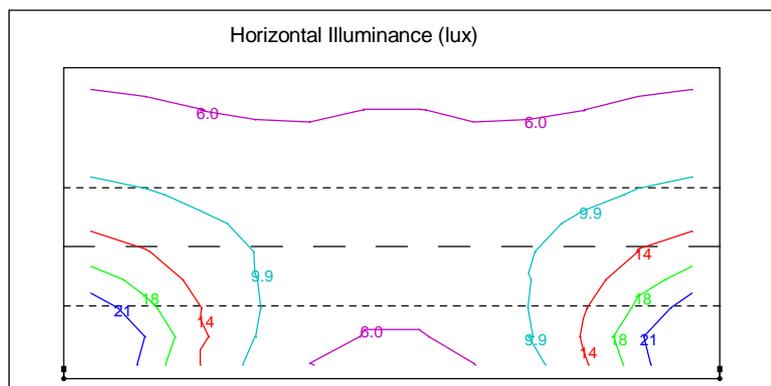


## Energy performance indicators

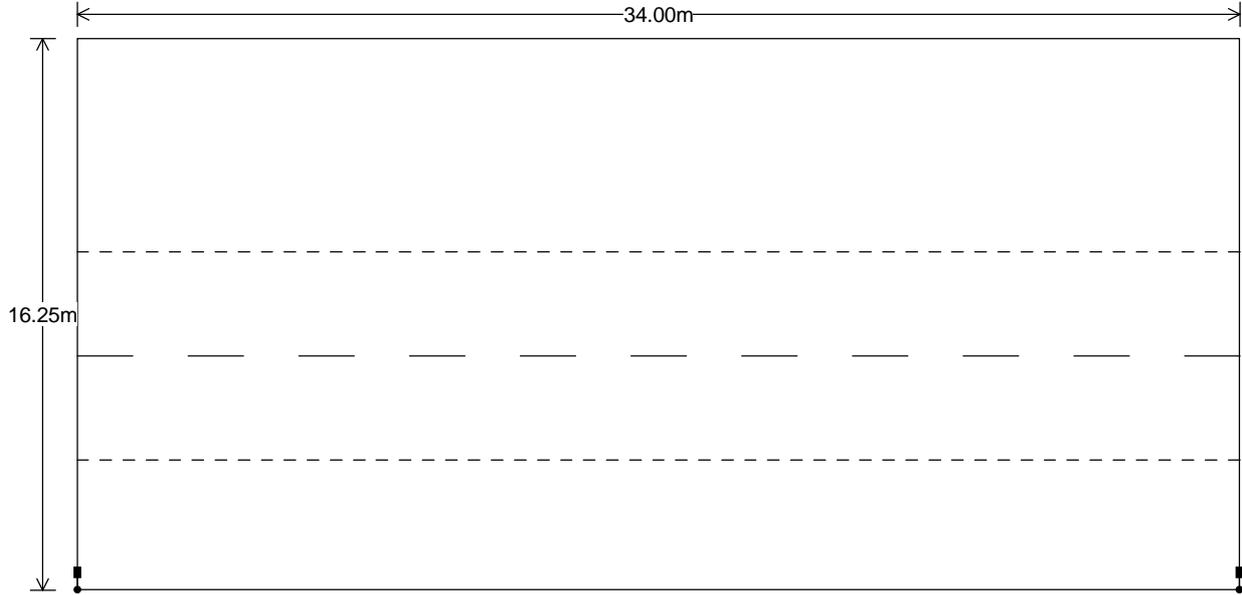

Power Main Luminaire(W)	53.00
Parasitic Power(W)	0.00
Area(m <sup>2</sup> )	552
Hours per Year	4100
Power Density(mW/lx/m <sup>2</sup> )	9.58
AECI(kWh/m <sup>2</sup> )	0.39

## Horizontal Illuminance (lux)

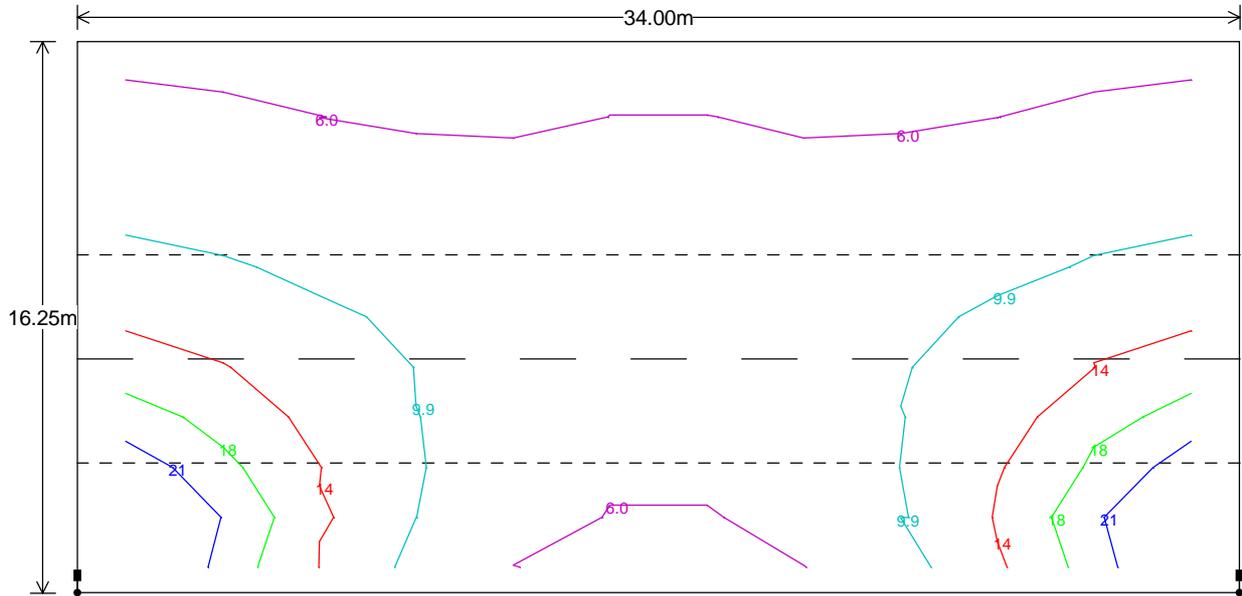

### Main Results

Eav	10.02
Emin	4.10
Emax	27.19
Emin/Emax	0.15
Emin/Eav	0.41
TI(%)	10.30

## Comparison Table

EN13201 Class: C4    Calculation Grid: 2015:EN13201 Illuminance    Road Surface: C2    Q0: 0.07    No. of Lanes: 2    Total Width: 16.25  
Configuration: Single Sided Right

No.	Luminaire	Lamp	Flux	MF	Spacing	Overhang	Height	Tilt	Eav	Emin	Emax	Emin/Emax	Emin/Eav	TI	Power Density	AECI
1	HWD6-#4LED526	LED	10.87	0.83	32.00	-3.30	8.00	5.00	10.07	4.18	23.79	0.18	0.42	19.26	0.00	0.00
2	P862-256-H5-740	740SS	10.53	0.83	34.00	-3.30	8.00	5.00	10.34	4.14	26.36	0.16	0.40	7.23	0.00	0.00
3	BGP292 DM33	LED-HB 5.2	9.50	0.83	34.00	-3.30	8.00	5.00	10.02	4.10	27.19	0.15	0.41	10.30	0.00	0.00
4	ISARO PRO L - 7	LED_4000K	11.92	0.83	34.00	-3.30	8.00	5.00	10.27	5.85	26.92	0.22	0.57	17.28	0.00	0.00
5	AXIA 3.3 5293 Int	48 OSLON	12.54	0.83	34.00	-3.30	8.00	5.00	10.00	5.21	22.71	0.23	0.52	8.47	0.00	0.00

## Cable Calculations

Project Name Strategic Housing Development ~ Lissywollen, Athlone  
Project Number 20043

Midi Pillar Number 1							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_b$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	4.4	5	2.09	420	1.53	3.86	1.68%
2	4.4	5	2.09	440		4.05	1.76%
3	4.4	6	2.46	272		2.94	1.28%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_s$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	2.59	2.9	78.3	10	10mm <sup>2</sup>
2	0.35	3.08	2.71	3.1	75.2	10	10mm <sup>2</sup>
3	0.35	3.08	1.68	2.0	113.6	10	10mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

The voltage drop on each circuit is below the allowed maximum.  
The minimum sized cable permissible under I.S. 10101:2020 is 6mm SQ.  
It is the duty of the electrical contractor to calculate the appropriate fuse size.

Approximate Total Cable (m) = 1860 10mm<sup>2</sup>  
Approximate Total Cable (m) = 9849 6mm<sup>2</sup>

Midi Pillar Number 2							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	7	1.96	288	0.86	4.12	1.79%
2	7.3	2	0.31	74		0.17	0.07%
3	7.3	7	1.45	212		2.24	0.98%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_S$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	1.77	2.1	108.3	10	6mm <sup>2</sup>
2	0.35	3.08	0.46	0.8	285.4	10	6mm <sup>2</sup>
3	0.35	3.08	1.31	1.7	138.9	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues. It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 3							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	2	0.50	49	0.58	0.18	0.08%
2	7.3	8	1.72	245		3.08	1.34%
3	7.3	2	0.32	102		0.24	0.10%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_S$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	0.30	0.7	352.8	10	6mm <sup>2</sup>
2	0.35	3.08	1.51	1.9	123.7	10	6mm <sup>2</sup>
3	0.35	3.08	0.63	1.0	235.1	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues. It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 4							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	7	1.74	232	0.99	2.95	1.28%
2	7.3	6	1.52	275		3.05	1.33%
3	7.3	4	1.03	208		1.56	0.68%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_S$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	1.43	1.8	129.3	10	6mm <sup>2</sup>
2	0.35	3.08	1.69	2.0	112.5	10	6mm <sup>2</sup>
3	0.35	3.08	1.28	1.6	141.0	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues. It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 5							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	5	1.31	211	0.82	2.02	0.88%
2	7.3	5	1.30	266		2.52	1.10%
3	7.3	4	0.96	208		1.46	0.63%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_S$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	1.30	1.6	139.4	10	6mm <sup>2</sup>
2	0.35	3.08	1.64	2.0	115.7	10	6mm <sup>2</sup>
3	0.35	3.08	1.28	1.6	141.0	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues. It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 6							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	4.4	5	1.59	384	0.67	2.69	1.17%
2	4.4	4	1.34	344		2.03	0.88%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_S$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	2.37	2.7	84.7	10	10mm <sup>2</sup>
2	0.35	3.08	2.12	2.5	93.2	10	10mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 7							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	4	0.52	171	0.24	0.65	0.28%
2	7.3	6	0.51	250		0.93	0.40%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_S$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	1.05	1.4	163.9	10	6mm <sup>2</sup>
2	0.35	3.08	1.54	1.9	121.7	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 8							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	2	0.29	77	0.21	0.16	0.07%
2	7.3	2	0.29	98		0.21	0.09%
3	7.3	3	0.35	222		0.57	0.25%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_s$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	0.47	0.8	279.0	10	6mm <sup>2</sup>
2	0.35	3.08	0.60	1.0	241.2	10	6mm <sup>2</sup>
3	0.35	3.08	1.37	1.7	133.9	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues. It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 9							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	4	0.52	140	0.39	0.53	0.23%
2	7.3	4	0.46	125		0.42	0.18%
3	7.3	8	0.71	254		1.32	0.57%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_s$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	0.86	1.2	189.7	10	6mm <sup>2</sup>
2	0.35	3.08	0.77	1.1	205.4	10	6mm <sup>2</sup>
3	0.35	3.08	1.56	1.9	120.1	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues. It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 10							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	5	0.35	126	0.27	0.32	0.14%
2	7.3	7	0.55	212		0.85	0.37%
3	7.3	3	0.27	117		0.23	0.10%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_S$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	0.78	1.1	204.2	10	6mm <sup>2</sup>
2	0.35	3.08	1.31	1.7	138.9	10	6mm <sup>2</sup>
3	0.35	3.08	0.72	1.1	214.8	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 11							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	1	0.06	16	0.03	0.01	0.00%
2	7.3	1	0.06	24		0.01	0.00%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_S$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	0.10	0.4	512.8	10	6mm <sup>2</sup>
2	0.35	3.08	0.15	0.5	462.0	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 12							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	5	0.49	166	0.43	0.59	0.26%
2	7.3	9	0.72	301		1.58	0.69%
3	7.3	11	0.67	311		1.52	0.66%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_S$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	1.02	1.4	167.6	10	6mm <sup>2</sup>
2	0.35	3.08	1.85	2.2	104.3	10	6mm <sup>2</sup>
3	0.35	3.08	1.92	2.3	101.5	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 13							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	2	0.23	75	0.17	0.13	0.05%
2	7.3	4	0.30	228		0.50	0.22%
3	7.3	3	0.19	118		0.16	0.07%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_S$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	0.46	0.8	283.3	10	6mm <sup>2</sup>
2	0.35	3.08	1.40	1.8	131.1	10	6mm <sup>2</sup>
3	0.35	3.08	0.73	1.1	213.6	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 14							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	2	0.17	45	0.25	0.06	0.02%
2	7.3	2	0.22	86		0.14	0.06%
3	7.3	7	0.70	220		1.12	0.49%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_s$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	0.28	0.6	366.7	10	6mm <sup>2</sup>
2	0.35	3.08	0.53	0.9	261.4	10	6mm <sup>2</sup>
3	0.35	3.08	1.36	1.7	134.9	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 15							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	5	0.41	144	0.23	0.43	0.19%
2	7.3	6	0.57	190		0.79	0.34%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_s$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	0.89	1.2	185.9	10	6mm <sup>2</sup>
2	0.35	3.08	1.17	1.5	151.3	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

### Midi Pillar Number 16

Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	7	0.60	229	0.27	1.00	0.44%
2	7.3	3	0.32	225		0.53	0.23%
3	7.3	4	0.26	134		0.25	0.11%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_S$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	1.41	1.8	130.6	10	6mm <sup>2</sup>
2	0.35	3.08	1.39	1.7	132.5	10	6mm <sup>2</sup>
3	0.35	3.08	0.83	1.2	195.7	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

### Midi Pillar Number 17

Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	1	0.15	13	0.27	0.01	0.01%
2	7.3	5	0.44	202		0.65	0.28%
3	7.3	5	0.57	140		0.58	0.25%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_S$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	0.08	0.4	534.8	10	6mm <sup>2</sup>
2	0.35	3.08	1.24	1.6	144.3	10	6mm <sup>2</sup>
3	0.35	3.08	0.86	1.2	189.7	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 18							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	2	0.29	69	0.07	0.15	0.06%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_s$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	0.43	0.8	296.8	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 19							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	1	0.15	26	0.14	0.03	0.01%
2	7.3	2	0.21	63		0.10	0.04%
3	7.3	3	0.27	79		0.16	0.07%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_s$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	0.16	0.5	450.8	10	6mm <sup>2</sup>
2	0.35	3.08	0.39	0.7	311.6	10	6mm <sup>2</sup>
3	0.35	3.08	0.49	0.8	274.9	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 20							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	4	0.38	147	0.21	0.41	0.18%
2	7.3	7	0.54	220		0.87	0.38%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_s$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	0.91	1.3	183.2	10	6mm <sup>2</sup>
2	0.35	3.08	1.36	1.7	134.9	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 21							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	2	0.29	81	0.22	0.17	0.07%
2	7.3	6	0.68	172		0.85	0.37%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_s$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	0.50	0.8	270.9	10	6mm <sup>2</sup>
2	0.35	3.08	1.06	1.4	163.2	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 22							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	8	0.52	208	0.12	0.79	0.34%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_S$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	1.28	1.6	141.0	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 23							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	8	0.86	288	0.40	1.81	0.79%
2	7.3	6	0.54	190		0.75	0.33%
3	7.3	3	0.35	99		0.25	0.11%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_S$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	1.77	2.1	108.3	10	6mm <sup>2</sup>
2	0.35	3.08	1.17	1.5	151.3	10	6mm <sup>2</sup>
3	0.35	3.08	0.61	1.0	239.6	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 24							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	3	0.19	81	0.04	0.11	0.05%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_s$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	0.50	0.8	270.9	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 25							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	3	0.28	73	0.06	0.15	0.06%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_s$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	0.45	0.8	287.6	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 26							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	5	0.23	153	0.24	0.26	0.11%
2	7.3	2	0.12	65		0.06	0.02%
3	7.3	6	0.68	205		1.02	0.44%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_s$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	0.94	1.3	178.0	10	6mm <sup>2</sup>
2	0.35	3.08	0.40	0.8	306.5	10	6mm <sup>2</sup>
3	0.35	3.08	1.26	1.6	142.6	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 27							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	3	0.29	94	0.20	0.20	0.09%
2	7.3	6	0.58	210		0.89	0.39%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_s$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	0.58	0.9	247.6	10	6mm <sup>2</sup>
2	0.35	3.08	1.29	1.6	139.9	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 28							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	3	0.18	54	0.04	0.07	0.03%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_S$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	0.33	0.7	336.9	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

Midi Pillar Number 29							
Circuit	Tabulated Voltage drop (cable)	Total columns on circuit	Total luminaire Current ( $I_D$ )	Total circuit length	kVA for pillar	Voltage drop	Voltage drop percentage
1	7.3	4	0.41	149	0.18	0.45	0.19%
2	7.3	3	0.38	94		0.26	0.11%
Circuit	$Z_E$	Conductor Resistance $\Omega/m$	$Z_S$	Circuit Impedance Ohm	Fault Current Amp	Circuit Fuse ( $I_N$ ) Amp	Cable size
1	0.35	3.08	0.92	1.3	181.4	10	6mm <sup>2</sup>
2	0.35	3.08	0.58	0.9	247.6	10	6mm <sup>2</sup>

*Note that circuit length includes an extra 10m per luminaire to allow for turns, access and other potential issues.  
It is the duty of the electrical contractor to undertake appropriate electrical safety tests and to certify the electrical installation.*

## Energy consumption

Project Name Strategic Housing Development ~ Lissywollen, Athlone, Co. Westmeath  
Project Number 20043  
Dimming Profile U14 & U15

Proposed Installation							
Lantern	Connected Load ~ W	Quantity	Burn Hours Annum	kW/h per Annum	Cost per kW/h	Annual Cost	
9.5 klm luminaire	53	28	2350	3487	€ 0.158	€551.01	FP
	40	28	1710	1903	€ 0.158	€300.71	Dim U14
9.0 klm luminaire	50	31	2350	3643	€ 0.158	€575.52	FP
	38	31	1710	1988	€ 0.158	€314.08	Dim U14
2.8 klm luminaire	17	45	2350	1798	€ 0.158	€284.04	FP
	13	45	1710	981	€ 0.158	€155.02	Dim U14
5.0 klm luminaire	29	69	2350	4702	€ 0.158	€742.97	FP
	22	69	1710	2566	€ 0.158	€405.47	Dim U14
2.0 klm luminaire	12	78	2350	2200	€ 0.158	€347.54	FP
	9	78	1710	1200	€ 0.158	€189.67	Dim U14
2.4 klm luminaire	14	44	2350	1448	€ 0.158	€228.72	FP
	11	44	1710	790	€ 0.158	€124.82	Dim U14
11.0 klm luminaire	63	13	2350	1925	€ 0.158	€304.09	FP
	42	13	1710	924	€ 0.158	€146.04	Dim U15
4.0 klm luminaire	23	13	2350	703	€ 0.158	€111.02	FP
	15	13	1710	337	€ 0.158	€53.32	Dim U15
12.5 klm luminaire	74	5	2350	870	€ 0.158	€137.38	FP
	56	5	1710	475	€ 0.158	€74.97	Dim U14

**Total Annual Energy Cost** €4,669.71

**Total Annual Energy Consumption (kW/h)** 29555.11

**DATE:** 8 December 2020  
**DESIGNER:** Patrick Redmond  
**PROJECT No:** 20043  
**PROJECT NAME:** SHD ~ Lissywollen, Athlone



Lighting designed to comply with I.S. EN 13201-2:2015 M4 and at least I.S. EN 13201-2:2015 P2 on the cycle lane at full output.

Lighting designed to comply with I.S. EN 13201-2:2015 M5 and at least I.S. EN 13201-2:2015 P3 on the cycle lane after dimming by 33%.


LMF 0.92 x LDF 0.9 x LSF 1 = MF 0.83 at 100,000 hours with 25 degree ambient. Photometry measured at minimum 15 degree ambient.

## **Brawney Road ~ West**

**PREPARED BY:** Patrick Redmond Hdip BUS, EngTech AMILP, AMSLL, Tech IEI  
Redmond Analytical Management Services Ltd.  
M~ 086 2356356  
O~ 053 9383696  
patrick@redmondams.ie  
Rosewood House, Mount Seaton, Camolin,  
Enniscorthy, Co. Wexford. Y21 K8P3  
www.redmondams.ie  
Document control: TD 01 Version: 1.0

## Roadway Report Summary

### Layout

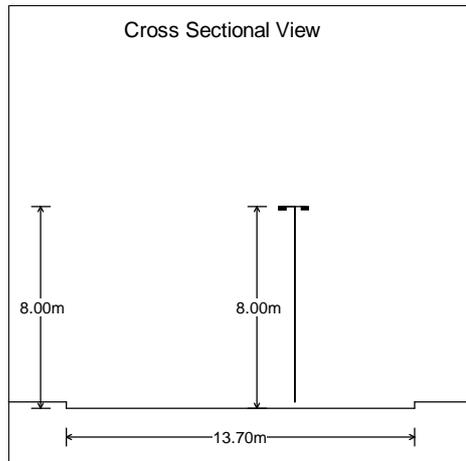

### Road Data

Calculation Grid	EN13201 Luminance
Width (m)	13.70
No. of Lanes	2
Road Surface	C2
Q0	0.07
Lane Width (m)	3.40
Rei Width (m) (m)	6.90
Rei Width (m)	3.40

### Main Lighting

#### Column Data

Configuration	Single Sided Right
Spacing (m)	40.00
Height (m)	8.00
Tilt (deg)	0.00
Setback (m)	-4.70
Outreach (m)	0.50
Overhang (m)	5.20

#### Luminaire Data



Supplier	Philips
Type	BGP292 DX70
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	11.00
File Name	LumiStreet Gen2 Mini_BGP292_DX70_11000_40LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Lum. Int. Class	None

### Additional Row Lighting

#### Column Data

Configuration	Single Sided Left
Spacing (m)	40.00
Height (m)	8.00
Tilt (deg)	0.00
Setback (m)	-9.00
Outreach (m)	0.40
Overhang (m)	9.40
Offset (m)	0.00

#### Luminaire Data



Supplier	Philips
Type	BGP291 DM11
Lamp(s)	LED-HB 5.2S 740
Lamp Flux (klm)	4.00
File Name	LumiStreet Gen2 Micro_BGP291_DM11_400_0_20LED_5.2S_CLO_L90_740.ies
Maintenance Factor	0.83
Lum. Int. Class	G3

### Results

#### Main

Complies with M4\*

Lavmin	1.26 (1)
Lmin	0.53 (1)
Lmax	2.20 (1)
U0min	0.42 (1)
Ulmin	0.68 (2)
TI(%)	14.82 (1)
Rei	0.58


#### Hard Shoulder

Complies with M4

Lav	0.75
Lmin	0.31
Lmax	1.44
U0	0.42
UI	0.69
TI(%)	13.20


Number in brackets is the Observer Lane for Result shown.

\*Rei not applicable with hard shoulder.

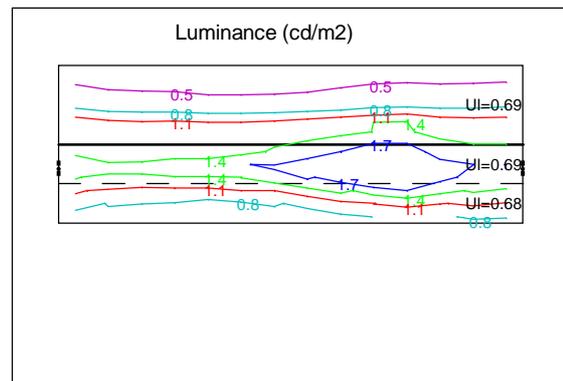




## Energy performance indicators

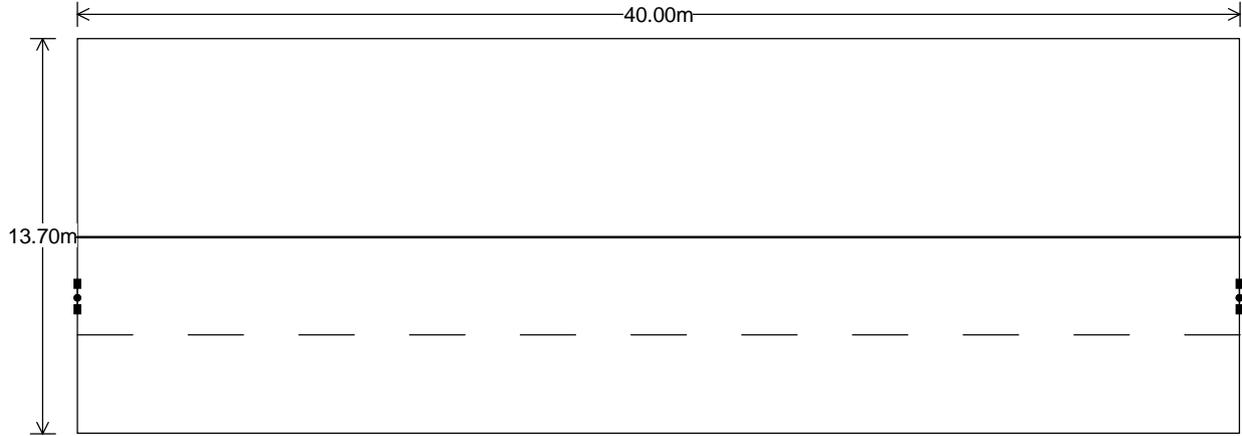

Power Main Luminaire(W)	42.21
Power Additional Luminaire(W)	15.41
Parasitic Power(W)	0.00
Area(m <sup>2</sup> )	548
Hours per Year	4100
Power Density(mW/lx/m <sup>2</sup> )	13.92
AECI(kWh/m <sup>2</sup> )	0.43

## Luminance (cd/m<sup>2</sup>)

Observer in Lane 1

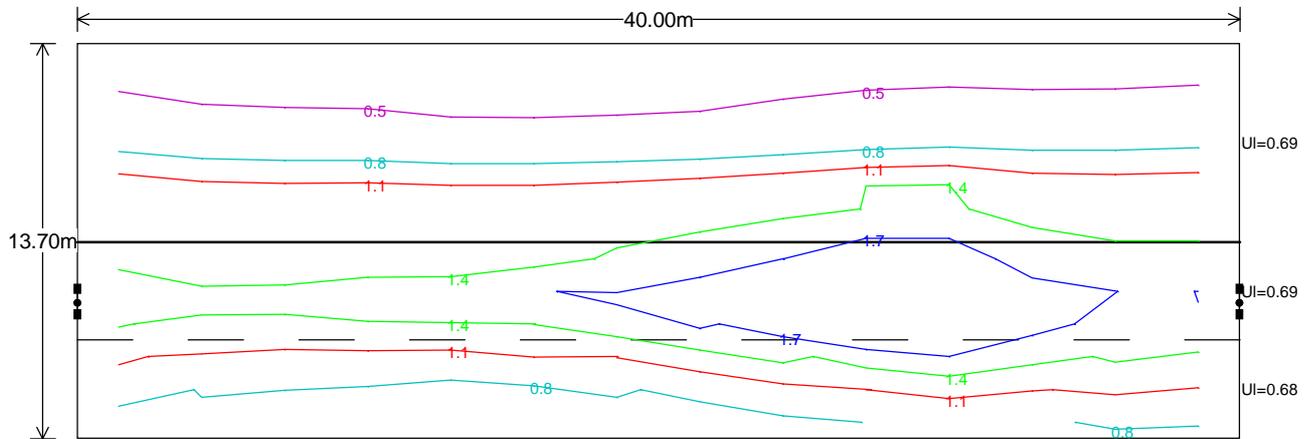

### Main Results

Observers in all Lanes

Lavmin	1.26 (1)
Lmin	0.53 (1)
Lmax	2.20 (1)
U0min	0.42 (1)
UImin	0.68 (2)
TI <sub>max</sub> (%)	14.82 (1)
Rei	0.58


Number in brackets is the  
Observer Lane for Result shown.

### Hard Shoulder Results

Lav	0.75
Lmin	0.31
Lmax	1.44
U0	0.42
UI	0.69
TI(%)	13.20

## Luminance (cd/m<sup>2</sup>)

Observer in Lane 1

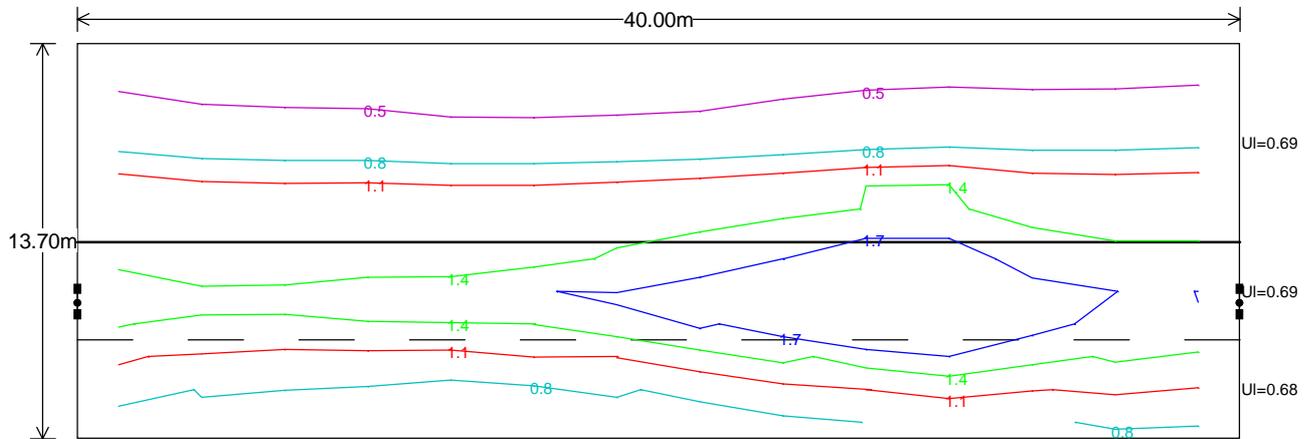

### Main Results

Observer in Lane 1


Lav	1.26
Lmin	0.53
Lmax	2.20
U0	0.42
UI	0.69
TI(%)	14.82

### Hard Shoulder Results

Lav	0.75
Lmin	0.31
Lmax	1.44
U0	0.42
UI	0.69
TI(%)	13.20

## Luminance (cd/m<sup>2</sup>)

Observer in Lane 2

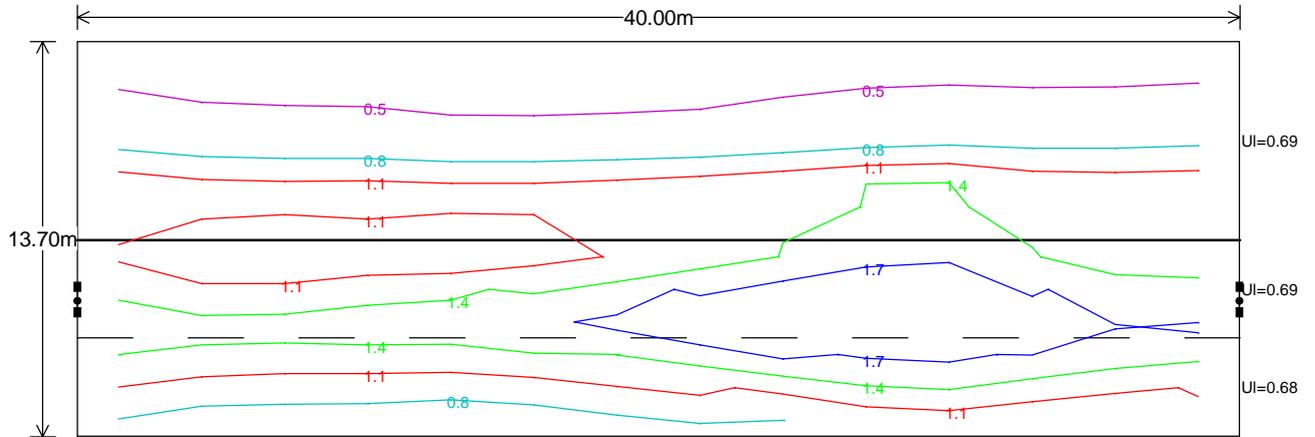

### Main Results

Observer in Lane 2

Lav	1.30
Lmin	0.61
Lmax	2.18
U0	0.47
UI	0.68
TI(%)	11.37

### Hard Shoulder Results

Lav	0.75
Lmin	0.31
Lmax	1.44
U0	0.42
UI	0.69
TI(%)	13.20